
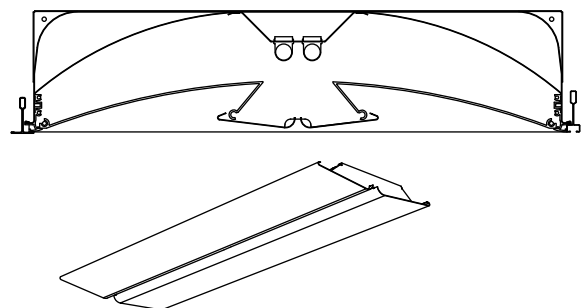
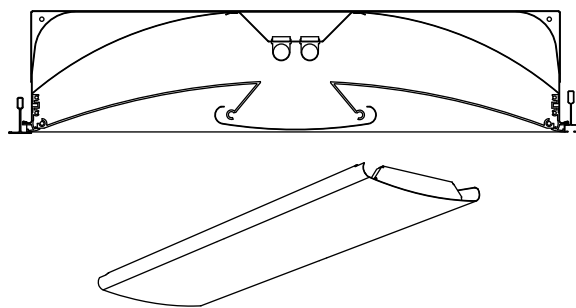
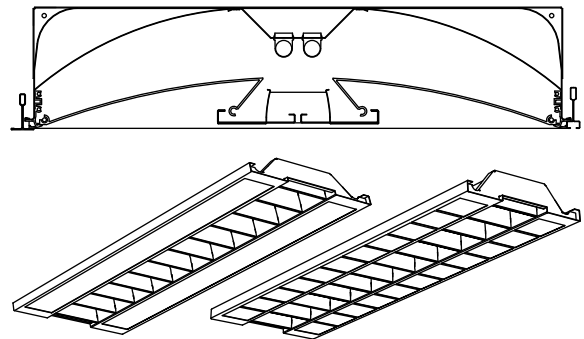


READ AND UNDERSTAND THESE INSTRUCTIONS BEFORE PROCEEDING.  
RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

This fixture is intended for installation in accordance with the National Electrical Code and local regulations. To assure full compliance with local codes and regulations, check with your local electrical inspector before installation. To prevent electrical shock, turn off electricity at electrical panel before proceeding.


DO NOT INSTALL THIS SYSTEM IN A WET OR DAMP LOCATION.  
DO NOT ENERGIZE ANYTHING OTHER THAN THE FIXTURES IN THE SYSTEM.

CONTRACTOR IS RESPONSIBLE FOR ADEQUATELY REINFORCING CEILING TO SUPPORT FIXTURE WEIGHT.

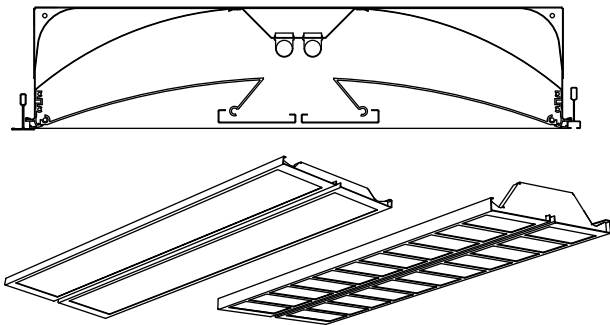


Continuous runs only - Prior to installing Aletta in a grid ceiling, the installing contractor must ensure that the fixture will set into two main runners, spaced 2' on center. No grid cross members are required except at the beginning and end of the run.

1. Place STARTER fixture in designated location and support ends with hang-wires from building structure above.  
(Fig. 1-2)

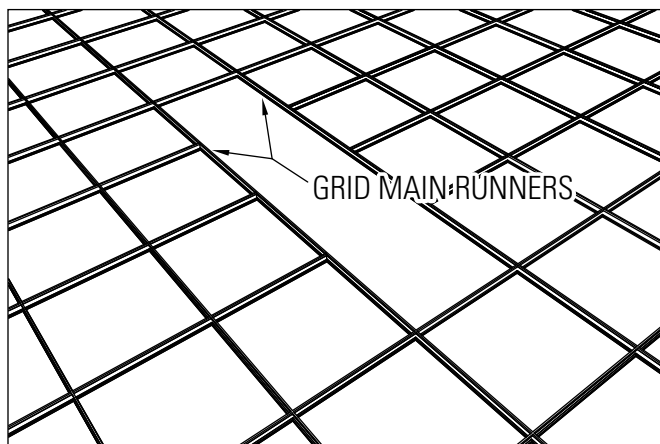


**Figure 1**

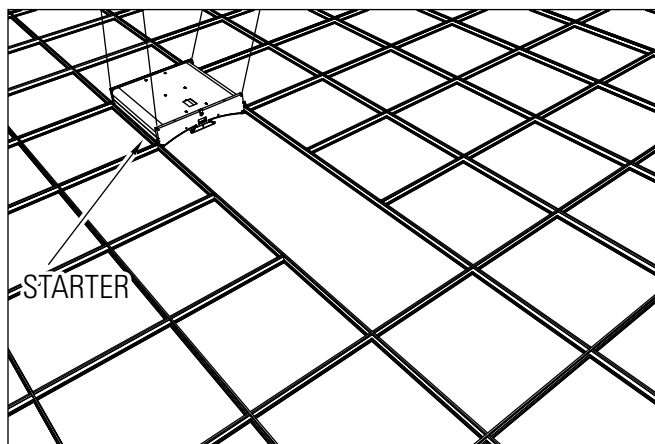

**Figure 2**

2. Locate first JOINER fixture next to STARTER and before dropping into place make quick-electrical connections.
3. Hang first JOINER fixture from building structure above and secure to previous fixture using supplied hardware.  
(Fig. 3)

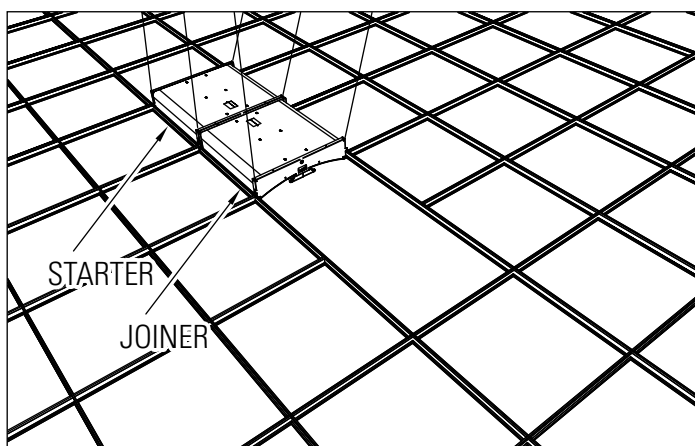

**Figure 3**

4. Repeat steps 2 and 3 until row is completed and ended with an ENDER fixture. (Fig. 4-5)

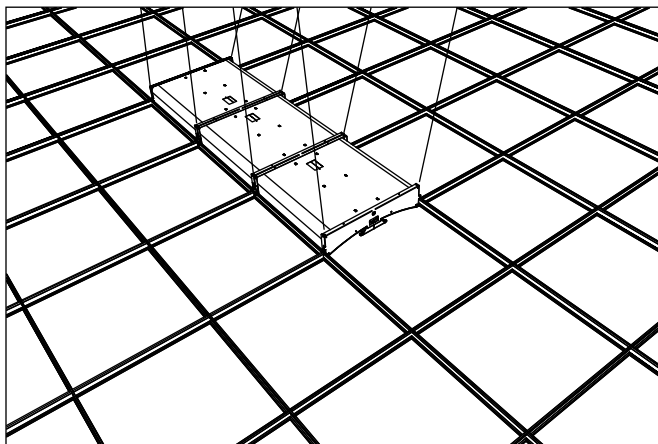


Figure 4

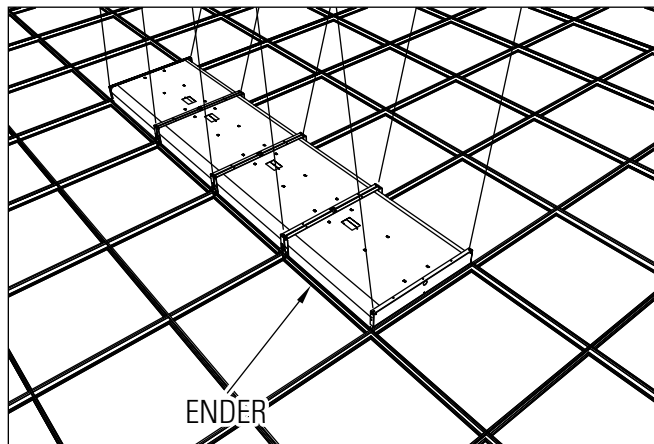


Figure 5

5. Remove ACCESS-PLATE on top of fixture designated to provide power to row and remove a 7/8" knock-out from ACCESS-PLATE and pull necessary wires out of fixture. (Fig. 6)
6. Provide power feed wires to fixture per NEC & local codes and re-install ACCESS-PLATE. (Fig. 7)

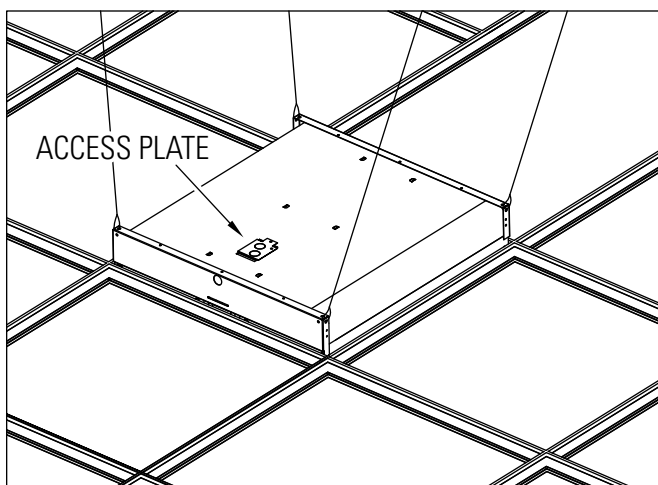


Figure 6

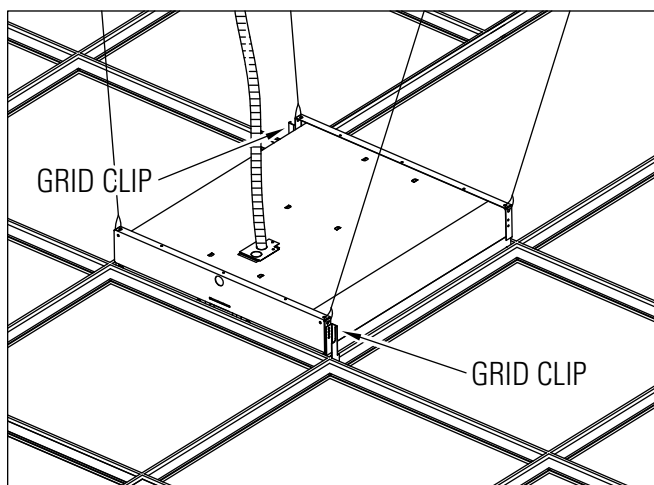


Figure 7

7. Install GRID CLIPS at each joint to maintain grid ceiling integrity. (Fig. 8-9)

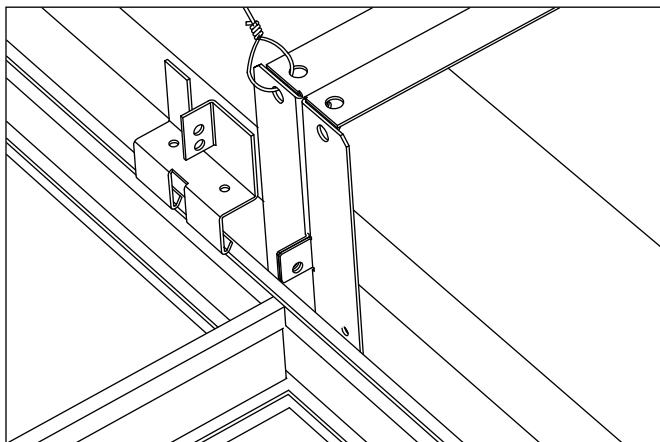


Figure 8

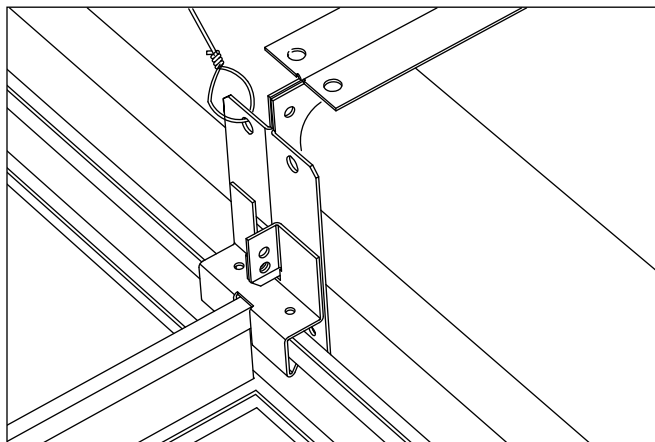


Figure 9

8. Install designated lamps and test. (Fig. 10) *NOTE: Depending on lamp configuration, installer may need to swing down a SIDE DIFFUSER to simplify lamp installation. (Fig. 11)*

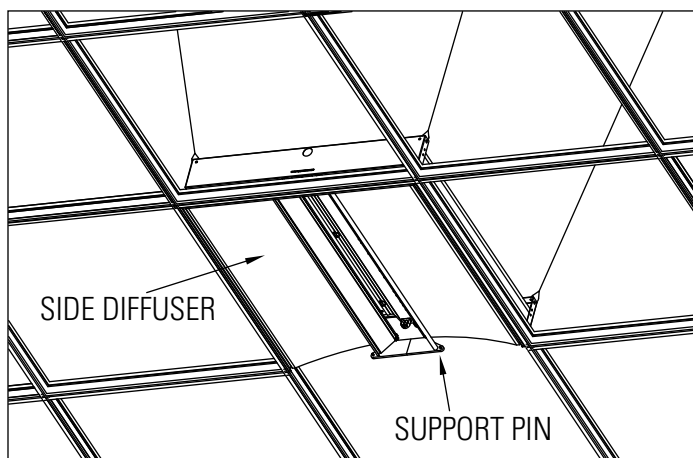


Figure 10



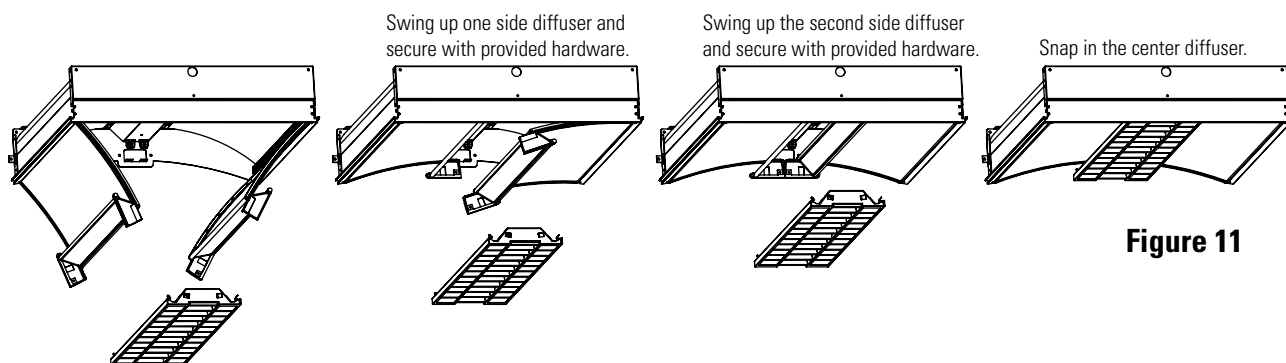


Figure 11


9. Install diffuser provided with fixture, making sure end springs are fully engaged around SUPPORT PINS.  
(Fig. 12-15) *NOTE: Diffusers from STARTER/ENDER and JOINER fixtures are not interchangeable.*

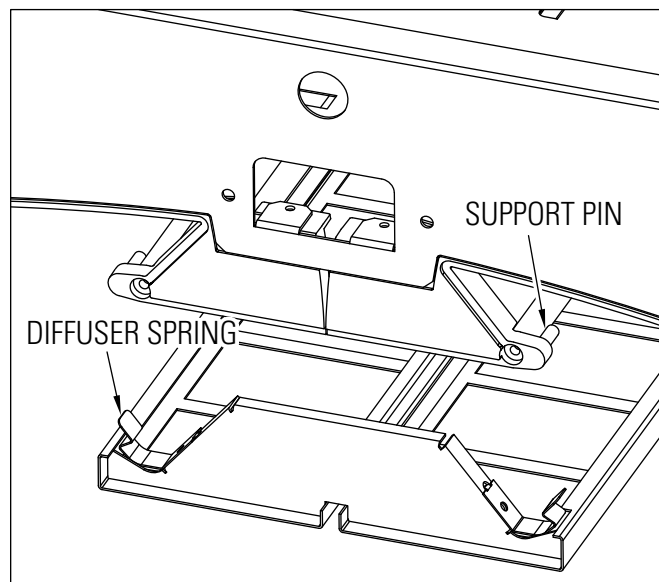


**Figure 12**

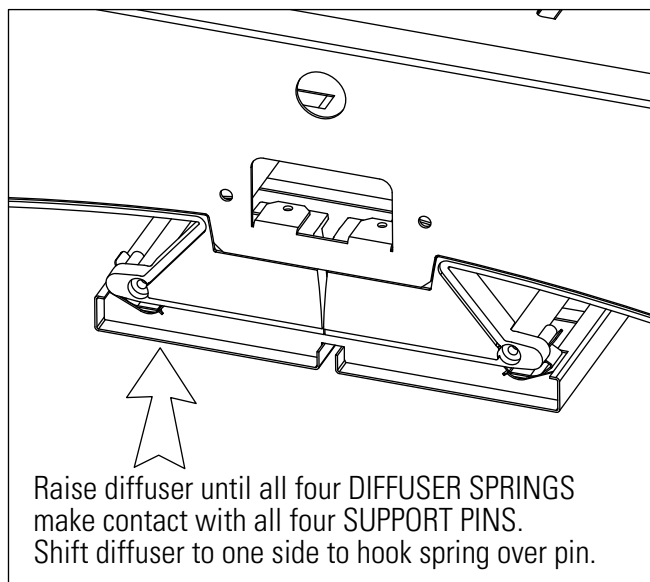

**Figure 13**

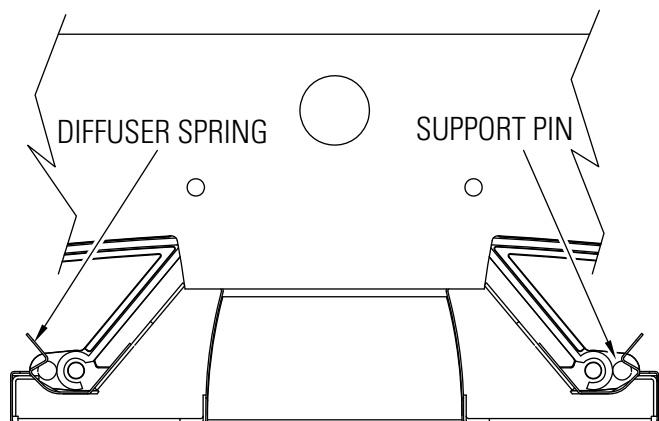

**Figure 14**

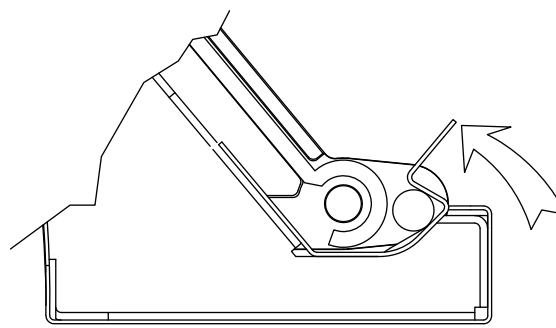

**Figure 15**

Assure the center diffuser is properly inserted into the lower pins.  
Secure the center diffuser with the provided safety lanyard.