

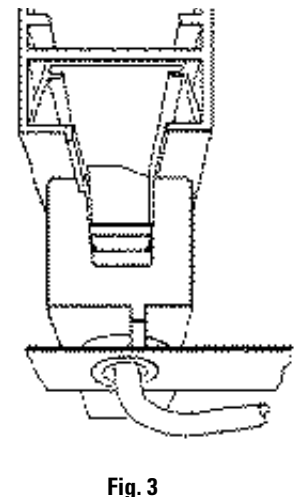
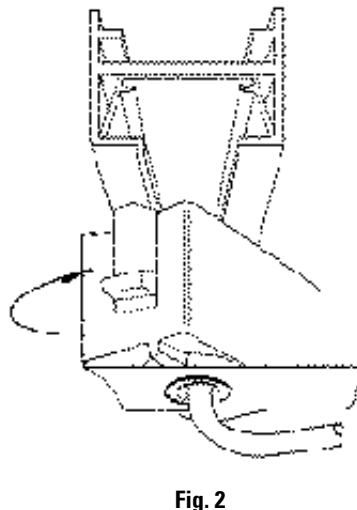
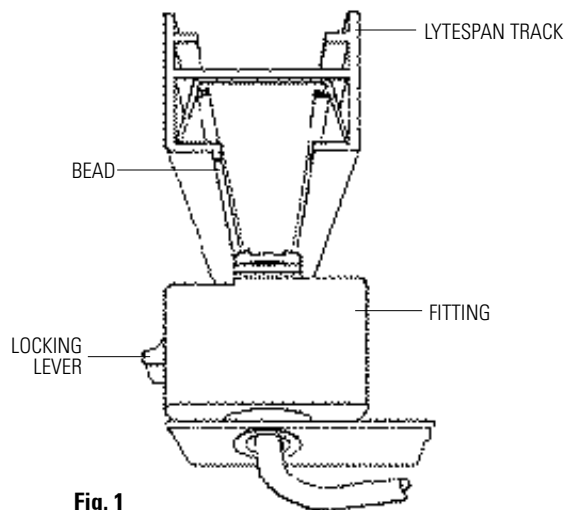
READ AND UNDERSTAND THESE INSTRUCTIONS BEFORE INSTALLING FIXTURE

This fixture is intended for installation in accordance with the National Electrical Code and local regulations. To assure full compliance with local codes and regulations, check with your local electrical inspector before installation. To prevent electrical shock, turn off electricity at fuse box before proceeding.

Retain these instructions for maintenance reference.

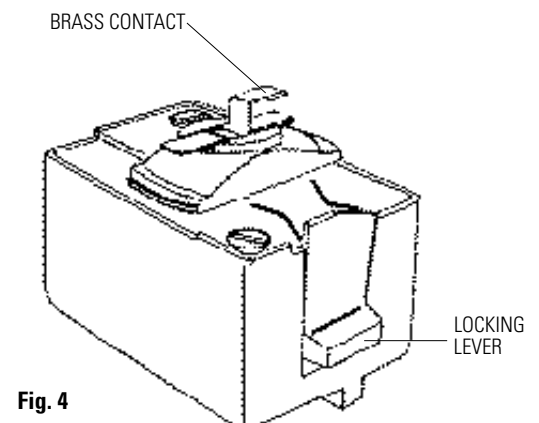
INSTRUCTION SHEET NO.**IS:6422MC****0498****Page 1 of 2****INSTRUCTIONS FOR ATTACHING LYTESPOT® TO LYTESPAN® TRACK**
For use with Lytespan® Track Systems Only**INSTRUCTIONS FOR ATTACHING LYTESPOT® TO SINGLE CIRCUIT TRACK SYSTEMS**

1. Insert into LYTESPAN TRACK. (Fig. 1) LOCKING LEVER must be on the same side of track as BEAD.
2. Rotate FITTING clockwise until LOCKING LEVER snaps and locks in place. (Fig. 2 & 3)
3. To remove: depress LOCKING LEVER, then rotate FITTING 90° counterclockwise.

**INSTRUCTIONS FOR CONVERTING LYTESPOT® ATTACHMENT FITTINGS TO OPERATE ON 2 CIRCUIT TRACK**

See Fig. 4. BRASS CONTACT can be raised or lowered. Broken line indicates position for 1 circuit or lower circuit of 2 circuit track system.

To convert attachment FITTING for upper circuit of 2 circuit track, raise BRASS CONTACT to high position by lifting CONTACT as high as stop permits and CONTACT clicks into place.

**LIGHTOLIER®****LIGHTOLIER a GENLYTE company.**

631 Airport Road, Fall River, MA 02720

READ AND UNDERSTAND THESE INSTRUCTIONS BEFORE INSTALLING FIXTURE

This fixture is intended for installation in accordance with the National Electrical Code and local regulations. To assure full compliance with local codes and regulations, check with your local electrical inspector before installation. To prevent electrical shock, turn off electricity at fuse box before proceeding.

Retain these instructions for maintenance reference.

INSTRUCTION SHEET NO.

IS:6422MC

0498

Page 2 of 2

WARNING: LIGHT FIXTURE and LAMP get extremely hot during operation. Allow FIXTURE to cool before handling.

INSTRUCTIONS FOR LAMPING (Fig. 5 & 6)

1. Remove LOUVER by pulling straight out. (Fig. 5)
2. **WARNING: RISK OF FIRE**
Use only T-4 Tungsten – Halogen outside frosted minican base LAMP, 150 watts maximum. Insert LAMP into SOCKET. Turn clockwise until tight. To remove, turn counterclockwise. (Fig. 6)
3. Replace LOUVER with GLASS LAMP GUARD in place by pushing straight up until LOUVER is flush with FIXTURE HOUSING.

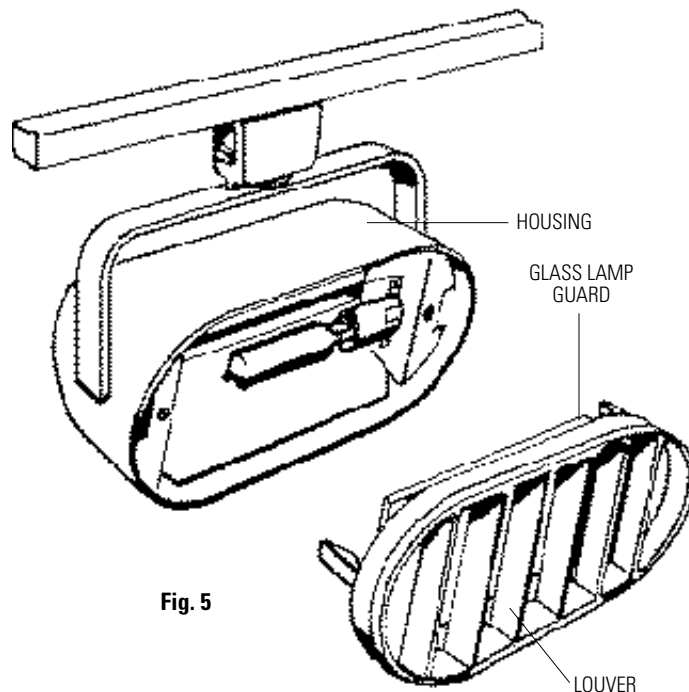


Fig. 5

WARNING: Lamp manufacturers require the GLASS LAMP GUARD be in place before energizing LAMP, and that great care should be taken that LAMP is fully cooled before relamping.

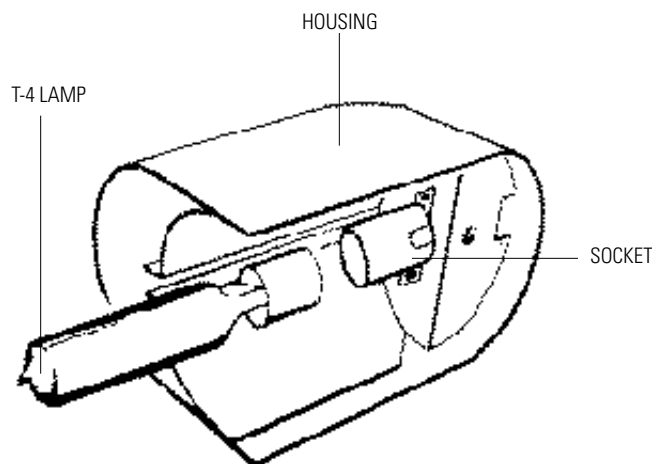


Fig. 6

LIGHTOLIER®

LIGHTOLIER a GENLYTE company.

631 Airport Road, Fall River, MA 02720