

XP95



- Ionisation Smoke Detector**
- Optical Smoke Detector**
- Heat Detector**
- Multisensor Detector**
- Manual Call Point**
- Isolating Base**
- Sounders & Beacons**



The XP95 range of intelligent fire detectors is advanced in design, improved in performance and has unique features that benefit the installer and the end user. The range includes ionisation and optical smoke detectors, heat detectors as well as a multisensor. All have an unobtrusive profile, a zero insertion force base, user friendly addressing and extended data and alarm features. A manual call point, an isolating base, sounders, beacons and other compatible products are also available.

These detectors have been carefully researched and developed by the Apollo design team and the range has undergone rigorous testing to ensure that it meets not only European and other standards but also the demands of today's high technology environments.

This Product Guide aims to provide engineers with full information on XP95, in order to be able to design optimum solutions to fire protection problems.

Apollo Fire Detectors Limited, part of the Halma plc group of companies, operates from one site at Havant, near Portsmouth, England. All departments – Research and Development, Sales and Marketing, Manufacturing and Finance – are located there. Apollo applies the most modern production techniques and has invested in sophisticated manufacturing equipment to ensure consistent high quality of product and fast response to customer requirements. Through planned expansion Apollo has reached a leading position in the market for professional fire detectors and exports over half of its production to countries around the world.




Key features

- Analogue Value Report
- Digital data transmission
- Input Bits Reporting
- Interrupt Warning
- Automatic Type Identification
- Address Confirmation
- XP95 Device Flag

Information in this guide is given in good faith, but Apollo Fire Detectors Limited cannot be held responsible for any omissions or errors. The company reserves the right to change specifications of products at any time without prior notice.

	Application of XP95 Detectors	4
	Addressing and Communications	4
	Features of the XP95 Range	5
	Ionisation Smoke Detector	
	Operating principles	6
	Electrical description	7
	Environmental characteristics	7
	Safety note	7
	Technical data	7
	Optical Smoke Detector	
	Operating principles	9
	Electrical description	9
	Environmental characteristics	9
	Technical data	10
	Heat Detector	
	Operating principles	11
	Electrical description	11
	Environmental characteristics	11
	Technical data	12
	Multisensor Detector	
	Operating principles	13
	Technical data	14
	Manual Call Point	
	Operating principles	15
	Technical data	16
	XP95 Mounting Base	17
	XP95 20D Isolating Base	
	Operating principles	18
	Electrical description	18
	Technical data	18
	XP95 Isolator	19
	XP95 Loop-Powered Beam Detector	19
	Intelligent Reflective Beam Detector	19
	MiniDisc Remote Indicator	19
	Loop-powered Sounders, Beacon & Sounder Beacons	19
	XP95 Flame Detector	20
	Approvals and Regulatory Compliance	21
	EMC	21
	Maintenance of Detectors	22

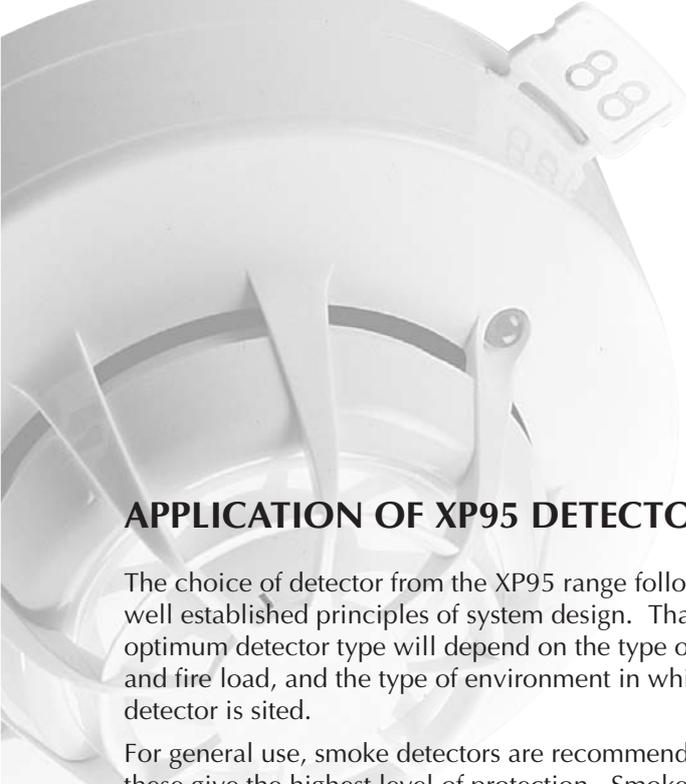

APPLICATION OF XP95 DETECTORS

The choice of detector from the XP95 range follows the well established principles of system design. That is, the optimum detector type will depend on the type of fire risk and fire load, and the type of environment in which the detector is sited.

For general use, smoke detectors are recommended since these give the highest level of protection. Smoke detectors from the XP95 range may be ionisation, optical or multisensor types. It is generally accepted that ionisation types have a high sensitivity to flaming fires whereas optical detectors have high sensitivity to smouldering fires. As a result of this, ionisation types are widely used for property protection, and optical types for life protection. These general principles still apply to XP95 detectors although the availability of a multisensor in the range offers more choice to the system designer.

The multisensor is basically an optical smoke detector and will therefore respond well to the smoke from smouldering fires. The detector also senses air temperature. This temperature sensitivity allows the multisensor to give a response to fast burning (flaming) fires, which is similar to that of an ionisation detector. The multisensor can therefore be used as an alternative to an ionisation detector

Where the environment is smoky or dirty under normal conditions, a heat detector may be more appropriate. It must be recognised, however, that any heat detector will respond only when the fire is well established and generating a high heat output.

Unless otherwise specified, devices described in this guide are suitable for indoor use only.

ADDRESSING AND COMMUNICATIONS

Each XP95 device responds to interrogation and command from central control equipment. It communicates to the panel information on status, command bits, type, location, and other information that allows an alarm to be raised even when the device is not itself being interrogated. Message error checking is also provided. The devices are compatible with Series 90, Discovery® and XPlorer systems and control equipment to aid maintenance, extension and upgrade of existing systems.

A unique, patented XPERT card provides simple, user friendly and accurate identification of detector location whereby a coded card, inserted in the base, is read by any detector once it is plugged in. All the electronic components are in the detector but the location information is held in the base. The address card simplifies and speeds up installation and commissioning. Addressing errors during maintenance and service are eliminated.

The XP95 manual call point continues to use DIL switch addressing, but its interrupt feature also provides automatic reporting of its location in the interrupt mode.

The XP95 detectors provide an alarm facility that automatically puts an alarm flag on the data stream and reports its address when the pre-set EN54 thresholds are exceeded. The devices provide great flexibility in system design with the control equipment determining the characteristics of the system. A large and growing range of compatible control equipment is available from many sources - details are included in Apollo publication PP1010, which is available on request.

	Ionisation	Optical	Multisensor	Heat
Overheating/thermal combustion	Poor	Very Good	Very Good	Very Poor
Smouldering/glowing combustion	Moderate/Good	Good	Good	Very Poor
Flaming combustion	Very Good	Good	Good	Poor
Flaming with high heat output	Very Good	Good	Very Good	Moderate/Good
Flaming - clean burning	Poor	Very Poor	Moderate/Good	Moderate/Good

Table 1 Response characteristics of smoke and heat detectors.

PROTOCOL FEATURES

Control Unit Interrogation and Command:

3 bits of command instruction and the 7-bit address are issued by the control equipment following an initiating pulse.

Interrupt Warning:

Notification that an XP95 manual call point or XP95 Mini Switch Monitor (interrupt) has been operated.

Analogue Value Report:

Status continually reported.

Input Bits Reporting:

Field devices advise control equipment of actions they have taken. For smoke and temperature detectors, these confirm compliance with the output command bits. Bit information depends on device type.

Automatic Type Identification:

The device being interrogated replies with a 5-bit type code, allowing up to 32 device types.

Address Confirmation:

The 7-bit address (up to 126 devices per loop) of the detector responding is confirmed back to the control unit.

XP95 Device Flag:

Tells the control equipment that more information is available.

Alarm Flag:

For accelerated alarm reporting.

Parity Error Check:

For received message accuracy.

Interrupt or Alarm Address:

Provides fast location of a device in alarm state.

ENGINEERING FEATURES

High Level Integration:

ASICs technology for lower component count.

Zero Insertion Force Base:

For easier installation and maintenance.

Ease of Maintenance:

Snap lock chambers for easy cleaning.

Surface Mounted Components:

For long life and high reliability

Latest Data Reported:

As well as free running data update, device will update data when the preceding device is being interrogated.

XPERT Card Addressing:

For fast reliable installation and service.

Unobtrusive Design:

For elegant designs in modern buildings.



XP95 Ionisation Smoke Detector

▲ Part Number 55000-500

page
6

OPERATING PRINCIPLES

The XP95 ionisation smoke detector has a moulded self-extinguishing white polycarbonate case with wind resistant smoke inlets. Stainless steel wiper contacts connect the detector to the terminals in the mounting base. Inside the detector case is a printed circuit board that has the ionisation chamber mounted on one side and the address capture, signal processing and communications electronics on the other.

The ionisation chamber system is an inner reference chamber contained inside an

outer smoke chamber (Fig 1). The outer smoke chamber has smoke inlet apertures that are fitted with an insect resistant mesh.

The radioactive source holder and the outer smoke chamber are the positive and negative electrodes respectively. An Americium 241 radioactive source mounted within the inner reference chamber irradiates the air in both chambers to produce positive and negative ions. On applying a voltage across these electrodes an electric field is formed as shown in Fig 2. The ions are attracted to the electrode of the opposite sign, some ions collide and recombine, but the net result

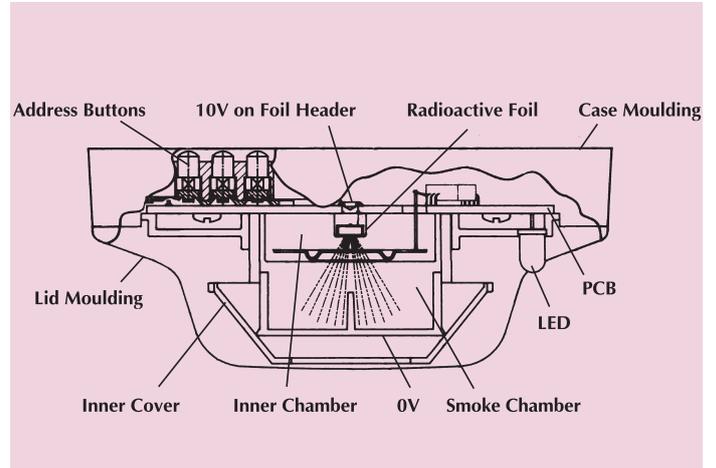


Fig.1 Sectional view - XP95 Ionisation Smoke Detector

is that a small electric current flows between the electrodes. At the junction between the reference and smoke chambers is the sensing electrode that is used to convert variations in the chamber currents into a voltage.

When smoke particles enter the ionisation chamber, ions become attached to them with the result that the current flowing through the ionisation chamber decreases. This effect is greater in the smoke chamber than in the reference chamber and the imbalance

causes the sensing electrode to go more positive.

The voltage on the sensing electrode is monitored by the sensor electronics and is processed to produce a signal that is translated by the A/D converter in the communications ASIC ready for transmission when the device is interrogated.

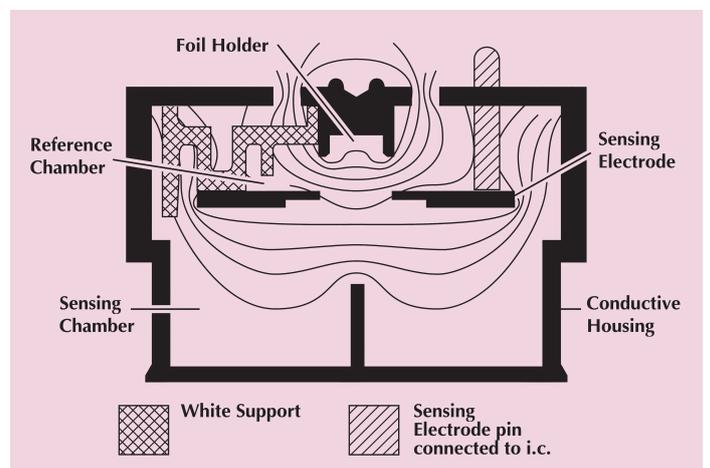


Fig.2 Diagram showing lines of equipotential for the XP95 Ionisation Smoke Monitor

ELECTRICAL DESCRIPTION

The detector is designed to be connected to a two wire loop circuit carrying both data and a 17V to 28V dc supply. The detector is connected to the incoming and outgoing supply via terminals L1 and L2 in the mounting base. A remote LED indicator requiring not more than 4mA at 5V may be connected between +R and -R terminals. An earth connection terminal is also provided, although this is not required for the functioning of the detector.

When the device is energised the ASICs regulate the flow of power and control the data processing. The ionisation chambers are energised and the ultra low leakage sensor ASIC provides a conditioned analogue signal to the analogue to digital (A/D) converter within the communications and processing ASIC. When smoke enters the ionisation chambers through the integral gauze, the voltage at the sensing electrode increases to produce an analogue signal. An A/D conversion of the signal from the ionisation chambers is carried out once per second or when either the detector or preceding address is being interrogated. Whenever the device is interrogated this data is sent to the control equipment. EN54 threshold alarm levels are calibrated within the processing ASIC. If the device is not addressed within 1 second of its last polling and the analogue value is greater than 55 then

alarm flag is initiated and the device address is added to the data stream every 32 polling cycles from its last polling for the duration of the alarm level condition, except when the alarming device is being interrogated. This can provide a location identified alarm from any device on the loop in approximately two seconds.

The detector is calibrated to give an analogue value of 25 ± 7 counts in clean air. This value increases with smoke density. A count of 55 corresponds to the EN54 alarm sensitivity level. See Fig 3. Counts of 8 or less indicate fault conditions. Count levels between 45 counts and 55 counts can be used to provide an early warning of fire.

ENVIRONMENTAL CHARACTERISTICS

XP95 ionisation smoke detectors are designed to operate in a wide variety of environments (See Figs 4 to 6). There are only small effects from temperature, humidity, atmospheric pressure and wind. Detectors are well protected against electromagnetic interference over a wide frequency range.

The XP95 ionisation detector, like all ionisation detectors, has some sensitivity to air movement (wind). The extent to which the analogue value will change depends on the wind speed and on the orientation of the detector relative to the wind direction. Relatively small changes in wind direction can cause significant changes in analogue value.

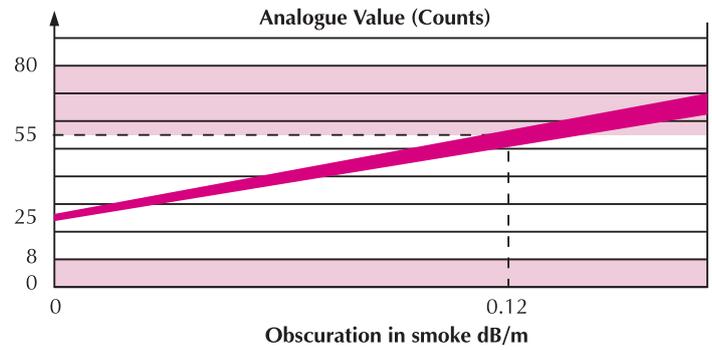


Fig.3 Typical response characteristics - XP95 Ionisation Detector

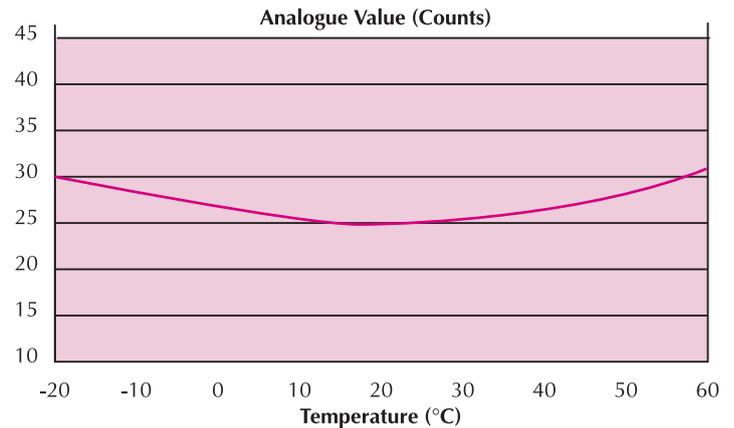


Fig.4 Typical temperature response - XP95 Ionisation Detector

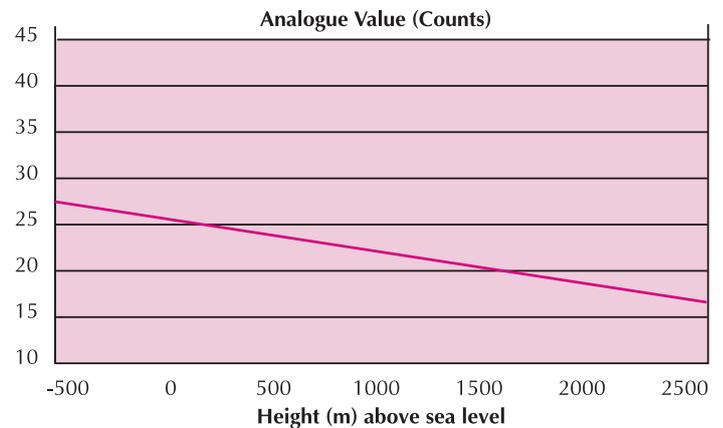


Fig.5 Typical pressure response - XP95 Ionisation Detector

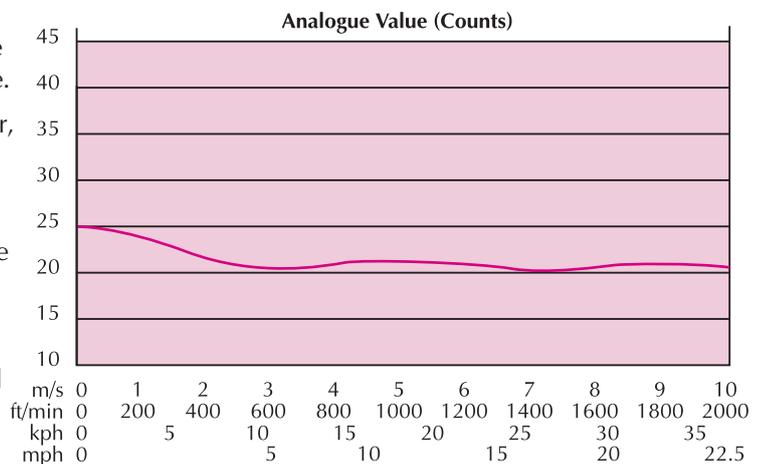


Fig.6 Typical wind speed response - XP95 Ionisation Smoke Detector

TECHNICAL DATA

XP95 Ionisation
Detector Part No 55000-500/
520/560
Base Part No 45681-210

Specifications are typical and given at 23°C and 50% relative humidity unless otherwise stated.

Detector Type:
Point type smoke detector for fire detection and fire alarm systems for buildings

Detection Principle:
Ionisation Chamber

Chamber Configuration:
Twin compensating chambers using one single sided ionising radiation source

Radioactive Isotope:
Americium 241

Activity:
33.3kBq, 0.9µCi

Sampling Frequency:
Continuous

Sensitivity:
Nominal threshold γ value of 0.7 to EN54-7:2000

Supply Wiring:
Two wire supply, polarity insensitive

Terminal Functions:
L1&L2 supply in and out connections (polarity insensitive)
+R remote indicator positive connection (internal 2.2k Ω resistance to supply +ve)
-R remote indicator negative connection (internal 2.2k Ω resistance to supply - ve)

Supply Voltage:
17 to 28 Volts dc

Modulation Voltage at Detector:
5 to 9 Volts peak to peak

Quiescent Current:
280µA average, 500µA peak

Power-up Surge Current:
1mA

Duration of Power-up Surge Current:
0.3 seconds

Maximum Power-up Time:
4 seconds for communications (measured from application of power and protocol)

10 seconds to exceed 10 counts 15 seconds for stable clean air value

Clean Air Analogue Value:
25±7 counts

Alarm Level 55 Counts:
EN54 γ value of 0.7

Alarm Indicator:
Red light emitting diode (LED)

Alarm LED Current:
2mA

Remote LED Current:
4mA at 5V (measured across remote load)

Type Code:
(210 43) 011 00

Storage Temperature:
-30°C to +80°C

Operating Temperature:
-20°C to +70°C

Guaranteed Temperature Range:
(No condensation or icing)
-20°C to +60°C

Humidity:
(No condensation or icing)
0% to 95% relative humidity

Wind Speed:
10m/s maximum

Atmospheric Pressure:
Automatic compensation by dual chambers to maintain sensitivity up to a height of 2000m above sea level

Vibration, Impact & Shock:
To EN54-7:2000

Electro-magnetic Compatibility:
See page 21 for full details

IP Rating:
23D

Approvals & Regulatory Compliance:
See page 21 for full details

Dimensions: (diameter x height)
Detector: 100mm x 42mm
Detector in Base:
100mm x 50mm

Weights:
Detector: 105g
Detector in Base: 161g

Materials:
Detector Housing: White polycarbonate V-0 rated to UL 94
Terminals: Nickel plated stainless steel



For wind speeds up to 1m/s (200ft/min) the change in analogue value will not exceed 5 counts. Continuous operation in wind speeds greater than 2m/s (400ft/min) is not recommended. However, wind speeds up to 10m/s (2000ft/min) can be tolerated for short periods and will not under any conditions increase the probability of false alarms.

SAFETY NOTE

In the United Kingdom, ionisation smoke detectors are subject to the requirements of the Radioactive Substances Act 1993 and to the Ionising Radiations Regulations 1999 made under the provisions of the Health and Safety at Work Act 1974.

The detectors, independently tested by the National Radiological Protection Board (NRPB), conform to all the requirements specified in the 'Recommendations for ionisation smoke detectors in implementation of radiation standards' published by the Nuclear Energy Agency of the

Organisation for Economic Co-operation and Development (OECD) 1977.

There is no limit to the number of ionisation smoke detectors which may be installed in any fire protection system within the UK. See Certificate of Approval No. TA1 of 1999 issued by the HSE for further details.

Storage regulations depend on local standards and the legislation, but, in the UK, the number of ionisation smoke detectors in any building or premises shall be less than 500. See Certificate of Approval No. TA3 of 1999 issued by the HSE for further details.

At the end of their recommended working life

of ten years, ionisation smoke detectors should be returned to Apollo for safe disposal or disposed of in an otherwise locally approved and environmentally safe manner. Please see "A Guide to the Care, Maintenance and Servicing of Apollo Products", PP2055.

Guidance on storage can be given by Apollo Fire Detectors and full details can be requested from:

Radioactive Substances Regulation Function
Environment Agency
Rio House, Waterside Drive
Aztec West, Almondsbury,
Bristol, BS32 4UD

Outside the UK, please contact the relevant national agency.

XP95 OPTICAL SMOKE DETECTOR



XP95 Optical Smoke Detector

▲ Part Number 55000-600

OPERATING PRINCIPLES

The XP95 optical detector uses the same outer case as the ionisation smoke detector and is distinguished by the indicator LED which is clear in standby and red in alarm. Within the case is a printed circuit board which on one side has the light proof labyrinth chamber with integral gauze surrounding the optical measuring system and on the other the address capture, signal processing and communications electronics.

An infrared light emitting diode within its collimator is arranged at an obtuse angle to the photo-diode. The photo-diode has an integral daylight-blocking filter.

The IR LED emits a burst of collimated light every second.

In clear air the photo-diode receives no light directly from the IR LED because of the angular arrangement and the dual mask. When smoke enters the chamber it scatters photons from the emitter IR LED onto the photo-diode in an amount related to the smoke characteristics and density. The photo-diode signal is processed by the optical ASIC and passed to the A/D converter on the communications ASIC ready for transmission when the device is interrogated.

ELECTRICAL DESCRIPTION

The detector is designed to be connected to a two wire loop circuit carrying both data and a 17V to 28V dc

supply. The detector is connected to the incoming and outgoing supply via terminals L1 and L2 in the mounting base. A remote LED indicator requiring not more than 4mA at 5V may be connected between the +R and -R terminals. An earth connection terminal is also provided.

When the device is energised the ASICs regulate the flow of power and control the data processing. The optical ASIC is controlled by the communications ASIC and pulses the IR LED. The signal from the photo-diode is processed by the optical ASIC and transferred to the A/D converter in the communications ASIC where it is then stored. When smoke enters the chamber the photo-diode signal increases. The information to the A/D converter is updated once per second or when either the monitor or the preceding address is interrogated. Whenever the device is interrogated this data is sent to the control equipment. EN54 threshold alarm levels are calibrated within the processing ASIC. If the

device is not addressed within 1 second of its last polling and the analogue value is greater than the EN54 alarm level the alarm flag is initiated and the device address is added to the data stream every 32 polling cycles from its last polling for the duration of the alarm level condition, except when the alarming device is being interrogated. This can provide a location identified alarm from any device on the loop in approximately 2 seconds.

The detector is calibrated to give an analogue value of 25 ± 7 counts in clean air. This value increases with smoke density. A count of 55 corresponds to the EN54 alarm sensitivity level. See Fig.9.

ENVIRONMENTAL CHARACTERISTICS

The XP95 optical smoke detector is unaffected by wind or atmospheric pressure and operates over the temperature range -20°C to $+60^{\circ}\text{C}$. See Fig. 10.

page
9

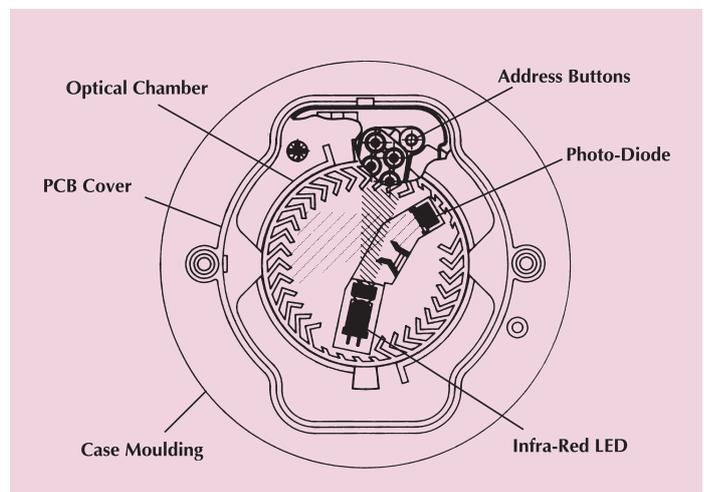


Fig.7 Top section - XP95 Optical Smoke Detector

TECHNICAL DATA

XP95 Optical Smoke Detector
Detector Part No 55000-600/
620/660
Base Part No 45681-210

Specifications are typical and given at 23°C and 50% relative humidity unless otherwise stated.

Detector Type:

Point type smoke detector for fire detection and fire alarm systems for buildings

Detection Principles:

Photo-electric detection of light scattered in a forward direction by smoke particles

Chamber Configuration:

Horizontal optical bench housing an infrared emitter and sensor arranged radially to detect scattered light

Sensor:

Silicon PIN photo-diode

Emitter:

GaAs Infra-red light emitting diode

Sampling Frequency:

1 second

Sensitivity:

Nominal response threshold value of 0.12 dB/m when measured in accordance with EN54-7:2000

Supply Wiring:

Two wire supply, polarity insensitive

Terminal Functions:

- L1&L2 supply in and out connections (polarity insensitive)
- +R remote indicator positive connection (internal 2.2kΩ resistance to supply +ve)
- R remote indicator negative connection (internal 2.2kΩ resistance to supply - ve)

Supply Voltage:

17 to 28 Volts dc

Quiescent Current:

340µA average, 600µA peak

Power-up Surge Current:

1 mA

Duration of Power-up Surge Current:

0.3 seconds

Maximum Power-up Time:

4 seconds for communications (measured from application of power and protocol)
 10 seconds to exceed 10 counts
 35 seconds for stable clean air value

Alarm Level Analogue Value:

55

Clean Air Analogue Value:

25±7 counts

Alarm Indicator:

Clear light emitting diode (LED) emitting red light

Alarm LED Current:

4mA

Remote LED Current:

4mA at 5V (measured across remote load)

Type Code:

(210 43) 101 00

Storage Temperature:

-30°C to +80°C

Operating Temperature:

-20°C to +60°C

Guaranteed Temperature Range:

(No condensation or icing)
 -20°C to +60°C

Humidity:

(No condensation or icing)
 0% to 95% relative humidity

Wind Speed:

Unaffected by wind

Atmospheric Pressure:

Unaffected

Electro-magnetic Compatibility:

See page 21 for full details

IP Rating:

23D

Approvals & Regulatory Compliance:

See page 21 for full details

Vibration, Impact & Shock:

To EN54-7:2000

Dimensions: (diameter x height)

Detector: 100mm x 42mm
 Detector in Base: 100mm x 50mm

Weights:

Detector: 105g
 Detector in Base: 157g

Materials:

Detector Housing: White polycarbonate V-0 rated to UL 94
 Terminals: Nickel plated stainless steel



technical data

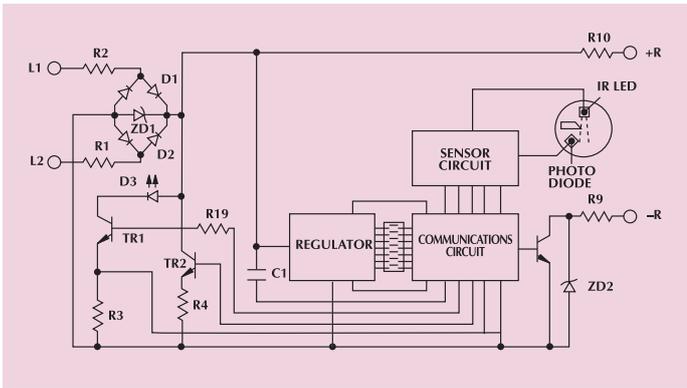


Fig.8 Schematic diagram - XP95 Optical Smoke Detector

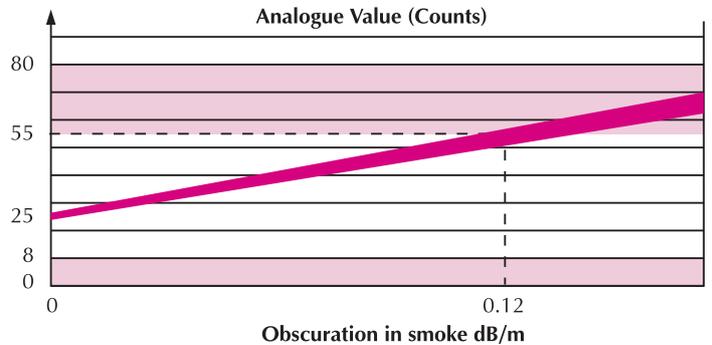


Fig.9 Typical Response Characteristic - XP95 Optical Smoke Detector

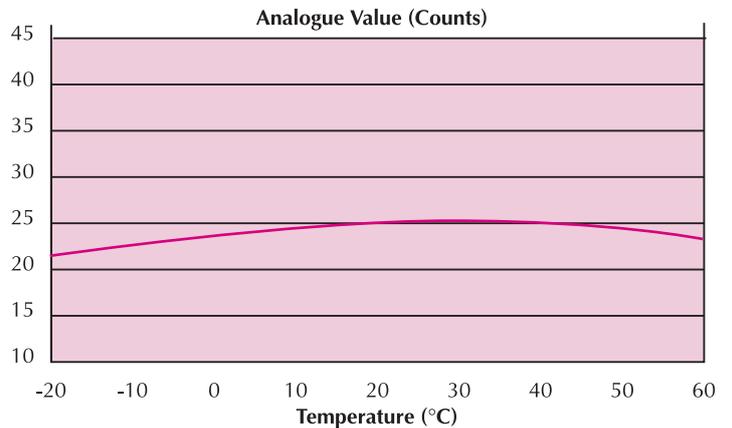


Fig.10 Typical Temperature Response - XP95 Optical Smoke Detector



XP95 HEAT DETECTOR



XP95 Heat Detector

▲ Part Number 55000-400

OPERATING PRINCIPLES

The XP95 heat detectors have a common profile with ionisation and optical smoke detectors but have a low air flow resistance case made of self-extinguishing white polycarbonate. The devices monitor heat by using a single thermistor network which provides a voltage output proportional to the

external air temperature.

The standard heat detectors, 55000-400 and 55000-420, respond to increasing air temperature in such a way that they are classified as an A2S device. See figure 13. Both devices will give 55 counts at 55°C.

A high temperature CS heat detector, 55000-401, which can be installed in a typical ambient temperature of 55°C is available. See figure 14. This device will give 55 counts at 90°C.

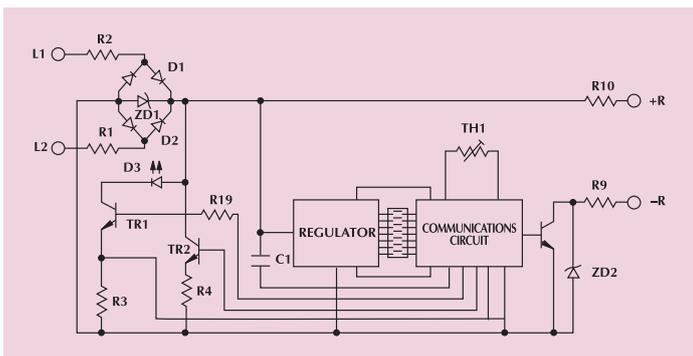


Fig.11 Schematic diagram - XP95 Heat detector

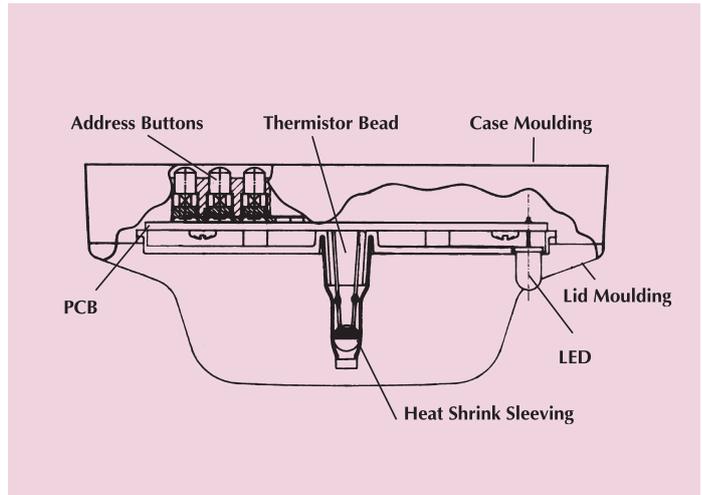


Fig.12 XP95 Heat Detector

ELECTRICAL DESCRIPTION

The detectors are designed to be connected to a two wire loop circuit carrying both data and a 17V to 28V dc supply. The detectors are connected to the incoming and outgoing supply via terminals L1 and L2 in the mounting base. A remote LED indicator requiring not more than 4mA at 5V may be connected between +R and -R terminals. An earth connection terminal is also provided.

When a device is energised the ASIC regulates the flow of power and controls the data processing. The thermistor provides an output over normal operating ranges that is proportional to the external air temperature. This voltage output is processed in the A/D converter and stored by the communications ASIC. It is transmitted to control equipment when the device is interrogated. When a count of 55 is exceeded the alarm flag is initiated and

the device address is added to the data stream every 32 polling cycles from its last polling for the duration of the alarm level condition, except when an alarming device is being interrogated. This can provide a location identified alarm from any device on the loop in approximately two seconds.

The detector is calibrated to give an analogue value of 25 ± 5 counts at 25°C.

ENVIRONMENTAL CHARACTERISTICS

XP95 Standard Heat Detectors operate over the range -20°C to +70°C, the High Temperature Heat Detectors operate over the range -20°C to +120°C. The detectors are unaffected by atmospheric pressure.

TECHNICAL DATA

XP95 Heat Detector (Standard)

Detector Part No
55000-400/420
Base Part No 45681-210

Specifications are typical and given at 23°C and 50% relative humidity unless otherwise stated.

Detector Type:

Point type heat detector for fire detection and fire alarm systems for buildings

Detector Principle:

Linear approximation over temperature range 25°C to 90°C

Sensor:

Single NTC Thermistor

Sampling Frequency:

Continuous

Sensitivity:

25°C to 90°C: 1°C/count.
-20°C returns 8 counts

Supply Wiring:

Two wire supply, polarity insensitive

Terminal Functions:

L1&L2 supply in and out connections (polarity insensitive)
+R remote indicator positive connection (internal 2.2kΩ resistance to supply +ve)

-R remote indicator negative connection (internal 2.2kΩ resistance to supply - ve)

Supply Voltage:

17 to 28 Volts dc

Modulation Voltage at Detector:

5 to 9 Volts peak to peak

Quiescent Current:

250µA average, 500µA peak

Power-up Surge Current:

1 mA

Duration of Power-up Surge Current:

0.3 seconds

Maximum Power-up Time:

4 seconds

Analogue Value at 25°C

25± 5 counts

Alarm Level 55 Counts:

55°C when measured under static conditions

Alarm Indicator:

Red light emitting diode (LED)

Alarm LED Current:

2mA

Remote LED Current:

4mA at 5V (measured across remote load)

Type Code:

(210 43) 110 00

Storage Temperature:

-30°C to +80°C

Operating Temperature:

-20°C to +70°C

Guaranteed Temperature Range:

(No condensation or icing)
-20°C to +70°C

Humidity:

(No condensation)
0% to 95% relative humidity

Wind Speed:

Unaffected in fixed temperature use

Atmospheric Pressure:

Unaffected

Vibration, Impact & Shock:

To EN54-5:2000

Electro-magnetic Compatibility:

See page 21 for full details

IP Rating:

53

Approvals & Regulatory Compliance:

See page 21 for full details

Dimensions: (diameter x height)

Detector: 100mm x 42mm
Detector in Base:
100mm x 50mm

Weights:

Detector: 105g
Detector in Base: 157g

Materials:

Detector Housing: White polycarbonate V-0 rated to UL 94

Terminals: Nickel plated stainless steel

XP95 High Temperature Heat Detector

Detector Part No:
55000-401

Specifications are the same as those for the standard detector, apart from the following points:

Detector Principles:

Linear approximation designed to give 25 counts at 25°C and 55 counts at 90°C

Sensitivity:

25°C to 90°C: 2·17°C/count
-20°C returns 20 counts.



technical data

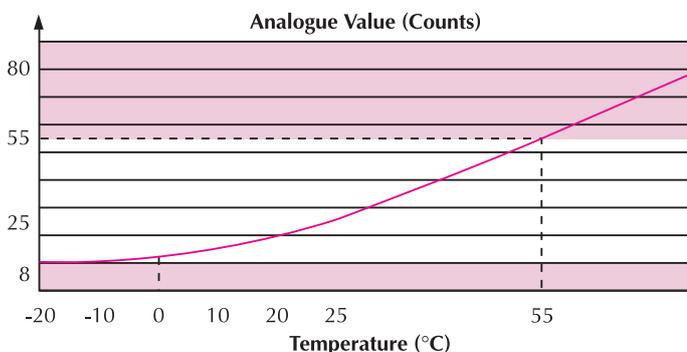


Fig.13 Typical response characteristic - XP95 Standard heat detector

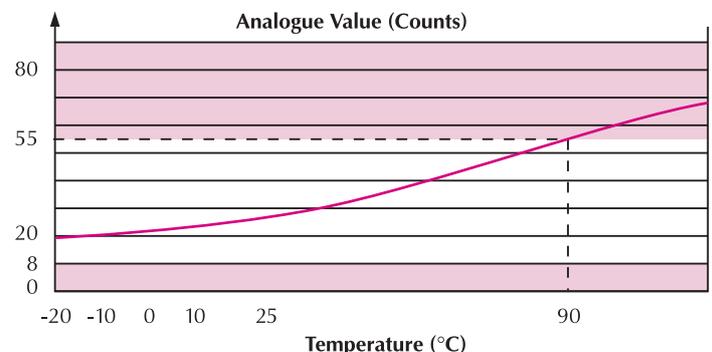


Fig.14 Typical response characteristic - XP95 High temperature heat detector



XP95 Multisensor Detector

▲ Part Number 55000-885

OPERATING PRINCIPLES

The XP95 multisensor detector contains an optical smoke sensor and a thermistor temperature sensor whose outputs are combined to give the final analogue value.

The multisensor construction is similar to that of the optical detector but uses a different lid and optical mouldings to accommodate the thermistor temperature sensor. The sectional view (Fig.15) shows the arrangement of the optical chamber and thermistor.

The signals from the optical smoke sensing element and the temperature sensor are independent, and represent

the smoke level and the air temperature respectively in the vicinity of the detector. The detector's microcontroller processes the two signals. The temperature signal processing extracts only rate of rise information for combination with the optical signal. The detector will not respond to a slow temperature increase - even if the

temperature reaches a high level. A large sudden change in temperature can, however, cause an alarm without the presence of smoke, if sustained for 20 seconds.

The processing algorithms in the multisensor incorporate drift compensation. The control panel must not have a drift compensation algorithm enabled.

The sensitivity of the detector is considered the optimum for most general applications since it offers good response to both smouldering and flaming fires.

Note: in situ testing of the multisensor should be carried out as for smoke detectors.

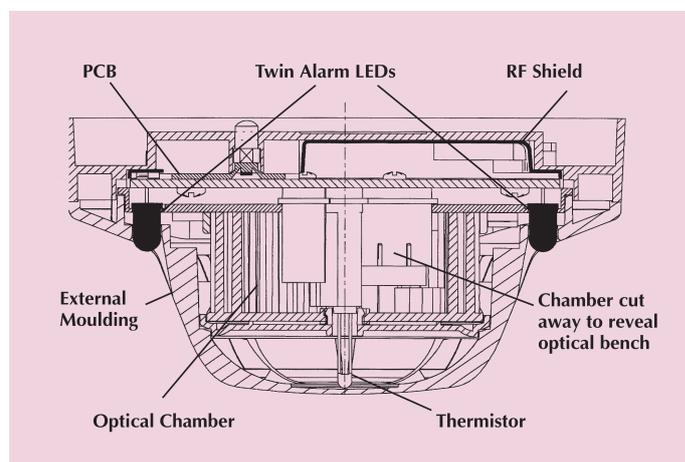


Fig.15 Sectional view - XP95 Multisensor Detector

TECHNICAL DATA

XP95 Multisensor Detector
Detector Part No 55000-885
Base Part No 45681-210

Specifications are typical and given at 23°C and 50% relative humidity unless otherwise stated.

Detector Type:

Point type smoke detector for fire detection and fire alarm systems for buildings

Detector principle:

Smoke: Photoelectric detection of light scattered by smoke particles
Heat: Temperature-sensitive resistance

Type code:

Bits (2 1 0 4 3)
1 0 1 1 1

Supply wiring:

Two-wire supply, polarity insensitive

Terminal functions:

L1&L2 supply in and out connections (polarity insensitive)

+R remote indicator positive connection (internal 2.2kΩ resistance to positive remote indicator negative connection)
-R remote indicator negative connection (internal 2.2kΩ resistance to negative)

Operating voltage:
17-28V DC

Communications protocol:
Apollo Series 90/XP95 5-9V peak to peak

Quiescent current:
500µA average 750µA peak

Power-up surge current:
1mA

Maximum power-up time:
10s

Alarm LED current:
3.5mA

Remote LED current:
4mA at 5V (measured across remote load)

Clean air analogue value:
23 +4/-0

Alarm level analogue value:
55

Alarm indicator:

2 colourless Light Emitting Diodes (LEDs); illuminated red in alarm
Optional remote LED

Electro-magnetic compatibility:

See page 21 for full details

Temperature range:

Max. continuous operating: +60°C
Min. continuous operating: 0°C

Min. operating (no condensation/icing): -20°C
Storage -30°C to +80°C

Humidity:

(No condensation)
0 to 95% relative humidity

Effect of temperature on optical detector:

Less than 15% change in sensitivity over rated range. Slow changes in ambient conditions will automatically be compensated and will not affect sensitivity

Effect of atmospheric pressure on optical sensor:
None

Effect of wind on optical sensor:
None

IP rating:
23D

Approvals & Regulatory Compliance:

See page 21 for full details

Vibration, Impact and Shock:

To prEN54-7

Dimensions:

100mm diameter
50mm height
58mm (height in base)

Weight:

Detector: 105g
Detector in base: 160g

Materials:

Housing: White polycarbonate V-0 rated to UL94
Terminals: Nickel plated stainless steel

Smoke element only:

Chamber configuration:
Horizontal optical bench housing infra-red emitter and sensor, arranged radially to detect forward scattered light


Sensor:
Silicon PIN photo-diode

Emitter:
GaAlAs infra-red light emitting diode

Sampling frequency:
1 per second

technical data

WARNING: if the control panel incorporates a drift compensation algorithm, this should be disabled when polling the XP95 Multisensor detector.

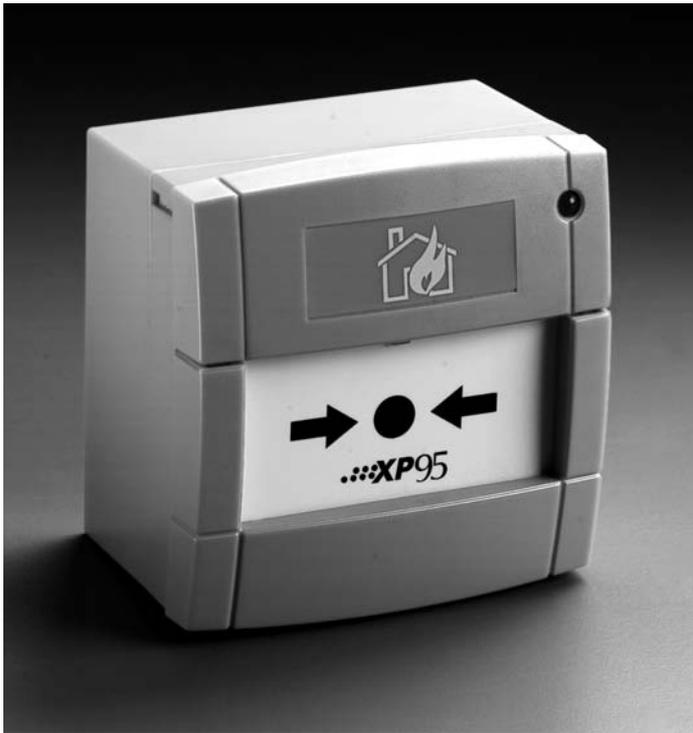

XP95 Manual Call Point (MCP)

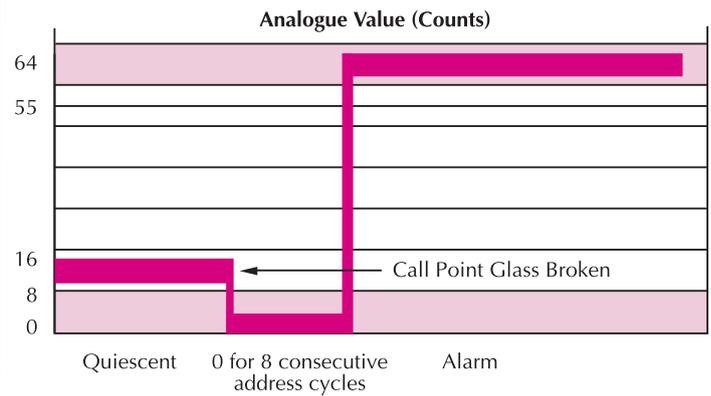


Fig.16 Typical response characteristic - XP95 Manual Call Point

OPERATING PRINCIPLES

The new Apollo XP95 EN54-11:2001 compliant Manual Call Point (MCP) is based on the KAC conventional MCP range. It is electronically and mechanically backward compatible with previous Apollo call points based on KAC's World Series product.

The address of each call point is set at the commissioning stage by

means of a seven-segment DIL switch.

A single bi-coloured alarm LED is provided on the call point. This LED is controlled, independently of the call point, by the control panel. The red LED is lit when the call point has been activated. An amber/yellow LED indicates a fault.

Call points can be remotely tested from the panel by transmission of a single bit in the communications protocol. Call points respond by providing a

value of 64 which corresponds to the alarm value. The panel should recognise this response as a test signal and should not raise a general alarm.

XP95 Manual Call Points are available with or without an isolator. Each version is available with a resettable element and a backbox for surface mounting as standard. If a glass or flush mounting tray is required, these are available on request. Versions with a pattress box are also available with and

without an isolator. For all part numbers please refer to Table 2.

To provide additional protection against accidental operation, a transparent hinged cover with a locking tag, part number **26729-152** is available, which can be fitted to the manual call point. *Please note that the call point does not conform to EN54-11:2001 when this lid is fitted and secured with the locking tag.*

Important Note – the use of lubricants, cleaning solvents or petroleum based products should be avoided.

	Colour	Deformable Element	Backbox for surface Wiring	Pattress Box	Isolated	Non-isolated
55100-905	Red	•	•			•
55100-907	Red	•		•		•
55100-908	Red	•	•		•	
55100-909	Red	•		•	•	

Table2

TECHNICAL DATA

XP95 Manual Call Point

Specifications are typical and given at 23°C and 50% relative humidity unless otherwise stated.

Call Point Type:
Deformable element

Weight:
151g

Call Point Principle:
Operation of a switch

Alarm Indicator:
Red Light Emitting Diode (LED)

Fault Indicator:
Amber/yellow light emitting diode (LED)

Type Code:
(2 1 0 4 3)
1 1 1 1 1

Supply Wiring:
Two-wire supply, polarity sensitive

Loop connections L1/L2:
Terminal block

Operating Voltage:
17V-28V dc

Communication Protocol:
5V-9V peak to peak

Quiescent Current:
100µA

Power-up Surge Current:
1mA

Maximum Power-up Time:
1 second

Alarm Current, LED illuminated:
4mA

Normal Analogue Value:
16

Alarm State Value:
64

Electro-magnetic Compatibility:
See page 21 for full details

Temperature Range:
Max. continuous operating:
+60°C

Min. continuous operating:
0°C

Min. operating: -20°C
(no condensation/icing)

Storage: -30°C to +80°C

Humidity:
(No condensation)
0 to 95% relative humidity

Compliance Standard:
EN54-11:2001
EN54-17:2005 (isolated version)

IP Rating:
24

Dimensions:
89mm x 93mm x 26.5mm
(manual call point)
87mm x 87mm x 32mm
(back box)

Materials:
Housing: Red self-coloured Polycarbonate/ABS
Hinged cover and locking tag are also available, **part number: 26729-152**

XP95 glasses are also available, **part number: 26729-154** (pack of 5)

technical data

XP95 MOUNTING BASE



XP95 Mounting Base

▲ Part Number 45681-210

XP95 Mounting Bases and XPERT cards.

The XP95 smoke and heat detectors all fit the XP95 mounting base. The base is a zero insertion force base with dual finger receptacles of stainless steel into which the detector terminals slide. Cable connections of up to 2.5mm diameter are made via captive cable clamps.

There are four double terminals and one single one.

- L1 line IN and OUT, double terminal
- L2 line IN and OUT, double terminal
- +R remote LED positive supply, double terminal
- R remote LED negative supply, double terminal

The remaining single terminal is isolated and can be used to provide continuity of an earth or shield.

Universal address cards, known as XPERT cards are supplied with all bases. Consult the coding guide to determine which pips are to be removed. Pre-printed and pre-punched address cards that save time and increase accuracy during commissioning are available in sets, part number: 38531-771

The base has a 'one way only' fit and detectors can be locked into the base by a grub screw with the aid of a 1.5mm hexagonal driver, part number: 29600-095.

For more information on Apollo's range of bases, please refer to the Range of Bases & Mounting Accessories brochure, PP1089.

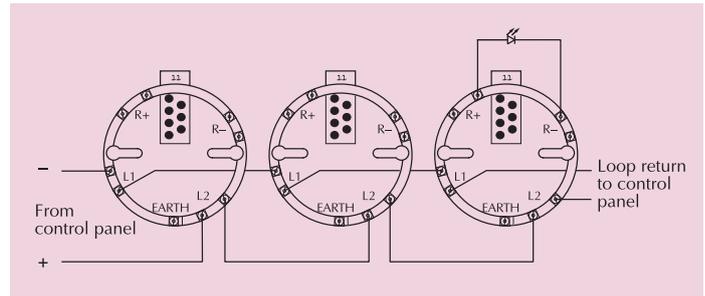


Fig.17 Schematic wiring diagram - XP95 mounting base

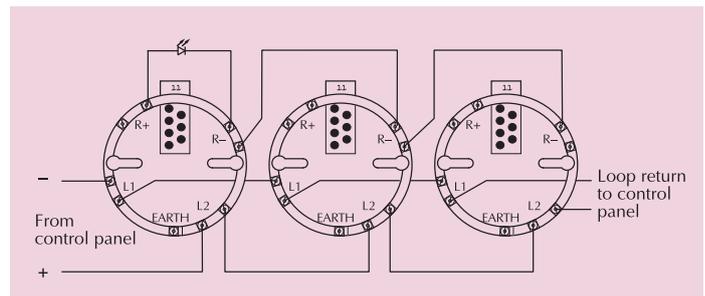


Fig.18 Schematic wiring diagram of XP95 detector circuit with a common remote LED

XP95 20D ISOLATING BASE



XP95 20D Isolating Base

▲ Part Number 45681-284

TECHNICAL DATA

XP95 20D Isolating Base

Device Part No:
45681-284

Maximum Loop Operating Voltage:
28V DC plus 9V protocol pulses

Minimum Normal Loop Operating Voltage:
17V DC

Power-up Time:
>10mS

Isolation time, 2Ω load at 28V:
20μs

Isolation Voltage:
14V

Isolation Indicator:
Yellow LED, lit continually in isolation condition

Current Consumption:

at 18V	23μA
at 28V	43μA
at 18V and adjacent sector isolated	4mA

Maximum Line Current:
Non-isolating continuous 1.0A
Transition into isolation 3.0A

On Resistance:
<0.2Ω

Device Reset Resistance:
300Ω

EMC:
See page 21 for full details

Operating Temperature:
-20°C to +60°C

Storage Temperature:
-30°C to +80°C

Relative Humidity (no condensation/icing):
0% to 95%

Dimensions:
100mm (diameter) x 24mm (height)
100mm (diameter) x 60mm (height) base with detector fitted

Weight:
100g

page
18

OPERATING PRINCIPLES

The XP95 20D isolating base senses and isolates short circuit faults on XP95 loops and spurs. The base is loop powered, polarity sensitive and accepts the XPERT card to set the associated device address.

In short circuit conditions the integral yellow LED is illuminated. The detector associated with the base remains active under short circuit conditions. Power and signals to the affected section are restored automatically when the fault is cleared.

ELECTRICAL DESCRIPTION

Under normal operating conditions, a low impedance is present between the -IN and -OUT terminals of the base, so that power and signals pass to the next base in the line.

If a short circuit or abnormally low impedance occurs, the fall in voltage is sensed and the base isolates the negative supply in the direction of the fault.

In applications where it is not necessary to use an isolating base for each detector, up to twenty devices (detectors and XP95 interfaces) may be installed between isolating bases, provided that their

total switch-on surge current does not exceed 20mA.

Circuits may include spurs, which should be connected between the spare -OUT terminal and the base L2 terminal. Spurs connected in this way appear directly across the loop on the output side of the isolating base. Short-circuit faults on the spur therefore short circuit the loop and vice versa. The effect of such short circuits must be taken into account in the system design and may require the use of extra isolating bases.

For further information on the use of XP95 isolators, please refer to PP2090 Short Circuit Isolation in XP95 and Discovery Fire Systems.

XP95 ISOLATOR

Part Number: 55000-720
Base Part Number: 45681-211

‘Stand-alone’ isolators, which have their own bases, may be used instead of isolating bases. The isolators are wired to a loop between detectors or other devices.

XP95 LOOP-POWERED BEAM DETECTOR

Part Number: 55000-265

The XP95 optical beam detector has been designed to protect large open spaces such as museums, churches, warehouses and factories. It consists of three main parts: the transmitter, which projects a beam of infra-red light, the receiver, which registers the light and produces an electrical signal, and the interface, which processes the signal and generates alarm or fault signals.

The transmitter and receiver are designed to be fitted on opposite walls approximately 30cm to 60 cm below the level of the ceiling. They can protect an area up to 100m long and 15m wide, a total of 1500m².

The interface contains the electronic circuitry needed to control the beam detector and communicate with the control panel via the XP95 loop.

The beam detector is loop-powered and needs no separate 24V supply. This not only eliminates the need for additional equipment, it also saves both cost and time in installation.

INTELLIGENT REFLECTIVE BEAM DETECTOR

Part Numbers:
55000-268 (5-50m)
55000-273 (50-100m)

The intelligent reflective beam detector is a compact detector for detecting smoke in large open areas such as atria, warehouses, theatres and churches. It also has a built-in 20D negative bi-directional short circuit isolator.

The transmitter and receiver form a single unit mounted to a wall of the building. A reflector which returns the IR beam from the transmitter to the receiver is mounted on the opposite wall. In the event of smoke partially obscuring the light an imbalance between the transmitted and received light will occur. On interrogation by the control panel the detector will then transmit an alarm value.

The intelligent reflective beam detector is an addition to the Apollo range and not a replacement for the XP95 loop-powered beam detector.

The intelligent reflective beam detector is supplied in two versions: one for use at distances of 5–50m from detector to reflector and the other for distances of 50–100m.

The detector is non-latching and resets 30 seconds after an alarm event ceases and in 3 seconds after the removal of a fault.

A termination backbox, part no 29600-241, is available. This allows easy first fixing of

the cabling and terminations to the intelligent reflective beam detector. The termination backbox can be surface or flush mounted.

MINIDISC REMOTE INDICATOR

Part Number: 53832-070

A light-weight, compact indicator for use in fire protection systems. The indicator may be used in all installations incorporating Series 60, XP95, Discovery and Intrinsically Safe detectors. It is only 20mm high and 80mm in diameter. It comprises two parts – the base, which is installed onto a wall or soffit and the lid, which is fitted to the base with a bayonet lock.

LOOP-POWERED SOUNDERS, BEACON & SOUNDER BEACONS

There are two types of loop-powered sounder available, allowing fire engineers to specify not only the sound output but also the functionality of individual sounders.

The 85dB(A) Low-Profile loop sounder is intended for use in confined spaces such as hotel rooms and corridors. It is designed to have a base and detector mounted upon it, but can also be used as a stand-alone sounder. The 100dB(A) loop sounder is intended as an open-space sounder, where a higher output is required.

Alarms may be signalled visually by means of a flashing beacon. Combined sounder beacon units are available where both audible and visual signalling is required.

The following types of device are available:

Ancillary Base Sounder

Part Number: 55000-276

A local-area sounder with an integral base for a detector head. The sounder is switched by the detector remote output and needs no address of its own. Sound output 85dB(A) at 1 metre.

Integrated Base Sounder

Part Numbers:
45681-278 (sounder)
45681-291 (slow whoop)
45681-277 (with isolator)
45681-290 (slow whoop with isolator)
45681-292 (white cap)
45681-293 (red cap)

A sounder with two volume ranges 55–75dB(A) and 75–91dB(A) which incorporates a detector base. It is supplied with a built-in isolator and ‘alert’ and ‘evacuate’ tones. A version with a Dutch-standard slow whoop is also available.



Integrated Base Sounder (DIN Tone)

Part Number: 45651-300

A sounder with an integral detector base configured to the requirements of German standard DIN33404, Part 3.

Loop-powered 100dB(A) Sounder

Part Numbers:

- 55000-276** (slow whoop, red)
- 55000-277** (slow whoop, white)
- 55000-274** (weatherproof, red)
- 55000-275** (weatherproof, white)
- 55000-278** (red)
- 55000-279** (white)

Designed for use in open areas this sounder is available in red or white. The weatherproof version is also available in red and white. The indoor version may be ordered with a Dutch-standard slow whop tone.

Loop-powered Beacon

Part Numbers:

- 55000-877** (red lens)
- 55000-878** (clear lens, red flash)
- 55000-879** (amber)

The beacon has been developed to alert those with hearing difficulties and to be used in areas with a high background noise level. The beacon is fitted to any XP95 or Discovery base.

Beacon Enclosure

Part Number: 29600-318

This is an enclosure with a clear lid and which has an IP rating of 67, allowing a beacon to be fitted for use outdoors.

Sounder Beacon Base

Part Numbers:

- 45681-330** (with isolator)
- 45681-331**
- 45681-332** (slow whoop with isolator)
- 45681-292** (white cap)
- 45681-293** (red cap)

This device combines a local-area sounder and a flashing beacon. It has an integral isolator and base for a detector head. Detection is thus co-located with both audible and visual alarms and short circuit isolation.

Multi-tone Open-area Sounder Beacons

Part Numbers:

- 55000-293** (with isolator, red)
- 55000-298** (weatherproof, with isolator, red)

Audio-visual fire alarm devices for large open areas. Sound output is nominally 100dB(A). The product features selectable tones, thus minimising the number of regional variants required. Available in red or white, indoor use or weatherproof, with or without isolator.

XP95 FLAME DETECTOR

Part Number: 55000-280

Operating Principles

An infrared sensor designed to detect specific types of flame, making it immune to solar radiation and other nuisance sources of infrared. The detector is rated at IP65, uses XP95 protocol and is loop powered – eliminating the need for a separate power supply.

APPROVALS AND REGULATORY COMPLIANCE

The XP95 range of detectors and manual call points is approved by a large number of third party certification bodies around the world. These include detector approvals to EN54:2000 with LPCB, VdS, DIBT, BOSEC and FG and to UL 268 and 521 with UL. For further information and updates on approvals held by Apollo for the XP95 range, contact the company directly or see our website, www.apollo-fire.co.uk

XP95 detectors comply with the requirements of a number of European New Approach Directives, such as the EMC Directive 89/336/EEC and the Construction Products Directive 89/106/EEC. Copies of EC certificates of conformity issued by LPCB as a Notified Body under the Construction Products Directive are available from our website www.apollo-fire.co.uk or directly from Apollo. In addition, copies of Declarations of Conformity issued by Apollo for all applicable New Approach Directives are available upon request.

All XP95 products will comply with the marking requirements of the WEEE Directive, 2002/96/EC. For further information on disposing of applicable electrical and electronic waste, contact Apollo directly.

EMC

All XP95 detectors and manual call points comply with the requirements of the following EMC standards:

Generic Emission Standard EN 61000-6-3

Emission standard for residential, commercial and light industrial environments.

Generic Emission Standard EN 61000-6-4

Emission standard for industrial environments.

EN 50130-4 : Alarm Systems

Electromagnetic compatibility - product family standard : Immunity requirements for components of fire, intruder and social alarm systems

EN 6100-4-2

Electrostatic discharge

EN 6100-4-3

Radiated immunity

EN 6100-4-4

Fast transient bursts

EN 6100-4-5

Surge immunity

EN 6100-4-6

Conducted immunity

In addition, all of the XP95 detectors have been assessed to the additional VdS EMC requirements, which are shown below and have been demonstrated full compliance.

Additional VdS requirements:

30V/m with 80% Am sine and 100% pulse modulation depth over the frequency ranges 415 to 467MHz and 890 to 960MHz.

MAINTENANCE OF DETECTORS

Apollo Fire Detectors has published a guide to the care, maintenance and servicing of Apollo products, PP2055, which is available on request. This guide outlines the maintenance routines recommended for optimum detector performance and the services available from Apollo's factory-based Service Department.



For more information on any of the products mentioned in this engineering guide, please refer to the following literature which is available on request.

Publication Name	Publication Number
Compatible Panel Manufacturers PIN Sheet	PP1010
Range of Bases & Mounting Accessories Brochure	PP1089
XP95 20D Isolating Base PIN Sheet	PP2039
A Guide to the Care, Maintenance and Servicing of Apollo Products	PP2055
XP95 Range of Interfaces Brochure	PP2025
XP95 Switch Monitor PIN Sheet	PP2015 (std enclosure) PP2048 (DIN-rail enclosure) PP2084 (with isolator)
Mini Switch Monitor PIN Sheet	PP2021
Mini Switch Monitor with Interrupt PIN Sheet	PP2020
Switch Monitor Plus PIN Sheet	PP2014 (std enclosure) PP2047 (DIN-rail enclosure) PP2083 (with isolator)
Zone Monitor PIN Sheet	PP2016 (std enclosure) PP2049 (DIN-rail enclosure) PP2101 (with isolator)
Sounder Control Unit PIN Sheet	PP2019 (std enclosure) PP2050 (DIN-rail enclosure) PP2094 (with isolator)
Input/Output Unit PIN Sheet	PP2017 (std enclosure) PP2045 (DIN-rail enclosure) PP2092 (with isolator)
Output Unit PIN Sheet	PP2018 (std enclosure) PP2046 (DIN-rail enclosure) PP2093 (with isolator)
XP95 Mains Switching Input/Output Unit PIN Sheet	PP2107
Dual Isolator PIN Sheet	PP2051 (DIN-rail enclosure)
XP95 Three Channel Input/Output Unit PIN Sheet	PP2121
MiniDisc Remote Indicator PIN Sheet	PP2074
XP95 Loop-Powered Beam Detector Sales Leaflet	PP2078
XP95 Flame Detector Sales Leaflet	PP2111
XP95 Flame Detector PIN Sheet	PP2110
Short Circuit Isolation in XP95 and Discovery Fire Systems	PP2090
Intelligent Reflective Beam Detector	PP2155
Ancillary Base Sounder	PP2148
Integrated Base Sounder	PP2209
Integrated Base Sounder (DIN Tone)	PP2227
Loop-powered 100dB Sounder	PP2082
Loop-powered Beacon	PP2156
Beacon Enclosure	PP2204
Sounder Beacon Base	PP2235
Multi-tone Open-area Sounder Beacon	PP2256



© Apollo Fire Detectors Ltd 1999 - 2006



INVESTOR IN PEOPLE



Assessed to ISO 9001:2000
Certificate number 010



36 Brookside Road, Havant, Hampshire PO9 1JR, UK. Tel: +44 (0)23 9249 2412. Fax: +44 (0)23 9249 2754.
Email: sales@apollo-fire.co.uk Website: www.apollo-fire.co.uk

Apollo GmbH, Am Anger 31, 33332 Gütersloh, Germany. Tel: +49 5241 33060. Fax: +49 5241 330629