FOR SERVICE PERSONNEL ONLY

HITACHI Inspire the Next

SPLIT UNIT AIR CONDITIONER INSTALLATION MANUAL

Indoor Unit

Outdoor Unit

RAS-14KH2

RAC-14KH2

Tools Needed For Installation Work

• Carefully read through the procedures of proper

The sales agent should inform customers regarding

installation before starting installation work.

the correct operation of installation.

 ♠ ⊕ Screwdriver
Measuring Tape
Knife • Saw • ø 65mm Power Drill • Hexagonal Wrench Key (∑ 4mm) • Wrench (14, 17, 22mm) • Gas Leakage Detector • Pipe Cutter • Putty • Vinyl Tape • Pliers • Flare Tool

SAFETY PRECAUTION

- The contents of this section are vital to ensure safety. Please pay special attention to the following sign.
 - MARNING Incorrect methods of installation may cause death or serious injury.
 - CAUTION Improper installation may result in serious consequence.

Be sure that the unit operates in proper condition after installation. Explain to customer the proper way of operating

⚠ WARNING

- Please request your sales agent or qualified technician to install your unit. Water leakage, short circuit or fire may occur if you do the installation work yourself.
- Please observe the instructions stated in the installation manual during the process of installation. Improper installation may cause water leakage, electric shock and fire
- units may collapse and impose danger
- Observe the rules and regulations of the electrical installation and the methods described in the installation manual when dealing with the electrical work. Use power cables approved by the authorities of your country.
- Be sure to use the specified wire for connecting the indoor and outdoor units. Please ensure that the connections are tight after the conductors of the wire are inserted into the terminals. Improper insertion and loose contact may cause over-heating
- and fire may occur.
- Be sure to use the specified piping set for R410A. Otherwise, this may result in broken copper pipes or faults.
- pressure in the refrigeration cycle may become abnormally high so that a rupture may be caused.
- Be sure to ventilate fully if a refrigerant gas leak while at work. If the refrigerant gas comes into contact with fire, a poisonous gas may occur.
- After completion of installation work, check to make sure that there is no refrigeration gas leakage. If the refrigerant gas leaks into the room, coming into contact with fire in the fan-driven heater, space heater, etc., a poisonous gas may occur.
- Unauthorized modifications to the air conditioner may be dangerous. If a breakdown occurs please call a qualified air conditioner technician or electrician. Improper repairs may result in water leakage, electric shock and fire, etc.

- A main switch with a contact gap of more than 3mm has to be installed in the power supply line to the outdoor unit.
- catch fire if flammable gas leaks around it.



- Piping shall be suitable supported with a maximum spacing of 1m between the supports

Installation of the Indoor Unit

VERTICALLY DOWNWARD PIPING

Preparation


• Connect connecting cord.

• Pull out the pipe, connecting cord and drain hose.

Installation

• The upper part of the Indoor unit is hanged on the hanger.

• The projection at the lower part of the Indoor unit is hooked onto the hanger.




⚠ CAUTION

together with Vinyl tape.

Please pull the lower part of the Indoor unit outwards to check if the unit is hooked onto the hanger. Improper installation may cause vibration and noise

HOW TO REMOVE INDOOR UNIT

 Push up the (PUSH) sections at the bottom of the indoor unit and pull the bottom plate towards you. Then the claws are released from the stationary (The (PUSH) sections are indicated by




HORIZONTAL PIPING


2 arrows in the right figure)

Preparation

Change of Drain Hose and Installation Procedures. Exchange the location of drain hose and drain cap during horizontal piping as shown in


- figure below. Be sure to plug in the drain hose until the insulating material folds upon itself.
- Please use pliers to pull out the drain cap. (This is an easier way to remove the drain cap)

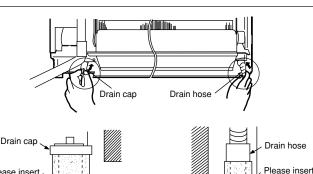



HORIZONTAL & DOWNWARD PIPING - MAKING OPENINGS

• During horizontal or downward piping, use a knife to cut openings as shown in figure. Then smoothen the edges of



• Turn the piping while holding down the lower

2,300mm or more

please use commersia products). • The difference in heigh between the indoor and outdoor unit should be

The indoor piping should be

insulation pipe. (If the insulator is insufficient,

kept max 5m. The connecting pipe, no matter big or small, should all be insulated with insulation pipe and then wrapped with viny tape. (The insulator wil deteriorate if it is not

The connection of insulated inner diameter ø 16mm

wrapped with tape).

Please use insulated drain hose for the indoor piping (commercial product)

Connecting

cord

INSTALLATION OF REFRIGERATING PIPES AFTER CONNECTION

• The refrigerating pipes should be adjusted to fit into the hole on the wall and then ready for further connection

• The terminals of 2 connected pipes must be covered with insulator used for terminal connection. Then the pipes are wrapped with insulation pipe.

 Connect the connecting cord after removing electrical cover. (Refer to "CONNECTION OF POWER CORD")

After adjustment, fit the connecting cord and pipes into the space available under the indoor unit. Use holder to hold them tight.



Holder can be attached at the either of 2 places

⚠ CAUTION The rubber strap used for fixing the insulator should not be tied with great force. Otherwise, this will damage



Please select the easier position

heat insulation and causes water condensation.

Rubber strap tied with great force

Please fix in the plastic core

after flaring to avoid plastic


THE CONNECTION OF REFRIGERATING PIPE DURING THE INSTALLATION OF INDOOR UNIT **⚠** CAUTION

Preparation To Install Refrigerating Pipes

• The refrigerating pipes and connecting cord


transform and are attached. • The end of the refrigerating pipes are at locations


marked with " ∇ " symbol.



Installation

chips entering the pipes.






Hang the Indoor unit onto the hanger. Use the temporary stand

at the back of the Indoor unit to push its lower part 15cm forwards • Place the drain hose through the hole on the wall.


• Wrap the refrigerating pipes with insulation pipe after connecting refrigerating pipe. • Connect the connecting cord after removing electrical cover. (Refer to "Connection of Power Cord")

• After adjustment, the connecting cord and refrigerating pipes


are placed into the space available under the Indoor unit. • The projection of Indoor unit must hook to the hanger.





Pull this to the front during the connection of refrigerating pipes to ease task.



Installation of Drain Hose







⚠ CAUTION Be sure that the drain hose is not loosely connected or bend.

You are free to choose the side (left or right) for the installation of drain

CAUTION

hose. Please ensure the smooth flow of condensed water of the Indoor unit during installation. (Carelessness may result in water leakage.)



- Read the safety precautions carefully before operating the unit.

the unit as described in the user's guide.

- Make sure that the units are mounted at locations which are able to provide full support to the weight of the units. If not, the
- Please use the specified components for installation work. Otherwise, the units may collapse or water leakage, electric shock
- When installing or removing an air conditioner, do not allow air or moisture to remain in the refrigeration cycle. Otherwise,

↑ CAUTION

- A circuit breaker or fuse must be installed. Without a circuit breaker or fuse the danger of electric shock exists.
- Do not install the unit near a location where there is flammable gas. The outdoor unit may
- Please ensure smooth flow of water when installing the drain hose.

Installation of Hanger, Wall Penetration and Installation of Protection Pipe


⚠ CAUTION

• The draining of the water container inside the indoor unit can be done from the left.

Therefore the hanger must be fixed horizontally or slightly tilted towards the side of


drain hose. Otherwise, condensed water may overflow the water container.

Direct Mounting On The Wall

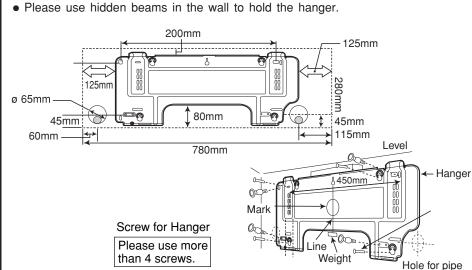


Procedures of Installation and Precautions

- Procedures to fix the hanger 1. Drill holes on wall. 2. Push plug into the holes. (As shown below) (As shown below)
- Procedures to fix the holder of remote control. 1. Drill holes on wall. 2. Push plug into the holes. (As shown below) (As shown below)



32mm

INDOOR




Wall Penetration and Installation of Protection Pipe

• Drill a ø 65mm hole on wall which is slightly tilted towards the outdoor side. Drill the wall at a small angle. • Cut the protection pipe

according to the wall thickness • Empty gap in the sleeve of protection pipe should be completely sealed pipe

with putty to avoid

dripping of rain water into



⚠ WARNING

3. Fix the hanger on wall

with 4.1 x 32 screw

(As shown in figure below)

Be sure that the wire is not in contact with any metal in the wall. Please use the protection pipe as wire passing through the hollow part of the wall so as to prevent the possibility of damaged by mouse. Unless it seals completely, any air with high humidity flows from outdoor and any dew may drop.

until here

openings with a file.

portion of pipe-support by hand.

the room.

of Indoor and Outdoor Unit.

Figure showing the Installation

of indoor unit must be

must be good and clear of obstruction.

⚠ WARNING

⚠ CAUTION

The Outdoor unit must be mounted at a location which can sup-

Do not expose the unit under direct sunshine or rain. Besides, ventilation

The air blown out of the unit should not point directly to animals or plants.

The clearances of the unit from top, left, right and front are specified in

Be sure that the hot air blown out of the unit and noise do not disturb the

• Do not install at a location where there is flammable gas, steam, oil and

Place the Outdoor unit and its connecting cord at least 1m away from the

antenna or signal line of television, radio or telephone. This is to avoid

Do not install outdoor unit facing strong wind direction. It may damage the

figure below. At least 3 of the above sides must be open air.

The location must be convenient for water drainage.

port heavy weight. Otherwise, noise and vibration will increase

Direction of Piping

neighbourhood

smoke

Be sure to There are 4 directions allowed, namely, horizontally seal anv perpendicular to the unit, gap with putty. vertically down from right, horizontally out from right and horizontally out to left. Don't form the piping downward at the left of the unit. Dimension of Mounting Stand of the Outdoor unit (unit: mm

THE CHOICE OF MOUNTING SITE (Please note the following matters and obtain permission from customer before installation).

⚠ WARNING

⚠ CAUTION

can provide full support to the unit.

connection with the Outdoor unit.

and high-power wireless systems.

(4.1x32)

(3.1x16)

LIND

INDOOR

allowed

figure below

non public area.

Names of Indoor Components

Hange

Screw for Hange

Holder for Remote

AAA Size Battery

Screw for holder of

Remote Controller

Remote Controller

Purifying Filter

Names of Outdoor Components

Item

Holder

Bush

Bush

No.

9

(11)

Controlle

4

• The unit should be mounted at stable, non-vibratory location which

No nearby heat source and no obstruction near the air outlet is

The clearance distances from top, right and left are specified in

The location must be convenient for water drainage and pipe

To avoid interference from noise please place the unit and its

To avoid any error in signal transmission from the remote controller.

please put the controller far away from high-frequency machines

The installation height of indoor unit must be 2.3m or more in a

Qty

1

6

2

2

1

1

1

Qty

2


1

1


The Length of Indoor Unit

Connecting Cord


remote controller at least 1m from the radio, television and inverter

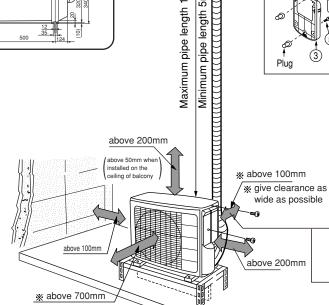
















- Decide the location for piping after sorting out the different types of pipe available.
- When removing side cover, please pull the handle after undoing the hook by pulling it downward.

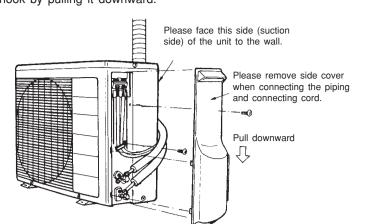

CONDENSED WATER DISPOSAL OF OUTDOOR UNIT

- There are holes on the base of Outdoor unit for condensed water to exhaust
- In order to flow condensed water to the drain, the unit is installed on a stand or a block so that the unit is 100mm above the ground as shown figure. Join the drain pipe to one hole.
- At first insert one portion of the hook to the base (Portion A), then pull the drain pipe in the direction shown by the arrow while inserting the hook into the base. After installation, check whether the drain pipe cling to the base firmly.

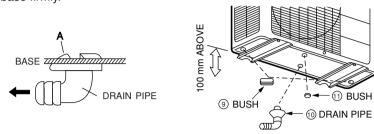

When using in cold region, etc.

In cold region with severe cold climate and heavy snow, water discharged from heat exchanger freeze on the base surface and this may affect drainage. In such a region, remove bush on the bottom face of outdoor unit for better drainage. When using drainpipe, consult our dealer.

Preparation of Pipe

REMOVAI

AIR

AN

ES

PP

GERATING


EFRI

<u>~</u>

OF

NSTALLATION


• Use a pipe cutter to cut the copper pipe.



⚠ CAUTION

- Jagged edge will cause leakage.
- Point the side to be trimmed downwards during trimming to prevent copper chips from entering the pipe.
- Before flaring, please put on the flare nut.





•	Please	use	exclusiv
	tool		


REMOVAL

Outer	A (mm)		
Diameter (mm)	For R410A tool	For R22 tool	
6.35	0.0 ~ 0.5mm	1.0mm	
9.52	0.0 ~ 0.5mm	1.0mm	

Pipe Connection

In case of removing flare nut of an Indoor unit, first remove a nut ↑ CAUTION of small diameter side, or a seal cap of big diameter side will fly out. Prevent water from entering into the piping when working.

- Please be careful when bending the copper pipe.
- Screw in manually while adjusting the center. After that, use of torque wrench to tighten the connection.



			Outer dia.of pipe	Torque N·m (kgf · cm)
	Small dia.	side	6.35 (1/4")	13.7 - 18.6 (140 - 190)
.	Large dia. side		9.52 (3/8")	34.3 - 44.1 (350 - 450)
,	Valve head cap	Small dia. side	6.35 (1/4")	19.6 - 24.5 (200 ~ 250)
		Large dia. side	9.52 (3/8")	19.6 - 24.5 (200 ~ 250)
	Valve core cap			12.3 - 15.7 (125 ~ 160)

Procedures of using Vacuum Pump for Air Removal


3 Removal Of Air From The Pipe And Gas Leakage Inspection

As shown in right figure, remove the cap of valve core. Then, connect the charge hose. Remove the cap of valve head. Connect the vacuum pump adapter to the vacuum pump and connect the charge hose to the adapter.


Fully tighten the "Hi" shuttle of the manifold valve and completely unscrew the "Lo" shuttle. Run the vacuum pump for about 10-15 minutes, then completely tighten the "Lo" shuttle and switch off the vacuum pump.

Completely unscrew the spindle of the service valve (at 2 places) in anticlockwise direction to allow the flow of coolant (using Hexagonal Wrench key).

Remove the charge hose and tighten the cap of valve head. Check the cap's periphery if there is any gas leakage. The task is then completed




When pumping starts, slightly loosen the flare nut to check of air sucked in. Then



Gas Leakage Inspection

Please use gas leakage detector to check if leakage occurs at the connection of Flare nut as shown on the right.

If gas leakage occurs, further tighten the connection to stop leakage.





↑ WARNING

• THIS APPLIANCE MUST BE EARTHED.

Procedures of Wiring

In case that power is supplied from Indoor Unit

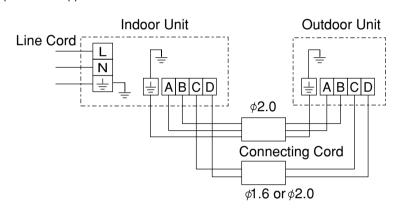

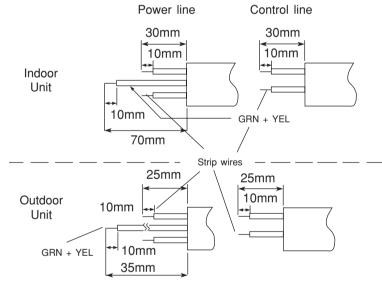

↑ WARNING

- The naked part of the wire core should be 10 mm and fix it to the terminal tightly. Then try to pull the individual wire to check if the contact is tight. Improper insertion may burn the terminal.
- Be sure to use only power cables approved from the authorities in your country. For example in Germany: Cable type: NYM 3x1.5mm².
- Please refer to the installation manual for wire connection to the terminals of the units. The cabling must meet the standards of electrical installation.
- There is an AC voltage drop between the L and N terminals if power is on. Therefore, before servicing, be sure to remove the plug from the AC outlet or switch off the main switch.

Wiring Of The Indoor Unit

• For wire connection of the Indoor unit, you need to remove low cover and front cover.

Method to remove front cover.

• Refer to "FINAL STAGE OF INSTALLATION - How to Remove The Front Cover".

Method to remove the low cover • Pull the cover at 1 and 2 in the directions as shown by arrows to remove the cover.

Wiring of The Outdoor Unit

• Please remove the side cover for wire connection.

WARNING

- If you cannot attach the side cover due to the connecting cord, press the connecting cord in direction to the front panel to fix it.
- Be sure that the hooks of the side cover is fixed in certainly. Otherwise water leakage may occur and this causes short circuit or faults.
- The connecting cord should not touch to service valve and pipes. (It becomes high temperature in heating

Checking for the electric source and the voltage range

• Before installation, the power source must be checked and necessary wiring work must be completed. To make the wiring capacity proper, use the wire gauges list below for the lead-in from a pole transformer and for the wiring from a switch board of fuse box to the main switch and outdoor unit in consideration of the locked rotor current.


IMPORTANT


Screw (2 pieces)

Holder for

Remote Controller

Cable length	Wire cross-section
up to 6m	1.6mm²
up to 15m	2.5mm ²
up to 25m	4.0mm ²

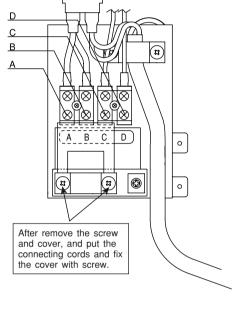



• Investigate the power supply capacity and other electrical conditions at the installation location.

Depending on the model of room air conditioner to be installed, request the customer to make arrangements for the necessary electrical work


The electrical work includes the wiring work up the outdoor. In localities where electrical conditions are poor, use of a voltage regulation is recommended.

IMPORTANT

Fuse Capacity 15A time delay fuse

1 Insulation And Maintenance Of Pipe Connection

- The connected terminals should be completely sealed with heat insulator and then tied up with rubber strap.
- Please tie the pipe and power line together with vinyl tape as shown in the figure showing the installation of Indoor and Outdoor units. Then fix their position with holders.
- To enchance the heat insulation and to prevent water condensation, please cover the outdoor part of the drain hose and pipe with insulation pipe.
- Completely seal any gap with putty.



Power Source And Operation Test

Power Source

⚠ CAUTION

- Please use a new socket. Accident may occur due to the use of old socket because of poor contact.
- Please plug in and then remove the plug for 2 − 3 times. This is to
- Keep additional length for the power cord and do not render the

- ensure that the plug is completely plugged into the socket.
- plug under external force as this may cause poor contact. • Do not fix the power cord with U-shape nail.

Operation Test

mounting location of the holder.

fixed on wall or beam.

The controller must

be hooked onto the

hook at the lower

part of the holder.

Push in the remote controller in the

direction as shown

in figure below.

• Please ensure that the air conditioner is in normal operating condition during the operation test.

Remote

Controlle

Installation Of Remote Controller

• The remote controller can be placed in its holder which is

• To operate the remote controller at its holder, please ensure

that the unit can receive signal transmitted from the controller

at the place where the holder is to be fixed. The unit will beep

when signal is received from the remote controller. The signal

transmission is weaken by the fluorescent light. Therefore,

during the installation of the remote control holder, please

switch on the light, even during day time, to determine the


• Explain to your customer the proper operation procedures as described in the user's manual.

How to Remove The Front Cover

- 1 Remove the front panel.
- Please remove and attach the front panel by both hands.



- After opening the front panel by both hands.
- Undo the right arm while pushing it inside.
- 2 Slide the front panel to right as shown in figure. Then remove while pulling it to front.
- 2 Remove the filters.
- 3 After removing two screws, pull the center of the front cover towards you and release the claws.
- 4 Pull the side faces (lower sections) of the front cover towards you as shown in the figure and remove the cover.




How to Attach the Front Cover

- Check that the drain pan is securely attached.
- After installing the front cover onto the unit, hook three claws at upper side of the cover securely. Then, push the center of the front cover to lock the claws.
- 3 Tighten the two screws.



- 4 Install the filter.
- Slide the shafts of the right and left arms on the washable panel along the steps to insert the shafts into the holes till they stop. After checking that the shafts are securely inserted, close the panel.



STAGE OF INSTALLATION