



CONTROLLER 48x48mm

RE72 TYPE



USER'S MANUAL



CONTENTS:

1.	APPLICATION	3
2.	CONTROLLER SET	3
3.	BASIC REQUIREMENTS, OPERATIONAL SAFETY	4
4.	INSTALLATION	4
4.1.	Controller Installation	4
4.2.	Electrical Connections	5
4.3.	Installation Recommendations	7
5.	STARTING TO WORK	7
6.	SERVICE	9
6.1.	Programming Controller Parameters	10
6.2.	Programming Matrix	11
6.3.	Setting Change	12
6.4.	Parameter Description	12
7.	CONTROLLER INPUTS AND OUTPUTS	19
7.1.	Main Measuring Inputs	19
7.2.	Additional Measuring Inputs	20
7.3.	Binary Inputs	20
7.4.	Outputs	20
8.	CONTROL	21
8.1.	ON-OFF Control	21
8.2.	Innovative SMART PID Algorithm	21
8.3.	Stepper control	24
8.4.	“Gain Scheduling” Function	24
8.5.	Control of Heating-cooling Type	25
9.	ALARMS	26
10.	TIMER FUNCTION	26
11.	CURRENT TRANSFORMER INPUT	27
12.	ADDITIONAL FUNCTIONS	28
12.1.	Control Signal Monitoring	28
12.2.	Manual Control	28
12.3.	Signal Retransmission	28
12.4.	Set Point Change Rate – Soft Start	29
12.5.	Digital Filter	29
12.6.	Manufacturer's Settings	30
13.	PROGRAMMING CONTROL	30
13.1.	Description of Programming Control Parameters	30
13.2.	Definition of Set Point Value Programs.	32
13.3.	Control of the Set Point Value Program	34
14.	RS-485 INTERFACE WITH MODBUS PROTOCOL	36
14.1.	Introduction	36
14.2.	Error Codes	36
14.3.	Register Map	36
15.	ERROR SIGNALING	46
16.	TECHNICAL DATA	47
17.	CONTROLLER VERSION CODES	49
18.	MAINTENANCE AND GUARANTEE	50

1. APPLICATION


The RE72 controller is destined for the temperature control in plastics, food, dehydration industries and everywhere when the temperature change stabilization is necessary.

The measuring input is universal for resistance thermometers (RTD), thermocouple sensors (TC), or for linear standard signals.

The controller has three outputs enabling the two-step control, step-by-step three-step control, three-step control of heating-cooling type and alarm signaling. The two-step control is acc. to the PID or ON-OFF algorithm.

The innovative SMART PID algorithm has been implemented in the controller.

2. CONTROLLER SET

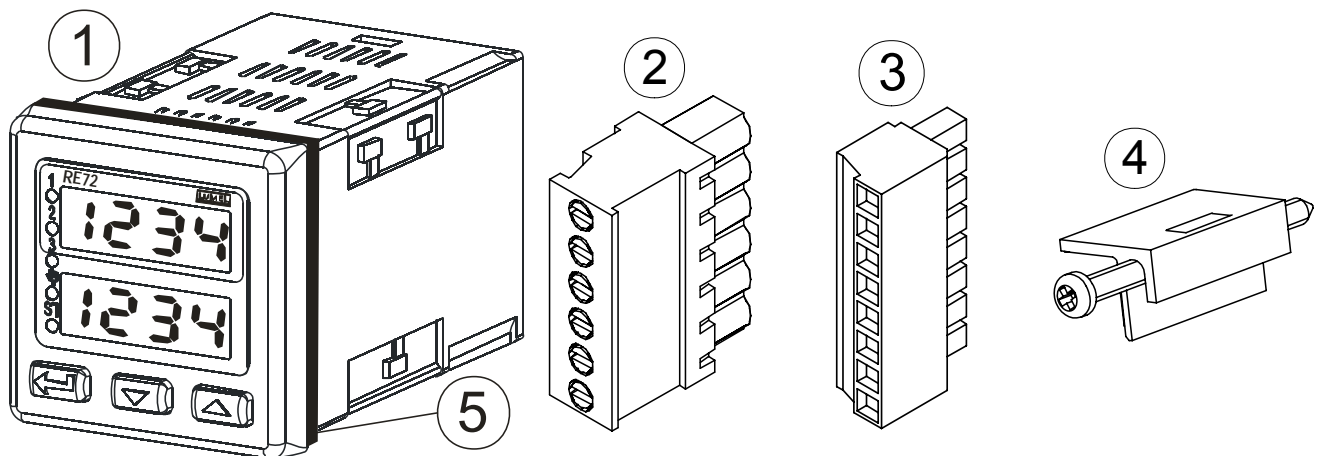

The delivered controller set is composed of:

- | | |
|--|-------|
| ▪ RE72 controller | 1 pc |
| ▪ Plug with 6 screw terminals | 1 pc |
| ▪ Plug with 8 screw terminals | 1 pc |
| ▪ Screw clamp to fix the controller in the panel | 4 pcs |
| ▪ Seal | 1 pc |
| ▪ User's manual | 1 pc |
| ▪ Guarantee card | 1 pc |

When unpacking the controller, please check whether the type and version code on the data plate correspond to the order.

3. BASIC REQUIREMENTS, OPERATIONAL SAFETY

In the safety service scope, the controller meets to requirements of the EN 61010-1 standard.

Observations Concerning the Operational Safety



- All operations concerning transport, installation, and commissioning as well as maintenance, must be carried out by qualified, skilled personnel, and national regulations for the prevention of accidents must be observed.
 - Before switching the controller on, one must check the correctness of connections to the network.
 - Do not connect the controller to the network through an autotransformer.
 - The removal of the controller casing during the guarantee contract period may cause its cancellation.
 - The controller fulfills requirements related to electromagnetic compatibility in the industrial environment
 - When connecting the supply, one must remember that a switch or a circuit-breaker should be installed in the room. This switch should be located near the device, easy accessible by the operator, and suitably marked as an element switching the controller off.
 - Non-authorized removal of the casing, inappropriate use, incorrect installation or operation, create the risk of injury to personnel or meter damage.
- For more detailed information, please study the User's Manual.

4. INSTALLATION

4.1. Controller Installation

Fix the controller in the panel, which the thickness should not exceed 15 mm, by means of four screw clamps acc. to the fig. 1.

The panel cut-out should have $45+0.6 \times 45+0.6$ mm

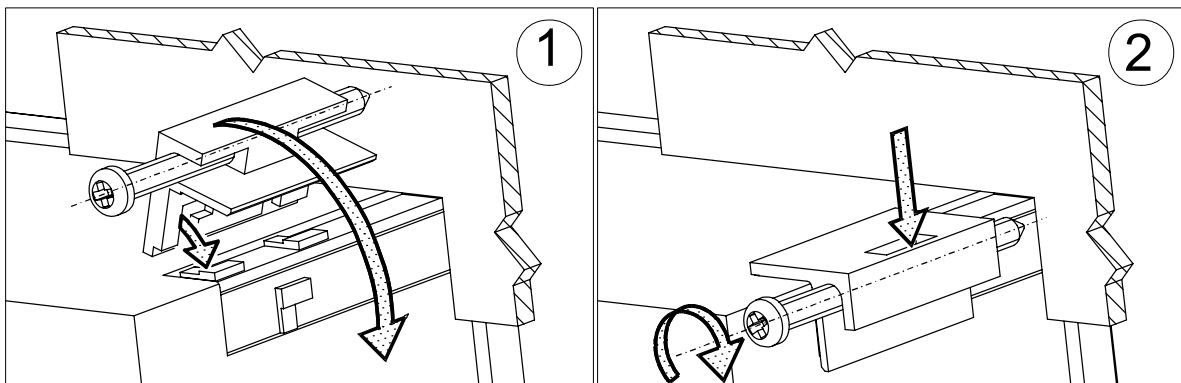


Fig.1 Controller fixing in the panel

Controller overall dimensions are presented on the fig. 2.

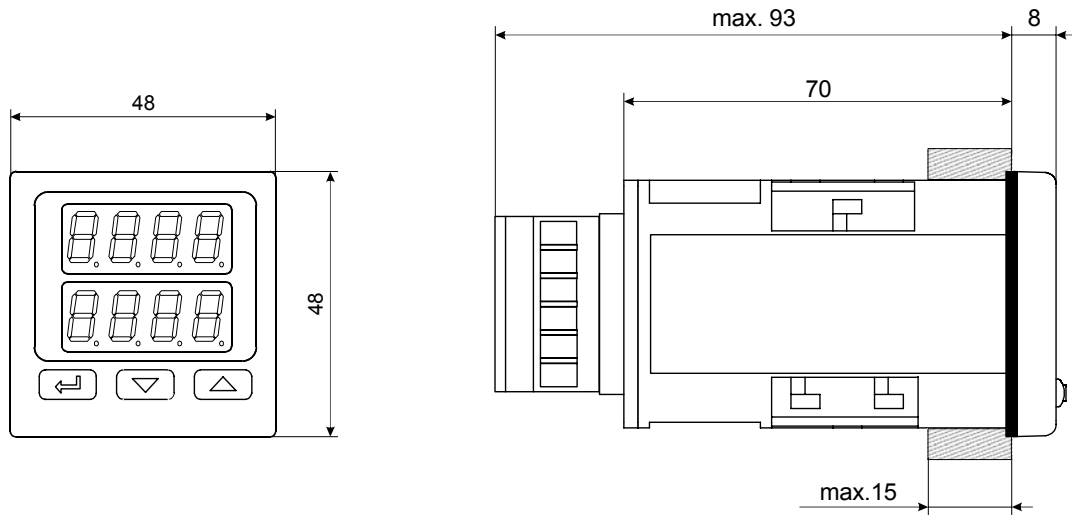


Fig. 2. Controller dimensions.

4.2. Electrical Connections

The controller has two separable terminal strips with screw terminals. One strip enables to connect the supply and outputs by a wire of 2.5 mm² cross-section. The second strip enables to connect input signals by a wire of 1.5 mm² cross-section.

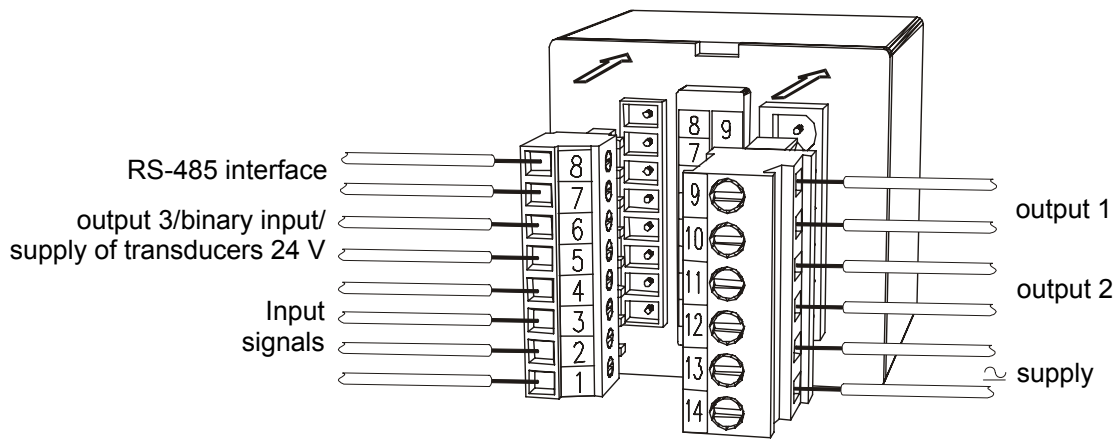


Fig. 3. View of controller connecting strips




Fig. 4. Supply

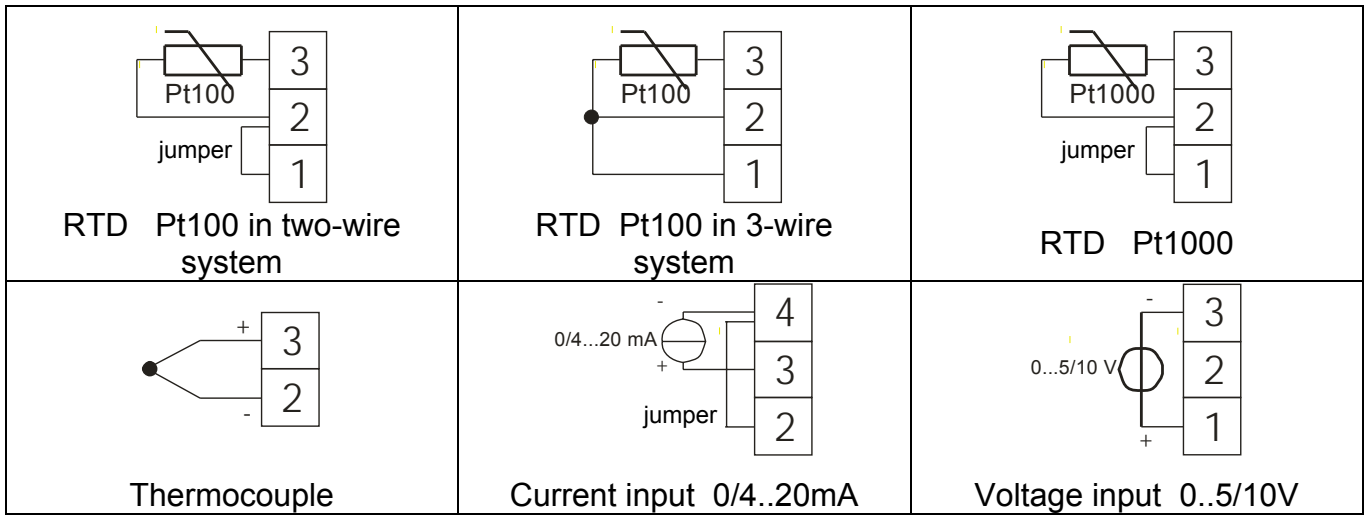


Fig. 5. Input signals




Fig. 6. Additional input signal

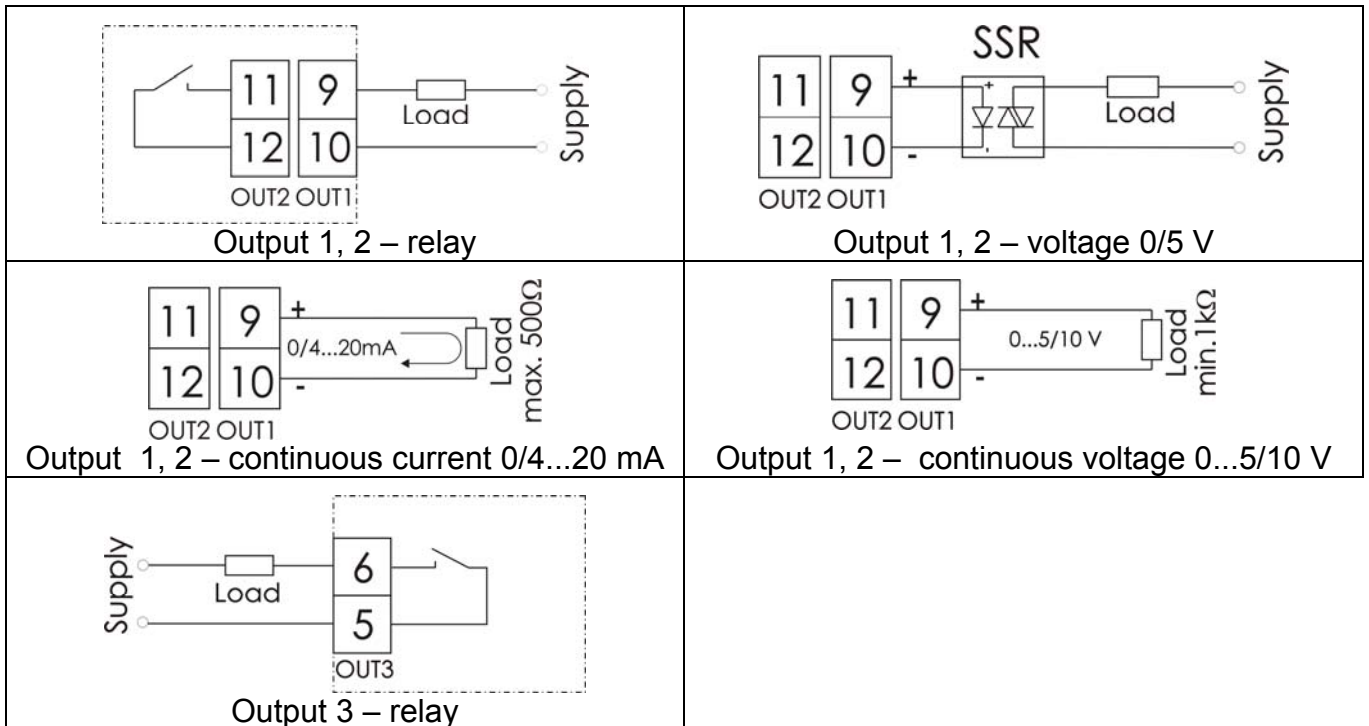


Fig. 7. Control outputs/ alarming




Fig. 8. Binary input




Fig. 9. Current transformer input




Fig. 10. RS-485 Interface




Fig. 11. Supply of 24V transducers

4.3. Installation Recommendations

In order to obtain a full fastness against electromagnetic noise, it is recommended to observe following principles:

- do not supply the controller from the network in the proximity of devices generating high pulse noise and do not apply common earth circuits,
- apply network filters,
- wires leading measuring signals should be twisted in pairs, and for resistance sensors in 3-wire connection, twisted of wires of the same length, cross-section and resistance, and led in a shield as above,
- all shields should be one-side earthed or connected to the protection wire, the nearest possible to the controller,
- apply the general principle, that wires leading different signals should be led at the maximal distance between them (no less than 30 cm), and the crossing of these groups of wires made at right angle (90°).






5. STARTING TO WORK

After turning the supply on, the controller carries out the display test, displays the **RE72** inscription, the program version and next, displays measured and set point values.

A character message informing about abnormalities may appear on the display (table 18).

The PID control algorithm with the proportional range 30°C, integration time constant of 300 seconds, differentiation time constant of 60 seconds and pulse period of 20 seconds is set by the manufacturer.

Changing the Set Point Value

One can change the set point value by pressing the  or the  push-button (fig. 12). The beginning of change is signaled by the flickering dot of the lower display. One must accept the new set point value by pressing the  push-button during 30 seconds since the last pressure of the  or  push-button. In the contrary, the old value will be restored. The change limitation is set by parameters **SPL** and **SPH**.

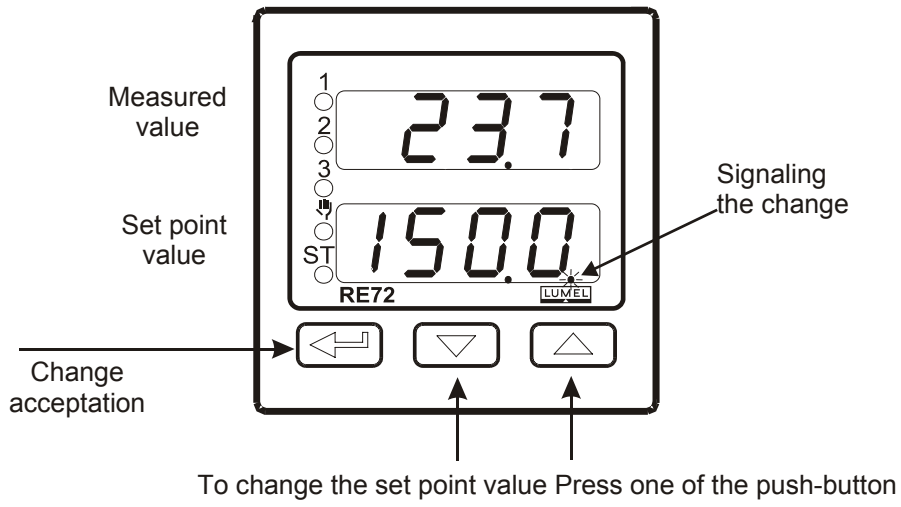


Fig. 12. Fast change of set point value

6. SERVICE

The controller service is presented on the fig. 13

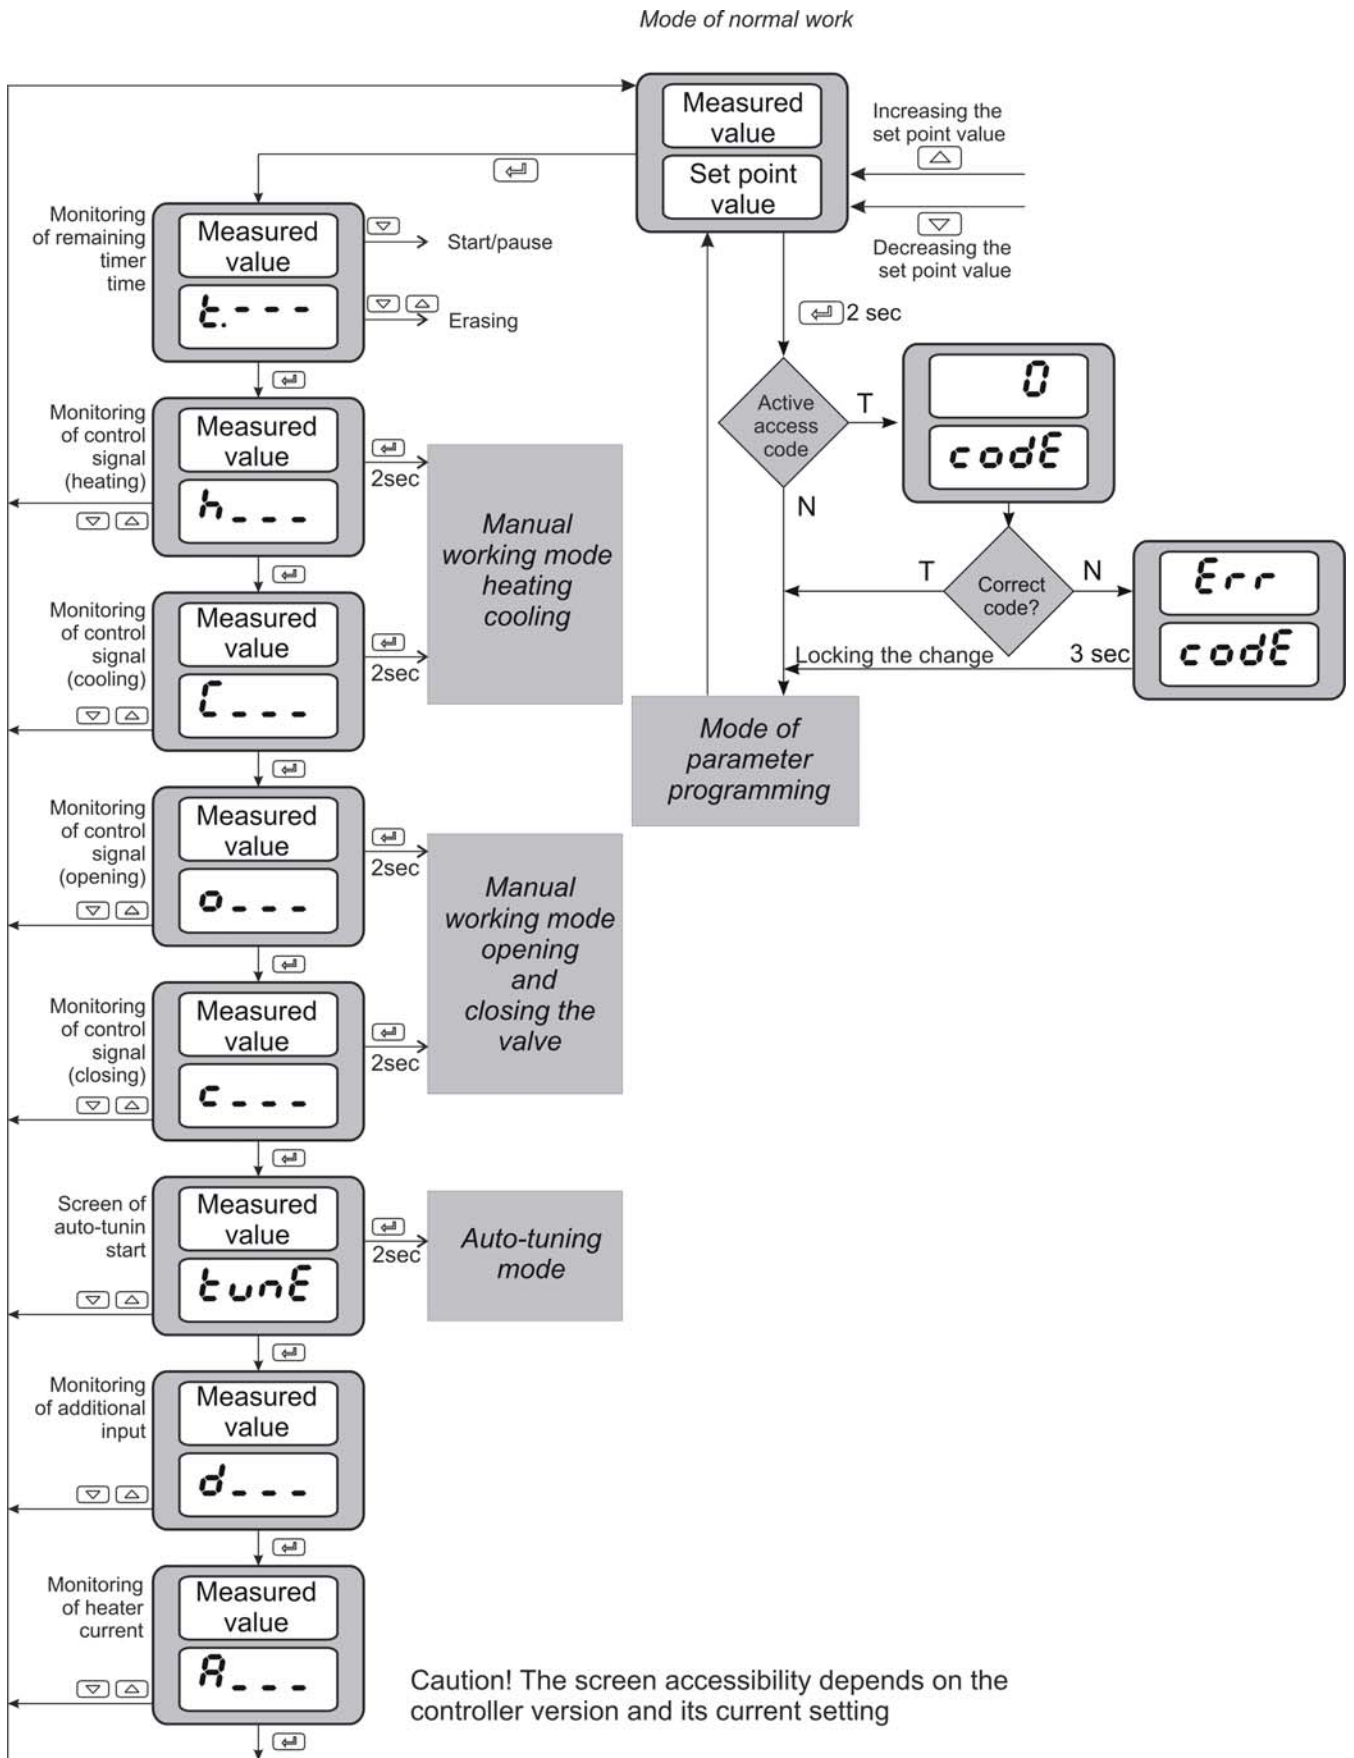










Fig. 13. Menu of controller service

6.1. *Programming Controller Parameters*

The pressure and holding down the  push-button during ca 2 sec. causes the entry in the programming matrix. The programming matrix can be protected by an access code. In case when giving a wrong value of the code, it is only possible to see settings through – without the possibility of changes.

The fig 14. presents the transition matrix in the programming mode. The transition between levels is carrying out by means of  and  push-buttons and the level selection by means of the  push-button.

After selecting the level, the transition between parameters is carried out by means of  and  push-buttons. In order to change the parameter setting, one must proceed acc. to the section 6.3. In order to exit from the selected level, one must transit between parameters until the symbol [. . .] appears and press the  push-button.

In order to exit from the programming matrix to the normal working mode, one must transit between levels until the symbol [. . .] appears and press the  push-button.

Some controller parameters can be invisible – it depends on the current configuration.

The table 1 includes the description of parameters. The return to the normal working mode follows automatically after 30 seconds since the last push-button pressure.

6.2. Programming Matrix

inp Input parameters	unit Unit	inty Kind of main input	dp Pos. of decimal point	inlo Indic. of lower threshold	inhi Indic. of higher threshold	shif Shift of measured value	rtxy Kind of auxiliary input	dp2 Pos. of decimal point	rtlo Indic. of lower threshold	rtHi Indic. of higher threshold	filte Time constant of filter	bin Binary input function	... Transit to higher level	
outp Output parameters	out1 Function of output 1	out2 Type of output 1	out2 Function of output 2	out2y Type of output 2	out3 Function of output 3	yfl Damage signal	out1 Impulse period Out 1	out2 Impulse period Out 2	out3 Impulse period Out 3	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	
ctrl Control parameters	alg Control algorithm	type Kind of control	hy Hysteresis	hn Dead zone	gain Gain "Schedule" function	pidn PID number for GS	pid1 Switching level PID1-2	pid2 Switching level PID2-3	pid3 Switching level PID3-4	const Constant set PID	stlo Lower threshold hold ST	sthi Upper threshold hold ST	fdb Reversible signal	
pid PID parameters	Submenu: pid													
alar Alarm parameters	pb Proportional band	ti Integration time constant	td Different time constant	yc Correction of control signal	Parameters as for PID1									... Transit to higher level
sp Alarm parameters	asp Set value alarm 1	adu Deviation for alarm 1	ahy Deviation for alarm 1	alt Memory alarm 1	asp Set value SP	adu Deviation for alarm 2	ahy Hysteresis alarm 2	alt Memory alarm 2	asp Set value alarm 2	adu Deviation for alarm 2	ahy Hysteresis of current alarm	alt Set value of current alarm	osp Set value of current alarm	... Transit to higher level
prg Program control parameters	spnd Kind of set value	prg Program No to carry out	sp Set value SP	sp2 Set value SP2	sp3 Set value SP3	sp4 Set value SP4	spl Lower limitation SP	spH Higher limitation SP	sprr Accretion rate of set value	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level
retr Retransmits. parameters	ralo Lower retransmits. threshold	rahi Higher retransmits. threshold	prot Transmis. protocol	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level
inte Interface parameters	addr Controller address	brud Transmis. rate	timr Timer function	ctnt Count-down of timer time	mon Monitor. auxiliary output	mon Monitor. heater current	exit Exit time from monitoring	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level
serv Service parameters	sectu Access code	stfn Auto-tuning function	stfn Auto-tuning function	ctnt Count-down of timer time	mon Monitor. auxiliary output	mon Monitor. heater current	exit Exit time from monitoring	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level	... Transit to higher level
... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu	... Exit from menu

Fig. 14. Programming matrix

6.3. Setting Change

The change of the parameter setting begins after pressing the push-button during the display of the parameter name. The setting selection is carried out through and push-buttons, and accepted by the push-button. The change cancellation follows after the simultaneous pressing of and push-buttons or automatically after 30 sec since the last push-button pressure. The way to change the setting is shown on the fig. 15.

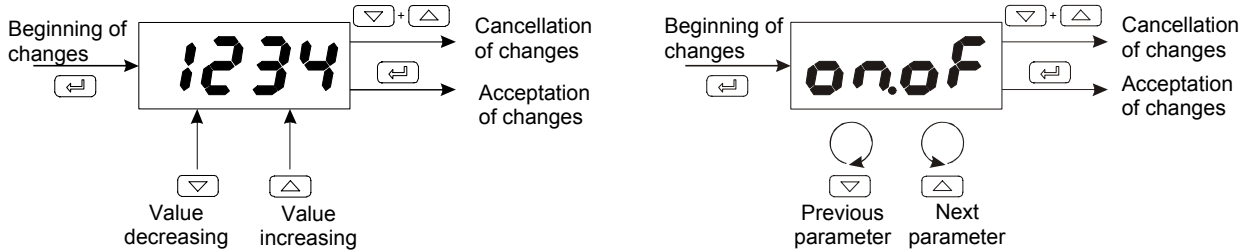


Fig. 15. Change of number and text parameter settings

6.4. Parameter Description

The list of parameters in the menu is presented in the table 1.

List of configuration parameters

Table 1

Parameter symbol	Parameter description	Manufacturer setting	Range of parameter changes	
			sensors	Linear input
Input parameters				
unit	Unit	°C	°C: Celsius degrees °F: Fahrenheit degrees PU: physical units	
input	Kind of main input	Pt 1	Pt 1: Pt100 Pt 10: Pt1000 J - J: thermocouple of J type T - T: thermocouple of T type K - K: thermocouple of K type S - S: thermocouple of S type R - R: thermocouple of R type B - B: thermocouple of B type E - E: thermocouple of E type N - N: thermocouple of N type L - L: thermocouple of N type 0 - 20: linear current 0-20mA 4 - 20: linear current 4-20mA 0 - 5: linear voltage 0-5 V 0 - 10: linear voltage 0-10 V	
dp	Position of the main input decimal point	1 - dp	0 - dp: without decimal point 1 - dp: 1 decimal place 2 - dp: 2 decimal place	0 - dp: without decimal point 1 - dp: 1 decimal place 2 - dp: 2 decimal place

Parameter symbol	Parameter description	Manufacturer setting	Range of parameter changes	
			sensors	Linear input
1 nLo	Indication for the lower threshold of the linear main input	0.0	-	-1999...9999 ¹⁾
1 nHi	Indication for the upper threshold of the linear main input	100.0	-	-1999...9999 ¹⁾
5H, F	measured value shift of the main input	0.0 °C	-100.0...100.0 °C (-180.0...180.0 °F)	-999...999 ¹⁾
1 2tY	Kind of the auxiliary input	4-20	0-20 : linear current 0-20mA 4-20 : linear current 4-20mA	
dP2	Position of the decimal point	1-dP	-	0-dP : without decimal place 1-dP : 1 decimal place 2-dP : 2 decimal place
1 2Lo	Indication for the lower threshold of the auxiliary linear input	0.0	-	-1999...9999 ¹⁾
1 2Hi	Indication for the upper threshold of the auxiliary linear input	100.0	-	-1999...9999 ¹⁾
F, Lt	Time constant of the filter	0.2	oFF : filter disabled 0.2 : time constant 0.2 s 0.5 : time constant 0.5 s 1 : time constant 1 s 2 : time constant 2 s 5 : time constant 5 s 10 : time constant 10 s 20 : time constant 20 s 50 : time constant 50 s 100 : time constant 100 s	
bn, n	Binary input function	none	none : none St oP : control stop HRnd : switching into manual working SP2 : switching SP1 into SP2 rSRt : erasing of timer alarm PStR : program start PnSt : jump to the next segment PHLd : stopping to count the set point in the program	
outP – Output parameters				
out 1	Function of output 1	Y	oFF : without function Y : control signal YOP : control signal for the stepper control – opening YCL : control signal for the stepper control - closing COOL : control signal - cooling	

Parameter symbol	Parameter description	Manufacturer setting	Range of parameter changes	
			sensors	Linear input
			<i>RH₁</i> : upper absolute alarm <i>RL₀</i> : lower absolute alarm <i>d.u.H₁</i> : upper relative alarm <i>d.u.L₀</i> : lower relative alarm <i>d.u.i.n</i> : inner relative alarm <i>d.u.o.u</i> : outer relative alarm <i>RL.t.r</i> : timer alarm <i>r.E.t.r</i> : retransmission <i>Ev1</i> : auxiliary output for the program-following control <i>Ev2</i> : auxiliary output for the program-following control	
<i>o1.t.y</i>	Output type 1	<i>4-20</i> ²⁾	<i>r.E.L.Y</i> : relay output <i>55r</i> : voltage output 0/5 V <i>4-20</i> : continuous current output 4 – 20 mA <i>0-20</i> : continuous current output 0 – 20 mA <i>0-5</i> : continuous voltage output 0 – 5 V <i>0-10</i> : continuous voltage output 0 – 10 V	
<i>out2</i>	Function of output 2	<i>OFF</i>	<i>OFF</i> : without function <i>Y</i> : control signal <i>YOP</i> : control signal of stepper control – opening <i>YCL</i> : control signal of stepper control – closing <i>COOL</i> : control signal - cooling <i>RH₁</i> : absolute upper alarm <i>RL₀</i> : absolute lower alarm <i>d.u.H₁</i> : relative upper alarm <i>d.u.L₀</i> relative : lower alarm <i>d.u.i.n</i> : inner relative alarm <i>d.u.o.u</i> : outer relative alarm <i>RL.t.r</i> : timer alarm <i>RL.h.b</i> heater damage alarm <i>RL.o.S</i> : controlling element damage alarm (short circuit) <i>r.E.t.r</i> : retransmission <i>Ev1</i> : auxiliary output for the program-following control <i>Ev2</i> : auxiliary output for the program-following control	
<i>o2.t.y</i>	output type 2	<i>4-20</i> ²⁾	<i>r.E.L.Y</i> : relay output <i>55r</i> : voltage output 0/5 V <i>4-20</i> : current continuous output 4 – 20 mA <i>0-20</i> : current continuous output 0 – 20 mA <i>0-5</i> : voltage continuous output 0 – 5 V <i>0-10</i> : voltage continuous output 0 – 10 V	
<i>out3</i>	Function of output 3	<i>OFF</i>	<i>OFF</i> : without function <i>Y</i> : control signal	

Parameter symbol	Parameter description	Manufacturer setting	Range of parameter changes	
			sensors	Linear input
			YOP : control signal of stepper control – opening YCL : control signal of stepper control – closing COOL : control signal - cooling RHi : absolute upper alarm RLo : absolute lower alarm d.u.Hi : relative upper alarm d.u.Lo : relative lower alarm d.u.in : inner relative alarm d.u.out : outer relative alarm RL.t.r : timer alarm RL.h.b heater damage alarm RL.o.S : controlling element damage alarm (short-circuit) Ev1 : auxiliary output for the program-following control Ev2 : auxiliary output for the program-following control	
YFL	Control signal of control output for proportional control in case of the sensor damage.	0.0	0.0...100.0	
t01	Pulse period of output 1	20.0 s	0.5...99.9 s	
t02	Pulse period of output 2	20.0 s	0.5...99.9 s	
t03	Pulse period of output 3	20.0 s	0.5...99.9 s	
ctrl – Control parameters				
ALG	Control algorithm	P, d	onoff : control algorithm on-off P, d : control algorithm PID	
TYPE	Kind of control	dir	dir : direct control (cooling) ind : reverse control (heating)	
HY	Hysteresis	1.1 °C	0.2...100.0 °C (0.2...180.0 °F)	
Hn	Displacement zone for heating-cooling control or dead zone for stepper control.	10.0 °C	0.0...100.0 °C (0.0...180.0 °F)	0...999 1)
GSY	“Gain Scheduling “ function	off	off : disabled SP : from set point value SEt : constant PID set	
GSnb	Number of PID sets for “Gain Scheduling” from the set point value	2	2 : 2 PID sets 3 : 3 PID sets 4 : 4 PID sets	
GL12	Switching level for PID1 and PID2 sets	0.0	MIN...MAX 3)	
GL23	Switching level for PID2 and PID3 sets	0.0	MIN...MAX 3)	
GL34	Switching level for PID3 and PID4 sets	0.0	MIN...MAX 3)	

Parameter symbol	Parameter description	Manufacturer setting	Range of parameter changes	
			sensors	Linear input
GSEt	Selection of the constant PID set	P, d 1	P, d 1 : PID1 set P, d 2 : PID2 set P, d 3 : PID3 set P, d 4 : PID4 set	
St.Lo	Lower threshold for auto-tuning	0.0 °C	MIN...MAX 3)	
St.Hi	Upper threshold for auto-tuning	800.0 °C	MIN...MAX 3)	
Fdb	Stepper control algorithm type	no	no : algorithm without feedback YES : algorithm with feedback	
P, d – PID parameters				
P, d 1	Pb	Proportional band	30.0 °C	0.1...550.0 °C (0.1...990.0 °F)
	t_i	Integration time constant	300 s	0...9999 s
	t_d	Differentiation time constant	60.0 s	0.0...2500 s
	Y0	Correction of the control signal, for P or PD control type	0.0 %	0...100.0 %
P, d 2	Pb2 t_i 2 t_d 2 Y02	Second set of PID parameters	as PB, TI, TD, Y0	
P, d 3	Pb3 t_i 3 t_d 3 Y03	Third set of PID parameters	as PB, TI, TD, Y0	
P, d 4	Pb4 t_i 4 t_d 4 Y04	Fourth set of PID parameters	as PB, TI, TD, Y0	
P, d C	PbC	Proportional band for the cooling channel (in relation to PB)	100 %	0.1...200 %
	t_i C	Integration time constant	300 s	0...9999 s
	t_d C	Differentiation time constant	60.0 s	0.0...2500 s

RLRr – Alarm parameters			
A1SP	Set point value for absolute alarm 1	100.0	MIN...MAX ³⁾
A1dU	Deviation from the set point value for relative alarm 1	0.0 °C	-200.0... 200.0 °C (-360.0... 360.0 °F)
A1HY	Hysteresis for alarm 1	2.0 °C	0.2...100.0 °C (0.2...180.0 °F)
A1Lt	Memory of alarm 1	oFF	oFF : disabled oOn : enabled
A2SP	Set point value for absolute alarm 2	100.0	MIN...MAX ³⁾
A2dU	Deviation from the set point value for relative alarm 2	0.0 °C	-200.0... 200.0 °C (-360.0... 360.0 °F)
A2HY	Hysteresis for alarm 2	2.0 °C	0.2...100.0 °C (0.2...180.0 °F)
A2Lt	Memory of alarm 2	oFF	oFF : disabled oOn : enabled
A3SP	Set point value for absolute alarm 3	100.0 °C	MIN...MAX ³⁾
A3dU	Deviation from the set point value for relative alarm 3	0.0 °C	-200.0... 200.0 °C (-360.0... 360.0 °F)
A3HY	Hysteresis for alarm 3	2.0 °C	0.2...100.0 °C (0.2...180.0 °F)
A3Lt	Memory of alarm 3	oFF	oFF : disabled oOn : enabled
hbSP	Set point for the heater damage alarm	0.0 A	0.0...50.0 A
hbHY	Hysteresis for the heater damage alarm	0.1 A	0.0...50.0 A
o5SP	Set point for the controlling element damage alarm (short-circuit)	0.0 A	0.0...50.0 A
o5HY	Hysteresis for the controlling element damage alarm (short-circuit)	0.1 A	0.1...50.0 A
SPP – Set point value parameters			
SP.nd	Kind of set point value	SP12	SP12 : set point value SP1 or SP2 r.n.n : set point value with soft start in units per minute r.Hr : set point value with soft start in units per hour i.n2 : set point value from the additional input P.r.G : set point value from programming control
C.P.r.G	Program No to carry out	1	1...15
SP1	Set point value SP1	0.0 °C	MIN...MAX ³⁾
SP2	Set point value SP2	0.0 °C	MIN...MAX ³⁾
SP3	Set point value SP3	0.0 °C	MIN...MAX ³⁾
SP4	Set point value SP4	0.0 °C	MIN...MAX ³⁾
SPL	Lower limitation of the fast set point value change	-200 °C	MIN...MAX ³⁾

Parameter symbol	Parameter description	Manufacturer setting	Range of parameter changes	
			sensors	Linear input
SPH	Upper limitation of the fast set point value change	1767.0 °C	MIN...MAX ³⁾	
SP.r.r	Accretion rate of the set point value SP1 or SP2 during the soft start .	0.0 °C	0...999.9 / time unit ⁴⁾	0...9999 ¹⁾ / time unit ⁴⁾
PrG – Programming control parameters				
The description of parameters is in the section: Programming control – table 5				
IntE – Serial interface parameters				
Addr	Device address	1	1...247	
bAud	Transmission rate	96	48 : 4800 bit/s 96 : 9600 bit/s 192 : 19200 bit/s 384 : 38400 bit/s 576 : 57600 bit/s	
Prot	Protocol	r8n2	nonE : lack r8n2 : RTU 8N2 r8E1 : RTU 8E1 r8o1 : RTU 8O1 r8n1 : RTU 8N1	
rEtE – Retransmission parameters				
Rofn	Quantity retransmitted on the continuous output	Pv	Pv : measured value on the main input PV Pv2 : measured value on the additional input PV2 P1-2 : measured value PV – PV2 P2-1 : measured value PV2 – PV SP : set point value dv : control deviation (set point value – measured value)	
Rolo	Lower threshold of the signal to retransmit	0.0	MIN...MAX ³⁾	
Rohi	Upper threshold of the signal to retransmit	100.0	MIN...MAX ³⁾	
SErP – Service parameters				
SECU	Access code to the menu	0	0...9999	
StFn	Auto-tuning function	on	oFF : locked on : available	
t.nr	timer function	oFF	oFF : disabled on : enabled	
t.nE	Counting off the time by the timer	30.0 min	0.1...999.9 min	
d.2	Monitoring of the auxiliary input	oFF	oFF : disabled on : enabled	
d.Ct	Monitoring of the heater current	oFF	oFF : disabled on : enabled	

Parameter symbol	Parameter description	Manufacturer setting	Range of parameter changes	
			sensors	Linear input
tout	Time of the automatic output from the monitoring mode	30 s	0...9999 s	

¹⁾ The definition at which the given parameter is shown depends on the parameter **dP** – position of the decimal point.

²⁾ For the output 0/4...20 mA, parameter to write, for other cases, to readout – acc. to the version code.

³⁾ See table 2.

⁴⁾ Time unit defined by the parameter **SPnd** (r.n. n, r.Hr).

Caution!

The accessibility of parameters depends on the controller version and its current settings.

Parameters depended on the measuring range

Table 2

Symbol	Input/ sensor	MIN	MAX
Pt 1	Resistance thermometer Pt100	-200 °C (-328 °F)	850 °C (1562 °F)
Pt 10	Resistance thermometer Pt1000	-200 °C (-328 °F)	850 °C (1562 °F)
t - J	Thermocouple of J type	-100 °C (-148 °F)	1200 °C (2192 °F)
t - t	Thermocouple of T type	-100 °C (-148 °F)	400 °C (752 °F)
t - K	Thermocouple of K type	-100 °C (-148 °F)	1372 °C (2501,6 °F)
t - S	Thermocouple of S type	0 °C (32 °F)	1767 °C (3212,6 °F)
t - R	Thermocouple of R type	0 °C (32 °F)	1767 °C (3212,6 °F)
t - B	Thermocouple of B type	0 °C (32 °F)	1767 °C (3212,6 °F)
t - E	Thermocouple of E type	-100 °C (-148 °F)	1000 °C (1832 °F)
t - N	Thermocouple of N type	-100 °C (-148 °F)	1300 °C (2372 °F)
t - L	Thermocouple of L type	-100 °C (-148 °F)	800 °C (1472 °F)
0 - 20	Linear current 0-20mA	-1999 ¹⁾	9999 ¹⁾
4 - 20	Linear current 4-20 mA	-1999 ¹⁾	9999 ¹⁾
0 - 5	Linear voltage 0-5 V	-1999 ¹⁾	9999 ¹⁾
0 - 10	Linear voltage 0-10 V	-1999 ¹⁾	9999 ¹⁾

¹⁾ The definition at which the given parameter is shown depends on the parameter **dP** – position of the decimal point.

7. CONTROLLER INPUTS AND OUTPUTS

7.1. Main Measuring Inputs

The main input is the source of measured value taking part in control and alarms.

The main input is an universal input, to which one can connect different types of sensors or standard signals. The selection of the input signal type is made by the parameter **rntY**.

The position of the decimal point which defines the display format of the measured and the set point value is set by the parameter **dP**. For linear inputs, one must set the indication for the lower and upper analog input threshold **rL0** and **rLH**.


The correction of the measured value indication is carried out by the parameter **Sh, F**.

7.2. Additional Measuring Inputs

The additional input can be the source of remote set point value (**SPnd** set on **1n2**) or the signal for retransmission (**Rafn** set on **P42**).

The additional input is a linear input. The selection of the input signal type is possible between 0...20 mA and 4...20 mA by the parameter **2t5**.

The position of decimal point which defines the display format of the measured and set point value is set by the parameter **dP2**. One must also set the indication for the lower and upper analog input threshold **2L0** and **2H1**.

The signal from the additional input is displayed with the character „d” on the first position. To display the value, one must press the  push-button till the moment of its appearance on the lower display (acc. to the fig. 13.) The return to display the set point value is set by the manufacturer for 30 sec, but it can be changed, or disabled through the parameter **tout**.

7.3. Binary Inputs

The function of the binary input is set by the parameter **bn1n**.

Following binary input functions are available:

- **without function** – the binary input state does not influence the controller operation,
- **control stop** – the control is interrupted, and control outputs are behaved as after a sensor damage, alarm and retransmission operate independently,
- **switching on manual operation** – transition to the manual control mode'
- **switching SP1 on SP2** – change of the set point value during the control,
- **erasing of the timer alarm** – disabling of the relay responsible for the timer alarm,
- **program start** – the programming control process begins (after a prior set of the programming control),
- **jump to the next segment** – the transition to the next segment, follows during the duration of programming control.
- **stoppage to count the set point value in the program** – the stoppage of set point value counting follows during the duration of the programming control.

7.4. Outputs

The controller has maximal three outputs. Each of them can be configured as a control or an alarm output.

For the proportional control (with the exception of analog outputs), the pulse period is additionally set.

The pulse period is the time which goes by between successive switches of the output during the proportional control. The length of the pulse period must be chosen depending on dynamic object properties and suitably for the output device. For fast processes, it is recommended to use SSR relays. The relay output is used to steer contactors in slow-changing processes. The application of a high pulse period to steer slow-changing processes can give unwanted effects in the shape of oscillations. In theory, lower the pulse period, better the control, but for a relay output it can be as large as possible in order to prolong the relay life.

Recommendations concerning the pulse period:

Table 3

output	Pulse period to	Load
Electromagnetic relay	Recommended >20 s, min.10 s	2 A/230 V a.c.
	Min. 5 s	1 A/230 V a.c.
Transistor output	1...3 sec	SSR relay

8. CONTROL

8.1. ON-OFF Control

When a high accuracy of temperature control is not required, especially for objects with a great time constant and small delay, one can apply the on-off control with hysteresis. Advantages of this way of control are simplicity and liability, but disadvantage are the occurring oscillations, even at small hysteresis values.

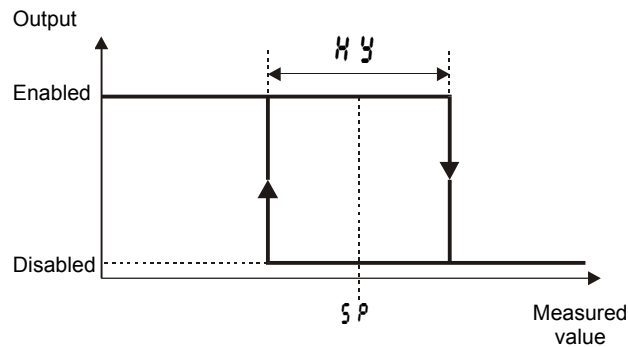


Fig. 16. Operation way of the heating output type


8.2. Innovative SMART PID Algorithm

When a high accuracy of the temperature control is required, one must use the PID algorithm. The applied innovative SMART PID algorithm is characterized by an increased accuracy for a wider class range of controlled objects.

The controller tuning of the object consists on the manual setting of the proportional element value, integration element, differentiation element, or automatically – by means of the auto-tuning function.

8.2.1. Auto-tuning


The controller has the function to select PID settings. These settings ensure in most of case an optimal control.


To begin the auto-tuning, one must transit to the **tune** message (acc. to the fig. 13) and hold down the  push-button during at least 2 seconds. If the control algorithm is set on on-off or the auto-tuning function is locked then, the **tune** message will be hidden.

For a correct realization of the auto-tuning function, it is required to set **SetLo** and **SetHi** parameters. The **SetLo** parameter must be set on the value corresponding to the measured value at disabled control. For temperature control objects, one can set 0°C. One must set the **SetHi** parameter on the value corresponding to the maximum measured value at switched on control on full power.

The flickering ST symbol informs about the activity of the auto-tuning function. The duration of auto-tuning depends on dynamic object properties and can last maximally 10 hours. In the middle of the auto-tuning or directly after it, over-regulations can occur, and for this reason one must set a smaller set point, if it possible.

The auto-tuning is composed of following stages:

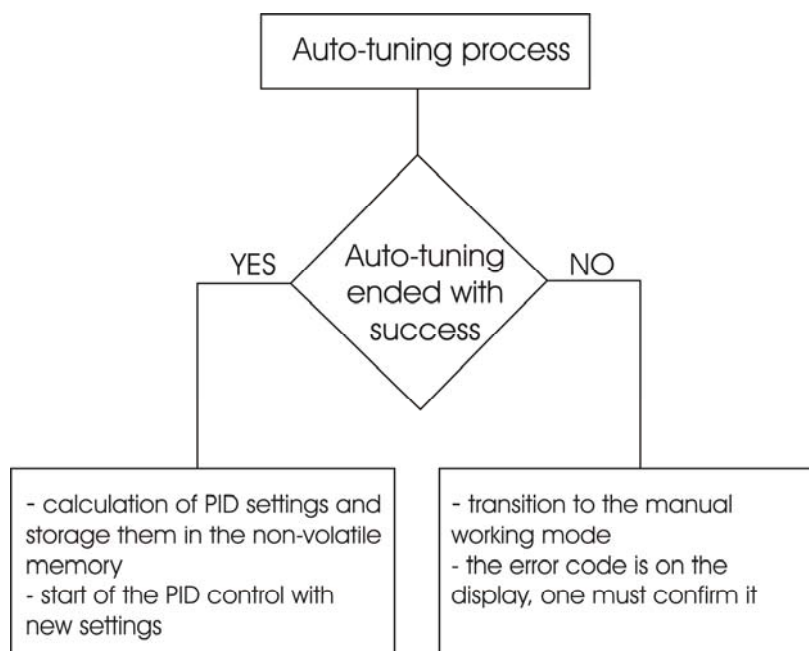


The auto-tuning process will be stopped without counting PID settings, if a supply decay occurs or the  push-button is pressed. In this case, the control with current PID settings begins.

If the auto-tuning is not achieved with success, the error code will be displayed acc. to the table 4.

Error codes for auto-tuning

Table 4

Error code	Reason	How to proceed
E501	P or PD control was selected.	One must select PI, PID control, i.e. the TI element must be higher than zero.
E502	The set point value is incorrect.	One must change one or more set point value or StLo , StHi .
E503	The  push-button was pressed.	
E504	The maximal duration time of auto-tuning was exceeded.	Check if the temperature sensor is correctly placed and if the set point value is not set too higher for the given object.
E505	The waiting time for switching was exceeded	
E506	The measuring input range was exceeded.	Pay attention for the sensor connection way. Do not allow that an over-regulation could cause the exceeding of the input measuring range
E520	Very non-linear object, making impossible to obtain correct PID parameter values, or noises have occurred.	Carry out the auto-tuning again. If that does not help, select manually PID parameters.

8.2.2. Auto-tuning and "Gain Scheduling"

In case, when "Gain Scheduling" is used, one can carry out the auto-tuning in two ways.

The first way consist on choosing a suitable set of PID parameters, in which calculated PID parameters will be stored and realizing the auto-tuning on the level of the currently chosen set point value for the fixed set point control. One must set the **StY** parameter on **SEt**, and choose **USEt** between **P, d i** and **P, d Y**

The second way enables the automatic realization of the auto-tuning for all PID sets. One must set the **StY** parameter on **SP**, and choose the number of PID sets for setting –

parameter $U.S.n.b$. Set point values for individual PID sets must be give in SP , $SP2$, $SP3$, $SP4$ parameters, from the lowest to the highest.

8.2.3. Proceeding Way in Case of a Dissatisfying PID Control

The best way to select PID parameters is to change the value into a twice higher or into a twice lower. During changes, one must respect following principles:

- a) Oscillations:
 - increase the proportional band,
 - increase the integration time,
 - decrease the differentiation time.
- b) Over-regulations:
 - increase the proportional band,
 - increase the integration time,
 - increase the differentiation time.
- c) Instability:
 - decrease the proportional band,
 - decrease the differentiation tim,
- a) Slow jump response:
 - decrease the proportional band,
 - decrease the integration time,

Run of the controlled quantity	Algorithms of controller operations			
	P	PD	PI	PID
	Pb↑	Pb↑ td↓	Pb↑	Pb↑ ti↑ td↓
	Pb↑	Pb↑ td↑	Pb↑ ti↑	Pb↑ ti↑ td↑
		Pb↓ td↓		Pb↓ td↓
	Pb↓	Pb↓	ti↓	Pb↓ ti↓

Fig. 17 Way to correct PID parameters

8.3. Stepper control

There are two stepper control algorithms available to steer the valve:

- without feedback – valve opening and closing is run basing on the PID parameters and the control deviation
- with feedback from the valve positioned – valve opening and closing run basing on the PID parameters, the control deviation and the valve position obtained using the additional input.

To select the stepper control one of the outputs $out\ 1 \dots out\ 3$ should be set to YOP and one of the outputs $out\ 1 \dots out\ 4$ to YCL . For the algorithm without feedback – the Fbd parameter should be set to no , for the algorithm with feedback - the Fbd parameter should be set to YES . There should be set the dead zone around the set point value, where the valve does not change its position – the parameter Hn . The pulse period for both the outputs should be the same.

The first loop - valve opening – operates as a reverse controller, the second loop – valve closing – operates as a direct controller. The PID parameters for the second loop are the same as for the first loop. The PD algorithm is recommended for the stepper control. The operation of a three-stage stepper controller with algorithm P is shown on the fig. 18. The auto-tuning algorithm is not available for the stepper control. The pulse period is the same for valve opening and valve closing (parameter tp !).

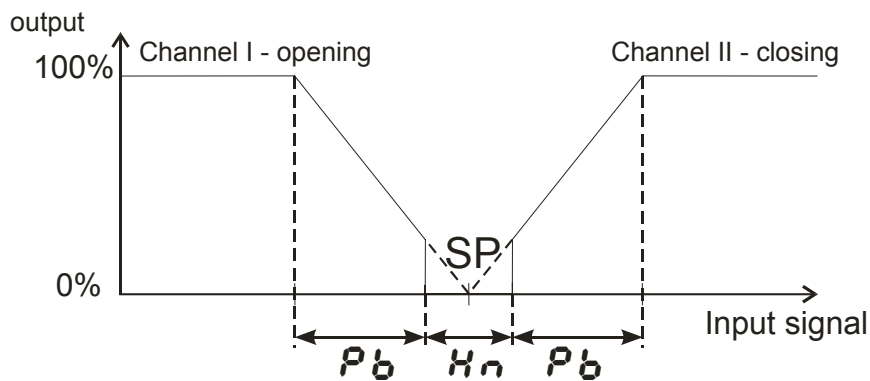


Fig. 18. three-stage stepper control

8.4. "Gain Scheduling" Function

For control systems, Where the object behaves decidedly differently in various temperatures, it is recommended to use the "Gain Scheduling" function. The controller allows to remember up to four sets of PID parameters and switch them over automatically.. The switching between PID sets runs percussiveless and with hysteresis, in order to eliminate oscillations on switching limits.

The GS parameter settles the way of the function operation.

OFF	The function is disabled
SP	a) switching depending on the set point value. For the fixed set point control one must also choose the number of PID sets – the $GSnb$ parameter, and set switching levels in dependence from the number of PID sets.

	b) For the programmed control, one can set the PID set individually for each segment. Then, one must set the P, I, D parameter on $00n$ for the given P, I, D, n program, in the P, I, D, G group.
5E6	Permanently setting of one PID set, the PID set is put through the $G, 5E6$ parameter.

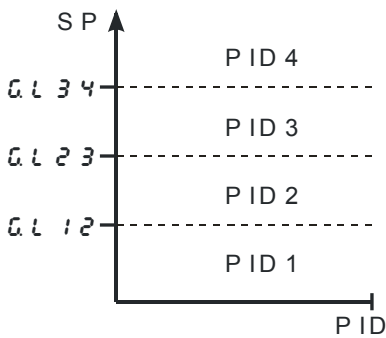


Fig. 19. "Gain Scheduling" switched over from SP

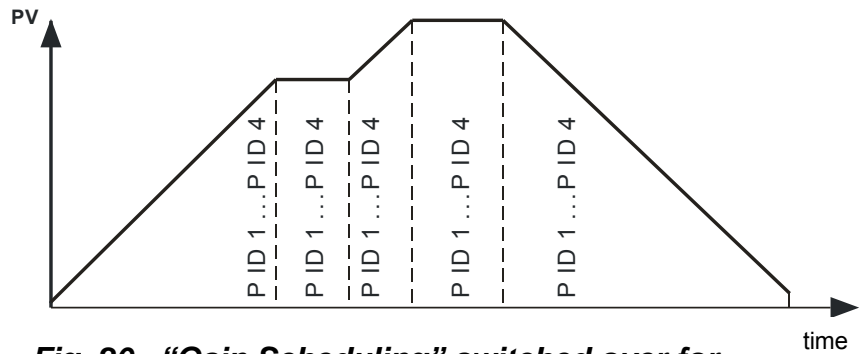


Fig. 20. "Gain Scheduling" switched over for each segment in the programmed control

8.5. Control of Heating-cooling Type

For the heating-cooling control, one of the outputs $out 1...out 3$ should be set to Y , one of the outputs $out 1...out 3$ should be set to $cool$ and the displacement zone Hn for cooling should be configured.

For the heating loop, the PID parameters should be configured: Pb, ti, td , for the cooling loop the PID parameters: PbC, tiC, tdC . The parameter PbC is defined as the ratio of the Pb parameter from the range 0.1...200.0 %.

The pulse period for logic outputs (relay, SSR) is set independently for the heating and cooling loops (depending on the output, these are $to 1 ... to 3$).

If there is the need to use the PID control in one loop and the ON-OFF control in the other loop, one output should be set to PID control and the other one upper relative alarm.


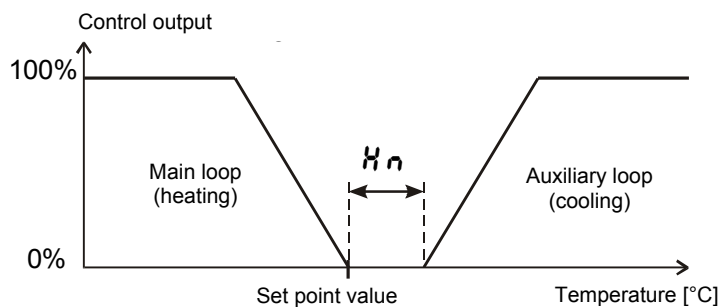


Fig.21. Control with two loops – heating-cooling type

9. ALARMS

Four alarms are available in the controller, which can be assigned: to each output. The alarm configuration requires the selection of the alarm kind through setting *out 1*, *out 2*, *out 3* and *out 4* parameters on the suitable type of alarm. Available types of alarms are given on the fig. 22.

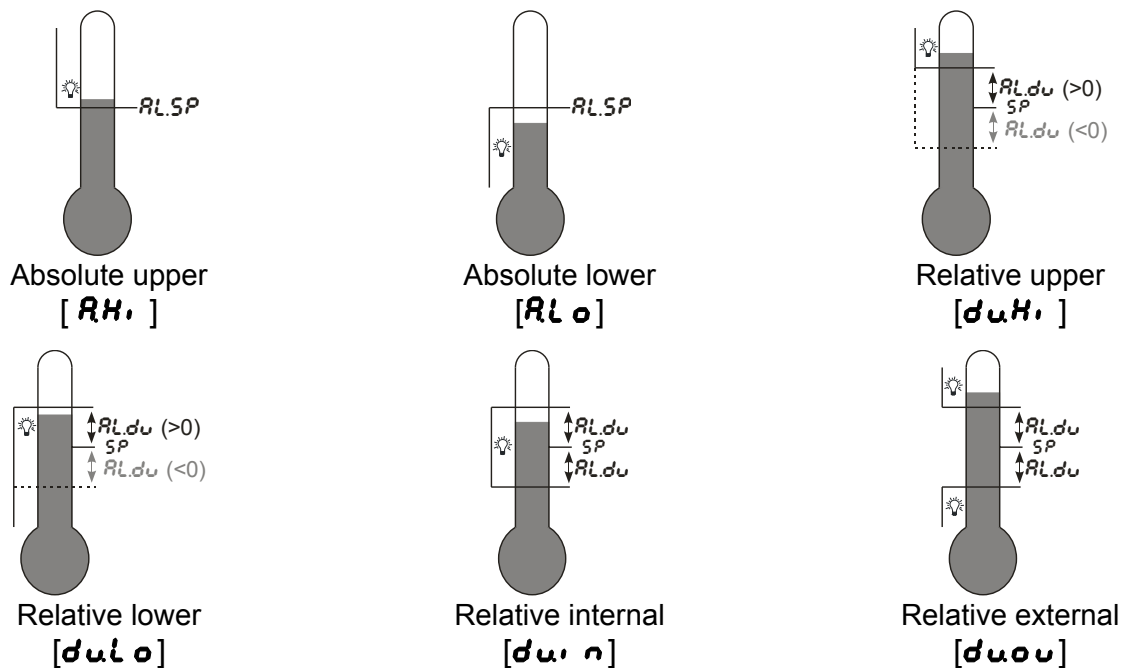

Rys. 22. Kinds of alarms

The set point value for absolute alarms is the value defined by the $Rx.SP$ parameter, and for relative alarms, it is the deviation from the set point value in the main channel - $Rx.du$ parameter. The alarm hysteresis, i.e. the zone around the set point value, in which the output state is not changed, is defined by the $Rx.HY$ parameter.

One can set the alarm latch, i.e. the memorizing of the alarm state after stopping alarm conditions (parameter $Rx.Lt = on$). The erasing of alarm memory can be made by the simultaneous pressure of and push-buttons in the normal working mode or interface.

10. TIMER FUNCTION

When reaching the set point temperature (SP) the timer begins the countdown of the time defined by the t_{nr} parameter. After counting down to zero, the timer alarm is set, which remains active till the moment of the timer erasing.

To activate the timer function, one must set the parameter $t_{nr} = on$.

To indicate the alarm state on an output, one of the outputs *out 2*...*out 4* should be set to RLe .

The timer status/ residual time is displayed with the mark „t” on the first position. To display it, one must press the push-button till the moment of its appearance on the lower display (acc. to the fig. 13)

The return to the set point value display is set by the manufacturer on 30 sec, but can be changed, or disabled through the t_{out} parameter.

Status	Description	Sygnaling
timer stopped		⌚ - - -
Starting of the timer	- temperature over SP - Press the <input type="button" value="▼"/> push-button	Residual time in minutes: e.g. (⌚ 299)
Pause of the timer	Press the <input type="button" value="▼"/> push-button	Flickering residual time in minutes
End of the countdown	Reaching zero by the timer	⌚ End
Timer erasing	During the countdown: Press <input type="button" value="▼"/> and <input type="button" value="▲"/> push-buttons	
	After the countdown end: - press the <input type="button" value="▲"/> push-button - through the binary input	

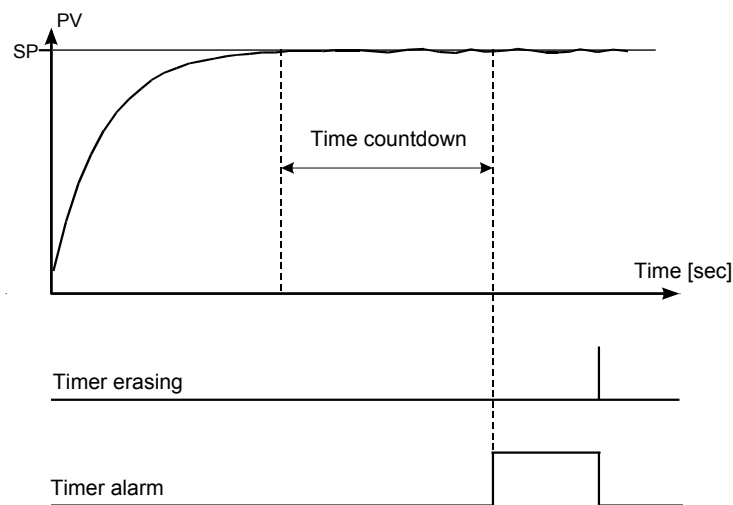


Fig.23. Principle of timer operation

11. CURRENT TRANSFORMER INPUT

After connecting the current transformer (designation CT-94-1), the measurement and display of the current flowing through the load steered by the output 1, is possible.

The first output must be of relay or voltage 0/5 V type. For the current counting, the minimal time of the output switching on must be at least 200 ms.

The transformer work range is equal from 0 to 50 A. The heater current is displayed with the mark "R" in the first position. In order to display the heater current, one must press the push-button till the moment of its appearance on the lower display (acc. to the fig. 13).

The return to the set point value display is set by the manufacturer on 30 sec, but can be changed or disabled through the `tout` parameter.


Two types of alarms concerning the heating element are available. The alarm of damage to the control element and alarm of the heater burnout. The alarm of the control element damage is realized by the current measurement when the control element is disabled, however the burnout alarm is realized when the control element is enabled.

The alarm configuration includes setting the alarm type. For the heater damage alarm **out2** or **out3=AL.hb**, and for the controlling element damage alarm **out2** or **out3=AL.oS** Remaining parameters to set are the alarm set point value **hb.SP**, **oS.SP** and the **hb.HY**, **oS.HY** hysteresis.


For a correct detection of the heater alarm burnout, the heating element can not be connected later than the controller.


12. ADDITIONAL FUNCTIONS





12.1. Control Signal Monitoring

The control signal of heating type is displayed with the mark „h” on the first position, of cooling type is displayed with the mark “c”, of valve opening is displayed with the mark “o” and valve closing is displayed with the mark “c”. The accessibility of the control signal depends on the suitable controller configuration. To display the control signal, one must press the  push-button till the moment of its appearance on the lower display (acc. to the fig. 13). The return to the set point value display is set by the manufacturer on 30 sec. but it can be changed, or disabled through the **tout** parameter.

12.2. Manual Control

The input to the manual control mode follows after holding down the  push-button during the control signal display. The manual control is signaled by the pulsation of the LED diode. The controller interrupts the automatic control and begins the manual control of the output. The control signal value is on the lower display, preceded by the symbol “h” – for the main channel and “c” – for the auxiliary channel (cooling).

The  push-button serves to transit between channels (if the heating – cooling control mode has been selected).

 and  push-buttons serve to change the control signal. The exit to the normal working mode follows after the simultaneous pressure of  and  push-buttons.

At set on-off control on the output 1 (parameter PB=0), one can set the control signal on 0% or 100% of the power, however when the PB parameter is higher than zero, one can set the control signal on any value from the range 0...100%.

12.3. Signal Retransmission

The continuous output can be used for the retransmission of selected value, e.g. in order to the temperature recording in the object or the set point value duplication in multi-zone furnaces.

The signal retransmission will be possible if the output 2 is of continuous type. We begin the signal retransmission from setting the **out2** parameter into **retr**. Additionally, one must set the upper and lower limit of the signal to be retransmitted (**RaLo** and **RaHi**). The signal selection for retransmission is carried out through the **RaFn** parameter.

The recounting method of the retransmitted parameter into a suitable analog signal is shown on the fig. 24.

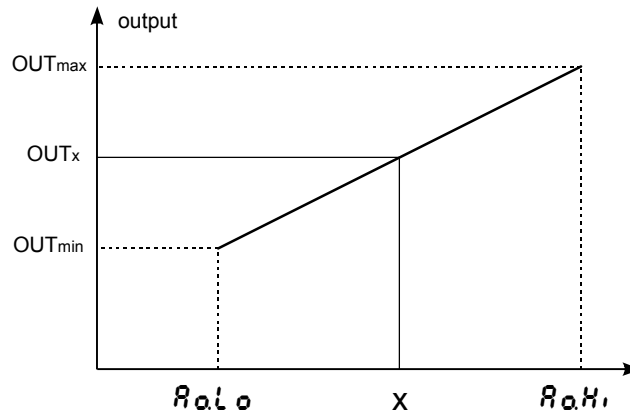


Fig. 24. Recounting of the signal for retransmission

The output signal is calculated acc. to the following formula.

$$wy_x = wy_{min} + (x - Ao.Lo) \frac{wy_{max} - wy_{min}}{Ao.Lo - Ao.Hi}$$

The $Ao.Lo$ parameter can be set as higher than $Ao.Hi$, but the output signal will be then, inversed.

12.4. Set Point Change Rate – Soft Start

The limitation of the temperature accretion rate is carried out through the gradually change of the set point value. This function is activated after the controller supply connection and during the change of the set point value. This function allows to reach softly from the actual temperature to the set point value. One must write the accretion value in the $SP.r$ parameter and the time unit in the rRP parameter. The accretion rate equals zero means that the soft start is disabled.

12.5. Digital Filter

In case when the measured value is instable, one can switch a programmed low-pass filter on. One must set the lowest possible time constant at which the measured value is stable. A high time constant can cause the control instability.

A high time constant can cause a control instability. The time constant of the filter Flt can be set from 0.2 sec. up to 100 seconds.

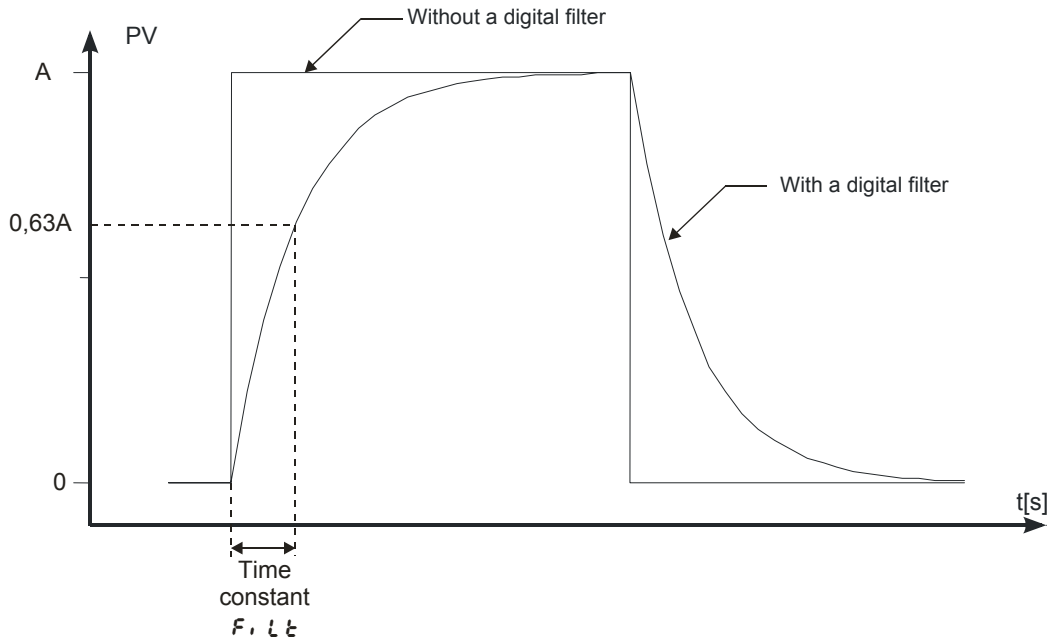


Fig. 25. Time characteristic of the filter

12.6. Manufacturer's Settings

Manufacturer's settings can be restored during the supply connection by holding down and push-buttons, till the moment when the **F A b r** inscription appears on the higher display.

13. PROGRAMMING CONTROL

13.1. Description of Programming Control Parameters

List of configuration parameters

Table 5

P r C – Programming control					
P r 0 1	Sub-menu of the program no 1				
:					
P r 1 5	Sub-menu of the program no 15				
	P C F C	Sub-menu of program parameters			
	parameter Symbol	Parameter description	Manufactur- er's setting	Range of parameter change	
				Sensors	Linear input
	S t r t	Way to begin the program	P u	S P 0 : from the way defined by SP0 P u : from the currently measured value	

	SP0	Initial set point value	0,0 °C	MIN...MAX ¹⁾	
	t.n.u.n	Unit for the segment duration time	n.n.SS	n.n.SS: minutes and seconds HH.n.n: hours and minutes	
	r.r.u.n	Unit for the accretion rate of the set point value	n.n	n.n: minutes Hour: hours	
	hold	Locking of the control deviation	d.S	d.S: inactive Lo: lower Hi: upper b.R.n.d: reversible	
	CYC.n	Number of program repetition	1	1...999	
	FR.L	Control after the supply decay	Cont	Cont: program continuation StoP: control stoppage	
	End	Control on the program end	StoP	StoP: Control stoppage L.S.P: fixed set point control with set point from the last segment.	
	P.d	"Gain Scheduling function for the program	oFF	oFF: disabled on: enabled	
St.01	Submenu of program parameters				
:	Submenu of program parameters				
St.15	Submenu of program parameters				
	Parameter symbol	Parameter description	Manufacturer's setting	Range of parameter change	
				sensors	linear input
	tYPE	Kind of segment	t.n.E	t.n.E: segment defined by the time r.R.t.E: segment defined by the accretion d.u.E.L: set point stoppage End: program end	
	t.SP	Set point on the segment end	0.0 °C	MIN...MAX ¹⁾	
	t.n.E	Segment duration	00.01	00.01...99.59 ²⁾	
	r.r	Accretion rate of the set point	0.1	0.1...550.0 °C / time unit ⁴⁾ / (0.1...990.0 °F / time unit ⁴⁾)	1...5500 °C ³⁾ / time unit ⁴⁾ / (1...9900 °F ³⁾ / time unit ⁴⁾)

		hLdU	Value of the control deviation for which the counting of set point is interrupted	0.0	0.0... 200.0 °C (0.0... 360.0 °F)	0... 2000 °C ³⁾ (0... 3600 °F ³⁾)
		Eu1	State of the auxiliary output no 1	oFF	oFF: disabled oN: enabled	
		Eu2	State of the auxiliary Output no 2	oFF	oFF: disabled oN: enabled	
		P,d	PID set for the segment	P,d1	P,d1 : PID1 P,d2 : PID2 P,d3 : PID3 P,d4 : PID4	

¹⁾ See table 2.

²⁾ The time unit is defined by the parameter **t.u.n**

³⁾ The resolution to show the given parameter depends on the parameter **dP** – position of decimal point.

⁴⁾ The time unit is defined by the parameter **r.u.n**.

13.2. Definition of Set Point Value Programs.

One can define 15 programs. The maximum number of segments in the program is equal to 15. To render visible parameters related to the programming control in the menu, the parameter **SP.nd** must be set on **PrG**.

For each program, one must set parameters given in the submenu of program parameters. For each segment, one must select the kind of segment and next, parameters depending on the kind of segment, acc. to the table 6. One must also set the output state (only when **out1... out3** are set on **Eu1, Eu2**) – parameter **Eu1** and **Eu2**.

List of segment configuration parameters

Table 6

tYPE = t,nE	tYPE = rRtE	tYPE = duEL	tYPE = End
t.SP	t.SP	t,nE	
t,nE	rr		
hLdU	hLdU		

The fig. 26 and the table 7 represent an example of set point value program. It is assumed in the program that the temperature in the object has to increase from the initial temperature in the object up to 800°C, with the rate of 20°C per minute, at the active locking from the deviation.

Next, during 120 minutes, the temperature is maintained (locking disabled), after that, the temperature has to decrease to 50°C during 100 minutes (locking disabled). During the object cooling, one must turn on the fan connected to the auxiliary output no 2 (parameter **out2** set on **Eu1**).

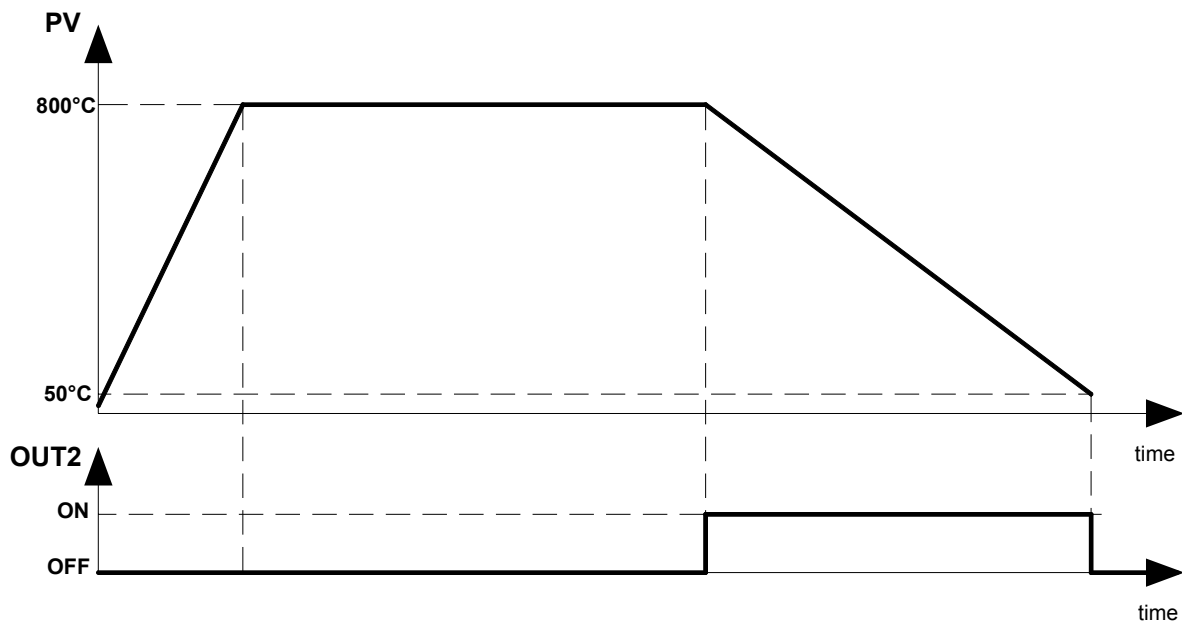


Fig. 26. Example of program

Parameter values for the example as above.

Table 7

	Parameter	value	Meaning
P.C.F.G	St.r.t	P.v	Start to count the set point value from the current temperature
	t.u.u.n	HH:nn	Time unit: hour, minute
	r.r.u.n	nn	Unit for the accretion rate: minute
	h.o.l.d	b.R.n.d	Locking for the program: active – two-sided
	C.Y.C.n	1	Number of program repetitions
	F.R.i.L	c.o.n.t	Program continuation after a supply decay
	E.n.d	S.t.o.p	Control stoppage after the program end
S.t.01	t.Y.P.E	r.R.t.E	Kind of segment: accretion rate
	t.S.P	800,0	Target set point value: 800.0 °C
	r.r	20,0	Accretion rate 20.0 °C / minute
	h.l.d.u	50,0	Active locking, when the deviation exceeds 50.0 °C
	E.v.1	o.F.F	Output 2 as the auxiliary output Ev1: disabled
S.t.02	t.Y.P.E	d.u.E.L	Kind of segment: stoppage of set point value
	t.i.n.E	02.00	Segment time 2h00 = 120 minutes
	E.v.1	o.F.F	Output 2 as the auxiliary output Ev1 – disabled
S.t.03	t.Y.P.E	t.i.n.E	Kind of segment: accretion time
	t.S.P	50,0	Target set point value: 50.0 °C
	t.i.n.E	01.40	Segment time 1h40 = 100 minutes
	h.l.d.u	0,0	Inactive locking
	E.v.1	o.n	Output 2 as the auxiliary output Ev1: enabled
S.t.04	t.Y.P.E	E.n.d	Kind of segment: program end
	E.v.1	o.F.F	Output 2 as the auxiliary output Ev1: disabled

13.3. Control of the Set Point Value Program

When the **SPnd** parameter is set on **PrG**, the controller controls the object in compliance with the set point value changing in time acc. to the given program. Before starting the control with the changeable set point value, one must select the required program (parameter **CPG**).

To start the program, one must press  and  push-buttons when the inscription **StoP** appears on the lower display (fig . 27).

The lighted dot in the right corner of the lower display, means that the programming control is lasting. During the program duration, one can display parameters of the realized program, i.e. program status, program number, number of the operating segment, the number of cycles which still remains to carry out, time which goes by in the segment, time which remained to the end of the segment, time which remained to the program end.

After finishing the program the dot is gone out, or the program is renewed, if the number of the program repetition **CYCn** is higher than 1.

After finishing the control, auxiliary outputs are in the state defined by parameters – output state for the segment set as the program end.

When the parameter **hold** (locking in the program) is set on **Lo**, **H**, or **band** and the locking value **holdu** in the operating segment is higher than zero then, the size of the control deviation is controlled (set point value minus measured value). For **hold=Lo** the locking is active, when the measured value is below the set point value diminished by the locking value. For **hold=H**, the locking is active, when the measured value exceeds the set point value by the locking value. For **hold=band** the locking is active, as for the upper and lower locking. If the locking is active then, the counting of the set point value is interrupted, and the dot in the right corner is flickering. The controller controls acc. to the last calculated set point value.

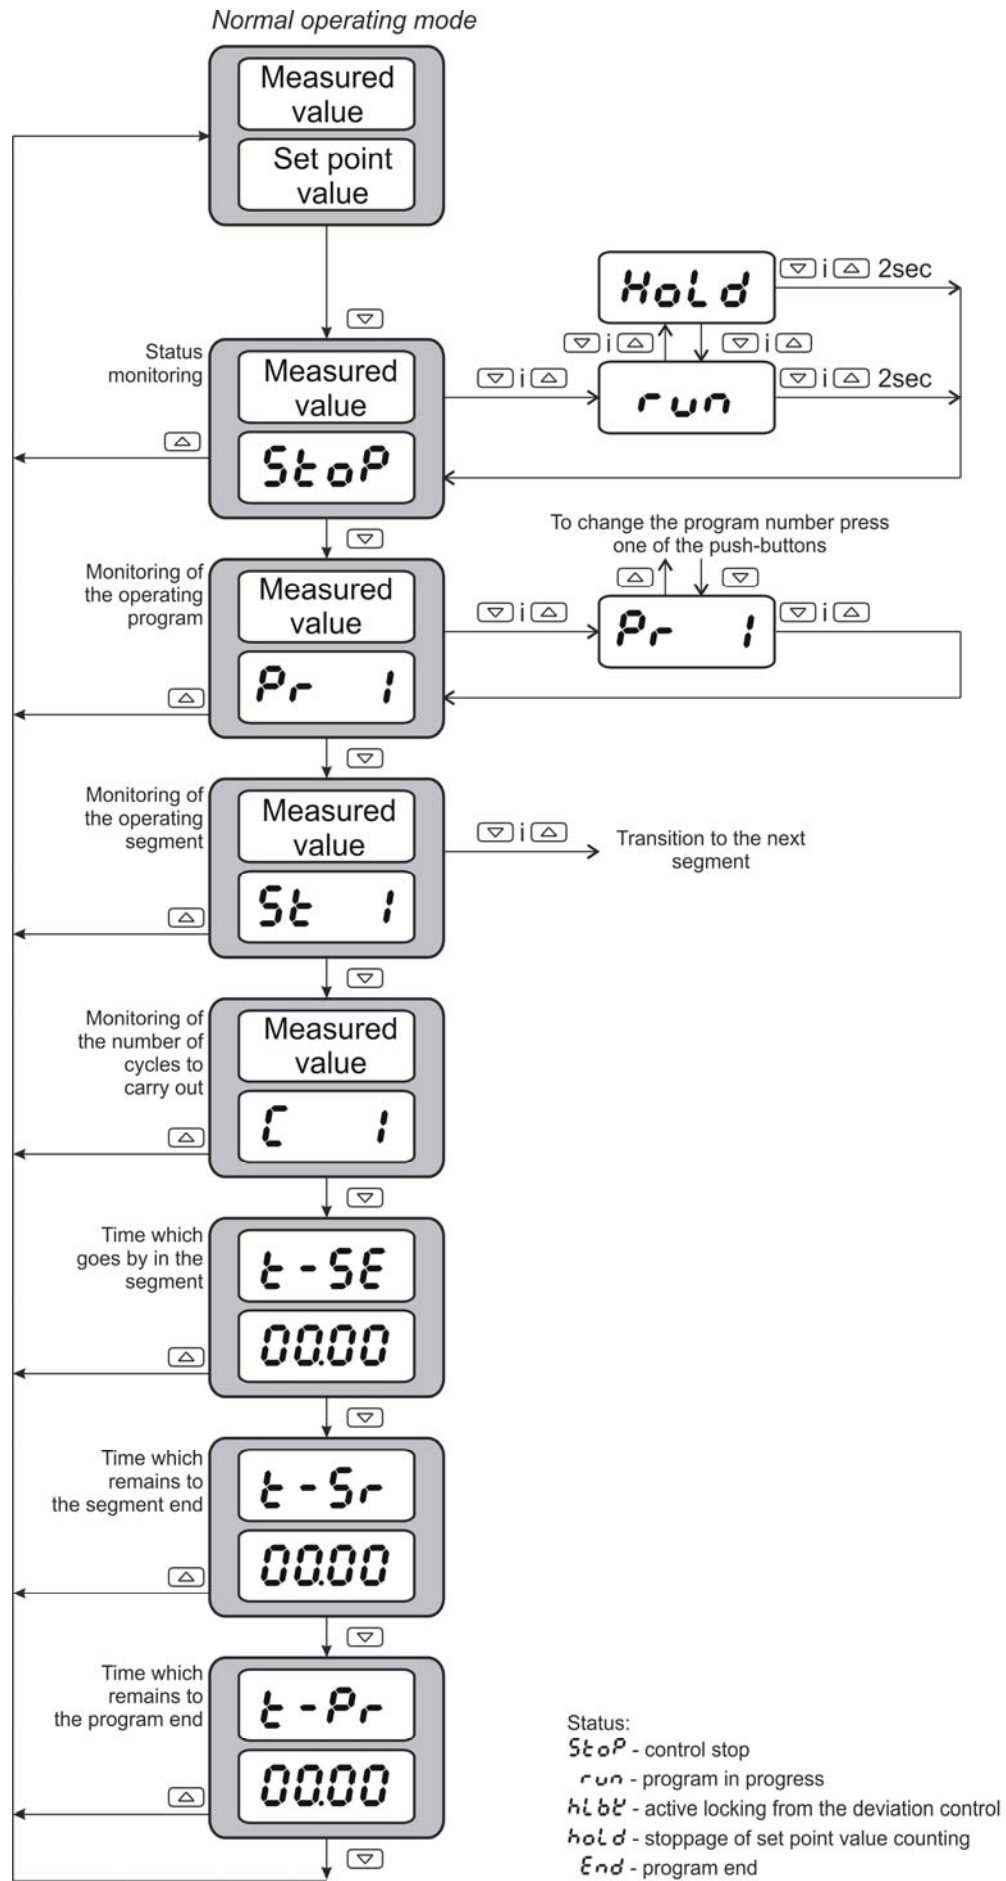


Fig.27. Menu of programming control service

14. RS-485 INTERFACE WITH MODBUS PROTOCOL

14.1. Introduction

The RE72 controller is equipped with a serial interface in RS-485 standard, with implemented asynchronous communication protocol MODBUS.

Combination of serial interface parameters for the RE72 controller:

- device address: 1..247,
- transmission rate: 4800, 9600, 19200, 38400, 57600 bit/s,
- operating mode: RTU,
- information unit: 8N2, 8E1, 8O1, 8N1,
- data format: integer (16 bit), float (32 bit), float (2x16 bit),
- maximum response time: 500 ms,
- maximum number of registers read out/ written by a single Modbus frame: 116.

The RE72 controller realizes following protocol functions:

Table 8

code	Meaning
03	read out of n-registers
06	write of 1 register
16	write of n-registers
17	identification of the slave device

14.2. Error Codes

If the controller receives a request with a transmission or checksum error, the request will be ignored. For a request synthetically correct but with incorrect values, the controller will send an answer including the error code.

Possible error codes and their meanings are presented in the table 9.

Error codes

Table 9

code	meaning	reason
01	forbidden function	The function is not serviced by the controller
02	forbidden data address	The register address is beyond the range
03	forbidden data value	The register value is beyond the range or the register is only to readout.

14.3. Register Map

Map of register groups

Table 10

Range of addresses	Type of values	Description
4000 – 4099	integer (16 bits)	The value is situated in a 16-bit register
4100 – 5599	integer (16 bits)	The value is situated in a 16-bit register
7000 – 7099	float (2x16 bits)	The value is situated in two successive 16-bit registers; Registers only for readout
7500 – 7599	float (32 bits)	The value is situated in two successive 32-bit registers; Registers only for readout

In the controller, data are situated in 16-bit registers. The list of registers for write and readout is presented in the table 11.

Operation „R-” – means the possibility of readout, and the operation „RW” means the possibility for readout and write.

Map of registers from address 4000

Table 11

Register address	Marking	Operation	Parameter range	Description
4000		-W	1...6	Register of commands: 1 – input in the automatic control mode 2 – input in the manual control mode 3 – beginning of the auto-tuning 4 – erasing of alarm memory 5 – restoration of manufacturer's settings (apart interface settings and defined programs) 6 – restoration of manufacturer's settings of defined programs.
4001		R-	100...999	Number of program version [x100]
4002		R-		Version code of the controller: bit 2 1 0 – OUTPUT 1: 0 0 1 – output 1 – relay 0 1 0 – output 1 – 0/5 V 0 1 1 – output 1 – continuous current : 0/4...20 mA 1 0 0 – output 1 – continuous voltage: 0...10 V bit 5 4 3 – OUTPUT 2: 0 0 1 – output 2 – relay 0 1 0 – output 2 – 0/5 V 0 1 1 – output 2 – continuous current: 0/4...20 mA 1 0 0 – output 2 – continuous voltage: 0...10 V bit 8 7 6 – OPTIONS: 0 0 1 – output 3 - relay 0 1 0 – binary input 0 1 1 – current transformer input 1 0 0 – additional current input: 0/4...20 mA 1 0 1 – supply of transducers: 24V d.c. 30 mA
4003		R-	0...0xFFFF	Controller status – description in table 12
4004		R-	0...0xFFFF	Alarm state – description in table 13
4005		R-	0...0xFFFF	Error status – Description in table 14
4006		R-	acc. to table 17 ¹⁾	Measured value PV
4007		R-	-1999...9999	Measured value on additional input
4008		R-	acc. to table 17 ¹⁾	Current set point value SP
4009		RW	0...1000	Control signal of loop 1 [% x10] ²⁾
4010		RW	0...1000	Control signal of loop 2 [% x10] ²⁾
4011		R-	0...59994	Timer value [s]
4012		R-	0...500	Heater current when the output is turned on [A x10]
4013		R-	0...500	Heater current when the output is turned off [A x10]
4014	UNIT	RW	0...2	Unit: 0 – Celsius degrees 1 – Fahrenheit degrees 2 – physical units

Register address	Marking	Operation	Parameter range	Description
4015	INPT	RW	0...14	Kind of main input: 0 – resistance thermometer Pt100 1 – resistance thermometer Pt1000 2 – thermocouple of J type 3 – thermocouple of T type 4 – thermocouple of K type 5 – thermocouple of S type 6 – thermocouple of R type 7 – thermocouple of B type 8 – thermocouple of E type 9 – thermocouple on N type 10 – thermocouple of L type 11 – current input: 0-20mA 12 – current input: 4-20mA 13 – voltage input: 0-5 V 14 – voltage input: 0-10 V
4016	DP	RW	0...1 ³⁾⁴⁾ 0...2 ⁵⁾	Position of the decimal point of the main input: 0 – without decimal place 1 – 1 decimal place 2 – 2 decimal places
4017	INLO	RW	-999...9999 ¹⁾	Indication for the lower threshold of the analog main input.
4018	INHI	RW	-999...9999 ¹⁾	Indication for the upper threshold of the analog main input.
4019	SHIF	RW	-999...999 ¹⁾	Shift of the measured value of the main input.
4020	I2TY	RW	0...1	Kind of the additional input: 0 – current input: 0-20mA 1 – current input: 4-20mA
4021	DP2	RW	0...2	Position of the decimal point of the additional input. 0 – without a decimal place 1 – 1 decimal place 2 – 2 decimal places
4022	I2LO	RW	-999...9999 ¹⁾	Indication for the lower threshold of the analog main input.
4023	I2HI	RW	-999...9999 ¹⁾	Indication for the upper threshold of the analog main input.
4024	FILT	RW	0...9	Time-constant of the filter: 0 – OFF 1 – 0.2 sec 2 – 0.5 sec 3 – 1 sec 4 – 2 sec 5 – 5 sec 6 – 10 sec 7 – 20 sec 8 – 50 sec 9 – 100 sec
4025	BNIN	RW	0...7	Binary input function: 0 – none 1 – control stop 2 – switching on manual control 3 – switching SP1 into SP2 4 – erasing of the timer alarm 5 – program start 6 – jump to the next segment 7 – stoppage of set point value counting in the program
4026	-	RW	0...65535	reserved

Register address	Marking	Operation	Parameter range	Description
4027	OUT1	RW	0...14	Function of output 1: 0 – without function 1 – control signal 2 – control signal of stepper control – opening ⁷⁾ 3 – control signal of stepper control – closing ⁷⁾ 4 – control signal - cooling 5 – absolute upper alarm 6 – absolute lower alarm 7 – relative upper alarm 8 – relative lower alarm 9 – relative internal alarm 10 – relative external alarm 11 – timer alarm 12 – retransmission ⁸⁾ 13 – auxiliary output EV1 in the programming control 14 – auxiliary output EV2 in the programming control
4028	O1TY	R	1...6	Output 1 type: 1 – relay output 2 – voltage output: 0/5 V 3 – current output : 4-20 mA 4 – current output : 0-20 mA 5 – voltage output: 0-5 V 6 – voltage output:: 0-10 V
		RW	3...4 ⁶⁾	
4029	YFL	RW	0...1000	Control signal of control output for proportional control in case of sensor damage [% x10]
4030	OUT2	RW	0...16	Function of output 2: 0 – without function 1 – control signal 2 – control signal of stepper control – opening ⁷⁾ 3 – control signal of stepper control – closing ⁷⁾ 4 – control signal - cooling 5 – absolute upper alarm 6 – absolute lower alarm 7 – relative upper alarm 8 – relative lower alarm 9 – relative internal alarm 10 – relative external alarm 11 – timer alarm 12 – alarm of heater burnout 13 – controlling element damage alarm (short-circuit) 14 – retransmission ⁸⁾ 15 – auxiliary output EV1 in the programming control 16 – auxiliary output EV2 in the programming control
4031	O2TY	R	0...6	Output 2 type: 0 – without relay 1 – relay output 2 – voltage output: 0/5 V 3 – current output : 4-20 mA 4 – current output : 0-20 mA 5 – voltage output: 0-5 V 6 – voltage output:: 0-10 V
		RW	3...4 ⁶⁾	

Register address	Marking	Operation	Parameter range	Description
4032	OUT3	RW	0...15	Function of output 3: 0 – without function 1 – control signal 2 – control signal of stepper control – opening ⁷⁾ 3 – control signal of stepper control – closing ⁷⁾ 4 – control signal - cooling 5 – absolute upper alarm 6 – absolute lower alarm 7 – relative upper alarm 8 – relative lower alarm 9 – relative internal alarm 10 – relative external alarm 11 – timer alarm 12 – alarm of heater burnout 13 – controlling element damage alarm (short-circuit) 14 – auxiliary output EV1 in the programming control 15 – auxiliary output EV2 in the programming control
4033	-	RW	0...65535	reserved
4034	ALG	RW	0...1	Control algorithm: 0 – on-off 1 – PID
4035	TYPE	RW	0...1	Kind of control: 0 – direct control – cooling 1 – reverse control – heating
4036	HY	RW	2...999 ¹⁾	Hysteresis HY
4037	GTY	RW	0...2	“Gain Scheduling” function 0 – disabled 1 – from set point value 2 – constant PID set
4038	GSNB	RW	0...2	Number of PID sets for “Gain Scheduling” from the set point value 0 – 2 PID sets 1 – 3 PID sets 2 – 4 PID sets
4039	GL12	RW	acc. to table 17 1)	Switching level for PID1 and PID2 sets
4040	GL23	RW	acc. to table 17 1)	Switching level for PID2 and PID3sets
4041	GL34	RW	acc. to table 17 1)	Switching level for PID3 and PID4 sets
4042	GSET	RW	0...3	Choice of a constant PID set 0 – PID1 1 – PID2 2 – PID3 3 – PID4
4043	PB	RW	0...9999 ¹⁾	Proportional band PB
4044	TI	RW	0...9999	Integration time constant TI [s]
4045	TD	RW	0...9999	Differentiation time constant TD [s x10]
4046	Y0	RW	0...1000	Correction of control signal Y0 (for P or PD control) [% x10]
4047	PB2	RW	0...9999 ¹⁾	Proportional band PB2
4048	TI2	RW	0...9999	Integration time constant TI2 [s x 10]
4049	TD2	RW	0...9999	Differentiation time constant TD2 [s x10]
4050	Y02	RW	0...1000	Correction of control signal Y02 (for P or PD control) [% x10]
4051	PB3	RW	0...9999 ¹⁾	Proportional band PB3
4052	TI3	RW	0...9999	Integration time constant TI3 [s]
4053	TD3	RW	0...9999	Differentiation time constant TD3 [s x10]
4054	Y03	RW	0...1000	Correction of control signal Y03 (for P or PD control) [% x10]
4055	PB4	RW	0...9999 ¹⁾	Proportional band PB4
4056	TI4	RW	0...9999	Integration time constant TI4 [s]
4057	TD4	RW	0...9999	Differentiation time constant TD4 [s x10]

Register address	Marking	Operation	Parameter range	Description
4058	Y04	RW	0...1000	Correction of control signal Y04 (for P or PD control) [% x10]
4059	TO1	RW	5...999	Pulse period of output 1[s x10]
4060	HN	RW	0...999 ¹⁾	Displacement zone for heating-cooling control or dead zone for stepper control
4061	PBC	RW	500...3000	Proportional band PBC [% x10] (in relation to PB)
4062	TIC	RW	0...9999	Integration time constant TIC [s x10]
4063	TDC	RW	0...9999	Differentiation time constant TDC [s]
4064	TO2	RW	5...999	Pulse period of output 2 [s x10]
4065	A1SP	RW	acc. to table 17 ¹⁾	Set point value for absolute alarm 1
4066	A1DV	RW	-1999...1999 ¹⁾	Deviation from the set point value for relative alarm 1
4067	A1HY	RW	2...999 ¹⁾	Hysteresis for alarm 1
4068	A1LT	RW	0...1	Memory of alarm 1: 0 – disabled 1 – enabled
4069	A2SP	RW	acc. to table 17 ¹⁾	Set point value for absolute alarm 2
4070	A2DV	RW	-1999...1999 ¹⁾	Deviation from the set point value for relative alarm 2
4071	A2HY	RW	2...999 ¹⁾	Hysteresis for alarm 2
4072	A2LT	RW	0...1	Memory of alarm 2: 0 – disabled 1 – enabled
4073	A3SP	RW	acc. to table 17 ¹⁾	Set point value for absolute alarm 3
4074	A3DV	RW	-1999...1999 ¹⁾	Deviation from the set point value for relative alarm 3
4075	A3HY	RW	2...999 ¹⁾	Hysteresis for alarm 3
4076	A3LT	RW	0...1	Memory of alarm 3: 0 – disabled 1 – enabled
4077	-	RW	0...65535	Reserved
4078	-	RW	0...65535	Reserved
4079	-	RW	0...65535	Reserved
4080	-	RW	0...65535	Reserved
4081	AHSP	RW	0...500	Set point value for the heater damage alarm [Ax10]
4082	AHHY	RW	0...500	Hysteresis for the heater damage alarm [Ax10]
4083	SPMD	RW	0...4	Kind of set point value: 0 – set point value SP1 or SP2 1 – set point value with soft start in units per minute 2 – set point value with soft start in units per hour 3 – set point value from the additional input 4 – Set point value acc. to the programmed control
4084	SP	RW	acc. to table 17 ¹⁾	Set point value SP
4085	SP2	RW	acc. to table 17 ¹⁾	Set point value SP2
4086	SP3	RW	acc. to table 17 ¹⁾	Set point value SP3
4087	SP4	RW	acc. to table 17 ¹⁾	Set point value SP4
4088	SPL	RW	acc. to table 17 ¹⁾	Lower limitation of the fast set point value change
4089	SPH	RW	acc. to table 17 ¹⁾	Upper limitation of the fast set point value change
4090	SPRR	RW	0...9999 ¹⁾	Accretion rate of the set point value SP or SP2 during the soft start.
4091	ADDR	RW	1...247	Device address
4092	BAUD	RW	0...4	Baud rate: 0 – 4800 1 – 9600 2 – 19200 3 – 38400 4 – 57600
4093	PROT	RW	0...4	Protocol 0 – lack 1 – RTU 8N2 2 – RTU 8T1 3 – RTU 8O1 4 – RTU 8N1

Register address	Marking	Operation	Parameter range	Description
4094	-	RW	0...65535	Reserved
4095	AOFN	RW	0...5	Quantity retransmitted on the main input: 0 – measured value on the main input PV 1 – measured value on the additional input PV2 2 – measured value PV – PV2 3 – measured value PV2 – PV 4 – set point value 5 – deviation (set point value – measured value PV)
4096	AOLO	RW	-1999...9999 ¹⁾	Lower signal limit for retransmission
4097	AOHI	RW	-1999...9999 ¹⁾	Upper signal limit for retransmission
4098	SECU	RW	0...9999	Access code to the menu
4099	STFN	RW	0...1	Auto-tuning function: 0 – locked 1 – unlocked
4100	STLO	RW	acc. to table 17 ¹⁾	Lower threshold for auto-tuning
4101	STHI	RW	acc. to table 17 ¹⁾	Upper threshold for auto-tuning
4102	TOUT	RW	0...250	Time of automatic output from the monitoring mode
4103	TIMR	RW	0...1	Timer function: 0 – disabled 1 – enabled
4104	TIME	RW	1...9999	Time counted down by the timer [min x 10]
4105	DI2	RW	0...1	Monitoring of the auxiliary input: 0 – disabled 1 – enabled
4106	DCT	RW	0...1	Monitoring of heater current: 0 – disabled 1 – enabled
4107	-	RW	0...65535	reserved
4108	-	RW	0...65535	reserved
4109	-	RW	0...65535	reserved
4110	-	RW	0...65535	reserved
4111	TO3	RW	5...999	Pulse period of output 3 [s x10]
4112	-	RW	0...65535	reserved
4113	FDB	RW	0...1	Algorithm for stepper control 0 – without feedback 1 – with feedback
4114	OSSP	RW	0...500	Set point for the controlling element damage alarm (short-circuit) [Ax10]
4115	OSHY	RW	0...500	Hysteresis for the controlling element damage alarm (short-circuit) [Ax10]

¹⁾ Value with the decimal point position defined by bits 0 and 1 in the register 4003.

²⁾ Parameter to write only in the manual operating mode

³⁾ Concerns resistance thermometer inputs

⁴⁾ Concerns thermocouple inputs

⁵⁾ Concerns linear inputs

⁶⁾ Range to write for the continuous current output

⁷⁾ Concerns output 1 of binary type

⁸⁾ Concerns output 1 of continuous type.

Register 4003 – controller status

Table 12

bit	Description
0-1	Decimal point position for MODBUS registers from address 4000, depending on the input (0...2) ¹⁾
2-3	Decimal point position for MODBUS registers from address 4000, depending on the additional input (0...2) ¹⁾
4	Auto-tuning finished with failure
5	Soft start: 1 – active, 0 – inactive
6	Timer status: 1 – countdown finished, 0 – remaining states
7	Automatic control/manual: 0 – auto, 1 – manual
8	auto-tuning: 1 – active, 0 – inactive

9-10	Current set of PID parameters: 0 – PID1, 1 – PID2, 2 – PID3, 3 – PID4
11-12	reserved
13	Measured value beyond the measuring range
14	Measured value on the additional input beyond the measuring input
15	Controller error – check the error register

1) For sensor inputs value is equal 1, for linear inputs the value is depended on the parameter dp (register 4023)

Register 4004 – alarm state

Table 13

bit	Description
0	State of alarm 1.:1 – active, 0 – inactive
1	State of alarm 2.:1 – active, 0 – inactive
2	State of alarm 3.:1 – active, 0 – inactive
3	Reserved
4	Alarm state of heater burning
5	Alarm state of permanent output 1 shorting :1 – active , 0 – inactive
6-15	Reserved

Register 4005 – error register

Table 14

bit	Description
0	Discalibrated input
1	Discalibrated additional input
2	Discalibrated analog output 1
3	Discalibrated analog output 2
4-14	Reserved
15	Checksum error of controller memory

Register map from address 4150

Table 15

Register address	Symbol	operation	Parameter range	Description
4150		RW	0...14	Program number for realization (0 – means first program)
4151		RW	0...1	Program start/stop: 0 –program stop 1 –program start (the write causes the program start from the beginning)
4152		RW	0...1	Stoppage of set point value counting in the program 0 – disabled 1 – enabled
4153		RW	0...14	Realized segment (0 – means the first program) The write causes the jump to the given segment.
4154		R-		Control status: 0 – control stop 1 – program in progress 2 – active locking from the control deviation 3 – Stoppage of set point value counting (by the push-button, binary input or interface) 4 – program end
4155		R-		Number of cycles which remains to the end
4156		R-		Time which goes out in the segment LSB [s]
4157		R-		Time which goes out in the segment MSB [s]
4158		R-		Time to the segment end LSB [s]
4159		R-		Time to the segment end MSB [s]
4160		R-		Time to the program end LSB [s]
4161		R-		Time to the program end MSB [s]
4162		RW	0...65535	Reserved
4163		RW	0...65535	Reserved
4164		RW	0...65535	Reserved

Register address		Symbol	operation	Parameter range	Description				
4165			RW	0...65535	Reserved				
4166			RW	0...65535	Reserved				
4167			RW	0...65535	Reserved				
4168			RW	0...65535	Reserved				
4169			RW	0...65535	Reserved				
4170	Program 1	Program parameters	STRT	RW	0...1	Way to begin the program: 0 – from value defined by SP0 1 – from current measured value			
4171			SP0	RW	acc. to table 17 ¹⁾	Initial set point value			
4172			TMUN	RW	0...1	Unit for the segment duration: 0 – minutes and seconds 1 – hours and minutes			
4173			RRUN	RW	0...1	Unit for the accretion rate of the set point value: 0 – minutes 1 – hours			
4174			HOLD	RW	0...3	Locking of control deviations: 0 – inactive 1 – lower 2 – upper 3 – two-sided			
4175			CYCN	RW	1...999	Number of program repetitions			
4176			FAIL	RW	0...1	Control after a supply decay: 0 – program continuation 1 – control stoppage			
4177			END	RW	0...1	Control on the program end: 0 – control stoppage 1 – fixed set point control with the set point value of the last segment			
4178			PID	RW	0...1	“Gain Scheduling “ function for the program 0 – disabled 1 - enabled			
4179		Segment 1	TYPE	RW	0...3	Kind of segment: 0 – segment defined by the time 1 – segment defined by the accretion 2 – stoppage of the set point value 3 – program end			
4180						TSP	RW	Acc. to table 17 ¹⁾	Set point value on the segment end
4181						TIME	RW	1...5999	Segment duration
4182						RR	RW	1...5500 ¹⁾	Accretion rate of the set point
4183						HLDV	RW	0...2000 ¹⁾	Value of the control deviation, over which the set point value counting is interrupted
4184							RW	0...3	State of auxiliary outputs (sum of bits): bit 0 is set – auxiliary output EV1 is turned on bit 1 is set – auxiliary output EV2 is turned on
4185	...	PID	RW	0...3	PID set for the segment 0 – PID1 1 – PID2 2 – PID3 3 – PID4				
...					...				
4277					Segment 15	TYPE	RW	0...3	Kind of segment
4278	TSP	RW	acc. to table 17 ¹⁾	Set point value on the segment end					
4279	TIME	RW	0...5999	Segment duration					
4280	RR	RW	1...5500 ¹⁾	Accretion rate of the set point value					

Register address		Symbol	operation	Parameter range	Description	
4281		HLDV	RW	0...2000 ¹⁾	Control deviation value, over which the set point value counting is interrupted	
4282			RW	0...3	State of auxiliary outputs	
4283		PID	RW	0...3	PID set for the segment	
...						
5766	Program 15	Program parameters	STRT	RW	0...1	Way of program beginning
5767			SP0	RW	acc. to table 17 ¹⁾	Initial set point value
5768			TMUN	RW	0...1	Unit for the segment duration
5769			RRUN	RW	0...1	Unit for the accretion rate of the set point value
5770			HOLD	RW	0...3	Blockings of the control deviation
5771			CYCN	RW	1...999	Number of program repetitions
5772			FAIL	RW	0...1	Way of the controller behaviour after a supply decay.
5773			END	RW	0...1	Way of the controller behaviour on the program end
5774			PID	RW	0...3	"Gain Scheduling" function for the program
5775			TYPE	RW	0...3	Kind of segment
5776			Segment 1	TSP	RW	acc. to table 17 ¹⁾
5777		TIME		RW	0...5999	Segment duration
5778		RR		RW	1...5500 ¹⁾	Accretion rate of the set point value
5779		HLDV		RW	0...2000 ¹⁾	Control deviation value, over which the counting of the set point value is interrupted
5780				RW	0...3	State of auxiliary outputs
5781		PID		RW	0...3	PID set for the segment
...						
5873		Segment 15	TYPE	RW	0...3	Kind of segment
5874			TSP	RW	acc. to table 17 ¹⁾	Set point value on the segment end
5875	TIME		RW	0...5999	Segment duration	
5876	RR		RW	1...5500 ¹⁾	Accretion rate of the set point value	
5877	HLDV		RW	0...2000 ¹⁾	Control deviation value, over which the counting of the set point value is interrupted	
5878			RW	0...3	State of auxiliary outputs	
5879	PID	RW	0...3	PID set for the segment		

¹⁾ Value with the decimal point position defined by bits 0 and 1 in the register 4002.

Map of registers from address 7000 i 7500

Table 16

Register address	Register address	Symbol	operation	Description
7000	7500		R-	Measured value PV
7002	7501		R-	Measured value on the additional input
7003	7502		R-	Current set point value SP
7006	7503		R-	Control signal of output 1
7008	7504		R-	Control signal of output 2
7010	7505	SP	R-	Set point value SP
7012	7506	SP2	R-	Set point value SP2
7014	7507	A1SP	R-	Set point value for the absolute alarm 1
7016	7508	A1DV	R-	Deviation from the set point value for the relative alarm 1
7018	7509	A2SP	R-	Set point value for the absolute alarm 2
7020	7510	A2DV	R-	Deviation from the set point value for the relative alarm 2
7022	7511	A3SP	R-	Set point value for the absolute alarm 3
7024	7512	A3DV	R-	Deviation from the set point value for the relative alarm 3

Input ranges









Table 17

Kind of sensors	Range		
	UNIT = °C [x10]	UNIT = °F [x10]	UNIT = PU
Pt100	-2000...8500	-3280...15620	
Pt1000	-2000...8500	-3280...15620	
Fe-CuNi (J)	-1000...12000	-1480...21920	
Cu-CuNi (T)	-1000...4000	-1480...7520	
NiCr-NiAl (K)	-1000...13720	-1480...25016	
PtRh10-Pt (S)	0...17670	320...32126	
PtRh13-Pt (R)	0...17670	320...32126	
PtRh30-PtRh6 (B)	0...17670	320...32126	
NiCr-CuNi (E)	-1000...10000	-1480...18320	
NiCrSi-NiSi (N)	-1000...13000	-1480...23720	
chromel – kopel (L)	-1000...8000	-1480...14720	
Linear current (I)			-1999...9999
Linear current (I)			-1999...9999
Linear voltage (U)			-1999...9999
Linear voltage (U)			-1999...9999

15. ERROR SIGNALING

Character messages

Table 18

Error code (upper display)	Reason	Procedure
	Down overflow of the measuring range or shorting in the sensor circuit.	Check, if the type of chosen sensor is in compliance with the connected one; check, if input signal values are situated in the appropriate range – If yes, check if there is no break in the sensor circuit.
	Upper overflow of the measuring range or break in the sensor circuit.	Check, if the type of chosen sensor is in compliance with the connected one; check, if input signal values are situated in the appropriate range – If yes, check if there is no break in the sensor circuit.
	Incorrect controller configuration.	After selecting the valve opening on one output, the valve closing should be set on another output.
	Incorrect controller configuration.	After selecting the cooling type control on one output, the reverse control (heating) and the PID algorithm (ALG=PID) should be set on another output.
	Auto-tuning is ended with failure	Check the reason of the auto-tuning process interruption in the auto-tuning point.
	Input discalibrated	Turn off and turn on again the controller supply, when this not help, contact the nearest service shop.
	Continuous output discalibrated	Turn off and turn on again the controller supply, when this not help, contact the nearest service shop.
	Error of readout verification from the non-volatile memory.	Turn off and turn on again the controller supply, when this not help, contact the nearest service shop. The controller exploitation in his state can cause its unforeseen behaviour.

16. TECHNICAL DATA

Input signalsacc. to table 19

Input signals and measuring ranges

Table 19

Sensor type	Standard	Range		Symbol	
Pt100	EN 60751+A2:1997	-200...850 °C	-328...1562 °F	<i>Pt 1</i>	
Pt1000		-200...850 °C	-328...1562 °F	<i>Pt 10</i>	
Fe-CuNi (J)	EN 60584-1:1997	-100...1200 °C	-148...2192 °F	<i>t - J</i>	
Cu-CuNi (T)		-100...400 °C	-148...752 °F	<i>t - t</i>	
NiCr-NiAl (K)		-100...1372 °C	-148...2501.6 °F	<i>t - K</i>	
PtRh10-Pt (S)		0...1767 °C	32...3212.6 °F	<i>t - S</i>	
PtRh13-Pt (R)		0...1767 °C	32...3212.6 °F	<i>t - R</i>	
PtRh30-PtRh6 (B)		0...1767 °C ¹⁾	32...3212.6 °F ¹⁾	<i>t - B</i>	
NiCr-CuNi (E)		-100...1000 °C	-148...1832 °F	<i>t - E</i>	
NiCrSi-NiSi (N)		-100...1300 °C	-148...2372 °F	<i>t - N</i>	
chromel – kopel (L)		GOST R 8.585-2001	-100...800 °C	-148...1472 °F	<i>t - L</i>
Linear current (I)			0...20 mA	0...20 mA	<i>0 - 20</i>
Linear current (I)	4...20 mA		4...20 mA	<i>4 - 20</i>	
Linear voltage (U)	0...5V		0...5V	<i>0 - 5</i>	
Linear voltage (U)	0...10V		0...10V	<i>0 - 10</i>	

¹⁾ The intrinsic error is related to measuring range: 200...1767 °C (392...3212.6 °F)

Intrinsic error of the real value measurement

0.2%, for resistance thermometer inputs,

0.3%, for inputs for thermocouple sensors (0.5% – for B, R, S);

0.2% ± 1 digit, for linear inputs

Current flowing through the resistance

thermometer sensor0.22 mA

Measurement time 0.2 s

Input resistance:

- for voltage input 150 kΩ

- for current input 5 Ω

Error detection in the measuring circuit:

- thermocouple, Pt100, Pt1000 overrun of measuring range

- 0...10 V..... over 11 V

- 0...5 V..... over 5.5 V

- 0...20 mA..... over 22 mA

- 4...20 mA..... under 1 mA and over 22 mA

Additional input:

- intrinsic error of the real value

Measurement.....0.3% ± 1 digit

- measurement time 0.5 sec

- input resistance 100 Ω

Setting range of controller parameters:

See table 1

Binary input..... voltageless

- shorting resistance ≤ 10 kΩ

- opening out resistance ≥ 100 kΩ

Kinds of outputs 1 and 2:

- voltageless relay NOC contact, load capacity 2 A/230 V a.c.,

- voltage transistor 0/5 V, maximum load capacity: 40 mA

- continuous voltage..... 0...5 V, 0...10 V at $R_{load} \geq 1 \text{ k}\Omega$

- continuous current 0...20 mA, 4...20 mA at $R_{load} \leq 500 \Omega$

Kinds of output 3:

- voltageless relay NOC contact, load capacity 1 A/230 V a.c.,

Way of output operation:

- reverse for heating
- direct for cooling

Error of analog outputs 0.2% of the range

Digital interface RS-485

- protocol Modbus
- transmission rate 4800, 9600, 19200, 38400, 57600 bit/s
- mode RTU – 8N2, 8E1, 8O1, 8N1
- address 1...247
- maximum response time 500 ms

Supply of object transducers 24V d.c. $\pm 5\%$, max.: 30 mA

Signaling:

- switching the output 1 on
- switching the output 2 on
- switching the output 3 on or switching the binary input on
- mode of manual control
- auto-tuning process

Rated operating conditions:

- supply voltage 85...253 V a.c./d.c.
20...40 V d.c.
- frequency 40...440 Hz
- ambient temperature 0...23...50 °C
- storage temperature -20...+70 °C
- relative air humidity < 85 % (condensation inadmissible)
- preheating time 30 min
- operating position any
- resistance of wires connecting the
resistance thermometer or the thermocouple
with the controller < 20 Ω / wire

Power input < 8 VA

Weight < 0.2 kg

Protection grade ensured by the casing acc. to EN 60529

- from the frontal plate IP65
- from the terminal side IP20

Additional errors in rated operating conditions caused by:

- compensation of thermocouple cold
junction temperature changes ≤ 2 °C,
- ambient temperature change $\leq 100\%$ value of intrinsic error /10 K.

Safety requirements acc. to EN 61010-1

- installation category III,
- pollution level, 2
- maximum phase-to-earth operating voltage:
 - for supply circuits, outputs 300 V
 - for input circuits 50 V
- altitude above sea level < 2000 m

Electromagnetic compatibility

- noise immunity acc. to EN 61000-6-2 standard
- noise emissions acc. to EN 61000-6-4 standard

17. CONTROLLER VERSION CODES

The way of coding is given in the table 20

Table 20

Controller RE72 –		X	X	X	X	XX	X	X
Output 1	relay	1						
	Voltage: 0/5 V	2						
	continuous current: 0/4...20 mA	3						
	continuous voltage: 0...10 V	4						
Output 2	relay ¹⁾		1					
	Voltage: 0/5 V		2					
	continuous current: 0/4...20 mA		3					
	continuous voltage: 0...10 V		4					
Option	none			0				
	output 3 - relay			1				
	binary input			2				
	current transformer input ¹⁾			3				
	additional current input: 0/4...20 mA			4				
	supply of transducers: 24V d.c., 30 mA			5				
Supply	85...253 V a.c. / d.c.				1			
	20...40 V a.c. / d.c.				2			
Version	standard					00		
	custom-made ²⁾					XX		
Language version	Polish						P	
	English						E	
	Other ²⁾						X	
Acceptance tests	without extra quality requirements							8
	with an extra quality inspection certificate							7
	acc. to customer's request ²⁾							X

¹⁾ Only, when a relay or voltage 0/5 V is also selected on the output 1.

²⁾ Only after agreeing by the manufacturer.

Ordering Example

The code: **RE72 – 1.2.2.1.00.E.7** means:

RE72 – controller of RE72 type,

1 – output 1: relay

2 – output 2: voltage 0/ 5 V

2 – option with binary output

1 – supply: 85...253 V a.c./d.c.

00 – standard version

E – documentation and descriptions in English version

1 – with an extra quality inspection certificate.

When ordering please respect the code number.

18. MAINTENANCE AND GUARANTEE

The RE72 controller does not require any periodical maintenance.

In case of some incorrect operations:

In the period of 18 months from the date of purchase:

One should take the controller down from the installation and return it to the Manufacturer's Quality Control Dept.

If the unit has been used in compliance with the instructions, the Manufacturer warrants to repair it free of charge.

After the guarantee period:

One should turn over the controller to repair it in a certified service workshop.

The disassembling of the casing causes the cancellation of the granted guarantee.

<p>Our policy is one of continuous improvement and we reserve the right to make changes in design and specifications of any products as engineering advances or necessity requires and revise the above specifications without notice.</p>

SALES PROGRAM

- DIGITAL AND BARGRAPH PANEL METERS
- MEASURING TRANSDUCERS
- ANALOG PANEL METERS (DIN INSTRUMENTS)
- INDUSTRIAL CONTROLLERS
- DOT, PEN AND PAPERLESS RECORDERS
- POWER CONTROL UNITS AND SOLIDE-STATE RELAYS
- 1-PHASE AND 3-PHASE WATT-HOUR METERS
- ACCESSORIES FOR MEASURING INSTRUMENTS
(SHUNTS AND CURRENT TRANSFORMERS)
- INTEGRATION ELEMENTS OF MEASURING NETWORKS
- LARGE-SIZE ALPHANUMERICAL DISPLAY PANELS
- MEASURING SYSTEMS (ENERGY, HEAT, CONTROL)
- CUSTOM - MADE PRODUCTS

WE ALSO OFFER OUR SERVICES IN THE PRODUCTION OF:

- ALUMINIUM ALLOY PRESSURE CASTINGS
- PRECISION ENGINEERING AND THERMOPLASTICS PARTS
- SMT ASSEMBLY SERVICES
- SUBCONTRACTED ELECTRONIC DEVICES

QUALITY PROCEDURES:

According to ISO 9001 and ISO 14001 international requirements.

All our instruments have CE mark .

For more information, please write to or phone our Export Department
or visit our website: www.lumel.com.pl/en/

RE72-09A/1 04.04.2011



Lubuskie Zakłady Aparatów Elektrycznych - LUMEL S.A.

ul. Sulechowska 1, 65-022 Zielona Góra, POLAND

<http://www.lumel.com.pl>

Tel.: (48-68) 32 95 1 00 (exchange)

Fax: (48-68) 32 95 1 01

e-mail: lumel@lumel.com.pl

<http://www.lumel.com.pl>

Export Department:

Tel.: (48-68) 329 53 02

Fax: (48-68) 325 40 91

e-mail: export@lumel.com.pl