

Infrared Thermosensor ES1C

Achieve Superior Environmental Resistance and a Wide Measurement Range of 0 to 400°C.

- Flexible placement with slim cylindrical shape and long focus with a distance of 500 mm and area diameter of 80 mm.
- The SUS body and silicon lens resist ambient operating temperatures of up to 70°C and resist dust and water to the equivalent of IP67.
- Fast measurement with high-speed response of 100 ms/90%.
- Strong resistance to noise with output of 4 to 20 mA.







Refer to the *Safety Precautions* on page 6.

Ordering Information

Specification (measuring temperature range)	Model
0 to 400°C	ES1C-A40

Application Examples

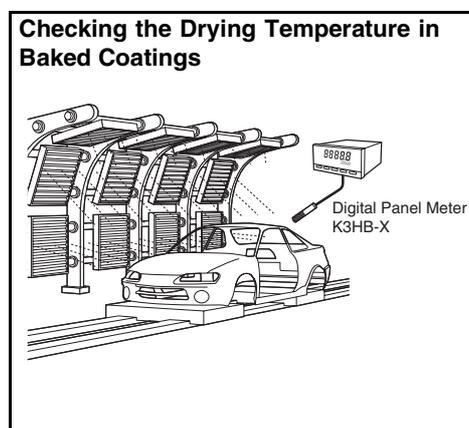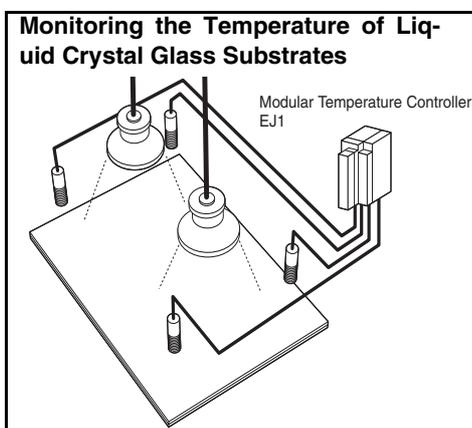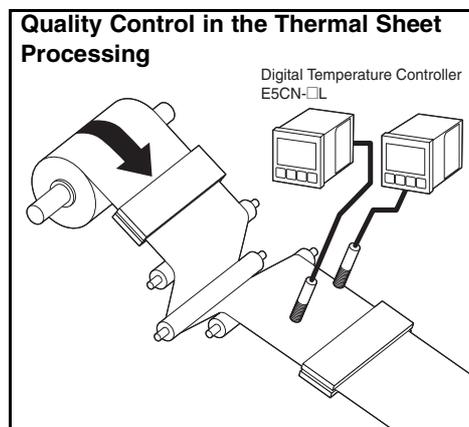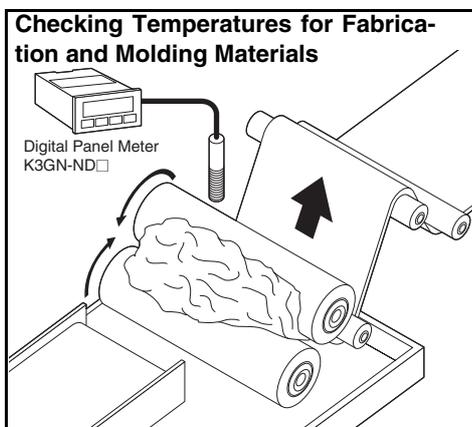


Do not use the ES1C in locations subject to rapid changes in ambient temperature. Use a heat shield to suppress temperature changes if the ES1C is used in a location that is subject to rapid changes in ambient temperature due to radiating heat or hot air.

ES1C


Ratings and Characteristics

Item	Model	ES1C
Power supply voltage		12 to 24 VDC
Operating voltage range		90% to 110% of rated voltage
Current consumption		70 mA max.
Measuring temperature range		0 to 400°C
Measurement accuracy		0 to 200°C: $\pm 2^\circ\text{C}$, 201 to 400°C: $\pm 1\%$ (emissivity: 0.95)
Response time		100 ms/90%
Reproducibility		$\pm 1^\circ\text{C}$ of reading value
Measurement wavelength		8 to 14 μm
Light-receiving element		Thermopile
Emissivity		0.95 fixed
Current output		4 to 20 mA DC, Load: 250 Ω max.
Ambient temperature range		Operating: 0 to 70°C, Storage: -20 to 70°C (with no icing or condensation)
Ambient humidity range		Operating and storage: 35% to 85%
Vibration resistance (destruction)		1.5-mm amplitude at 10 to 55 Hz for 2 hours each in the X, Y, and Z directions
Weight		180 g
Degree of protection		Equivalent to IP67

Connections

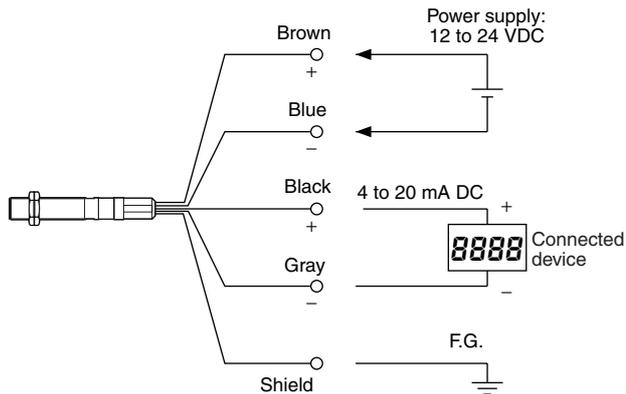

Measurement Range

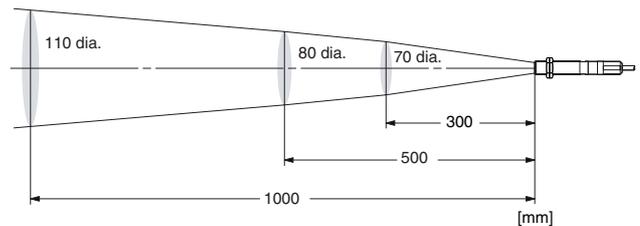


Note: The measurement range is the measurement diameter for an optical response of 90%. Make sure that the actual object to be measured is sufficiently larger than the measurement diameters in the above figure.

Dimensions

(Unit: mm)


ES1C

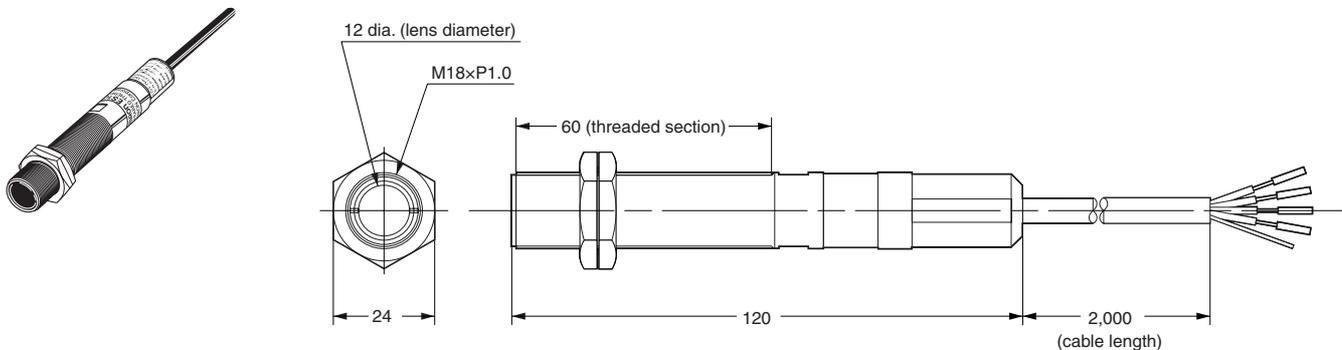

Characteristics of Infrared Thermosensors

1. Principles of Infrared Thermosensors

The ES1C uses thermopile light-receiving elements to receive the specific wavelengths (8 to 14 μm) in the infrared range radiated from the measurement range of the measurement object, converts the received light into an output signal in the internal circuits, and outputs a current that corresponds to the measured temperature.

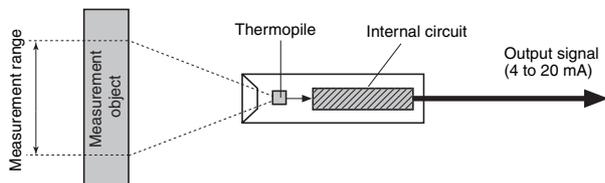

2. Measurement Error due to Emissivity

The ES1C outputs a current of 4 to 20 mA for measurement object temperatures of 0 to 400°C at a emissivity of 0.95. If the emissivity of the measurement object is less than 0.9, the effects of the ambient temperature will cause measurement error. Glossy metal surfaces generally have an extremely low emissivity, and so operation is easily affected by the ambient temperature, and it is difficult to measure the temperature of the measurement object. (Refer to the emissivities that are given on page 5.)

In an application like this, select a location with a high emissivity and use the ES1-T Black Tape (sold separately, emissivity of 0.95) or ES1-S Black Spray (sold separately, emissivity of 0.94).

Setting and Adjusting the Connected Device

This section describes an example of making settings and adjustments when a Digital Temperature Controller and Digital Panel Meter are connected.

1. Mounting

- Select a location with a high emissivity for the object to be measured. If required, use Black Spray or Black Tape.
- Secure the Thermosensor with the enclosed lock nuts. Use a tightening torque of 20 N·m max.
- Mount the Thermosensor so that it is perpendicular to the object to be measured.
- Mount the Thermosensor in a location that is not subject to ambient temperatures above 70°C, to direct hot air, etc.

2. Setting the Connected Device

Make the settings so that 0.0 to 400.0°C is displayed for an output of 4 to 20 mA for the ES1C.


E5□N-□L Digital Temperature Controller (Analog Input)		K3GN-ND□ Digital Panel Meter (DC Input)	
Input type	0 (4 to 20 mA)	Input type	Analog
Scaling upper limit	4,000	Analog range	4 to 20
Scaling lower limit	0	Scaling display value 1	0
Decimal point position	1	Scaling display value 2	4,000
		Decimal point position	0000.0

* For details, refer to the User's Manual for the connected device.

3. Adjusting the Connected Device

Error may occur due to the emissivity of the measurement environment or measurement object. There are two easy methods that can be used to adjust the error: simple shifting and two-point shifting, as described in the following section.

Setup for Adjustment

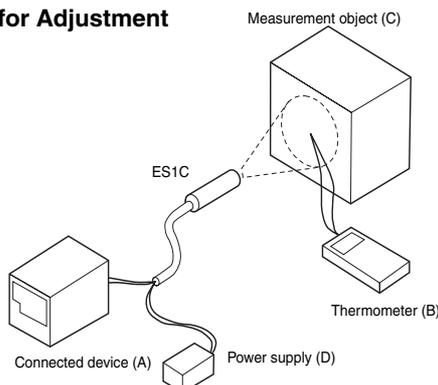

● Adjustment Example for the E5□N-L (Analog Input)

① Shift Method

1. Measuring the Temperature of the Measurement Object

Use the thermometer (B) to measure the actual temperature when using the measurement object (C).

2. Shifting the Display Value of the Connected Device


Adjust the settings of the connected device after checking the following value:

Temperature B (thermometer) – Temperature A (connected device)

If temperature B minus temperature A is 10.0, adjust the settings so that measurement value of the connected device is +10.0.

- Scaling upper limit = 4,000 to 4,100
- Scaling lower limit = 0 to 100

(The setting for the decimal point position is 1, and so the scaling set value will be increased by 100 for a displayed value of +10.0.)

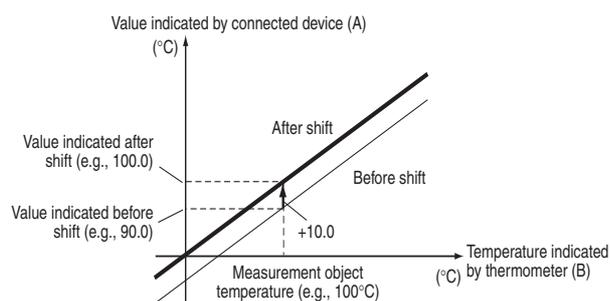

② Two-point Shift


1. Measuring the Temperature of the Measurement Object

Set the temperature of the measurement object to room temperature and to the temperature during operation, and check the values indicated by the connected device (A) and the temperatures of the measurement object (B).

	Value indicated by connected device (A)	Temperature of measurement object (B)
Room temperature	Y1	X1
Temperature during operation	Y2	X2

2. Shifting the Indicated Value

Use the following formula to calculate the upper limit and lower limit of input scaling after the shift from the values Y1 and Y2 indicated by the connected device and temperatures X1 and X2 of the measurement object.

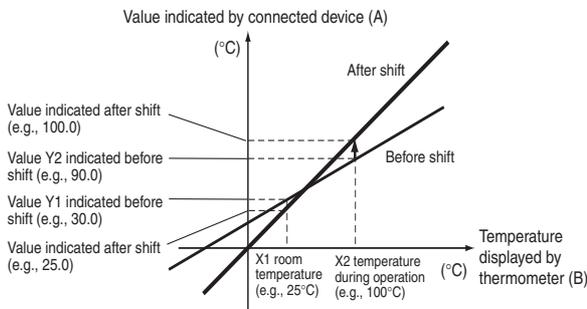

(1) Scaling upper limit after shift (°C)

$$= \frac{X2 - X1}{Y2 - Y1}(400 - Y1) + X1$$

(2) Scaling lower limit after shift (°C)

$$= \frac{X2 - X1}{Y2 - Y1}(0 - Y1) + X1$$

Change the values to the scaling upper and lower limits from the result considering the decimal point position. For example, if the scaling upper limit after shift is 487.5 (°C) and the scaling lower limit after shift is -12.5 (°C), the decimal point position of the connected device will be set to the first decimal position, and so the scaling upper limit will be set to 4,875 and the scaling lower limit to -125.

● Adjustment Example for the K3GN

① Shift Method

1. Measuring the Temperature of the Measurement Object

Use a thermometer (B) to measure the actual temperature when using the measurement object (C).

2. Shifting the Display Value


Adjust the settings of the connected device after checking the following value:

Temperature B (thermometer) – Temperature A (connected device)

If temperature B minus temperature A is 10.0, adjust the settings so that measurement value of the connected device is +10.0.

- Scaling display value 1 = 0 to 100
- Scaling display value 2 = 4,000 to 4,100


(The setting for the decimal point position is 0000.0, and so the scaling set value will be increased by 100 for a displayed value of +10.0.)

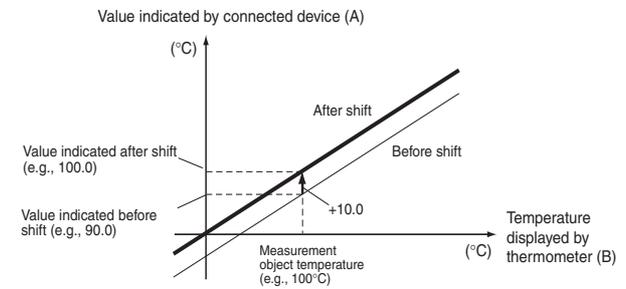

② Two-point Shift

Use the teaching function of the K3GN to make adjustments using the ES1C's actual analog input value and the actual temperature. Set one of the two teaching points to room temperature and the other to the actual temperature of the measurement object during operation.

1. Move the K3GN to the initial setting level.
2. Set the temperature of the object to be measured to room temperature and set scaling input value 1 using teaching. Next, set the temperature (B) of the thermometer to scaling display value 1. (Point ① in the following figure. The decimal point position for the K3GN is set to the first decimal position, and so set 250 for 25.0°C.)
3. Next, set the measurement object to the actual operating temperature and set scaling input value 2 and scaling display value 2 in step 2. (A value of 1,000 is set to specify 100.0°C for point ② in the following graph.)

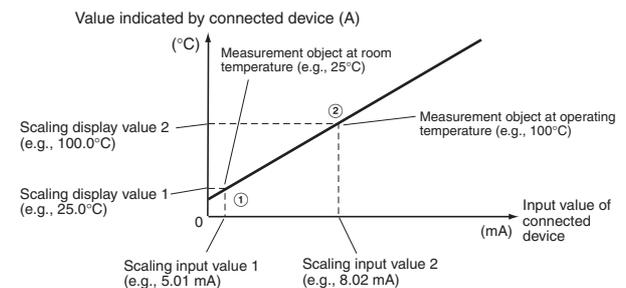

Emissivities

	Item	Emissivity	Item	Emissivity
Metals	Aluminum		Iron oxide	0.78 to 0.82
	Pure aluminum, high-gloss aluminum	0.04 to 0.06	Red rusted iron	0.69
	Aluminum oxide	0.76	Gray oxidized lead	0.28
	Commercially available aluminum sheets	0.09	Mercury	0.09 to 0.12
	Brass		Molybdenum filament	0.10 to 0.20
	High-gloss sheets of pure brass	0.10	Nickel	
	Brass oxide	0.56 to 0.64	Glossy	0.07
	Glossy chrome	0.08 to 0.36	Nickel oxide	0.90
	Chrome oxide	0.81	Platinum	
	Copper		Glossy platinum sheets	0.05 to 0.10
	Glossy	0.05	Platinum wire rods	0.07 to 0.18
	Copper oxide	0.78	Glossy pure silver	0.03 to 0.28
	Bronze with uneven surface	0.55	Stainless steel	
	Glossy pure gold	0.02 to 0.03	Glossy	0.07
	Iron and steel (except stainless)		Rolled stainless steel	0.45
	Glossy iron	0.14 to 0.38	Glossy tin	0.06
	Glossy cast iron	0.21	Etched tungsten filament	0.03 to 0.35
	Glossy wrought iron	0.28	Zinc	
	Oxidized dull-colored wrought iron	0.94	Commercially available glossy pure zinc	0.05
	Rusty iron sheet	0.69	Galvanized sheets	0.21
Glossy steel	0.07	Zinc oxide	0.11 to 0.28	
Thin rolled steel sheets	0.66	Titanium oxide	0.40 to 0.60	
Unpolished steel sheets	0.94 to 0.97			

	Item	Emissivity	Item	Emissivity
Non-metals	Asbestos	0.93 to 0.94	Water	0.92 to 0.96
	Bricks		Ice	0.96 to 0.98
	Red, unpolished	0.93	Snow	0.83
	Fireclay	0.75	Glass	0.85 to 0.95
	Carbon		Ceramics	0.90 to 0.94
	Filament	0.53	Marble	0.94
	Soot film	0.84 to 0.95	Fluorite	0.30 to 0.40
	Paint, lacquer, varnish		Gypsum	0.80 to 0.90
	Coated lacquer	0.80 to 0.95	Plaster	0.89 to 0.91
	White enamel	0.91	Brick (red)	0.93 to 0.95
	Black lacquer	0.96 to 0.98	Fibers	0.90
	Aluminum paint	0.27 to 0.67	Cloth (black)	0.98
	16-color oil-based paint	0.92 to 0.96	Skin (human)	0.98
	Glazed porcelain	0.92	Leather	0.75 to 0.80
	Opaque crystals (quartz)	0.68 to 0.92	Charcoal (powder)	0.96
	Asphalt	0.90 to 0.98	Rubber (black)	0.94
	Concrete	0.94	Plastic	0.85 to 0.95
	Cement	0.96	Lumber	0.90
	Sand	0.90	Paper	0.70 to 0.94
	Dirt	0.92 to 0.96		

Note: Operation will be easily affected by the ambient temperature if the emissivity of the measurement object is lower than 0.9. Glossy metal surfaces generally have an extremely low emissivity, and it is difficult to measure the temperature of the measurement object. Use Black Spray or Black Tape (sold separately).

Safety Precautions

 CAUTION

A malfunction in the product may occasionally result in property damage to connected equipment or devices. To maintain safety in the event of malfunction of the product, take appropriate safety measures, such as installing a monitoring device on a separate line.



Precautions for Safe Use

- (1) This Product is designed for indoor use only. Do not use the Product outdoors or in any of the following locations.
 - Locations directly subject to heat radiated from heating equipment.
 - Locations subject to splashing liquid or oil atmosphere.
 - Locations subject to direct sunlight.
 - Locations subject to dust or corrosive gases (in particular, sulfide or ammonia gases).
 - Locations subject to intense temperature changes.
 - Locations subject to icing or condensation.
 - Locations subject to excessive vibration or shock.
- (2) Use and store the Product within the rated ambient temperature and humidity. If there is heating equipment in the vicinity of the Product, heat radiated from the equipment will cause the temperature inside the Product to rise and shorten its service life. In such a case, use forced cooling by fans or other means of air ventilation.
- (3) Be sure to wire properly with correct polarity of terminals.
- (4) Attach a surge protector or noise filter on nearby noise-generating devices (in particular, motors, transformers, solenoids, magnetic coils, or devices that have an inductance component). If a noise filter is used on the power supply, check the voltage and current, and attach the noise filter as near as possible to the Product. Allow as much space as possible between the product and devices that generates high frequencies (such as high-frequency welders and high-frequency sewing machines) or surges.
- (5) Use the product within the rated load and power supply.
- (6) The current output and power supply are not isolated. Be sure that unwanted currents do not occur with the connected device.
- (7) Do not measure glossy surfaces.
- (8) Do not let the Product touch the object to be measured.
- (9) Do not touch the lens.
- (10) Do not allow charged objects in the vicinity of the Product.

Terms and Conditions of Sale

1. **Offer; Acceptance.** These terms and conditions (these "**Terms**") are deemed part of all quotes, agreements, purchase orders, acknowledgments, price lists, catalogs, manuals, brochures and other documents, whether electronic or in writing, relating to the sale of products or services (collectively, the "**Products**") by Omron Electronics LLC and its subsidiary companies ("**Omron**"). Omron objects to any terms or conditions proposed in Buyer's purchase order or other documents which are inconsistent with, or in addition to, these Terms.
2. **Prices; Payment Terms.** All prices stated are current, subject to change without notice by Omron. Omron reserves the right to increase or decrease prices on any unshipped portions of outstanding orders. Payments for Products are due net 30 days unless otherwise stated in the invoice.
3. **Discounts.** Cash discounts, if any, will apply only on the net amount of invoices sent to Buyer after deducting transportation charges, taxes and duties, and will be allowed only if (i) the invoice is paid according to Omron's payment terms and (ii) Buyer has no past due amounts.
4. **Interest.** Omron, at its option, may charge Buyer 1-1/2% interest per month or the maximum legal rate, whichever is less, on any balance not paid within the stated terms.
5. **Orders.** Omron will accept no order less than \$200 net billing.
6. **Governmental Approvals.** Buyer shall be responsible for, and shall bear all costs involved in, obtaining any government approvals required for the importation or sale of the Products.
7. **Taxes.** All taxes, duties and other governmental charges (other than general real property and income taxes), including any interest or penalties thereon, imposed directly or indirectly on Omron or required to be collected directly or indirectly by Omron for the manufacture, production, sale, delivery, importation, consumption or use of the Products sold hereunder (including customs duties and sales, excise, use, turnover and license taxes) shall be charged to and remitted by Buyer to Omron.
8. **Financial.** If the financial position of Buyer at any time becomes unsatisfactory to Omron, Omron reserves the right to stop shipments or require satisfactory security or payment in advance. If Buyer fails to make payment or otherwise comply with these Terms or any related agreement, Omron may (without liability and in addition to other remedies) cancel any unshipped portion of Products sold hereunder and stop any Products in transit until Buyer pays all amounts, including amounts payable hereunder, whether or not then due, which are owing to it by Buyer. Buyer shall in any event remain liable for all unpaid accounts.
9. **Cancellation; Etc.** Orders are not subject to rescheduling or cancellation unless Buyer indemnifies Omron against all related costs or expenses.
10. **Force Majeure.** Omron shall not be liable for any delay or failure in delivery resulting from causes beyond its control, including earthquakes, fires, floods, strikes or other labor disputes, shortage of labor or materials, accidents to machinery, acts of sabotage, riots, delay in or lack of transportation or the requirements of any government authority.
11. **Shipping; Delivery.** Unless otherwise expressly agreed in writing by Omron:
 - a. Shipments shall be by a carrier selected by Omron; Omron will not drop ship except in "break down" situations.
 - b. Such carrier shall act as the agent of Buyer and delivery to such carrier shall constitute delivery to Buyer;
 - c. All sales and shipments of Products shall be FOB shipping point (unless otherwise stated in writing by Omron), at which point title and risk of loss shall pass from Omron to Buyer; provided that Omron shall retain a security interest in the Products until the full purchase price is paid;
 - d. Delivery and shipping dates are estimates only; and
 - e. Omron will package Products as it deems proper for protection against normal handling and extra charges apply to special conditions.
12. **Claims.** Any claim by Buyer against Omron for shortage or damage to the Products occurring before delivery to the carrier must be presented in writing to Omron within 30 days of receipt of shipment and include the original transportation bill signed by the carrier noting that the carrier received the Products from Omron in the condition claimed.
13. **Warranties.** (a) **Exclusive Warranty.** Omron's exclusive warranty is that the Products will be free from defects in materials and workmanship for a period of twelve months from the date of sale by Omron (or such other period expressed in writing by Omron). Omron disclaims all other warranties, express or implied. (b) **Limitations.** OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, ABOUT NON-INFRINGEMENT, MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OF THE PRODUCTS. BUYER ACKNOWLEDGES THAT IT ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. Omron further disclaims all warranties and responsibility of any type for claims or expenses based on infringement by the Products or otherwise of any intellectual property right. (c) **Buyer Remedy.** Omron's sole obligation hereunder shall be, at Omron's election, to (i) replace (in the form originally shipped with Buyer responsible for labor charges for removal or replacement thereof) the non-complying Product, (ii) repair the non-complying Product, or (iii) repay or credit Buyer an amount equal to the purchase price of the non-complying Product; provided that in no event shall Omron be responsible for warranty, repair, indemnity or any other claims or expenses regarding the Products unless Omron's analysis confirms that the Products were properly handled, stored, installed and maintained and not subject to contamination, abuse, misuse or inappropriate modification. Return of any Products by Buyer must be approved in writing by Omron before shipment. Omron Companies shall not be liable for the suitability or unsuitability or the results from the use of Products in combination with any electrical or electronic components, circuits, system assemblies or any other materials or substances or environments. Any advice, recommendations or information given orally or in writing, are not to be construed as an amendment or addition to the above warranty. See <http://www.omron247.com> or contact your Omron representative for published information.
14. **Limitation on Liability; Etc.** OMRON COMPANIES SHALL NOT BE LIABLE FOR SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR PRODUCTION OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED IN CONTRACT, WARRANTY, NEGLIGENCE OR STRICT LIABILITY. Further, in no event shall liability of Omron Companies exceed the individual price of the Product on which liability is asserted.
15. **Indemnities.** Buyer shall indemnify and hold harmless Omron Companies and their employees from and against all liabilities, losses, claims, costs and expenses (including attorney's fees and expenses) related to any claim, investigation, litigation or proceeding (whether or not Omron is a party) which arises or is alleged to arise from Buyer's acts or omissions under these Terms or in any way with respect to the Products. Without limiting the foregoing, Buyer (at its own expense) shall indemnify and hold harmless Omron and defend or settle any action brought against such Companies to the extent based on a claim that any Product made to Buyer specifications infringed intellectual property rights of another party.
16. **Property; Confidentiality.** Any intellectual property in the Products is the exclusive property of Omron Companies and Buyer shall not attempt to duplicate it in any way without the written permission of Omron. Notwithstanding any charges to Buyer for engineering or tooling, all engineering and tooling shall remain the exclusive property of Omron. All information and materials supplied by Omron to Buyer relating to the Products are confidential and proprietary, and Buyer shall limit distribution thereof to its trusted employees and strictly prevent disclosure to any third party.
17. **Export Controls.** Buyer shall comply with all applicable laws, regulations and licenses regarding (i) export of products or information; (ii) sale of products to "forbidden" or other proscribed persons; and (iii) disclosure to non-citizens of regulated technology or information.
18. **Miscellaneous.** (a) **Waiver.** No failure or delay by Omron in exercising any right and no course of dealing between Buyer and Omron shall operate as a waiver of rights by Omron. (b) **Assignment.** Buyer may not assign its rights hereunder without Omron's written consent. (c) **Law.** These Terms are governed by the law of the jurisdiction of the home office of the Omron company from which Buyer is purchasing the Products (without regard to conflict of law principles). (d) **Amendment.** These Terms constitute the entire agreement between Buyer and Omron relating to the Products, and no provision may be changed or waived unless in writing signed by the parties. (e) **Severability.** If any provision hereof is rendered ineffective or invalid, such provision shall not invalidate any other provision. (f) **Setoff.** Buyer shall have no right to set off any amounts against the amount owing in respect of this invoice. (g) **Definitions.** As used herein, "including" means "including without limitation"; and "Omron Companies" (or similar words) mean Omron Corporation and any direct or indirect subsidiary or affiliate thereof.

Certain Precautions on Specifications and Use

1. **Suitability of Use.** Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases but the following is a non-exhaustive list of applications for which particular attention must be given: (i) Outdoor use, uses involving potential chemical contamination or electrical interference, or conditions or uses not described in this document. (ii) Use in consumer products or any use in significant quantities. (iii) Energy control systems, combustion systems, railroad systems, aviation systems, medical equipment, amusement machines, vehicles, safety equipment, and installations subject to separate industry or government regulations. (iv) Systems, machines and equipment that could present a risk to life or property. Please know and observe all prohibitions of use applicable to this Product. NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON'S PRODUCT IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.
2. **Programmable Products.** Omron Companies shall not be responsible for the user's programming of a programmable Product, or any consequence thereof.
3. **Performance Data.** Data presented in Omron Company websites, catalogs and other materials is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of Omron's test conditions, and the user must correlate it to actual application requirements. Actual performance is subject to the Omron's Warranty and Limitations of Liability.
4. **Change in Specifications.** Product specifications and accessories may be changed at any time based on improvements and other reasons. It is our practice to change part numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the Product may be changed without any notice. When in doubt, special part numbers may be assigned to fix or establish key specifications for your application. Please consult with your Omron's representative at any time to confirm actual specifications of purchased Product.
5. **Errors and Omissions.** Information presented by Omron Companies has been checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical or proofreading errors or omissions.

OMRON INDUSTRIAL AUTOMATION • THE AMERICAS HEADQUARTERS

Schaumburg, IL USA • 847.843.7900 • 800.556.6766 • www.omron247.com

OMRON CANADA, INC. • HEAD OFFICE

Toronto, ON, Canada • 416.286.6465 • 866.986.6766 • www.omron247.com

OMRON ELECTRONICS DE MEXICO • HEAD OFFICE

México DF • 52.55.59.01.43.00 • 001.800.556.6766 • mela@omron.com

OMRON ELECTRONICS DE MEXICO • SALES OFFICE

Apodaca, N.L. • 52.81.11.56.99.20 • 001.800.556.6766 • mela@omron.com

OMRON ELETRÔNICA DO BRASIL LTDA • HEAD OFFICE

São Paulo, SP, Brasil • 55.11.2101.6300 • www.omron.com.br

OMRON ARGENTINA • SALES OFFICE

Cono Sur • 54.11.4783.5300

OMRON CHILE • SALES OFFICE

Santiago • 56.9.9917.3920

OTHER OMRON LATIN AMERICA SALES

54.11.4783.5300

OMRON EUROPE B.V. • Wegalaan 67-69, NL-2132 JD, Hoofddorp, The Netherlands. • Tel: +31 (0) 23 568 13 00

Fax: +31 (0) 23 568 13 88 • www.industrial.omron.eu