


Thank you for purchasing this Esco Biological Safety Cabinet. Please read this manual thoroughly to familiarize yourself with the many unique features and exciting innovations we have built into your new equipment. Esco provides many other resources at our website, www.escoglobal.com, to complement this manual and help you enjoy many years of productive and safe use of your Esco products.

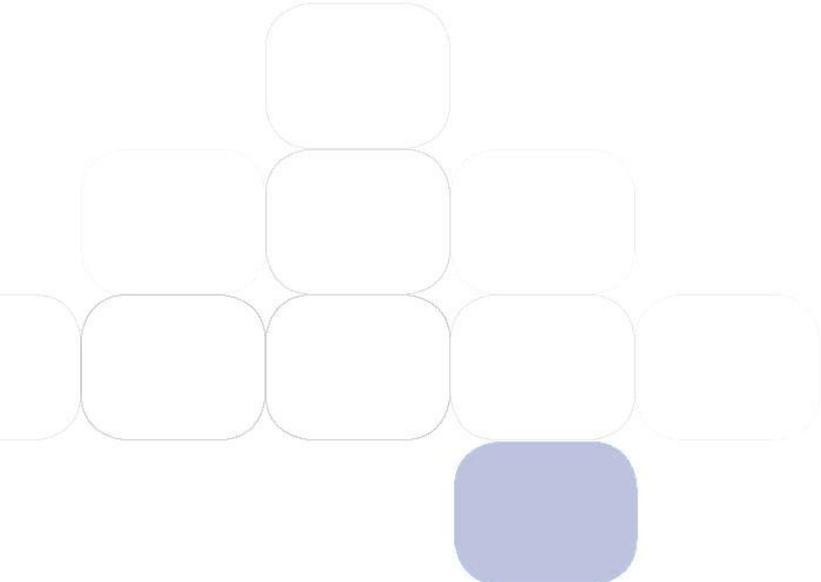

**For Technical Service, contact
North America**

*Esco Technologies, Inc.
2940 Turnpike Drive, Units 15-16 • Hatboro, PA 19040, USA
Toll-Free USA and Canada 1-877-479-3726
Tel 215-441-9661 • Fax 215-441-9660
us.escoglobal.com • usa@escoglobal.com*

Rest of World

*Esco Micro Pte. Ltd.
21 Changi South Street 1 • Singapore 486 777
Tel +65 6542 0833 • Fax +65 6542 6920
www.escoglobal.com • mail@escoglobal.com*

User Manual

Class II
Biological Safety Cabinet

Copyright Information

© Copyright 2011 Esco Micro Pte. Ltd. All rights reserved.

The information contained in this manual and the accompanying product is copyrighted and all rights are reserved by Esco.

Esco reserves the right to make periodic minor design changes without obligation to notify any person or entity of such change.

NordicSafe®, Labculture®, Airstream® and Sentinel® are registered trademarks of Esco.

“Material in this manual is provided for informational purposes only. The contents and the product described in this manual (including any appendix, addendum, attachment or inclusion), are subject to change without notice. Esco makes no representations or warranties as to the accuracy of the information contained in this manual. In no event shall Esco be held liable for any damages, direct or consequential, arising out of or related to the use of this manual.”

Table of Contents

INTRODUCTORY PAGES

i	Table of Contents	
iii	Warranty Terms and Conditions	
v	Introduction	
v	1. Products Covered	
v	2. Safety Warning	
v	3. Limitation of Liability	
vi	4. European Union Directives on WEEE and RoHS	
vii	Declaration of Conformity	

USER SECTION

1 Chapter 1 -Product Information

1	1.1 Quick View	
	1.1.1 BSC with Glass Side Walls	
	1.1.2 BSC with Stainless Steel Side Walls	

3 Chapter 2 -Control System

3	2.1 Sentinel Control System	
4	2.2 Menu Options	
5	2.2.1 Settings	
6	2.2.2 Setting Mode	
6	2.2.3 Field Calibration	
6	2.2.4 Admin Settings	
9	2.3 Stopwatch and Experiment Timer (only for non-motorized BSC)	
9	2.4 Half Speed Mode (only for NC2 Series BSC)	
9	2.5 Alarm and Warnings	
10	2.6 Diagnostic Mode	
10	2.6.1 NordicSafe	
10	2.6.2 Labculture	
11	2.6.3 Airstream	

13 Chapter 3 - Basic Cabinet Operation

13	3.1 Sash Window Operation	
13	3.1.1 Sash Window State	
13	3.1.2 Operating Motorized Sash Window	
14	3.1.3 Using Sash Window	
14	3.2 Starting and Shutting Down the BSC	
14	3.2.1 Turning on the BSC	
14	3.2.2 Turning off the BSC	
14	3.3 Working in the BSC	
15	3.4 Working Ergonomics	
16	3.5 UV Lamps	
16	3.6 Decontamination and Disinfecting Agents	

19 Chapter 4 - Maintenance

19	4.1 Scheduled Maintenance	
21	4.2 Maintenance/Service Log	

APPENDIX

Warranty Terms and Conditions

Esco products come with either a 1, 2 or 3 year limited warranty, depending on the product purchased, beginning on the date of shipment from any Esco international warehousing location. To determine which warranty applies to your product, refer to the appendix below.

Esco's limited warranty covers defects in materials and workmanship. Esco's liability under this limited warranty shall be, at our option, to repair or replace any defective parts of the equipment, provided if proven to the satisfaction of Esco that these parts were defective at the time of being sold, and that all defective parts shall be returned, properly identified with a Return Authorization.

This limited warranty covers parts only, and not transportation/insurance charges.

This limited warranty does not cover:

- Freight or installation (inside delivery handling) damage. If your product was damaged in transit, you must file a claim directly with the freight carrier.
- Products with missing or defaced serial numbers.
- Products for which Esco has not received payment.
- Problems that result from:
 - External causes such as accident, abuse, misuse, problems with electrical power, improper operating environmental conditions.
 - Servicing not authorized by Esco.
 - Usage that is not in accordance with product instructions.
 - Failure to follow the product instructions.
 - Failure to perform preventive maintenance.
 - Problems caused by using accessories, parts, or components not supplied by Esco.
 - Damage by fire, floods, or acts of God.
 - Customer modifications to the product
- Consumables such as filters (HEPA, ULPA, carbon, pre-filters) and fluorescent / UV bulbs.
- Esco is not liable for any damage incurred on the objects used on or stored in Esco equipment. If the objects are highly valuable, user is advised to have in place independent external preventive measures such as connection to a centralized alarm system.

Factory installed, customer specified equipment or accessories are warranted only to the extent guaranteed by the original manufacturer. The customer agrees that in relation to these products purchased through Esco, our limited warranty shall not apply and the original manufacturer's warranty shall be the sole warranty in respect of these products. The customer shall utilize that warranty for the support of such products and in any event not look to Esco for such warranty support.

Esco encourages all users to register their equipment online at www.escoglobal.com/warranty or complete the warranty registration form included with each product.

ALL EXPRESS AND IMPLIED WARRANTIES FOR THE PRODUCT, INCLUDING BUT NOT LIMITED TO ANY IMPLIED WARRANTIES AND CONDITIONS OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE LIMITED IN TIME TO THE TERM OF THIS LIMITED WARRANTY. NO WARRANTIES, WHETHER EXPRESS OR IMPLIED, WILL APPLY AFTER THE LIMITED WARRANTY PERIOD HAS EXPIRED. ESCO DOES NOT ACCEPT LIABILITY BEYOND THE REMEDIES PROVIDED FOR IN THIS LIMITED WARRANTY OR FOR SPECIAL, INDIRECT, CONSEQUENTIAL OR INCIDENTAL DAMAGES, INCLUDING, WITHOUT LIMITATION, ANY LIABILITY FOR THIRD-PARTY CLAIMS AGAINST YOU FOR DAMAGES, FOR PRODUCTS NOT BEING AVAILABLE FOR USE, OR FOR LOST WORK. ESCO'S LIABILITY WILL BE NO MORE THAN THE AMOUNT YOU PAID FOR THE PRODUCT THAT IS THE SUBJECT OF A CLAIM. THIS IS THE MAXIMUM AMOUNT FOR WHICH ESCO IS RESPONSIBLE.

These Terms and Conditions shall be governed by and construed in accordance with the laws of Singapore and shall be subject to the exclusive jurisdiction of the courts of Singapore.

Technical Support, Warranty Service Contacts

USA: 1-877-479-3726

Singapore: +65 65420833

Global Email Helpdesk: support@escoglobal.com

Visit <http://www.escoglobal.com/> to talk to a Live Support Representative

Distributors are encouraged to visit the Distributor Intranet for self-help materials.

Product Appendix, Warranty Listings

Biological Safety Cabinets, Laminar Flow Cabinets, HEPA-Filtered Cabinets (except Streamline brand)	The warranty periods for BSC may vary by country. Contact your local distributor for specific warranty details.
Laboratory Fume Hoods	1 year limited.
Ductless Fume Hoods	3 years limited for Ascent Opti's, 5 years for Ascent Max's.
Cleanroom Equipment	1 year limited.
Laboratory Ovens and Incubators	1 year limited.
CO ₂ Incubators	2 years limited.
Containment/Pharma Products	2 years limited.
Ultralow Temperature Freezer	3 years limited. 60 months on Compressor.

The warranty period starts two months from the date your equipment is shipped from Esco facility for international distributors. This allows shipping time so the warranty will go into effect at approximately the same time the equipment is delivered to the user. The warranty protection extends to any subsequent owner during the warranty period. Distributors who stock Esco equipment are allowed an additional four months for delivery and installation, providing the product is registered with Esco. User can register product online at www.escoglobal.com/warranty or complete the warranty registration form included with each product.

Policy updated on 12th Apr 2011 (This limited warranty policy does not apply to products purchased before 12th Apr 2011)

Introduction

1. Products Covered

Esco Class II Biological Safety Cabinet						
Model	Electrical Rating	0.6 meters 2 feet	0.9 meters 3 feet	1.2 meters 4 feet	1.5 meters 5 feet	1.8 meters 6 feet
NordicSafe	230 V AC, 50/60Hz, 1Φ			NC2-4L8		NC2-6L8
Labculture	220-240 V AC, 50Hz, 1Φ		LA2-3A1 LA2-3L1	LA2-4A1 LA2-4L1	LA2-5A1 LA2-5L1	LA2-6A1 LA2-6L1
	110-130 V AC, 60Hz, 1Φ		LA2-3A2	LA2-4A2	LA2-5A2	LA2-6A2
	220-240 V AC, 60Hz, 1Φ		LA2-3A3 LA2-3L3	LA2-4A3 LA2-4L3	LA2-5A3 LA2-5L3	LA2-6A3 LA2-6L3
Airstream	220-240 V AC, 50Hz, 1Φ	AC2-2E1	AC2-3E1 AC2-3S1	AC2-4E1 AC2-4S1	AC2-5E1 AC2-5S1	AC2-6E1 AC2-6S1
	110-130 V AC, 60Hz, 1Φ	AC2-2E2	AC2-3E2 AC2-3S2	AC2-4E2 AC2-4S2	AC2-5E2 AC2-5S2	AC2-6E2 AC2-6S2
	220-240 V AC, 60Hz, 1Φ	AC2-2E2	AC2-3E3 AC2-3S3	AC2-4E3 AC2-4S3	AC2-5E3 AC2-5S3	AC2-6E3 AC2-6S3
Airstream Duo	220-240 V AC, 50Hz, 1Φ			AC2-4D1 AC2-4G1		AC2-6D1 AC2-6G1
	220-240 V AC, 60Hz, 1Φ			AC2-4D3 AC2-4G3		AC2-6D3 AC2-6G3

2. Safety Warning

- Anyone working with, on or around this equipment should read this manual. Failure to read, understand and follow the instructions given in this documentation may result in damage to the unit, injury to operating personnel, and / or poor equipment performance.
- Any internal adjustment, modification or maintenance to this equipment must be undertaken by qualified service personnel.
- The use of any hazardous materials in this equipment must be monitored by an industrial hygienist, safety officer or some other suitably qualified individual.
- Before you process, you should thoroughly understand the installation procedures and take note of the environmental / electrical requirements.
- In this manual, important safety related points will be marked with the symbol. 
- If the equipment is used in a manner not specified by this manual, the protection provided by this equipment may be impaired.

3. Limitation of Liability

The disposal and / or emission of substances used in connection with this equipment may be governed by various local regulations. Familiarization and compliance with any such regulations are the sole responsibility of the users. Esco's liability is limited with respect to user compliance with such regulations.

4. European Union Directive on WEEE and RoHS

The European Union has issued two directives:

- **Directive 2002/96/EC on Waste Electrical and Electronic Equipment (WEEE)**

This product is required to comply with the European Union's Waste Electrical & Electronic Equipment (WEEE) Directive 2002/96/EC. It is marked with the following symbol:

Esco sells products through distributors throughout Europe. Contact your local Esco distributor for recycling/disposal.

- **Directive 2002/95/EC on Restriction on the use of Hazardous Substances (RoHS)**


With respect to the directive on RoHS, please note that this hood falls under category 8 (medical devices) and category 9 (monitoring and control instruments) and is therefore exempted from requirement to comply with the provisions of this directive.



Declaration of Conformation

In accordance to EN ISO/IEC 17050-1:2010

We, Esco Micro Pte. Ltd.
of 21 Changi South Street 1
Singapore, 486777
Tel: +65 6542 0833
Fax: +65 6542 6920

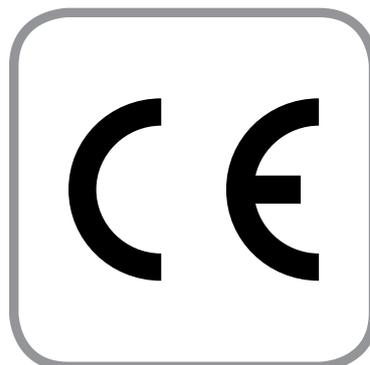

declare on our sole responsibility that the product:

Category : Class II Microbiological Safety Cabinet
Brand : NordicSafe
Model : NC2-4L8, NC2-6L8

in accordance with the following directives:

2006/95/EEC : The Low Voltage Directive and its amending directives
92/31/EEC : The Electromagnetic Compatibility Directive and its amending directives

has been designed to comply with the requirement of the following Harmonized Standard:

Low Voltage : EN 61010-1:2010
EMC : EN 61326-1:2006 Class B
Design/ : EN 12469 (2000) Class II Microbiological Safety Cabinet
Performance
Criteria

More information may be obtained from Esco's authorized distributors located within the European Union. A list of these parties and their contact information is available on request from Esco.

A handwritten signature in black ink, appearing to read 'XQ Lin', is written over a horizontal line.


XQ Lin
Group CEO, ESCO

This Declaration of Conformity is only applicable for 230V AC 50/60Hz units

Declaration of Conformation

In accordance to EN ISO/IEC 17050-1:2010

We, Esco Micro Pte. Ltd.
of 21 Changi South Street 1
Singapore, 486777
Tel: +65 6542 0833
Fax: +65 6542 6920

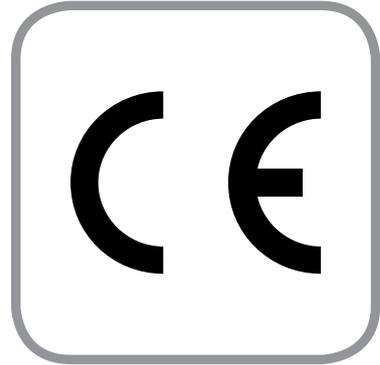

declare on our sole responsibility that the product:

Category : Class II Type A2 Biological Safety Cabinet
Brand : Labculture
Model : LA2-3A1, LA2-4A1, LA2-5A1, LA2-6A1

in accordance with the following directives:

2006/95/EEC : The Low Voltage Directive and its amending directives
92/31/EEC : The Electromagnetic Compatibility Directive and its amending directives

has been designed to comply with the requirement of the following Harmonized Standard:

Low Voltage : EN 61010-1:2010
EMC : EN 61326-1:2006 Class B
Design/Performance Criteria : EN 12469 (2000) Class II Biological Safety Cabinet

More information may be obtained from Esco's authorized distributors located within the European Union. A list of these parties and their contact information is available on request from Esco.

A handwritten signature in black ink, appearing to read 'XQ Lin', is written over a horizontal line.


XQ Lin
Group CEO, ESCO

This Declaration of Conformity is only applicable for 230V AC 50Hz units

Declaration of Conformation

In accordance to EN ISO/IEC 17050-1:2010

We, Esco Micro Pte. Ltd.
of 21 Changi South Street 1
Singapore, 486777
Tel: +65 6542 0833
Fax: +65 6542 6920

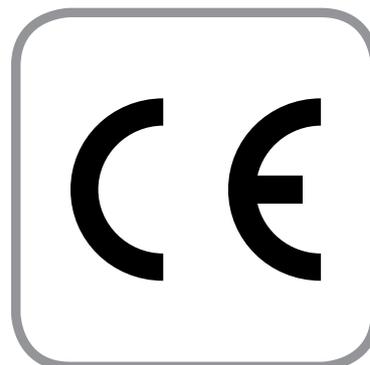

declare on our sole responsibility that the product:

Category : Class II Biological Safety Cabinet
Brand : Labculture
Model : LA2-3L1, LA2-4L1, LA2-5L1, LA2-6L1

in accordance with the following directives:

2006/95/EEC : The Low Voltage Directive and its amending directives
92/31/EEC : The Electromagnetic Compatibility Directive and its amending directives

has been designed to comply with the requirement of the following Harmonized Standard:

Low Voltage : EN 61010-1:2010
EMC : EN 61326-1:2006 Class B
Design/Performance Criteria : EN 12469 (2000) Class II Biological Safety Cabinet

More information may be obtained from Esco's authorized distributors located within the European Union. A list of these parties and their contact information is available on request from Esco.

A handwritten signature in black ink, appearing to read 'XQ Lin', is positioned above a horizontal line.


XQ Lin
Group CEO, ESCO

This Declaration of Conformity is only applicable for 230V AC 50Hz units

Declaration of Conformation

In accordance to EN ISO/IEC 17050-1:2010

We, Esco Micro Pte. Ltd.
of 21 Changi South Street 1
Singapore, 486777
Tel: +65 6542 0833
Fax: +65 6542 6920

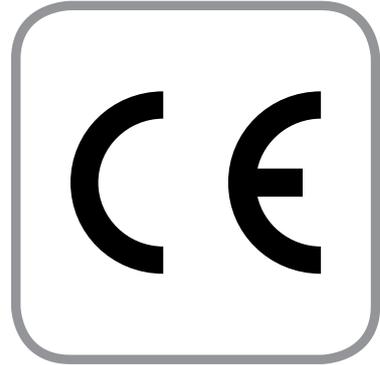

declare on our sole responsibility that the product:

Category : Class II Biological Safety Cabinet
Brand : Airstream
Model : AC2-2E1, AC2-3E1, AC2-4E1, AC2-5E1, AC2-6E1
AC2-3S1, AC2-4S1, AC2-5S1, AC2-6S1

in accordance with the following directives:

2006/95/EEC : The Low Voltage Directive and its amending directives
92/31/EEC : The Electromagnetic Compatibility Directive and its amending directives

has been designed to comply with the requirement of the following Harmonized Standard:

Low Voltage : EN 61010-1:2010
EMC : EN 61326-1:2006 Class B
Design/ : EN 12469 (2000) Class II Biological Safety Cabinet
Performance
Criteria

More information may be obtained from Esco's authorized distributors located within the European Union. A list of these parties and their contact information is available on request from Esco.

A handwritten signature in black ink, appearing to read 'XQ Lin', is written over a horizontal line.


XQ Lin
Group CEO, ESCO

This Declaration of Conformity is only applicable for 230V AC 50Hz units

Declaration of Conformation

In accordance to EN ISO/IEC 17050-1:2010

We, Esco Micro Pte. Ltd.
of 21 Changi South Street 1
Singapore, 486777
Tel: +65 6542 0833
Fax: +65 6542 6920

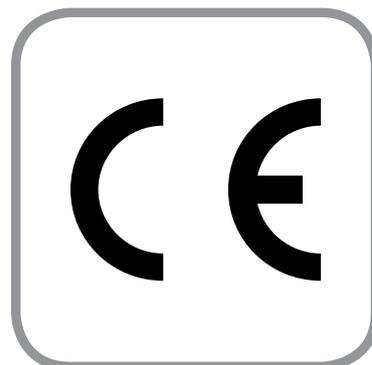

declare on our sole responsibility that the product:

Category : Class II Biological Safety Cabinet
Brand : Airstream Duo
Model : AC2-4D1, AC2-6D1, AC2-4G1, AC2-6G1

in accordance with the following directives:

2006/95/EEC : The Low Voltage Directive and its amending directives
92/31/EEC : The Electromagnetic Compatibility Directive and its amending directives

has been designed to comply with the requirement of the following Harmonized Standard:

Low Voltage : EN 61010-1:2010
EMC : EN 61326-1:2006 Class B
Design/Performance Criteria : EN 12469 (2000) Class II Biological Safety Cabinet

More information may be obtained from Esco's authorized distributors located within the European Union. A list of these parties and their contact information is available on request from Esco.

A handwritten signature in black ink, appearing to read 'XQ Lin', is written over a horizontal line.


XQ Lin
Group CEO, ESCO

This Declaration of Conformity is only applicable for 230V AC 50Hz units

Chapter 1 - Product Information


1.1 Quick View

1.1.1 BSC with Glass Side Walls

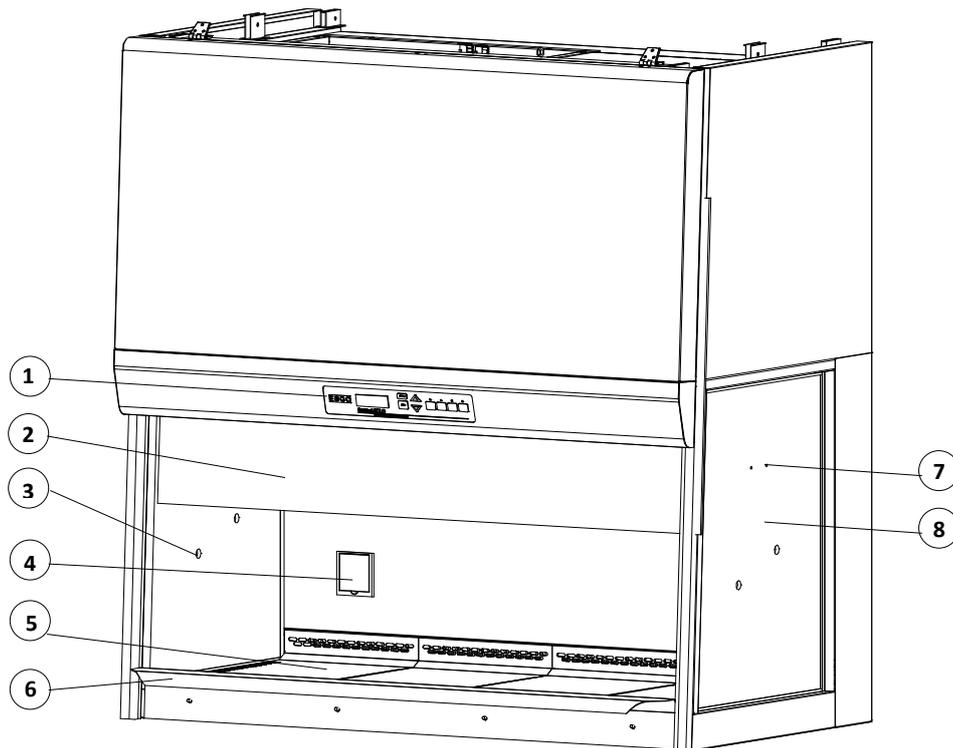

- | | |
|-------------------------------------------|--------------------------------|
| 1. Esco Sentinel Control System | 5. Interior Work Area |
| 2. Sash Window | 6. Armrest |
| 3. Service Fixture Provision (optional) | 7. IV Bar Provision (optional) |
| 4. Electrical Outlet Provision (optional) | 8. Glass Side Wall |


1.1.2 BSC with Stainless Steel Side Walls

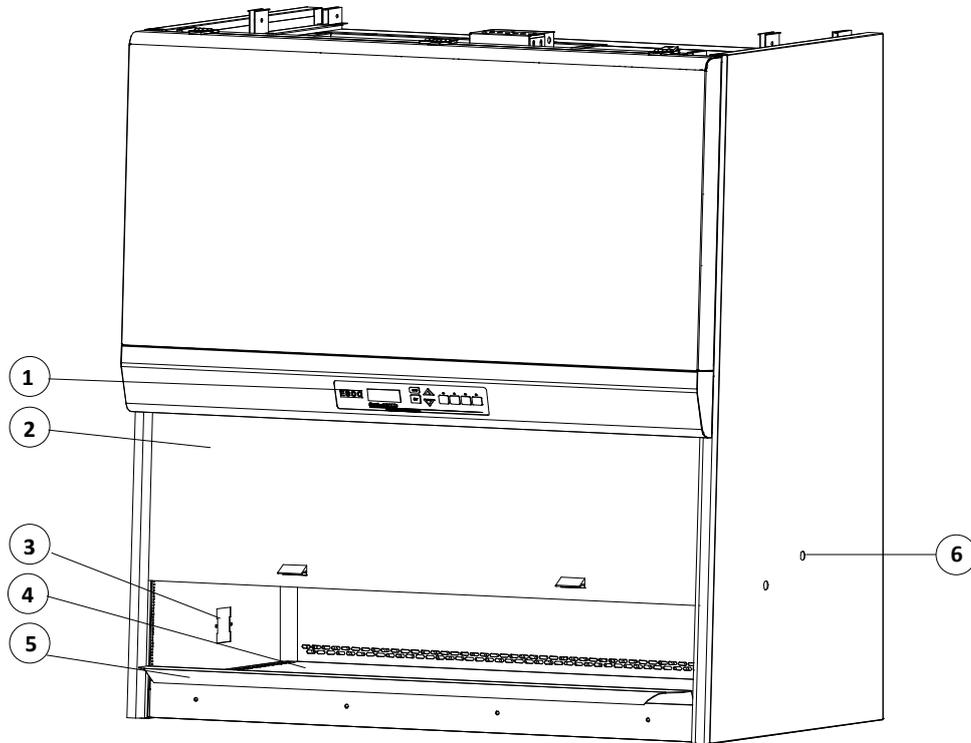

- | | |
|---------------------------------|-----------------------------------------|
| 1. Esco Sentinel Control System | 4. Interior Work Area |
| 2. Sash Window | 5. Armrest |
| 3. Electrical Outlet (optional) | 6. Service Fixture Provision (optional) |

Chapter 2 – Sentinel Control System

2.1 Sentinel Control System

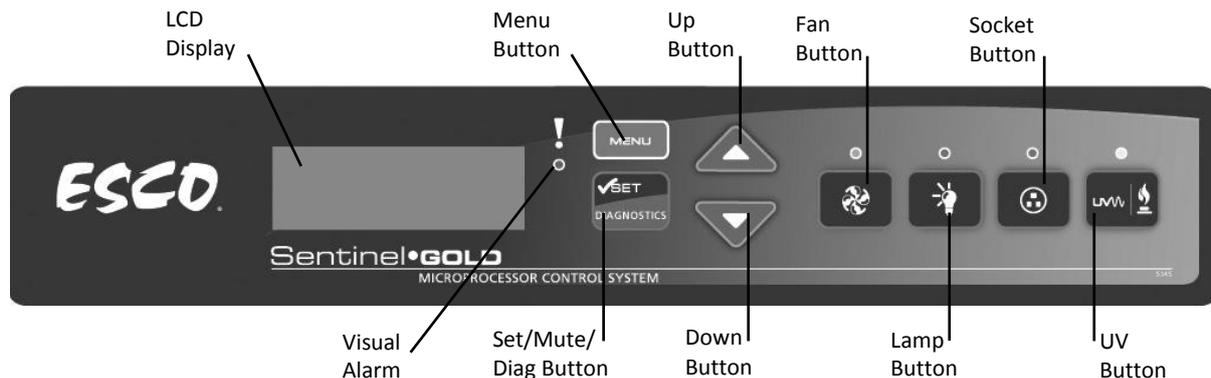


1. Fan Button
 - Turns on and turn off the fan.
2. Lamp Button
 - Turns on and turn off the fluorescent lamps.
3. Socket Button
 - Turns on and turn off the electrical socket (retrofit kit).
 - The maximum rating of all the outlets in the cabinet is 5 A. If overload, the fuse will blow.
4. UV Button
 - Turns on and turn off the UV lamp.
 - UV lamp can only be activated when the sash window is fully closed. Since the sash is capable of filtering UV rays, users are protected from the harmful UV radiation.
5. Up (▲) and Down (▼) Arrow Button
 - Move the menu options upwards and downwards.
 - Increase and decrease corresponding value inside one of the menu options.
 - Move the sash window upward and downward (for motorized sash BSC).
 - Accessing the stopwatch and experiment timer function (for non-motorized sash BSC).
6. Set or Mute or Diagnostic Button
 - Proceed to the next step, level or sequence inside the menu options.
 - To mute the fully opened sash and airfail alarm sound (during normal and quickstart mode)
 - Enter diagnostic mode
7. Menu Button

When you are entering menu options, the alarm will sound to indicate that the microprocessor is not monitoring the operation of the cabinet. No further warnings will be given.

- To enter and exit from the menu options.
- To go back to the previous level of the menu options.
- To access maintenance mode from error condition.

2.2 Menu Options

Please refer to the following diagram for complete reference to all menu options available.

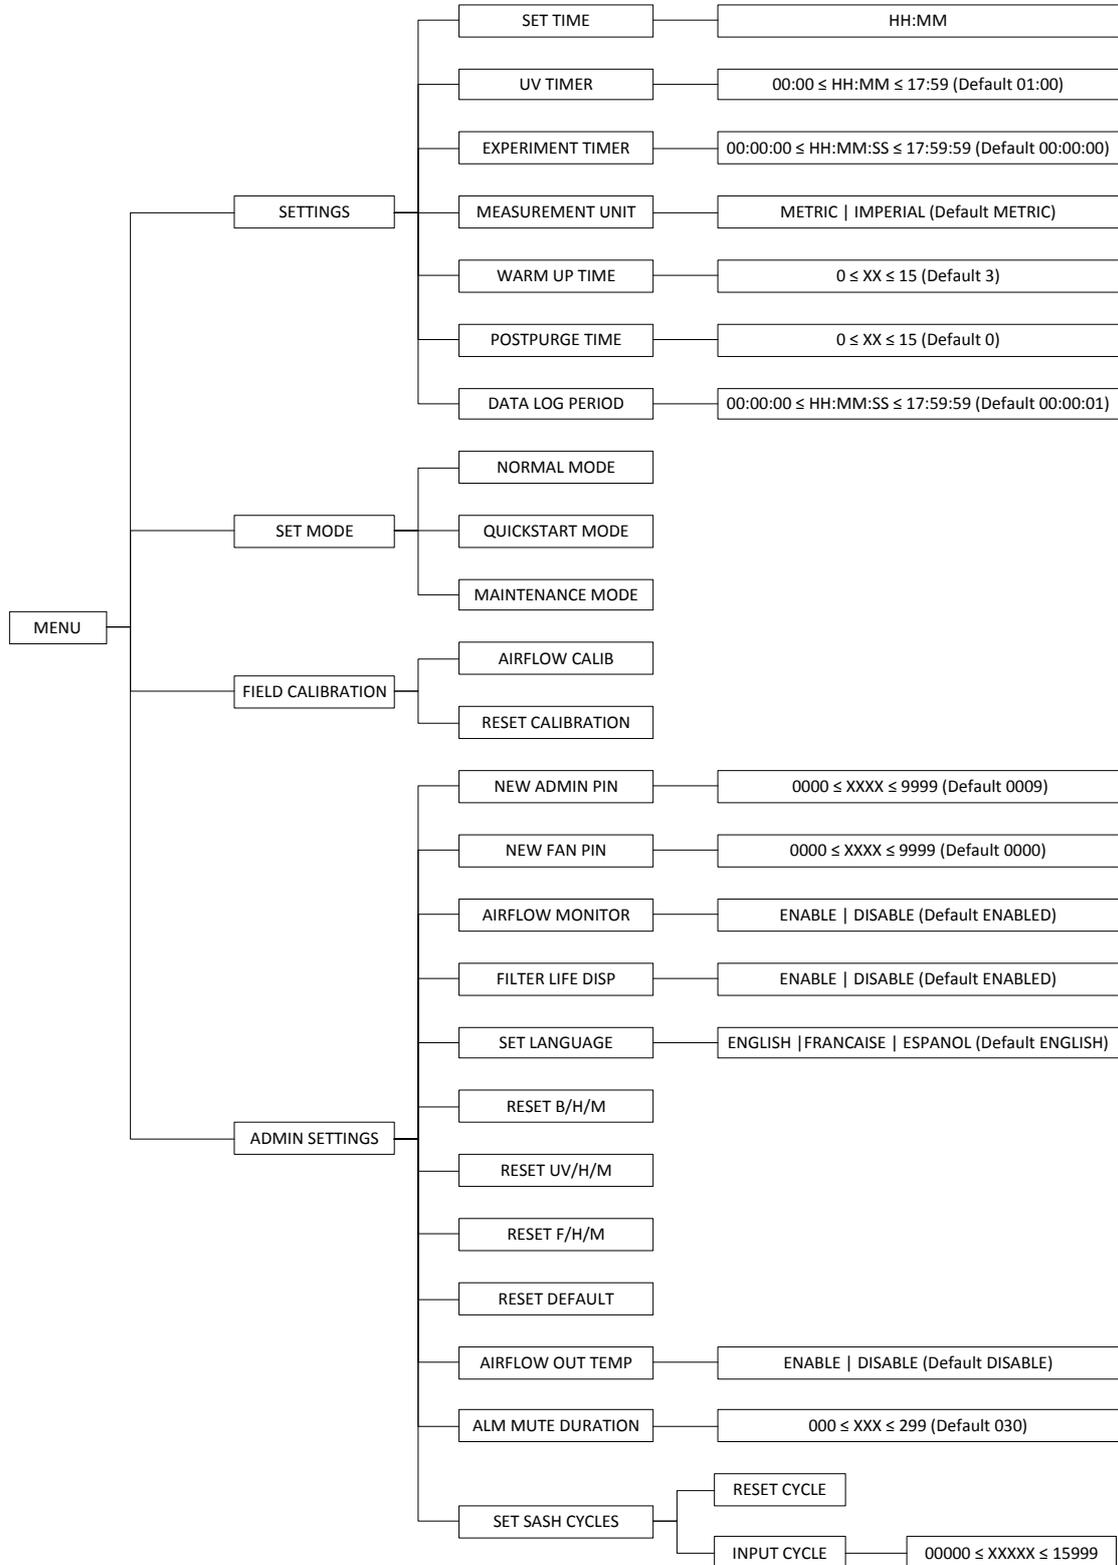

2.2.1 Settings

Users may use the settings menu function to customize the operation of the BSC to meet specific application requirements. The settings menu can be entered using both FAN PIN and ADMIN PIN.

2.2.1.1 Set Clock (Time)

Users can set the time by increasing/decreasing the hour and minute values. The correct time will be maintained even after the unit is turned off.



2.2.1.2 UV Timer

UV timer can be used to switch off the UV lamp automatically after a fixed period. The UV timer can be set up to 18 hours. By default, the timer is set to 60 minutes, which is considered the most effective UV decontamination time. Esco does not recommend leaving the UV lamp on for more than 60 minutes as it shortens the lifespan of the UV lamp. Without the UV timer, the lamp has to be switched off manually.




2.2.1.3 Experiment Timer (not applicable to motorized sash BSC)

Experiment timer is a countdown timer that can be used for critical experiment. Experiment timer can be set between "00:00:00" and "17:59:59".



2.2.1.4 Measurement Unit

Using this option, the user can select the unit in which air velocity is measured and displayed. The user can choose between metric (m/s) and imperial (fpm).



2.2.1.5 Warm Up Time

There will be a period of warm-up, before the fan is fully functioning. This is to ensure that the sensors, the blower, and the control system are stabilized, as well as purging the work zone of contaminants. The default setting is 3 minutes and the user can set it between 3 to 15 minutes.

During the warm up period, the user can use the FAN button to turn off the blower, LIGHT button to turn on and off the fluorescent lamp and MENU button. However, to be able to access the menu, the user need to input ADMIN PIN and even then, some portions of the menu (WARM UP and all FIELD CALIBRATION) is still not accessible for the user. Entering the menu during this time will pause the warm up period.




2.2.1.6 PostPurge Time

After the user switches off the BSC blower, there will be a post-purge period, to ensure that all contaminants are purged from the work zone. The default setting is zero minute (disable) and user can set it between 0 to 15 minutes. However, it is recommended to purge the BSC for around 3 minutes after the work is complete.



2.2.1.7 Data Log Period

Using RS232 communication port, the BSC can send data on the condition of the BSC to a PC. Data Log Period option allows the user to control the amount of time in between the BSC data sending procedure.



2.2.2 Setting Mode

The BSC has three working mode; two of which, normal mode and quickstart mode, can be used in daily activity. Both of these modes can be seen and accessed when you enter the FAN PIN.



2.2.2.1 Normal Mode

The normal mode is activated by factory default. In this mode, all alarms and interlocks are enabled.

2.2.2.7 Quickstart Mode

Quickstart mode allows the user to activate the blower and the light simply by opening the sash window to the operating position. In this mode, all alarms and interlocks are enabled.

2.2.2.3 Maintenance Mode

Maintenance mode should only be accessed by qualified personnel during maintenance. In this mode, all alarms are disabled and all interlocks are defeated.

2.2.3 Field Calibration

The purpose of calibration is to ensure the accuracy of the airflow display and alarm (if present). This involves measuring airflow with reference instrumentation and establishing reference between airflow sensor(s) on the BSC to the standard reference. Calibration should only be carried out by trained personnel. This section presents a brief overview of the calibration menu function. For more information, refer to test report.



2.2.3.1 Airflow Calibration

This option allows proper calibration and operation of the airflow sensor alarm. There will be three points to be calibrated, namely inflow fail point, inflow nominal point, and downflow nominal point.

2.2.3.2 Reset Calibration

This option allows the user to reset all value calibrated in the field and return it to the values gathered in factory calibration.

2.2.4 Admin Settings

The admin menu allows you to change both FAN and ADMIN PIN. The reset blower, filter and UV hour meter functions are usually used after you change the blower, filter or UV lamp as they can easily give you the indication on when to do BSC maintenance. While the reset default function will return the options in the settings menu to their factory settings.

2.2.4.1 New ADMIN PIN (default 0009)

ADMIN PIN restricts access to some of the more delicate menu functions, namely admin and field calibration, which should only be accessed by a qualified personnel. User must enter four digits ADMIN PIN before accessing these menus.

ADMIN PIN can also be used to switch to maintenance mode from error condition.




2.2.4.2 New FAN PIN (default 0000 - DISABLED)

FAN PIN restricts access to fan control and some parts of the menu, settings and set mode. User must enter four-digit PIN before switching fan on or off. As such, it can restrict access to operating the BSC by unauthorized personnel. It will also prevent unauthorized shutdown of the BSC when continuous operation is required. Note that continuous operation is recommended for better safety. Fan PIN is also needed to disable the alarm when the sash is fully raised and cleaning needs to be performed.

It is recommended that the Fan PIN be issued only to personnel authorized to use the BSC. With FAN PIN, the user can access admin and set mode parts of the menu.

Setting the PIN to 0000 will disable this feature. The FAN PIN is disabled by default. When the FAN PIN is disabled, the BSC can be turned on and off without requiring PIN, however to access the menu, the user is still required to enter the FAN PIN (0000).




2.2.4.3 Airflow Monitor

Whenever the air velocity falls below the fail point, the air fail alarm will be triggered. This option is used to enable/disable alarm. The alarm is enabled by default.

When the Airflow Monitor is disabled, the warm up period is removed. But the airflow will not be displayed for the first three minutes.


If the ambient temperature is outside of 18-30°C (which is the cabinet working temperature), the Airflow Monitor is automatically disabled



2.2.4.4 Filter Life Display

Using this option, the user can select the whether the filter life is displayed or not.


Filter life is calculated based on the filter hour meter (F/H/M). The filter life display will count down according to the amount of hours left in the filter hour meter with respect to filter life expectancy of 10000 hours. When the filter is changed the F/H/M must be reset, please see section 2.2.4.7 to reset the F/H/M.



2.2.1.5 Set Language (not applicable to NC2 Series BSC)

Using this option, the user can select the language of messages displayed on LCD

FRANÇAISE

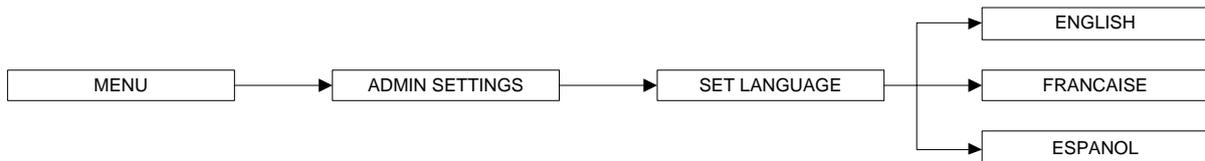

2.2.4.5 Reset B/H/M

This option is used to reset the blower hour meter. The blower hour meter indicates how long the blower has been in operation. There's no maximum value in blower hour meter. The counter value can be checked while in the diagnostic mode. The value can also provide some help in setting up maintenance schedule.



2.2.4.6 Reset UV/H/M

This option is used to reset the UV lamp hour meter. The UV lamp hour meter indicates how long the UV lamp has been in operation. Maximum counter is set at 2000 hours (100%). The counter value can be checked while in the diagnostic mode. Please reset the UV lamp hour meter after each UV lamp replacement.



2.2.4.7 Reset F/H/M

This option is used to reset the filter hour meter. The filter hour meter indicates how long the filter has been in operation. Maximum counter is set at 10000 hours (100%). The counter value can be checked while in the diagnostic mode. Please reset the filter hour meter after each filter replacement.



2.2.4.8 Reset Default


User can reset the default setting by choosing this option. The features being reset are warm-up period (3 minutes), post-purge period (0 minute), UV timer (60 minute), measurement unit (Metric), Airflow monitor (enabled), ADMIN PIN (0009), Filter Life Display (disabled) and FAN PIN (0000).

Note that the calibration settings cannot be reset as it may cause the BSC to operate in an unsafe manner. The hour meters cannot be reset either.



2.2.4.9 Airflow Out Temp

Using this option, the user can select the whether or not to display the airflow when the ambient temperature is out of optimum temperature range, below 18°C (65°F) or above 30°C (86°F).




2.2.4.10 Alarm Mute Duration

To mute airfail alarm for a certain period. The mute period can be set between 0 to 299 seconds, the default value is 30 seconds.



2.2.4.11 Set Sash Cycle (not applicable to non-motorized sash BSC)

To reset the sash cycles count to zero or to input the sash cycle count manually. The maximum of value of sash cycles is 16000. The cycles will raise every sash move to up and down.



Warning message will be showed after the cycle value reach 15000.

- 1st warning: "Replace Sash Motor" – after sash reached 15000 cycles.
- 2nd warning: "Stop Using Sash" - after sash reached 15500 cycles.
- 3rd warning: "Sash Motor Locked" (sash motor cannot operate) - after sash reached 16000 cycles.

2.3 Stopwatch and Experiment Timer (Only for non-motorized sash BSC)

- The stopwatch function can be started by pressing the UP button while the sash is in the safe/ready position. Pressing UP button again while the stopwatch function will stop and resume the timer. Pressing DOWN button will leave the stopwatch function and reset the timer. The timer in the stopwatch function is counting up and shown using the HH:MM:SS format.
- The experiment timer can be started by pressing the DOWN button while the sash is in the safe/ready position. Pressing DOWN button while the experiment timer function is working will stop and resume the timer. Pressing the UP button will leave the experiment timer function and reset the timer. The timer in the experiment timer function is counting down and shown using the HH:MM:SS format. Operator can use the SETTINGS | EXPERIMENT TIMER menu (refer to section 2.2.1.3) to set the experiment timer.

2.4 Half Speed Mode (Only for NC2 Series BSC)

NC2-L supports half speed mode, where the blower speed is reduced so that power consumption becomes less than half of normal mode. This mode is typically used during the night to maintain basic level of containment where the cabinet is not used by the operator.

The mode can be accessed by pressing the FAN button when the cabinet is in operation. In half speed mode, the airflow monitor is disabled and only the FAN button is operational, while other buttons are interlocked.



2.5 Alarms and Warnings

BSC uses alarms to indicate that the condition inside the BSC is not safe for the operator, so check the LCD display to understand the cause of these alarms. The most common alarm is the SASH ALARM that indicates that the sash is neither at the normal operating height nor at fully closed position (UV mode) – this condition can easily be corrected by putting the sash at the appropriate operation position.

Other alarms that indicate a failure or an error in the BSC system:

- AIRFLOW: NO! will be displayed if there is an airflow failure.
- SASH:ERROR POSITION indicates a failure in the sash detection system.
- SENSOR UNCALIBRATED will be displayed if the airflow velocity sensor is not yet calibrated.

2.6 Diagnostic Mode

Diagnostic mode can be accessed by pressing the SET button. The diagnostic mode allows the user to know the condition of the BSC or help the service engineer during maintenance and troubleshooting.

2.6.1 NordicSafe

On Screen	Explanation
MODE	Shows which mode is active: NORMAL MODE, QUICKSTART MODE or MAINTENANCE MODE
VERSION	Shows the version of the software; eg: CP107 V 1.0
TEMPERATURE	Shows the temperature inside the cabinet.
B/H/M	Blower Hour Meter – increase by the hour.
SASH CYCLE	Shows the cycle of sash moving. Maximum cycle is 16000.
FILTER LIFE	Shows percentage of filter life (based on Filter Hour Meter) and expected filter life of 10000 hours.
AF OUT TEMP	Airflow velocity display status when temperature is out of range
UV LIFE	Shows percentage of UV lamp life (based on UV Lamp Hour Meter).
UV TIMER	Shows the UV timer value – default is 60 minutes. Maximum value is 00 minutes (infinite on).
MUTE TIMER	Shows the mute timer value – default is 30 seconds. Maximum value is 299 seconds.
ADC IFF	ADC for Fail Point Inflow – calculated using offset based on Inflow Nominal Point.
ADC IFN	ADC for Nominal Point Inflow – based on field calibration.
ADC IFA	ADC for Actual Inflow – showing real time sensor reading.
ADC IF0	ADC for factory calibrated Zero Point Inflow (no inflow).
ADC IF1	ADC for factory calibrated Fail Point Inflow.
ADC IF2	ADC for factory calibrated Nominal Point Inflow.
ADC DFA	ADC for downflow velocity actual reading from the sensor
ADC DF0	ADC for factory calibrated zero point downflow (no inflow).
ADC DFN	ADC for downflow velocity nominal point – based on field calibration.
ADC DF2	ADC for factory calibrated nominal point downflow.
CONSTANT1	Inflow sensor constant. This value is needed when ordering a new sensor.
CONSTANT2	Downflow sensor constant. This value is needed when ordering a new sensor.
CALIB TEMP	Temperature when the factory calibration was performed.
ADC TEMP	ADC value for temperature.
M_SWITCH1	Shows the condition of magnetic switch 1 – safe position.
M_SWITCH2	Shows the condition of magnetic switch 2 – fully closed position.

2.6.2 Labculture

On Screen	Explanation
MODE	Shows which mode is active: NORMAL MODE, QUICKSTART MODE or MAINTENANCE MODE.
VERSION	Shows the version of the firmware.
TEMPERATURE	Shows the temperature inside the cabinet.
B/H/M	Blower Hour Meter – increase by the hour.
SASH CYCLE	Shows the cycle of sash moving. Maximum cycle is 16000.
FILTER LIFE	Shows percentage of filter life (based on Filter Hour Meter) and expected filter life of 10000 hours.
AF OUT TEMP	Velocity display status when temperature out of range.
UV LIFE	Shows percentage of UV lamp life (based on UV Lamp Hour Meter).
UV TIMER	Shows the UV timer value – default is 60 minutes. Maximum value is 00 minutes (infinite on).
MUTE TIMER	Shows the mute timer value – default is 30 seconds. Maximum value is 299 seconds.
ADC IFF	ADC for Fail Point Inflow – calculated using offset based on Inflow Nominal Point.
ADC IFN	ADC for Nominal Point Inflow – based on field calibration.
ADC IFA	ADC for Actual Inflow – showing real time sensor reading.
ADC IF0	ADC for factory calibrated Zero Point Inflow (no inflow).
ADC IF1	ADC for factory calibrated Fail Point Inflow.

ADC IF2	ADC for factory calibrated Nominal Point Inflow.
DFN	Nominal of Downflow – keyed in during field calibration.
CONSTANT	Airflow sensor constant. This value is needed when ordering a new sensor.
CALIB TEMP	Temperature value during calibration.
ADC TEMP	ADC value for TEMPERATURE.
M_SWITCH1	Shows the condition of magnetic switch 1 – fully open position.
M_SWITCH2	Shows the condition of magnetic switch 2 – safe position.
M_SWITCH3	Shows the condition of magnetic switch 3 – fully closed position.


2.6.3 Airstream

On Screen	Explanation
MODE	Shows which mode is active: NORMAL MODE, QUICKSTART MODE or MAINTENANCE MODE
VERSION	Shows the version of the software; eg: CP104D V 1.0
TEMPERATURE	Shows the temperature inside the cabinet.
B/H/M	Blower Hour Meter – increase by the hour.
SASH CYCLE	Shows the cycle of sash moving. Maximum cycle is 16000.
FILTER LIFE	Shows percentage of filter life (based on Filter Hour Meter) and expected filter life of 10000 hours.
AF OUT TEMP	Velocity display status when temperature out of range
UV LIFE	Shows percentage of UV lamp life (based on UV Lamp Hour Meter).
UV TIMER	Shows the UV timer value – default is 60 minutes. Maximum value is 00 minutes (infinite on).
MUTE TIMER	Shows the mute timer value – default is 30 seconds. Maximum value is 299 seconds.
ADC IFF	ADC for Fail Point Inflow – calculated using offset based on Inflow Nominal Point.
ADC IFN	ADC for Nominal Point Inflow – based on field calibration.
ADC IFA	ADC for Actual Inflow – showing real time sensor reading.
ADC IF0	ADC for factory calibrated Zero Point Inflow (no inflow).
ADC IF1	ADC for factory calibrated Fail Point Inflow.
ADC IF2	ADC for factory calibrated Nominal Point Inflow.
DFN	Nominal of Downflow – keyed in during factory or field calibration.
CONSTANT	Airflow sensor constant. This value is needed when ordering a new sensor.
CALIB TEMP	Temperature when the factory calibration was performed.
ADC TEMP	ADC value for TEMPERATURE.
M_SWITCH1	Shows the condition of magnetic switch 1 – fully open position.
M_SWITCH2	Shows the condition of magnetic switch 2 – safe position.
M_SWITCH3	Shows the condition of magnetic switch 3 – fully closed position.
TYPE	Cabinet type

Chapter 3 – Basic Cabinet Operation


3.1 Sash Window Operation

3.1.1 Sash Window State

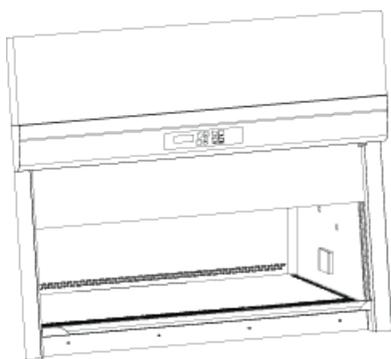


Sash is fully open

- ✓ Blower can be active
- ✓ Fluorescent lights can be used
- ✗ NC2 Fluorescent lights unusable
- ✗ Unsafe working condition

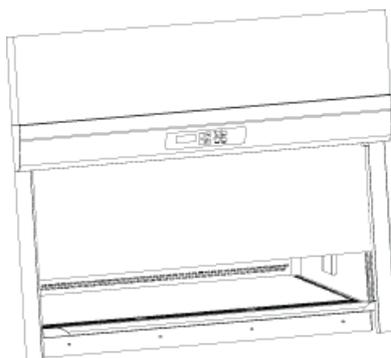

Sash is in safe position

- ✓ Blower can be activated
- ✓ Fluorescent lights can be used
- ✓ Safe working condition

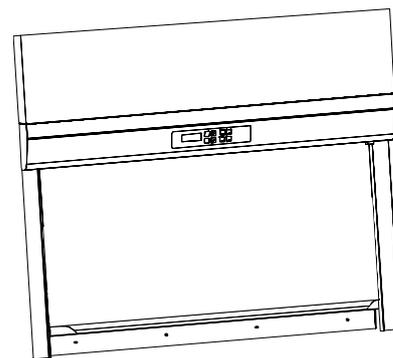

Sash is fully closed

- ✗ Blower can't be activated
- ✗ Fluorescent lights unusable

3.1.2 Operating Motorized Sash Window (Only for BSC with motorized sash window)

The motorized sash uses a “push and hold” mechanism, so if you remove your finger from the button the sash will stop immediately – this is a safety feature to control the closure and prevent anything getting trapped in the aperture as the sash descends.

Lower Sash from Fully Open Position

When the sash is fully open, pressing the down button and holding it will cause the sash to move to the Safe Height setting and stop. If the fluorescent lights are on as the sash descends, they will stay on as long as the sash stops in the Safe Position (not applicable for NC2). If you release the button before the sash has reached Safe Position the lights will switch off automatically.

Lower Sash from Safe Height Position

When the sash is at safe operating height pressing the down button and holding it will cause the sash to move down to the fully closed position and stop. If the fluorescent lights are on as the sash descends, they will switch off automatically as soon as the sash reaches fully closed. If you release the button before the sash has reached the fully closed position the lights will switch off automatically.

Raise Sash from Fully Closed Position

When the sash is fully closed, pressing the up button and holding it will prompt the user to input the password to turn on the fan. If the password is correct, if it was on fan will turn on and the sash will move up to the Safe Height setting and stop.

Raise Sash from Safe Height Position

When the sash is safe operation position, pressing the up button and holding it will cause the sash to move up to the fully open position and stop. If the fluorescent lights are on as the sash rises, they will stay on as long as the sash is allowed to fully open. Stopping the sash midway will cause the lights to switch off automatically.

3.1.3 Using Sash Window

- The sash window should be fully closed when the cabinet is not in use. This helps keep the work zone interior clean.
- The sash window should always be in the normal operating height at all times when the cabinet is in use. Even if the cabinet is left unattended, but the blower is on, the sash window should never be moved from the normal operating height, unless during loading or unloading of materials/apparatus into the cabinet.
- The alarm will be activated whenever the sash window is moved from the normal operating height.
- Whenever the sash window is moved to the correct height from a higher or lower position, the light will automatically be turned on as a signal to the user.
- The sash window may be opened to its maximum position for the purpose of loading/unloading of materials/apparatus into the cabinet. When the sash window is fully opened, the alarm sound may be muted by pressing MUTE button but, will be automatically sounded again after 5 minutes to remind the user that it is not safe to work in the cabinet and the light will be turned on to facilitate cleaning.

3.2 Starting and Shutting Down the BSC

3.2.1 Turning on the BSC


1. Raise the sash to the indicated normal operational height (READY state). The lamp will turned on when this height is reached.
Note: When Quickstart mode is selected, fan will turn on as well, without pressing the fan button.
2. Turn on the fan by pressing the FAN button. Input the Fan PIN if asked (if PIN ≠ 0000). This will start the warm up procedure (default: 3 minutes). All buttons are disabled during warm up period.
3. The BSC is ready for work.

3.2.2 Turning off the BSC

1. Turn off the fan by pressing the FAN button. Input the Fan PIN if asked (if PIN ≠ 0000). This will start the post purge procedure (default: 0 minute). All buttons are disabled during post purge period.
2. Lower the sash to the fully closed position (the display will show UV MODE). The sash can be lowered immediately after turning off the fan as it will not interrupt the post purge procedure.
Note: When Quickstart mode is selected, fan will turn off without pressing the fan button.
3. Turn on the UV lamp (when present) to decontaminate the work area by pressing the UV button. Leave the UV lamp on to make sure the decontamination is done effectively. The UV lamp can only be turned on after the post purge procedure is finished.

3.3 Working in the BSC

- Surface-decontaminate the work area (work surface, back and side wall, UV lamp, electrical outlet, service fixture and the inner surface of the sash window) before and after using the BSC.
- Allow the BSC to purge any contaminant by allowing the blower to operate at least 3 minutes before and after using the BSC.
- Surface-decontaminate any item (including your arms) or apparatus with appropriate disinfectant before entering or exiting the work area.
- Place the waste container (containment bag, pipette discard pans, etc.) inside the BSC work area.
- Place all items and apparatus in the safe working area.

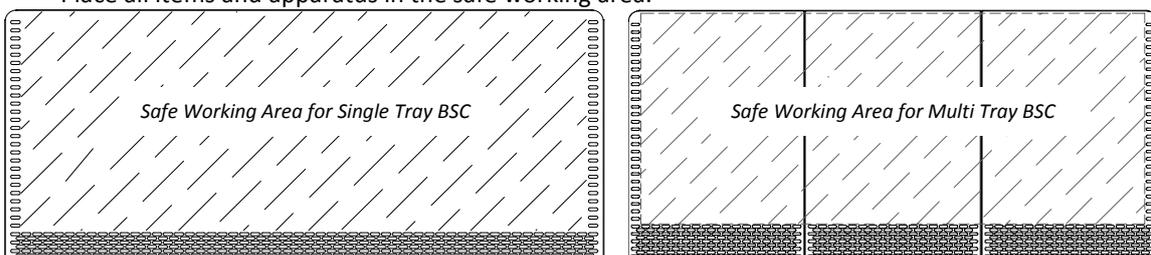

- Minimize room activity (personnel movements, closing and opening of doors, etc.) since these external airflow disturbances may adversely affect the BSC's internal airflow, thereby possibly impairing the containment capabilities of the BSC.
- Ensure that the sash is at normal operating height (READY state) before starting any experiment.
- Ensure the front and back air grilles are not obstructed by your arms or any other objects.
- Work as far inside the BSC as possible - at least 150 mm (6 inches) behind the front air intake grille.
- While working in the BSC, move your hands slowly and in a controlled manner. Rapid movements may disrupt the air barrier, allowing contaminants to escape or enter the BSC.
- The use of Bunsen burner inside the work zone is not recommended. However if the use of Bunsen burner is unavoidable, place the burner in the right side of the work zone.
- Place aerosol-generating instruments as far inside the BSC as possible and at least 150 mm (6 inches) from clean items/materials.
- Place air turbulence generating equipment such as centrifuges, blenders or sonicators towards the back of the BSC. Stop other work while any of this equipment is in operation.
- As far as possible, it is recommended that the BSC be operated continuously in order to achieve optimal containment and cleanliness. Airflow studies have shown that once the fan has been switched off, air from the BSC may escape due to the thermal currents from inside the BSC.

3.4 Working Ergonomics

On most occasions, you would most likely be operating the BSC in sitting rather than standing posture. There are some obvious advantages of the sitting posture:

- The physiological energy cost and fatigue involved in sitting are relatively less
- Sitting posture provides the body with a stable support

However, sitting position has some drawbacks too:

- The working area available is fairly limited
- There is a potential risk of being constrained in the same posture for a long time
- Sitting posture is one of the most stressful postures for one's back

Therefore you should pay careful attention to the following guidelines in order to achieve comfortable and healthy working conditions:

- Always ensure that your legs have enough legroom.
- Keep your lower back comfortably supported by your chair. Adjust the chair or use a pillow behind your back whenever necessary.
- You should place your feet flat on the floor or on a footrest. Don't dangle your feet and compress your thighs.
- You should keep varying your sitting position throughout the day at regular intervals so that you are never in the same posture for too long.
- Observe the following precautions with respect to your eyes:
 - Give your eyes frequent breaks. Periodically look away from the work area and focus at a distant point.
 - Keep your glasses clean.
- Arrange the items/apparatus frequently used in your work in such a way that you can minimize the physical strain involved in handling them.
- Exercise regularly

The BSC's noise emission has been tested and found to be in compliance with EN 12469, ISO 4871 and NSF/ANSI 49 which is important to ensure health and comfort for the operator.

Ergonomics accessories available with Esco include:

- Armrest padding
- Lab chair
- Footrest

Please contact your local distributor or Esco for more information.

3.5 UV Lamps

The UV light is a germicide and virucide. Even at the minimum acceptable irradiance in a BSC – $40 \mu\text{W}/\text{cm}^2$ (US Department of Health and Human Services et. al., 2000), it would only take 12.5 minutes to reach $30,000 \mu\text{W}/\text{cm}^2$ ($1 \text{ W} = 1 \text{ J}/\text{sec}$), which has been listed as germicidal for spore forming organism.

Unlike many other type of decontamination agent, UV light doesn't leave any residue. The decontamination action stops upon de-energizing of the lamp.

However, due to the short wavelength, the UV light does not penetrate well. Thus UV light can only be used to effectively disinfect the work area of an empty BSC. For any container stored inside the BSC's work area, the UV radiation will only disinfect the outer surface of the material, leaving the inner surface and the content inside the material untouched.

- UV light decontamination method may be used before and after working with vegetative organisms and viruses. However, it should not be the sole decontamination agent; the use of chemical decontamination agent is still encouraged.
- Minimize the material inside the BSC's work area during the process of UV light decontamination. A direct interaction with UV light can degenerate plastic- or rubber-based material and can cause other hazard.
- Make sure that the BSC sash is in the fully closed position and the interlock is working properly before activating the UV lamp. Avoid direct contact with skin and eyes as UV light is classified as a probable human carcinogen.
- The UV lamp should be activated for around 60 minutes to work effectively. Use the UV timer feature to easily control the period of decontamination (UV timer is disabled by default). Leaving the UV lamp on for over 60 minutes or even overnight is not recommended because it shortens the lifespan of the lamp. The UV lamps used in Esco BSC have a lifespan of 2,000 hours.
- The UV lamp should be cleaned of any dust and dirt weekly and changed annually to ensure its effectiveness.
- The use of UV lamp in BSC has been explicitly discouraged in all major international standards and recommendations.

3.6 Decontamination and Disinfecting Agents

- For stainless steel surfaces, all common disinfecting agents except chlorine-based ones are suitable.
- For powder coated surfaces, all common disinfecting agents are suitable. However, the BSC has been specifically evaluated for use with the following:
 - 1N hydrochloric acid
 - 1N sodium hydroxide
 - 1% quaternary ammonium compound
 - 5% formaldehyde
 - 5,000 ppm hypochlorite
 - 2% iodophor
 - 5% phenol
 - 70% ethyl alcohol
- Depending on the contaminant involved at the time of operating the BSC, there are various other types of disinfecting agents that may be used. The following table outlines the effectiveness of various disinfecting agents against the different types of contaminants.

Decontaminant	Glutaraldehyde	Peroxide/ Paracetic acid/ Acetic acid	Chlorine Dioxide	Chlorine	Iodophor	Alcohol	Phenolic	Quaternary Ammonium Compounds
Classification	Sterilant	Sterilant	Sterilant	High Level	Intermediate	Intermediate	Intermediate	Low Level
<i>Parameters for use:</i>								
Concentration	2%	1%	0.01-0.1%	0.01-5%	0.5-2.5%	70-85%	0.2-3%	0.1-2%
Contact time (min.)	10-600	10-720	10-600	10-30	10-30	10-30	10-30	10-30
Stability > 1 week ⁽¹⁾	+		+		+	+	+	+
<i>Agents:</i>								
Bacterial Endospores	+	+	+	+/-				
Naked Viruses	+	+	+	+	+/-	+/-	+/-	
Mycobacterium	+	+	+	+	+	+	+	
Vegetative Bacteria	+	+	+	+	+	+	+	+
Enveloped Viruses	+	+	+	+	+	+	+	+
<i>Characteristics:</i>								
Inactivated by Organics		+		+	+	+	+/-	+
Residual	+	+	+	+/-	+		+	
Corrosive		+		+	+		+	
Flammable						+		
Skin Irritant	+	+	+	+	+		+	
Eye Irritant	+	+	+	+	+	+	+	
Respiratory Irritant	+	+	+	+	+	+	+/-	
Toxic	+	+	+	+	+	+	+	+
<i>Use in BSCs:</i>								
Routine Surface Decon				+/-	+	+		+
Biohazardous Spill		+/-	+	+/-	+		+	+/-

(1) protected from light and air

+ = effective, +/- = results may vary, blank = not effective

Decontamination

Decontamination may frequently be carried out by means of formaldehyde fumigation or using other decontamination agents, such as chlorine dioxide or hydrogen peroxide. Decontamination process should only be carried out by trained personnel.

In any of the following eventualities, the user should ensure that the BSC has been properly decontaminated, keeping in mind the nature of the pathogens used:

- At the time of moving/relocating the BSC
- At the time of changing the type of work being carried out in the BSC
- Before accessing contaminated areas for servicing, for example - filter replacement

Chapter 4 – Maintenance

4.1 Scheduled Maintenance

Proper and timely maintenance is crucial for trouble free functioning of any device and your Esco BSC is no exception to this rule. We strongly recommend that you follow the maintenance schedule suggested hereunder in order to obtain optimal performance from your Esco BSC.

No.	Description of Task to Perform	Maintenance to be carried out every					
		Day	Week	Month	Quarter	1 Year	2 Years
1	Surface decontaminate the work zone	√					
2	BSC power-up alarm verification	√					
3	Thoroughly surface decontaminate the drain pan		√				
4	Check the paper catch for retained materials		√				
5	Clean the exterior surfaces of the BSC			√			
6	Clean the sash window			√			
7	Check all service fixtures (where present) for proper operation			√			
8	Inspect the BSC for any physical abnormalities or malfunction				√		
9	Clean up stainless steel surfaces with MEK				√		
10	Re-certification					√	
11	Change UV Lamp (where present)					√	
12	Change the fluorescent lamps						√

Cleaning the BSC

- Clean the work surface and walls with appropriate disinfectant agent and soap water afterward
- Clean the sash window using an appropriate disinfectant agent and glass cleaner afterward
- Use a damp cloth to clean the exterior surface of the BSC, particularly on the front and top in order to remove dust that accumulated there
- Use clean water to finish the cleaning and wash away any residue of disinfectant agent, soap water and glass cleaner
- For removing stubborn stains or spots on the stainless steel surface, make use of MEK (Methyl-Ethyl-Ketone). In such cases, make sure that you wash the steel surface immediately afterwards with clean water and some liquid detergent. Use a polyurethane cloth or sponge for washing. Regularly cleaning the stainless steel surface can help you retain the attractive factory finish.

Test the audible and visual alarm

The simplest method by far would be to move the sash until the glass window is no longer in the sash ready or UV mode position.

Check the cabinet's functionality

- Check the BSC's mechanical functionality; ex: sash window – lubricate if necessary
- Check the BSC's electrical functionality; ex: fluorescent lamp – replace if necessary
- Check the BSC for any defect, repair immediately

Re-certification


All BSC must be re-certified annually by a certified engineer. See test report for recertification procedure.

Accessing the paper catch

The purpose of accessing the paper catch is to remove any retained materials that might cause obstructions. Care must be taken as the area is contaminated.

Before opening the paper catch:



- Use appropriate personal protective equipment (PPE).
- Wipe down the interior of the BSC including the top and bottom surfaces of the work tray(s) while airflow is operating.
- If the interior cannot be wiped down, the BSC should be decontaminated

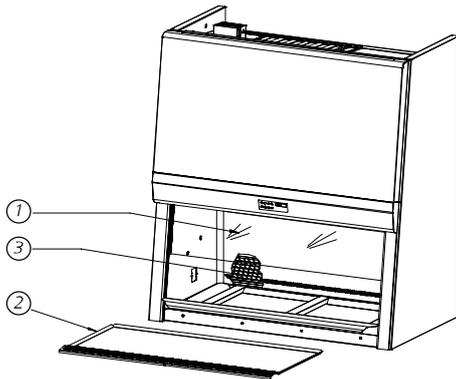

Accessing the paper catch


1. Turn the blower off. Then raise the sash to fully open position for easy access.
2. Remove the tray(s) to access the paper catch.
3. The figure beside, points to the location of the paper catch. Locate and remove any material trapped. Be careful of any sharp objects that might be present. You might want to use a mirror to help you see better.

Sash cleaning procedure for non-motorized sash BSC

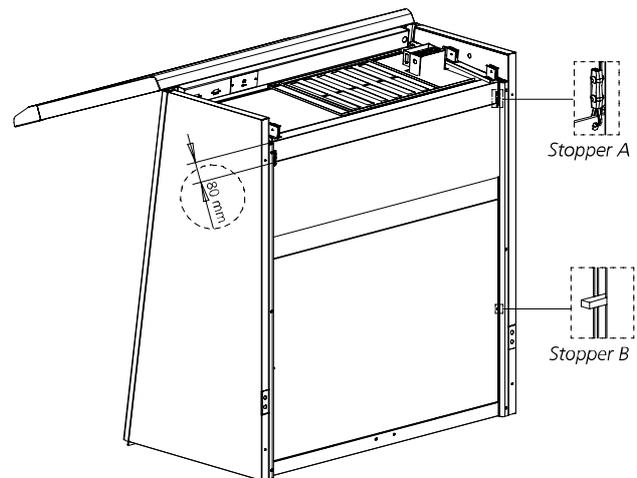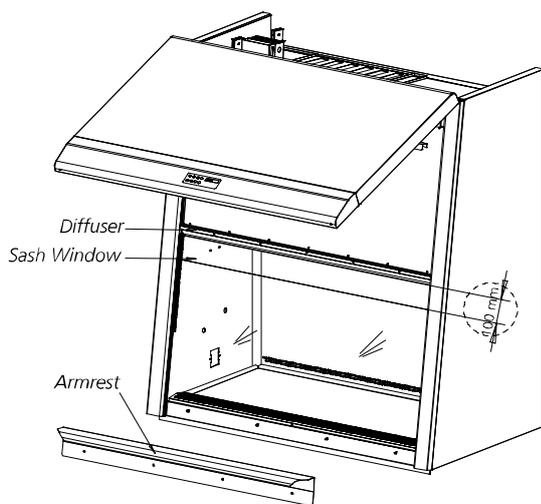

1. Remove armrest
2. Lower the sash by continuously until the sash is in the lowest position and create a 10 cm opening between the sash and the diffuser
3. Open the front panel.
4. Slide your hand through the opening and clean the inner side of the sash using cloth and IPA 70%
5. After cleaning, push continuously until the sash is in the sash ready position
6. Close the front panel.
7. Reattach armrest

Sash cleaning procedure for motorized sash BSC

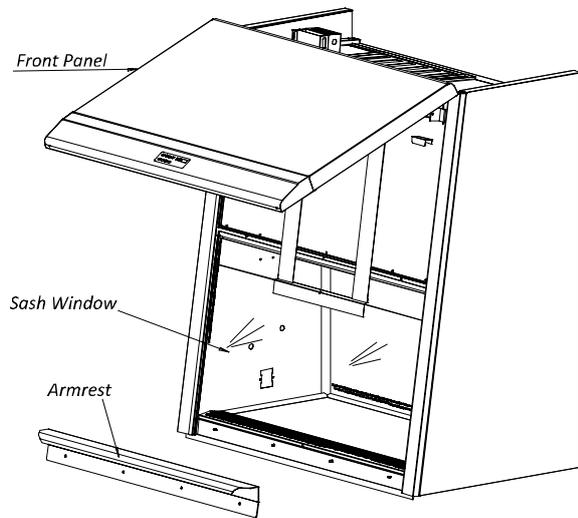

1. Remove armrest
2. Press MENU button, select SET MODE then choose MAINTENANCE MODE - this mode allows you to lower the sash further than usual
3. Lower the sash by pressing the DOWN button continuously until the sash is in the lowest position and create a 10 cm opening between the sash and the diffuser
4. Open the front panel.
5. Slide your hand through the opening and clean the inner side of the sash using cloth and IPA 70%
6. After cleaning, push the UP button continuously until the sash is in the sash ready position
7. Close the front panel.
8. Reattach armrest
9. Set the cabinet back to NORMAL MODE

4.2 Maintenance/Service Log

It is good practice (and in some cases regulatory requirement) to maintain a log of all maintenance work carried out on your cabinet.

APPENDIX

