


Chapter 8 Connecting DCON I/O Modules

The Win-GRAF PAC can connect the ICP DAS "I-7000" and "I-87KW" remote DCON I/O modules via the COM Port (RS-485). Each PAC can enable up to 16 DCON Ports, and each Port can connect up to 50 remote DCON I/O modules (not recommended over 32). If select the "I-87KW" series I/O modules, it must be used with the RS-485 I/O Expansion Unit (e.g., I-87K4/5/8/9 or RU-87P4/8). You can view the detailed product information on the ICP DAS website:

http://www.icpdas.com/root/product/solutions/remote_io/remote_io_products.html

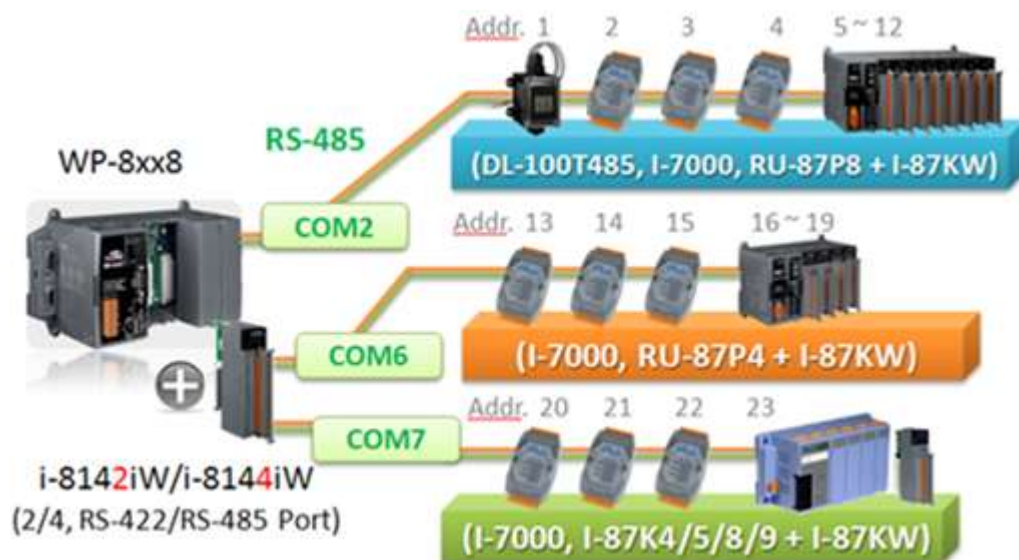

Before connecting "I-7000" or "I-87KW" remote DCON I/O modules, you must use "DCON Utility" software to configure each module for the Protocol (choose DCON mode), Address (1 ~ 255), Baudrate (the same with the Win-GRAF PAC, recommended set to 9600), Checksum (usually Disable), Data format and other Input/Output settings (set according to demand).

Note:

- A. When using the AI module of [I-7000](#) and [I-87KW](#), set the Data format to **"2's Complement"**.
E.g. I-7005, I-7013, I-7014D, I-7015, I-7016, I-7017R, I-7018Z, I-7019R, I-7033; I-87005W, I-87013W, I-87015W, I-87015PW, I-87016W, I-87017W, I-87017RCW, I-87017ZW, I-87017DW, I-87018W, I-87018RW, I-87018ZW, I-87019RW, I-87019ZW, and other Analog Input modules.
- B. When using the AO module of [I-7000](#) and [I-87KW](#), set the Data format to **"Engineering"**.
E.g. I-7021, I-7022, I-7024, I-7024R; I-87024W, I-87024UW, I-87024CW, I-87028UW, I-87028CW, I-87028VW, I-87028VW-20V, and other Analog Output modules.

"DCON Utility" is an easy-to-use software toolkit that help user search the network, configure the I/O modules and test the I/O status. Please visit the website to get the software program and user manual:


www.icpdas.com/products/dcon/introduction.htm

The following will introduce the setting method in the Win-GRAF Workbench.

8.1 Setting "DCON" I/O Boards


"DCON" can be used to enable an RS-485 Port to connect remote DCON I/O modules (e.g., I-7000 series modules, RU-87P8 I/O Expansion Unit + I-87KW I/O modules, or I-87K8 I/O Expansion Unit + I-87KW I/O modules). If want to enable more than one DCON Port, please set up multiple "DCON" I/O Boards. (One PAC can enable up to 16 "DCON".)

1. Click "Open I/Os" of the Win-GRAF tool bar to open the "I/O Boards" setting window.



2. Double click "Slot8" to add "DCON" I/O Boards (Refer [Chapter 4](#)), and then double click "DCON" to open the "Properties" window.

Note: The Slot 0 to Slot 7 are reserved for real I/O modules that plugged into the PAC, and the slot 8 or above are for other usage.

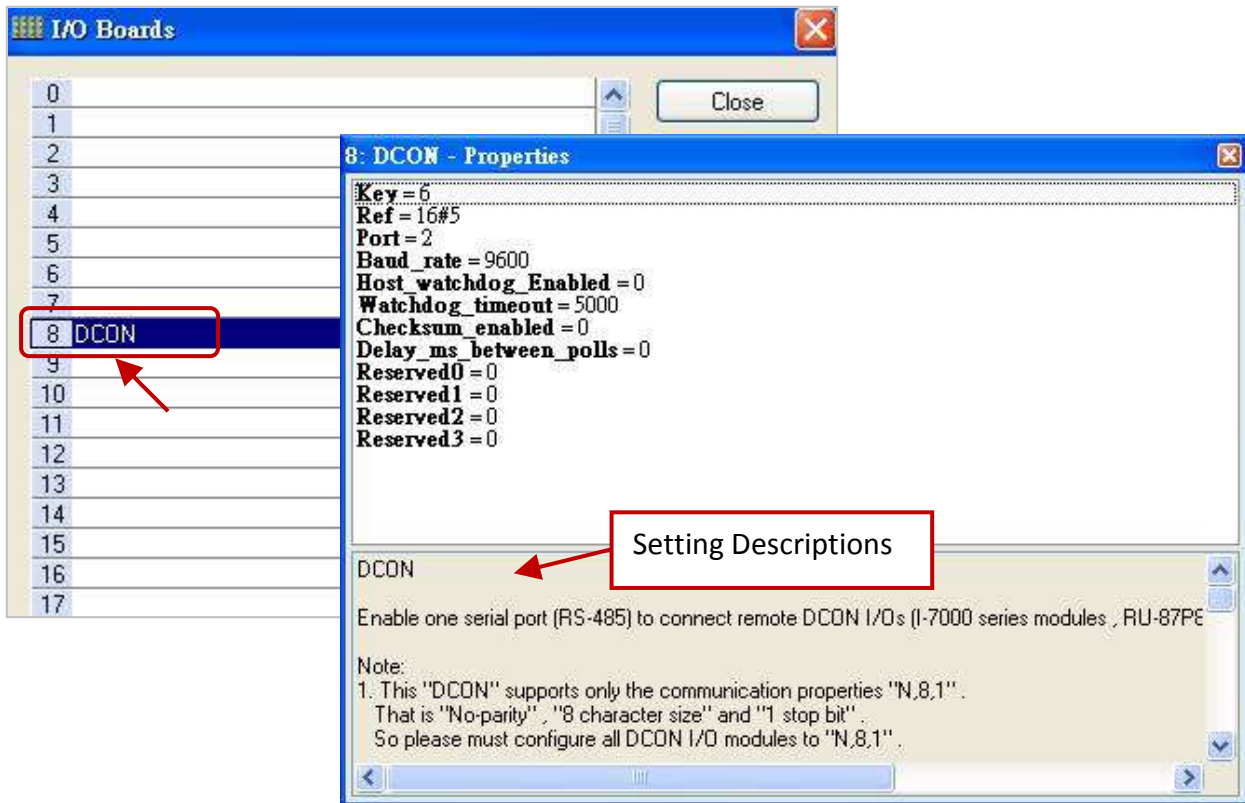

Parameters:

Note: This "DCON" supports only the communication properties "N,8,1". That is "No-parity", "8 character size" and "1 stop bit". So please must configure all DCON I/O modules to "N,8,1".

- Port:** COM port number (1 ~ 37, depends on the PAC.)
- Baud_rate:** Communication baudrate in bps, can be 1200, 2400, 4800, 9600, 19200, 38400, 57600, 115200 (bps). Set a wrong value will use the default value 9600.
- Host_watchdog_Enabled:** 1: enable host-watchdog, 0: disable it.
Set a nonzero value will use the value 1.
- Watchdog_timeout:** Unit: ms, can be 3000 ~ 25500.
Set larger than 25500 will use 25500 ms (25.5 sec).

Set smaller than 3000 will use 3000 ms (3 sec).
Ignore this setting when "Host_watchdog_Enabled" is 0.
0: disabled, 1: enabled.

Checksum_enabled:

Set a nonzero value will use the value 1.

Delay_ms_between_polls:

Unit: ms, default is 0 ms. Valid range is 0 ~ 1000.

Set smaller than 0 will use 0 ms.

Set larger than 1000 will use 1000 ms.

If there is no wireless module connected, set a smaller value.


For instance, set as 0 ~ 10.

If there are wireless modules (e.g., ICP DAS [ZigBee Products: ZigBee Converters or ZigBee I/O modules.](#)) connected, set a bigger value.


For instance, set a value between 30 ~ 100 or other values.

Set larger value will get slower polling efficiency.

3. Double click the item to be set, and then fill in the value.

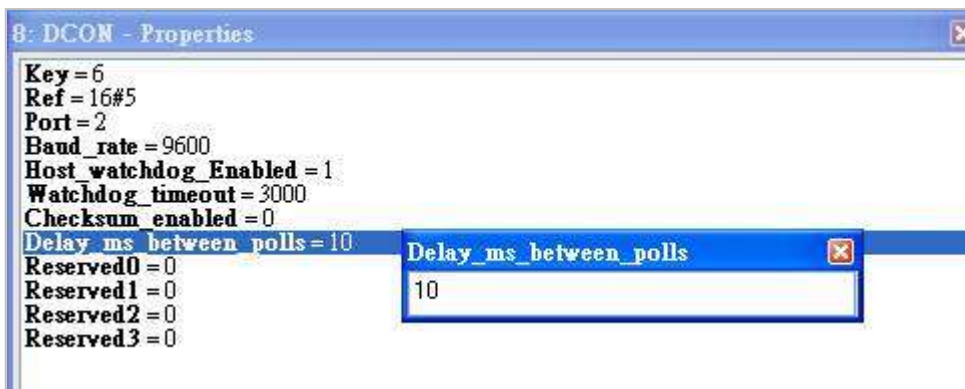


4. After setting up the "DCON" in the "I/O Boards" window, it will automatically add a "BOOL" input variable in the "Variables" window. When the Win-GRAF links to the PAC, it will show the COM Port communication status (TRUE: OK; FALSE: error.).

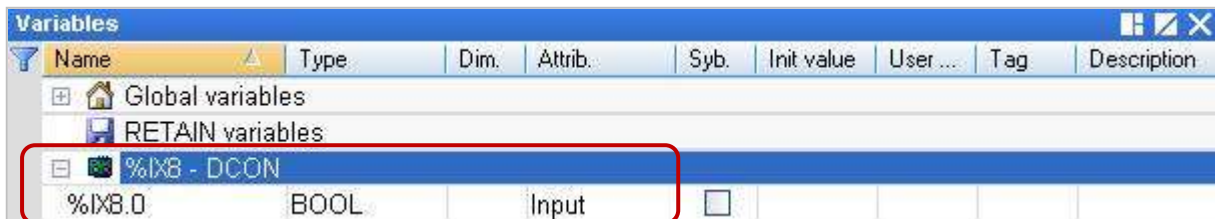


8.2 Using I/O Function Blocks

The Win-GRAF supports many ICP DAS DCON remote I/O modules, you can open the "Library Manager" (Refer [Section 1.2.3](#)) or press "F1" key in the "Function and FBs" to view these I/O Function Block descriptions. This section will introduce "D_7065", "D_7018Z", "D_7083", "D_87084_freq", "D_87084_cnt4", "D_87084_cnt8", and "DL_100T485" I/O Function Blocks.

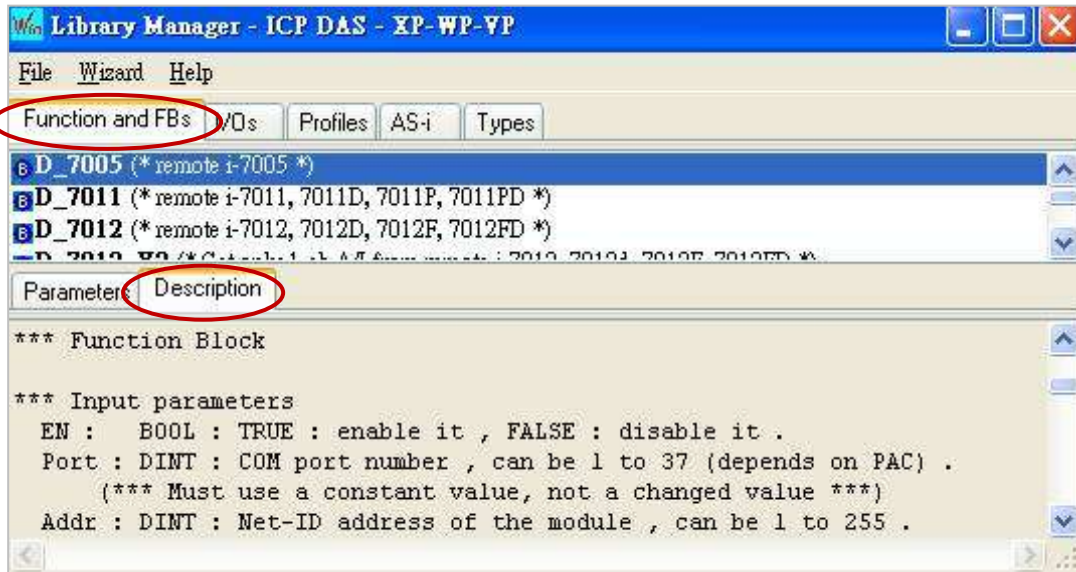

In the LD Program - Functional Block area, expand the "ICP DAS - XP-WP-VP" folder of the "Blocks" panel. There are many Functions and Function Blocks. You can select the desired one, and drag it into the editing area of the program.

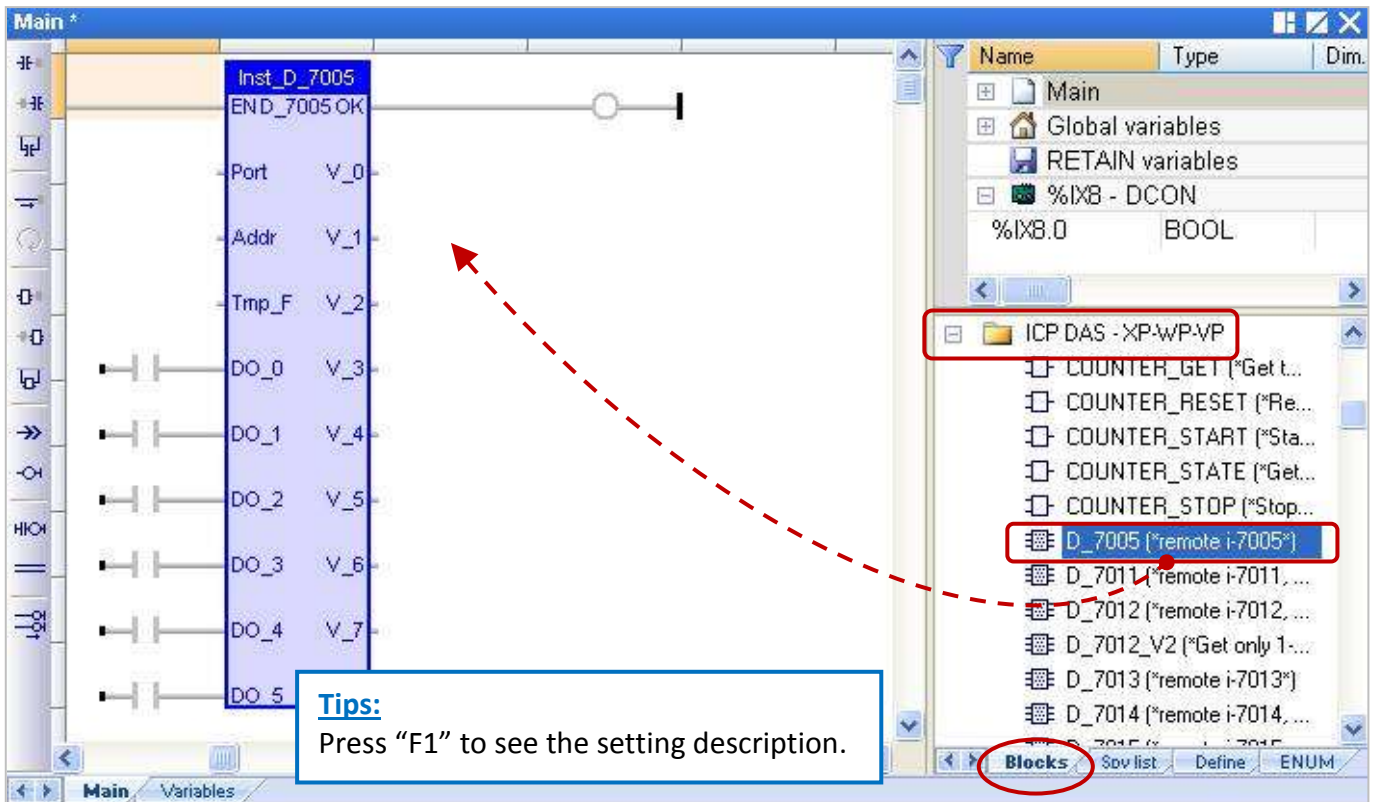


8.2.1 “D_7065” Function Block

“D_7065”: Connect a remote I-7065, I-7065D (Power Relay Output Module) or I-7065A, I-7065AD, I-7065B, I-7065BD (Solid State Relay Output Module).

Note:

1. All connected DCON I/O modules should be configured once by the DCON Utility (see [P8-1](#)).
2. Please use "DCON"([Section 8.1](#)) in the "I/O boards" window and set proper settings (Port, baud_rate, etc.) on it.
3. All values of DI channels are meaningful only when the returned communication state is TRUE (If "OK" returns "TRUE").
4. Referring [Chapter 12](#), click the menu bar "File" > "Add Existing Project" > "From Zip" to restore the demo project (CD-ROM: \Napdos\Win-GRAF\demo-project\DEMO_D_7065.zip) in the shipping CD and see the program and descriptions.

Supposition: Use PAC’s COM2 to connect the I-7065 (Addr. = 2) with 4 DI and 5 Relay output channels.

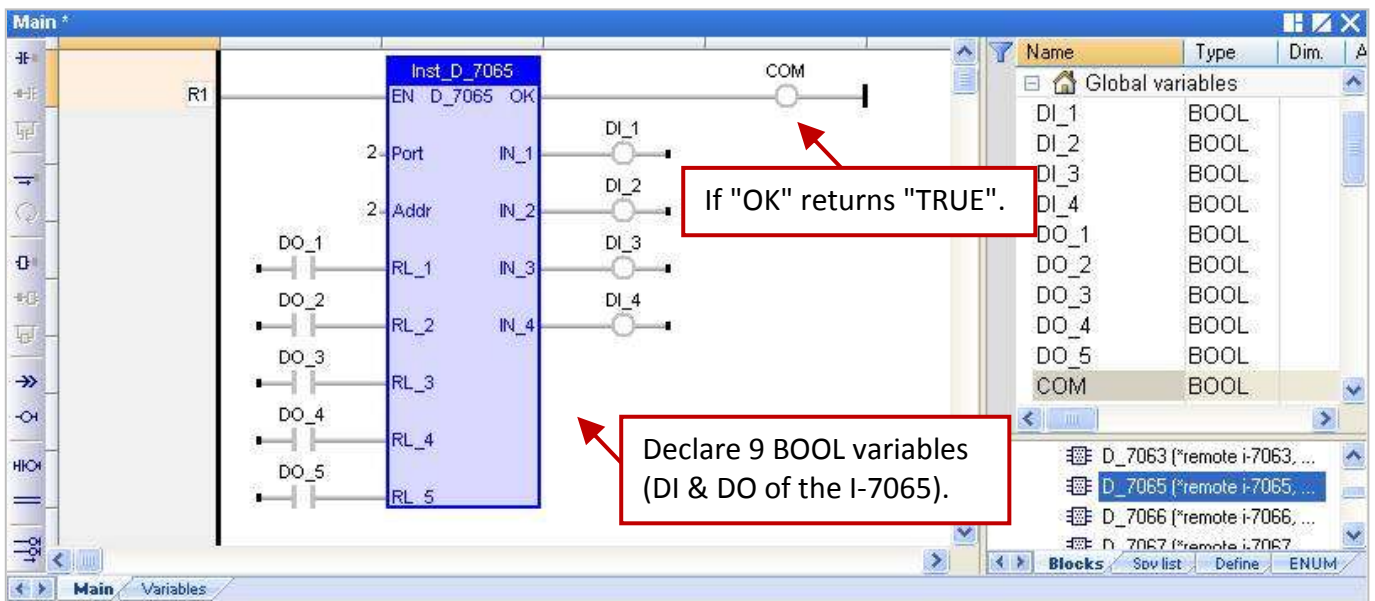

Input Parameters:

- EN:** Data type: BOOL. TRUE: enable it; FALSE: disable it.
- Port:** Data type: DINT. COM port number (can be 1 to 37, depends on PAC). (** Must use a constant value, cannot be a changed value. **)
- Addr:** Data type: DINT. The Net-ID address of the module, can be 1 to 255. (** Must use a constant value, not a changed value **)
- RL_1 ~ RL_5:** Data type: BOOL. 5-Ch DO values.

Output Parameters:

- OK:** Data type: BOOL. TRUE: Communication is Ok. FALSE: Communication failed.
- IN_1 ~ IN_4:** Data type: BOOL. 4-Ch DI values.


8.2.2 “D_7018Z” Function Block

“D_7018Z”: Connect a remote I-7018Z module that is a 10-channel Thermocouple analog input module for measuring voltage, current or temperature with features of individual channel configuration, open-wire detection and over Voltage protection.

Note:

1. All connected DCON I/O modules should be configured once (e.g., Address, Baudrate, etc.) by the DCON Utility (see [P8-1](#)). Please must configure the data format of AI modules to "2's complement" by DCON utility, or the Win-GRAF PAC can not read them well.
2. Please use "DCON"([Section 8.1](#)) in the "I/O boards" window and set proper settings (Port, baud_rate, etc.) on it.
3. All values of AI channels are meaningful only when the returned communication state is TRUE (If "OK" returns "TRUE".).
4. Referring [Chapter 12](#), click the menu bar "File" > "Add Existing Project" > "From Zip" to restore the demo project (CD-ROM: \Napdos\Win-GRAF\demo-project\DEMO_D_7018z.zip) in the shipping CD and see the program and descriptions.

Supposition: Use PAC’s COM2 to connect the I-7018Z (Addr. = 3) to measure the Celsius temperature.

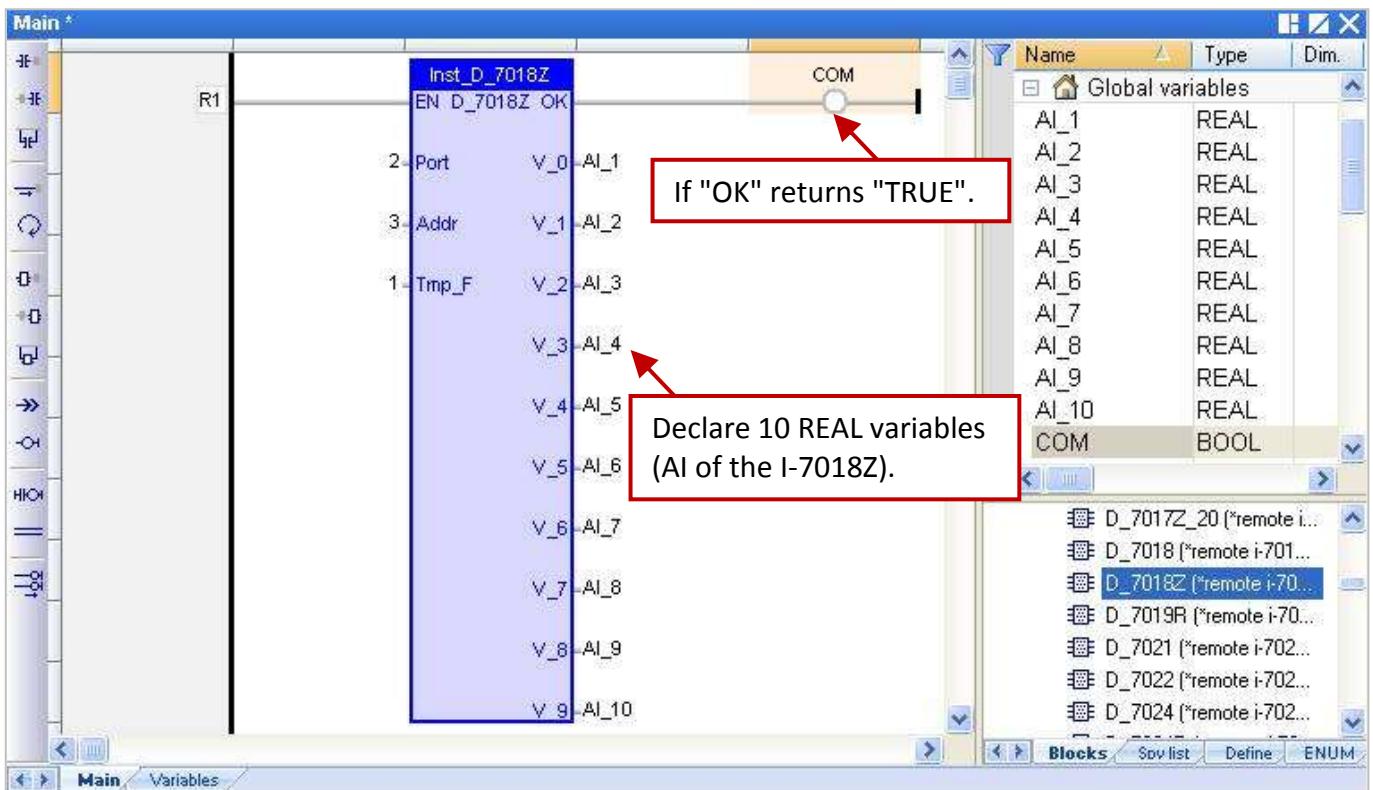

Input Parameters:

- EN:** Data type: BOOL. TRUE: enable it; FALSE: disable it.
- Port:** Data type: DINT. COM port number (can be 1 to 37, depends on PAC).
(***) Must use a constant value, cannot be a changed value. (***)
- Addr:** Data type: DINT. The Net-ID address of the module, can be 1 to 255.
(***) Must use a constant value, not a changed value (***)
- Tmp_F:** Data type: DINT. Temperature Format, can be 1 or 2:
1 : temperature unit in Degree Celsius.
2 : temperature unit in Degree Fahrenheit.
Other value: use it as "1:temperature unit in Degree Celsius".

Output Parameters:

OK: Data type: BOOL. TRUE: Communication is Ok. FALSE: Communication failed.

V_0 ~ V_9: Data type: REAL. 10-Ch AI value.

If the channel range type is configured as mV or Volt by DCON utility, the unit of the returned channel value is Volt.

For example, 0.85421 means 0.85421 V or 854.21 mV.

If the channel range type is configured as mA by DCON utility, the unit of the returned channel value is mA.

For example, 1.5567 means 1.5567 mA .

If the channel range type is configured as temperature, the value unit is degree.

For example, 25.75 means 25.75 degrees.

Open-wire Detection:

If the returned temperature is greater than "9000.0", it means that

1. The temperature sensor may be broken-line.
2. The temperature sensor may be damaged.
3. The DCON module is not configured well to fit the connected temperature sensors.
4. The ohm measured by the connected sensor is not correct.


8.2.3 "D_7083" Function Block

"D_7083": Connect a remote I-7083, I-7083D, I-7083B or I-7083BD module that is a 3-axis, 32 bits encoder counter.

Note:

1. To get the Encoder value of the I-7083, I-7083D, I-7083B and I-7083BD module, first using "D_7083" Function Block. Then, using the "Counter_Start", "Counter_Stop", "Counter_Get", "Counter_State" and "Counter_Reset" Functions (Refer [Section 4.9](#)) to operate encoder channels in an I-7083, I-7083D, I-7083B and I-7083BD module.
2. All connected DCON I/O modules should be configured once (e.g., Address, Baudrate, etc.) by the DCON Utility (see [P8-1](#)). Please must configure the data format of AI modules to "2's complement" by DCON utility, or the Win-GRAF PAC can not read them well.
3. Please use "DCON"([Section 8.1](#)) in the "I/O boards" window and set proper settings (Port, baud_rate, etc.) on it.
4. All values of AI channels are meaningful only when the returned communication state is TRUE (If "OK" returns "TRUE").
5. Referring [Chapter 12](#), click the menu bar "File" > "Add Existing Project" > "From Zip" to restore the demo project (CD-ROM: \Napdos\Win-GRAF\demo-project\DEMO_D_7083.zip) in the shipping CD and see the program and descriptions.

Supposition: Use PAC's COM2 to connect the I-7083 (Addr. = 4) with 3 DI channels.

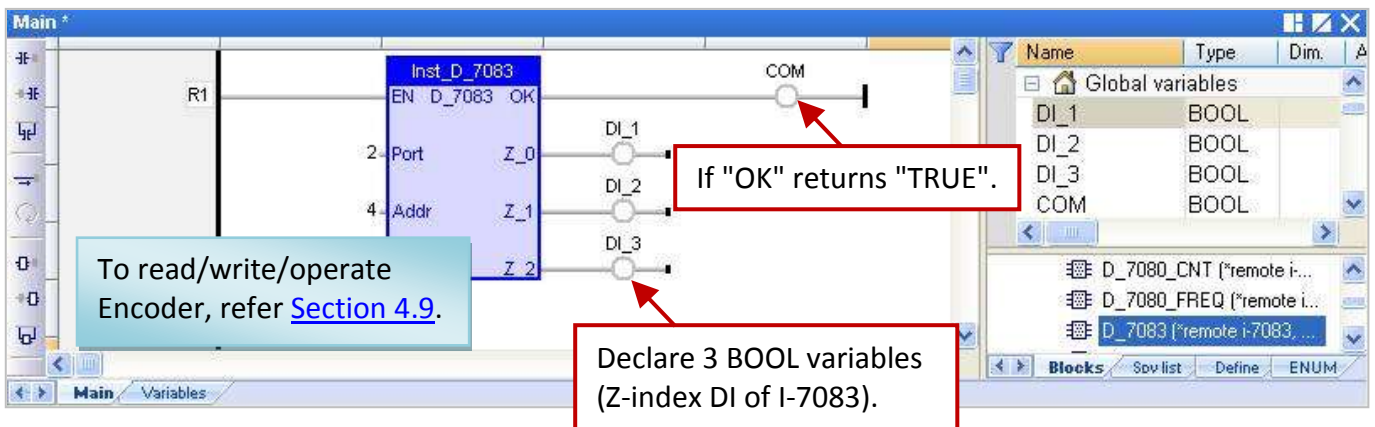

Input Parameters:

- EN:** Data type: BOOL. TRUE: enable it; FALSE: disable it.
- Port:** Data type: DINT. COM port number (can be 1 to 37, depends on PAC). (** Must use a constant value, cannot be a changed value. **)
- Addr:** Data type: DINT. The Net-ID address of the module , can be 1 to 255. (** Must use a constant value, not a changed value **)

Output Parameters:

- OK:** Data type: BOOL. TRUE: Communication is Ok. FALSE: Communication failed.
- Z_0 ~ Z_2:** Data type: BOOL. 3-ch Z-index DI value.


8.2.4 "D_87084_FREQ" Function Block

"D_87084_freq": Connect a remote I-87084W in an I/O Expansion Unit (e.g., I-87K4/5/8/9 or RU-87P4 or RU-87P8.) to measure 8-ch frequency.

Note:

1. Please **MUST** configure the I-87084W's frequency data format as "**Hex format**" by DCON utility (see [P8-1](#)) when using the I-87084W to measure frequency. Or it will not work.
2. Please use "DCON" ([Section 8.1](#)) in the "I/O boards" window and set proper settings (Port, baud_rate, etc.) on it.
3. All values of AI channels are meaningful only when the returned communication state is TRUE (If "OK" returns "TRUE").
4. Referring [Chapter 12](#), click the menu bar "File" > "Add Existing Project" > "From Zip" to restore the demo project (CD-ROM: \Napdos\Win-GRAF\demo-project\DEMO_D_87084_FR.zip) in the shipping CD and see the program and descriptions.

Supposition: Use PAC's COM2 to connect the I-87084W (Addr. = 5) to measure 8-ch frequency.

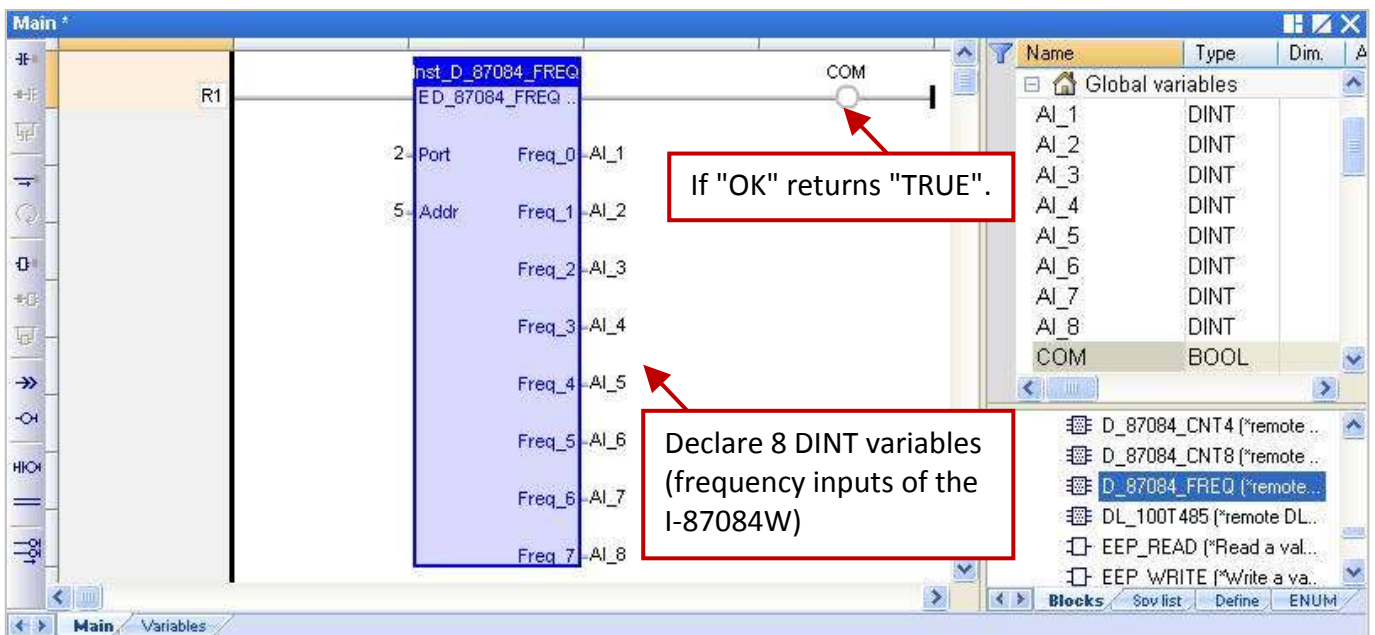

Input Parameters:

- EN:** Data type: BOOL. TRUE: enable it; FALSE: disable it.
- Port:** Data type: DINT. COM port number (can be 1 to 37, depends on PAC). (** Must use a constant value, cannot be a changed value. **)
- Addr:** Data type: DINT. The Net-ID address of the module, can be 1 to 255. (** Must use a constant value, not a changed value **)

Output Parameters:

- OK:** Data type: BOOL. TRUE: Communication is Ok. FALSE: Communication failed.
- Freq_0 ~ Freq_7:** Data type: DINT. 8-Ch frequency value, unit is Hz.


8.2.5 "D_87084_CNT4" Function Block

"D_87084_CNT4": Connect a remote I-87084W in an I/O Expansion Unit (e.g., I-87K4/5/8/9 or RU-87P4 or RU-87P8.) to measure 4-ch counters.

Note:

1. Please **MUST** configure the I-87084W's counter data format as "**Hex format**" by DCON utility (see [P8-1](#)) when using the I-87084W to measure counters. Or it will not work.
2. Please use "DCON" ([Section 8.1](#)) in the "I/O boards" window and set proper settings (Port, baud_rate, etc.) on it.
3. To get the 4-ch counter value from the remote I-87084W, first using "D_87084_cnt4" Function Block. Then, using the "Counter_Start", "Counter_Stop", "Counter_Get", "Counter_State" and "Counter_Reset" Functions (refer [Section 4.9](#)) to operate counter channels.
4. All values of AI channels are meaningful only when the returned communication state is TRUE (If "OK" returns "TRUE").
5. Referring [Chapter 12](#), click the menu bar "File" > "Add Existing Project" > "From Zip" to restore the demo project (CD-ROM: \Napdos\Win-GRAF\demo-project\DEMO_D_87084_C4.zip) in the shipping CD and see the program and descriptions.

Supposition: Use PAC's COM2 to connect the I-87084W (Addr. = 6) to measure 4-ch counters.

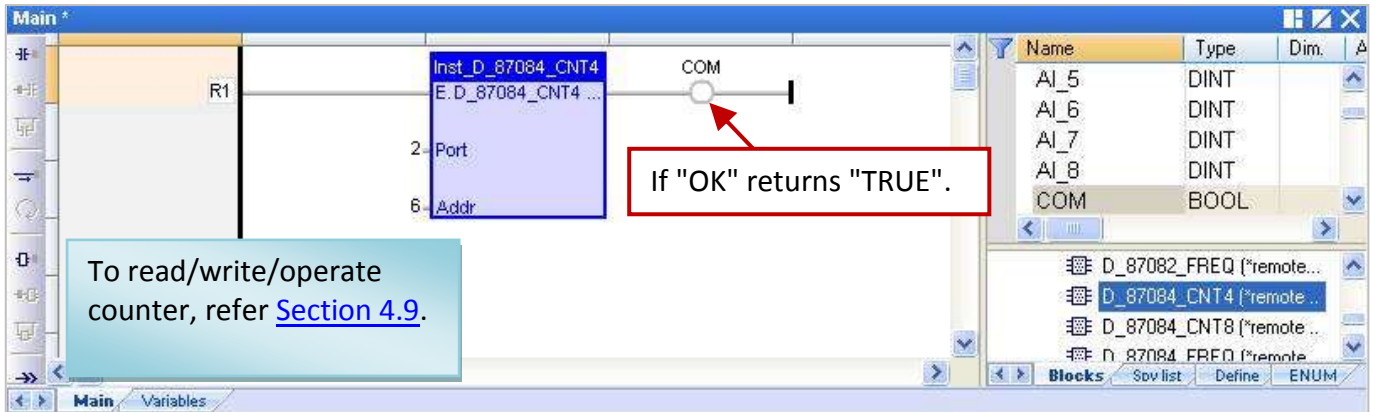

Input Parameters:

- EN:** Data type: BOOL. TRUE: enable it; FALSE: disable it.
- Port:** Data type: DINT. COM port number (can be 1 to 37, depends on PAC). (** Must use a constant value, cannot be a changed value. **)
- Addr:** Data type: DINT. The Net-ID address of the module, can be 1 to 255. (** Must use a constant value, not a changed value **)

Output Parameters:

- OK:** Data type: BOOL. TRUE: Communication is Ok. FALSE: Communication failed.


8.2.6 "D_87084_CNT8" Function Block

"D_87084_CNT8": Connect a remote I-87084W in an I/O Expansion Unit (e.g., I-87K4/5/8/9 or RU-87P4 or RU-87P8) to measure 8-ch counters.

Note:

1. Please **MUST** configure the I-87084W's counter data format as "**Hex format**" by DCON utility (see [P8-1](#)) when using the I-87084W to measure counters. Or it will not work.
2. Please use "DCON" ([Section 8.1](#)) in the "I/O boards" window and set proper settings (Port, baud_rate, etc.) on it.
3. To get the 8-ch counter value from the remote I-87084W, first using "D_87084_cnt8" Function Block. Then, using the "Counter_Start", "Counter_Stop", "Counter_Get", "Counter_State" and "Counter_Reset" Functions (refer [Section 4.9](#)) to operate counter channels.
4. All values of AI channels are meaningful only when the returned communication state is TRUE (If "OK" returns "TRUE".).
5. Referring [Chapter 12](#), click the menu bar "File" > "Add Existing Project" > "From Zip" to restore the demo project (CD-ROM: \Napdos\Win-GRAF\demo-project\DEMO_D_87084_C8.zip) in the shipping CD and see the program and descriptions.

Supposition: Use PAC's COM2 to connect the I-87084W (Addr. = 7) to measure 8-ch counters.

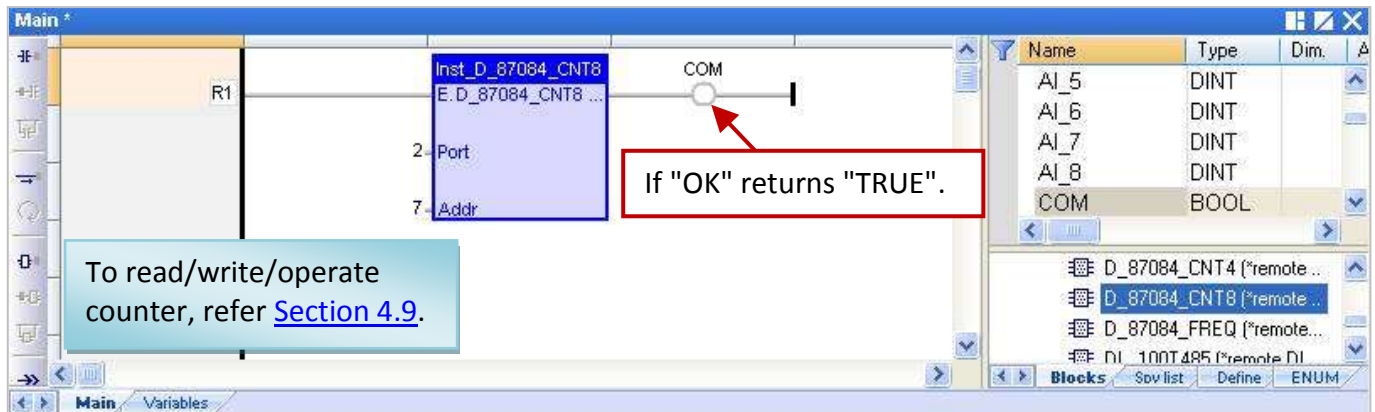

Input Parameters:

- EN:** Data type: BOOL. TRUE: enable it; FALSE: disable it.
- Port:** Data type: DINT. COM port number (can be 1 to 37, depends on PAC). (** Must use a constant value, cannot be a changed value. **)
- Addr:** Data type: DINT. The Net-ID address of the module, can be 1 to 255. (** Must use a constant value, not a changed value **)

Output Parameters:

- OK:** Data type: BOOL. TRUE: Communication is Ok. FALSE: Communication failed.

8.2.7 "DL_100T485" Function Block


"DL_100T485": Connect a remote DL-100T485 module to get humidity and temperature value.

Product website: http://www.icpdas.com/root/product/solutions/remote_io/rs-485/dl_series/dl-100t485.html

Note:

1. Please use "DL-100T485 Utility" software in the shipping CD to configure the appropriate parameters of the module (e.g., Module ID). The TDL-100T485's default Address (ID) is "1", Baudrate is "9600", and the Checksum is "Disable".
2. Please use "DCON"(Section 8.1) in the "I/O boards" window and set proper settings (Port, baud_rate, etc.) on it.
3. All values of AI channels are meaningful only when the returned communication state is TRUE (If "OK" returns "TRUE".).
4. Referring Chapter 12, click the menu bar "File" > "Add Existing Project" > "From Zip" to restore the demo project (CD-ROM: \Napdos\Win-GRAF\demo-project\ DEMO_DL_100T485.zip) in the shipping CD and see the program and descriptions.

Supposition: Use PAC's COM2 to connect the DL_100T485 (Addr. = 1) to get humidity and temperature value.

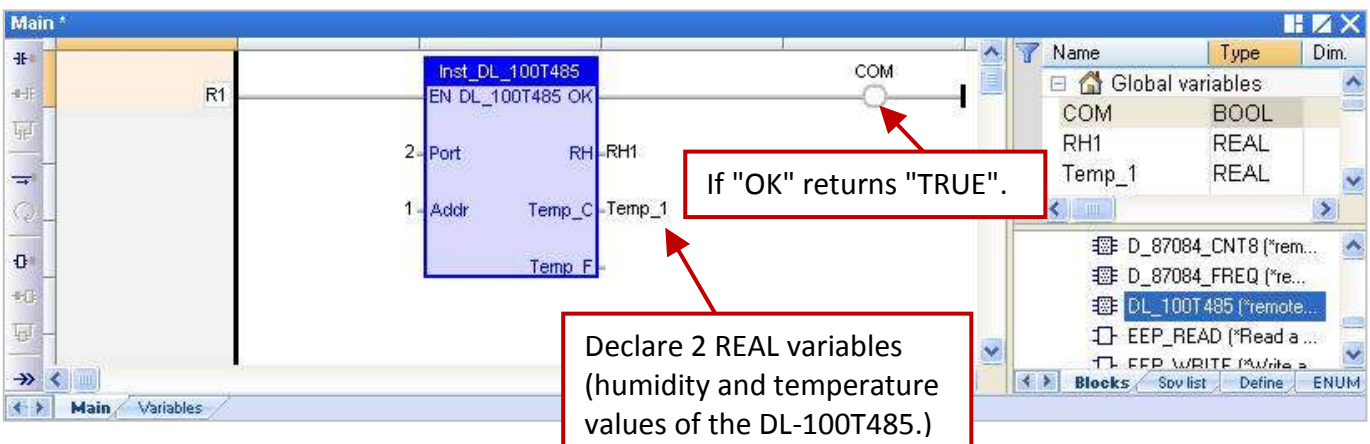

Input Parameters:

- EN:** Data type: BOOL. TRUE: enable it; FALSE: disable it.
- Port:** Data type: DINT. COM port number (can be 1 to 37, depends on PAC).
(*** Must use a constant value, cannot be a changed value. ***)
- Addr:** Data type: DINT. The Net-ID address of the module, can be 1 to 255.
(*** Must use a constant value, not a changed value ***)

Output Parameters:

- OK:** Data type: BOOL. TRUE: Communication is Ok. FALSE: Communication failed.
- RH:** Data type: REAL. The value is "Relative humidity"; unit is 1%.
For example, a value "45.7" means 45.7%.
- Temp_C:** Data type: REAL. The temperature value is in "Degree Celsius".
For example, a value "25.7" means 25.7 Degree C.
- Temp_F:** Data type: REAL. The temperature value is in "Degree Fahrenheit".
For example, a value "78.26" means 78.26 Degree F.