



USER MANUAL

Longo programmable controller LPC-2.P01 special module

Version 8



Written by SMARTEH d.o.o. Copyright © 2012, SMARTEH d.o.o.

User manual

Document Version: 008

July 1, 2012





STANDARDS AND PROVISIONS: Standards, recommendations, regulations and provisions of the country in which the devices will operate, must be considered while planning and setting up electrical devices. Work on 230 VAC network is allowed for authorized personnel only.

DANGER WARNINGS: Devices or modules must be protected from moisture, dirt and damage during transport, storing and operation.

WARRANTY CONDITIONS: For all modules LONGO LPC-2 – if no modifications are performed upon and are correctly connected by authorized personnel – in consideration of maximum allowed connecting power, we offer warranty for 24 months from date of sale to end buyer. In case of claims within warranty time, which are based on material malfunctions the producer offers free replacement. The method of return of malfunctioned module, together with description, can be arranged with our authorized representative. Warranty does not include damage due to transport or because of unconsidered corresponding regulations of the country, where the module is installed.

This device must be connected properly by the provided connection scheme in this manual. Misconnections may result in device damage, fire or personal injury.

Hazardous voltage in the device can cause electric shock and may result in personal injury or death.

NEVER SERVICE THIS PRODUCT YOURSELF!

This device must not be installed in the systems critical for life (e.g. medical devices, aircrafts, etc.).

If the device is used in a manner not specified by the manufacturer, the degree of protection provided by the equipment may be impaired.


Waste electrical and electronic equipment (WEEE) must be collected separately!

LONGO LPC-2 complies to the following standards:

- EMC:EN 61000-6-2 (EN 50082), EN 61000-6-4 (EN 50081)
- LVD: IEC 61131-2
- Vibrations and climatic-mechanical: EN 60068-2-6, EN 60068-2-27, EN 60068-2-29

Smarteh d.o.o. operates a policy of continuous development. Therefore we reserve the right to make changes and improvements to any of the products described in this manual without any prior notice.

MANUFACTURER: SMARTEH d.o.o. Trg tigrovcev 1 5220 Tolmin Slovenia









Index

Longo programmable controller LPC-2.P01 special module

1 DESCRIPTION		
3 INSTALLATION	1 DESCRIPTION	1
3.1 Connection scheme	2 FEATURES	3
3.2 Mounting instructions	3 INSTALLATION	4
5 TECHNICAL SPECIFICATIONS	3.1 Connection scheme	6 8
6 PROGRAMMERS GUIDE11 CHANGES12	4 REGULATION DIAGRAM	g
CHANGES14	5 TECHNICAL SPECIFICATIONS	10
	6 PROGRAMMERS GUIDE	11
NOTES15	CHANGES	14
	NOTES	15





1 DESCRIPTION

LPC-2.P01 control panel special module is used for room temperature regulation.

Controller is equipped with temperature sensor, light intensity sensor and three push buttons: "WARMER - ▲", "COOLER - ▼" and "FAN". To increase temperature set point "WARMER" push button is used and to decrease "COOLER" push button is used. With "FAN" push button constant I, II, III or AUTO fan command can be set and the controller can also be switched off. Temperature set point and fan command or controller switched off is represented with two LED bar-graphs (refer to the Table 3). Light intensity sensor is primary used for LED bar-graph intensity control, so LEDs do not disturb customer during the night if desired.

LPC-2.P01 has many integrated settings and functions which allows adaptation to required system and regulation diagram. Settings can be done and functions can be enabled or disabled using LPC Manager software.

Maximum and minimum temperature set point range can be set to scale temperature set point. Default range is between 18 °C and 24 °C.

If economic function is set, controller will start cooling when room temperature will raise above max. temperature set point and stop when temperature will drop 1 °C below max. temperature set point. On the other hand, when room temperature will fall below min. temperature set point controller will start heating and stop when temperature will raise 1 °C above min. temperature set point.

When four pipe (default) system is selected, controller will activate hot command when heating and cool command when cooling is required. In case of two pipe system selection, hot command is always activated when heating or cooling is required (depends on heating or cooling mode selection). For example that two pipe system, cooling mode is selected and room temperature is higher than temperature set point on the control panel, controller will activate cooling with hot command (cool command is off if heating or cooling is required).

In case that balcony door and/or window function is enabled and door and/or window contact is opened, fan will go to the first (I) speed and valves for heating or cooling will be closed.

Frost protection function activates heat command when room temperature measured by the panel drops below 5 °C. This function has priority over all control panel integrated functions.

LPC-2.P01 control panel is possible to switch off using "FAN" push button or off command is set from LPC Manager software. In this case cool, heat and fan commands are switched off. Cool and heat commands are also switched off when temperature measured by the panel is inside dead band (default = 0.5 °C) temperature values.

Control panel PI regulator output variable range is 0 to 10000. Values from 4999 down to 0 represents cooling and vales from 5000 up to 10000 represents heating.

Example: If proportional – P parameter (default = 25) is set to 1 and difference between measured temperature and temperature set point is +1 °C, the control panel regulator output value will be 5100. On the other hand if the difference is -1 °C, the control panel regulator output value will be 4900.

If integral – I parameter (default = 5) is set to 1 and difference between measured temperature and temperature set point is +1 °C, the control panel regulator output will increase every second by 100. On the other hand if the difference is -1 °C, the control panel regulator output will decrease every second by 100.





LPC-2.P01 is connected to the main control unit RS485 port using interconnection cable (e.g. SIC4-7) which must be ordered together with LPC-2.P01 special module. When more modules (e.g. LPC-2.ID1, LPC-2.ID2, LPC-2.P01 or up to four LPC-2.P01) are connected to main control unit, splitter (e.g. SPL-2) is also required (refer to the Figure 2).

LPC-2.P01 module RS485 address (0..3) is selected through two switches on the back side of the module (refer to the Table 4).

NOTE: For proper system configuration and data allocation please refer to LPC Composer software help menu.







2 FEATURES



Figure 1: LPC-2.P01 special module

Table 1: Technical data

Temperature measurement (room temperature)

2 push buttons for temperature set point

1 push button for manual fan speed, auto and controller off

12 LED bar-graph for temperature set point

4 LED bar-graph for manual/auto fan speed setting

Light intensity measurement

LED intensity control

Step-less or 3 step fan motor controlling

Economic function

Two / four pipe heating cooling system supported

Balcony door and window function

Frost protection function

Power LED

Internal fault LED

Interconnection cable SIC4-7 not included





3 INSTALLATION

3.1 Connection scheme

Figure 2: Connection scheme

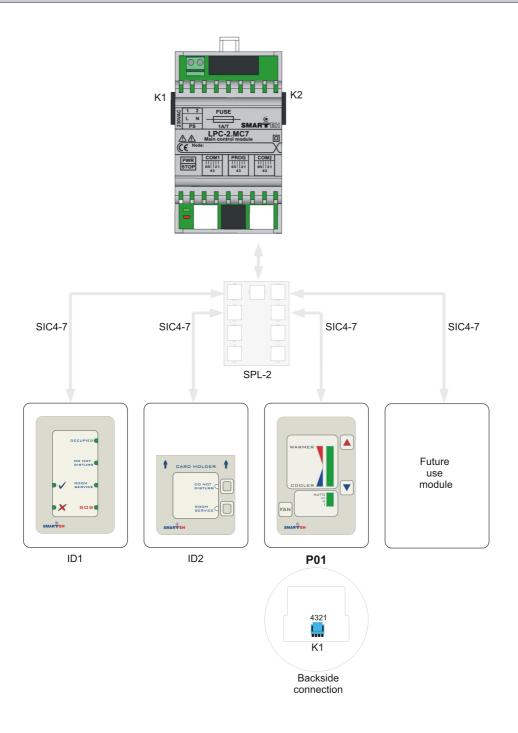






Table 2: K1		
K1.1	GND	Ground
K1.2	9 VDC	Power supply input
K1.3	Standard RS485 A	Data receive/send line A
K1.4	Standard RS485 B	Data receive/send line B

Table 3: LEDs & Butto	ns	
Power LED (on the upper side of the module)	Green LED: indicates power supply status	On: power supply OK Off: power supply missing or power off
Internal fault LED (on the upper side of the module)	Red LED: indicates LPC-2.ID1 communication state	On: RS485 communication fault Off: RS485 communication OK
Temperature set point LED bar-graph	Green LEDs: indicates actual temperature set point between min. and max. Temperature set point range	On: represents actual set point
Fan LED bar-graph	Green LEDs: indicates man. fan speed, auto or controller off selection	On: represents selected man. fan reference or auto mode Off: controller off command
WARMER	Push button: set point increase command	Set point increased by one step when pressed ¹
COOLER	Push button: set point decrease command	Set point decreased by one step when pressed ¹


Table 4: S1		
RS485 ADDRESS	Switch 1	Switch 2
0	OFF	OFF
1	OFF	ON
2	ON	OFF
3	ON	ON






3.2 Mounting instructions

Figure 3: Housing dimensions



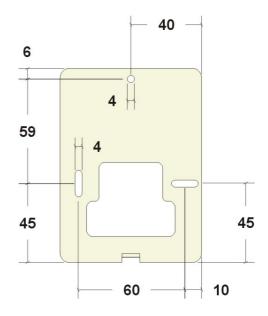

Dimensions in millimeters.



All connections, module attachments and assembling must be done while module is not connected to the main power supply.



The LPC-2.P01 module should be positioned on the wall inside the room. It is advised to avoid direct sunlight or position near heating/cooling source object. Round flush-mounting box (e.g. Gewiss GW 24232), Φ 60 mm is recommended for installation. A box must be installed with screw holes in the horizontal position!

Mounting instructions:

- 1. Mount LPC-2.P01 module back plate to the provided leveled place on the wall.
- 2. Fasten 2 screws (DIN 7981 or similar, Φ3 mm, **max. head height 3 mm**) to fix LPC-2.P01 module to its place.
- 3. Connect interconnection cable to the interconnection connector K1. Max. allowed tractive force is 30 N.
- 4. Set the correct RS485 address (S1 switch) for LPC-2.P01 (refer to the Table 4).
- 5. Power (PWR) green LED should switch on according to the Table 5.
- 6. Mount LPC-2.P01 module front plate to the back plate.
- 7. Fasten the screw in the bottom carefully (not too strong), to fix the front plate to the back plate.

NOTE: LPC-2.MC3 main control module should be powered separately from other electrical appliance connected to LPC-2 system. Signal wires must be installed separately from







power and high voltage wires in accordance with general industry electrical installation standard.





3.3 Module labeling

Figure 5: Labels on housing

Label 1:

LPC-2.MC3
P/N:225MC304001001
D/C:16/05

Label 2:

S/N:MC3-S9-0500000190

Label 1 description:

- 1. **LPC-2.MC3** is the full product name.
- 2. **P/N:225MC3040001001** is the part number.
 - 225 general code for LPC-2 product family,
 - MC3 short product name,
 - **04001** sequence code,
 - 04 year of code opening
 - 001 derivation code
 - **001** version code (reserved for future HW and/or SW firmware upgrades).
- 3. **D/C:16/05** is the date code.
 - 16 week and
 - **05** year of production.


Label 2 description:


- 1. **S/N:MC3-S9-0500000190** is the serial number.
 - MC3 short product name,
 - S9 user code (test procedure, e.g. Smarteh person xxx),
 - 0500000190 year and current stack code,
 - 05 year (last two cyphers)
 - 00000190 current stack number; previous module would have the stack number 00000189 and the next one 00000191.






4 REGULATION DIAGRAM

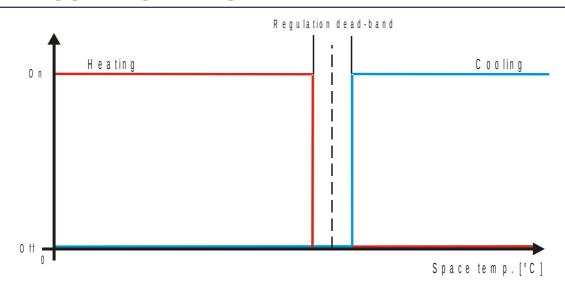

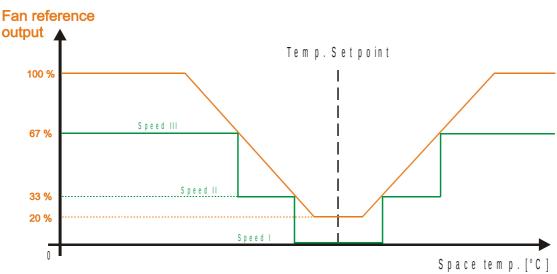

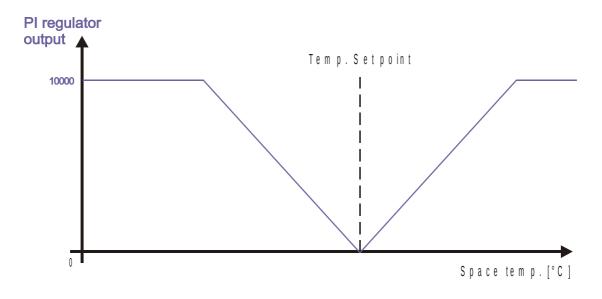







5 TECHNICAL SPECIFICATIONS

from main control unit (LPC-2.MC7)
Berg M
0.5 W
±1 °C
80 x 110 x 17 mm
80 g
2000 m
vertical
0 to 50 °C
max. 95 %, no condensation
-20 to 60 °C
IP 30





6 PROGRAMMERS GUIDE

Brief description

LPC-2.P01 control panel module is used for room temperature regulation. This module must be connected to LPC-2.C04 module. The RS485 address for an P01 module can be set from 0 to 3. The address is set through two switches on the back side of the module. It has many integrated settings and functions which allows adaptation to required system and regulation diagram. Settings can be done and functions can be enabled or disabled through LPC Manager software.

Variables

There are 22 bytes available for reading and writing from/to P01 module. While whole frame of 26 bytes is transferred at a time, LPC Manager variables described in the table below are accessed separately.

VBOOL8 (#N)		
variable	range	
Comm. status		
Normal / Economy mode	_	
Local / Remote status	_	
Hot valve status	0.1	
Cold valve status	01	
System status	_	
Change-over function status	_	
2/4 pipe status	_	

VBOOL8 (#N+1)	
variable	range
Fan speed I status	
Fan speed II status	
Fan speed III status	
BIT3	01
Fan speed mode	01
BIT5	
Enab./Dis. balcony status	
Enab./Dis. window status	





VBOOL8 (#N+2)		
variable	range	
BIT0		
Normal / Economy command		
Local / Remote command		
BIT3	0.1	
BIT4	01	
Start/Stop command		
Change-over command		
2/4 pipe command		

VBOOL8 (#N+3)		
variable	range	
BIT0		
BIT1		
BIT2		
BIT3	0.1	
Balcony door status	01	
Window switch status	-	
Enab./Dis. balcony door cmd.		
Enab./Dis. window command		

VWORD16 (#N+4)		
variable	range	
Max. temperature status [°C/°Fx100]	010000	
Min. temperature status [°C/°Fx100]	010000	
P regulation status	0100	
l regulation status	0100	
PI deadband status [°C/°Fx100]	010000	
Fan speed reference	010000	
Temperature setpoint [°C/°Fx100]	010000	
Space temperature [°C/°Fx100]	010000	
Absolute PI reference	010000	
Light intensity [%]	0100	

VWORD16 (#N+5)		
variable	range	





VWORD16 (#N+5)		
Max. temperature setpoint [°C/°Fx100]	010000	
Min. temperature setpoint [°C/°Fx100]	010000	
P regulation param.	0100	
l regulation param.	0100	
PI deadband parameter [°C/°Fx100]	010000	
Min. light intensity param. [%]	0100	
Remote setpoint [°C/°Fx100]	010000	
WORD8	1	
WORD9	I	
WORD10	I	

Accessing P01 module

Read LPC-2 Programmers guide for details.







CHANGES

The following table describes all the changes to the document.

Date	V.	Description
1.7.2012	800	CGP General update.
11.5.2010	007	Updated warranty permanence.
2.8.2007	006	updated echnical specificationsupdated description about connecting to main control unit
26.4.2007	005	connection scheme updatedupdated power supply source
25.4.2007	004	updated power supply sourceupdated connection scheme
31.3.2006	003	The initial version, issued as LPC-2.P01 module UserManual.







NOTES

