

VDISPLAY

OLED Remote Keypad Option Module

User Guide

Installation and Operating Instructions



Trans-Power

DECLARATION

All rights reserved. No part of this User Guide may be reproduced or transmitted in any form or by any means, electrical or mechanical including photocopying, recording or by any information storage or retrieval system without permission in writing from the publisher.

The manufacturer accepts no liability for any consequences resulting from inappropriate, negligent or incorrect installation, or adjustment of the optional operating parameters of the drive or from mismatching of the drive to the motor.

The contents of this User Guide are believed to be correct at the time of printing. In the interests of a commitment to a policy of continuous improvement, the manufacturer reserves the right to change the specification of the product or its performance or the contents of the User Guide without notice.

WARRANTY

The product carries a 2-year warranty, valid from the date of manufacture.

Complete Warranty Terms and Conditions are available upon request.

Contact Details	Internet : www.transpower.com Phone : 1-800-526-2626 Kaman Industrial Technologies
Part No. OPT-2-OPPAD-TP	OPT-2-OPPAD-TP
SKU Number	400188062041

SAFETY

VDISPLAY is designed to be used in conjunction with the V-Drive. It is intended for professional incorporation into complete equipment or systems. The drive must be installed correctly to prevent a safety hazard. The drive uses high voltages and currents, carries a high level of stored electrical energy, and is used to control mechanical plant that may cause injury. Close attention is required to system design and electrical installation to avoid hazards in either normal operation or in the event of equipment malfunction.

System design, installation, commissioning and maintenance must be carried out only by personnel who have the necessary training and experience. They must read carefully this safety information and the instructions in this and the drive User Guides and follow all information regarding transport, storage, installation and use, including the specified environmental limitations.

Please read the **IMPORTANT SAFETY INFORMATION** below, and all **Warning and Caution** boxes within this document.

SAFETY NOTICES

WARNING is given where there is a hazard that could lead to injury or death of personnel.

CAUTION is given where there is a hazard that could lead to damage to equipment.

IMPORTANT SAFETY INFORMATION

Safety of machinery, and safety-critical applications

The level of integrity offered by the VDISPLAY / drive control functions – for example stop/start, forward/reverse and maximum speed, is not sufficient for use in safety-critical applications without independent means of protection. All applications where malfunction could cause injury or loss of life must be subject to a risk assessment and further protection provided where needed.

Within the European Union, all machinery in which this product is used must comply with Directive 98/37/EC, Safety of Machinery. In particular, the electrical equipment should comply with EN60204-1.

GENERAL SPECIFICATION

Compatible Drives: V-Drive
Signal Interface: Standard 8-way RJ45 connector
Supply Input: 24V +/- 10%, DC, 30mA
RS485 signal: Industry standard 2-wire +5V differential
Environmental: Operational: -10 ... 50 °C
Storage: -40 °C ... 60 °C
Relative Humidity < 95% (non condensing)
Protection rating: IP55
Max cable length: 25m / 82.5ft shielded twisted pair

MECHANICAL INSTALLATION


WARNING

- When installing the VDISPLAY, all drives should be disconnected and **ISOLATED** before attempting any work. High voltages are present at the terminals and within the drive for up to 10 minutes after disconnection of the electrical supply. The drives should be installed by qualified electrical persons and in accordance with local and national regulations and codes of practice.
- Refer to the relevant drive user manual for further details.

CAUTION


- Carefully inspect the VDISPLAY before installation to ensure it is undamaged.
- Store the VDISPLAY in its box until required. Storage should be clean and dry. Temperature range -40°C to +60°C.
- Install the VDISPLAY on a flat, flame-resistant vibration-free surface.
- Flammable material should not be placed close to the VDISPLAY.

DIMENSIONS

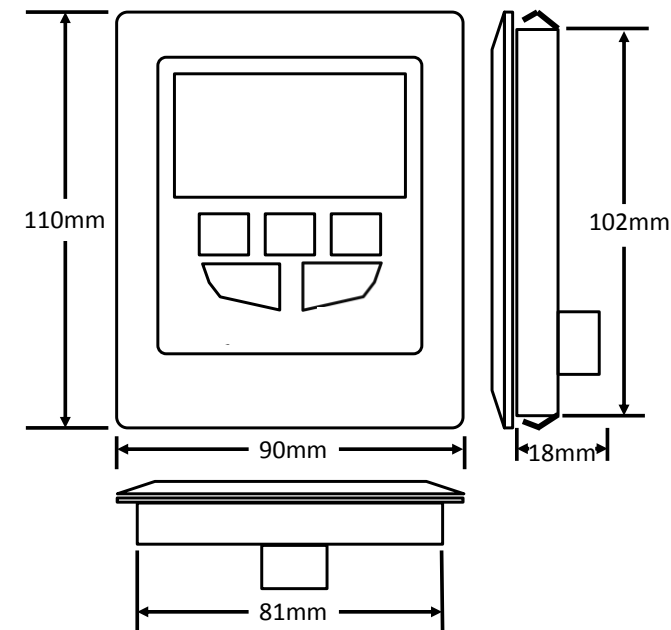

THROUGH PANEL MOUNT


The panel on to which the VDISPLAY is to be mounted should be cut out in accordance with the diagram below.

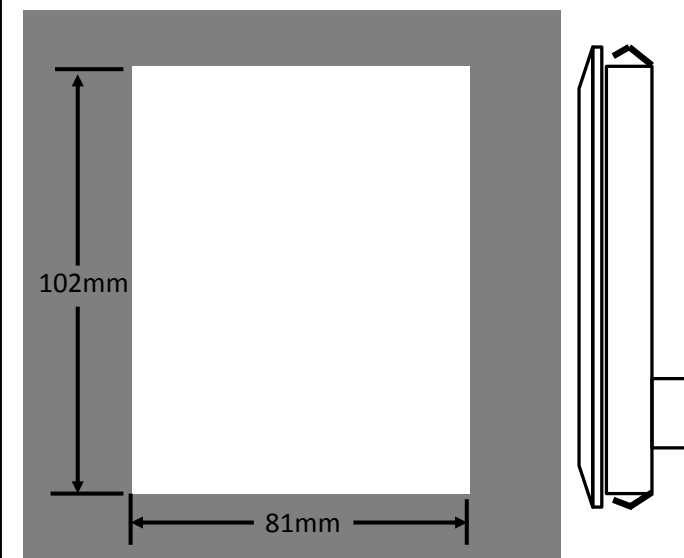

ELECTRICAL INSTALLATION

Electrical Interface

The VDISPLAY uses a standard RJ45 8-Way connector as its electrical interface, which provides a simple solution for the user to setup their system using a standard RJ45 8-Way data cable. The signal layout of the connector is as follows:

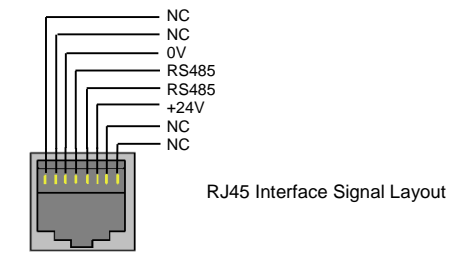


RJ45 Interface Signal Layout

Cable Requirements

Standard 8-way data cables with plugs are available from your local Trans-Power stockist on request.

If the data cable is made up on site, ensure that the connection pin out is correct: Pin 1 to Pin 1, through Pin 8 to Pin 8.




CAUTION

Incorrect cable connection may damage the drive. Extra care should be taken when using third party cable.

System Setup

The drive provides the +24V power supply to the VDISPLAY via the RJ45 connection. Once the physical connection has been setup, the system is ready to operate. See picture below:

Note: The location of the RJ45 connector on the drive will vary depending on the drive range and model.

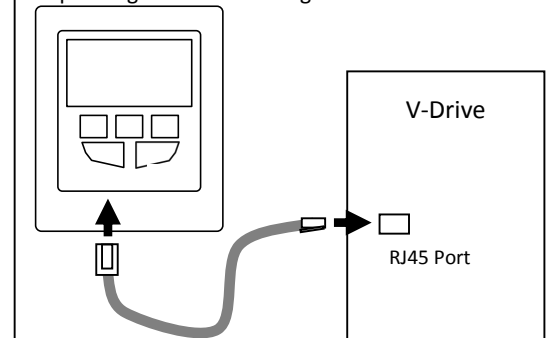


Trans-Power

The manufacturer adopts a policy of continuous improvement and whilst every effort has been made to provide accurate and up to date information, the information contained in this User Guide should be used for guidance purposes only and does not form the part of any contract.



82-OPAD-TP_V1.00

USER INTERFACE

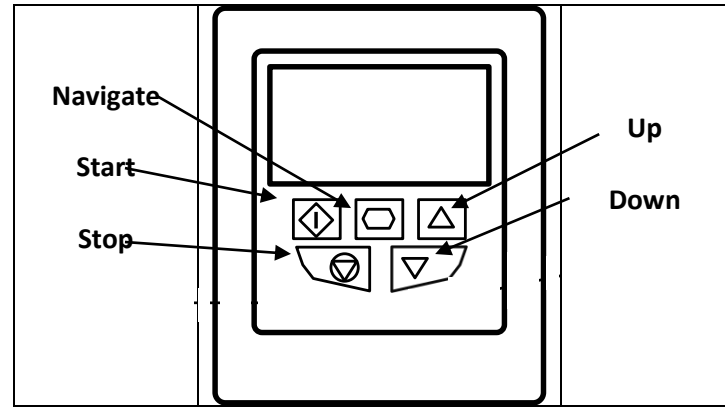

NAVIGATE: Used to display real-time information, to access and exit parameter edit mode and to store parameter changes

UP: Used to increase speed in real-time mode or to increase parameter values in parameter edit mode

DOWN: Used to decrease speed in real-time mode or to decrease parameter values in parameter edit mode


RESET / STOP: When drive is in trip mode, this button is used to reset a tripped drive. When operating in Keypad mode, this button is used to stop the drive when enabled and running.

START: When operating in Keypad mode, the button is used to start a stopped drive or to reverse the direction of rotation if bi-directional keypad mode is enabled (See drive user guide for more information).


Allowed System Configurations

Depending on the requirement of the application, V-DISPLAY can be used in the following different ways:


- One V-DISPLAY with one drive




- One V-DISPLAY with multiple drives (up to 63 max)

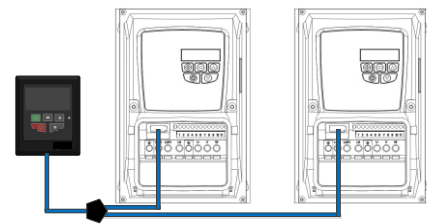

- Two V-DISPLAYs with one drive

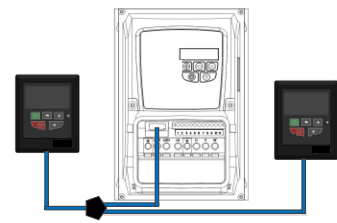

- Two V-DISPLAYs with multiple drives (up to 63 max)

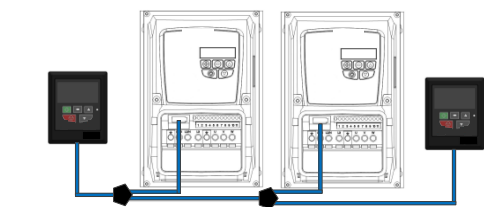

EASY STARTUP

To setup the drive communication address

By default, the V-DISPLAY will try to communicate with the drive that has Address 1 in the network after powering up for the first time.

The V-DISPLAY will display "Scanning for Drive 01." after power up, which indicates that the V-DISPLAY is searching for the drive with the correct drive address in the network. Once the drive has been found, the message "Load..." will be displayed on the V-DISPLAY, which indicates that the V-DISPLAY is reading the configuration information from the drive. Usually it will take 1~2 seconds for the V-DISPLAY to read this information. After the data has been loaded, the V-DISPLAY will display the drive real time status. If the V-DISPLAY cannot find the drive in the network, i.e. there is no drive in the network with address equal to 1, the V-DISPLAY will display "Select drive address 01". The user can then adjust the address from 1 to 63 by using the **UP** or **DOWN** buttons on the V-DISPLAY.

Once the address has been changed to a value to match that of a connected drive, the **STOP** button must be pressed to enable the V-DISPLAY to search for the drive again.

Working with Multiple Drive Networks

When the V-DISPLAY is used on networks with multiple drives, the user can change the drive address to set up communication with another drive in the same drive network at anytime.

Briefly pressing the **STOP** and **DOWN** buttons together results in the message "Select drive address xx" being displayed, where "xx" represents the present drive address. Use the **UP** or **DOWN** button to select the desired drive address. After selecting the new address, pressing **STOP** and **DOWN** button together again will result in V-DISPLAY establishing communications with the drive that has this address.

NOTE

For detailed parameter listing and functional setup, please refer to the corresponding drive user guide

Networks with 2 V-DISPLAYs connected

A maximum of 2 V-DISPLAYs can be connected within the same drive network to communicate with the same drive or different drives.

When using two V-DISPLAYs simultaneously on a network, the user must change the V-DISPLAY Device Number on the second V-DISPLAY to ensure correct operation. All V-DISPLAY units are set to Device Number 1 by default.

To change the Device Number, press the **NAVIGATE**, **STOP** and **DOWN** buttons together. The message "Select V-DISPLAY ID xx" (xx = 01 or 02) will be displayed. The User can then use the **UP** or **DOWN** buttons to change the V-DISPLAY Device Number to 1 or 2 as required. Press the **STOP** button to return to normal operation.

Note:

- The V-DISPLAY Device Address should only be changed to 2 if 2 V-DISPLAY units are connected on a network. A V-DISPLAY with Device Number 1 must always be present for the network to function correctly.

REAL TIME OPERATION

Once the communication has been established between the drive and V-DISPLAY, the user can operate and monitor the drive by using the control buttons on the front panel of the V-DISPLAY.

To monitor or change a parameter value

- Press and hold the **NAVIGATE** key for more than 1s when the drive is displaying "Stop". The display changes to the first parameter in the drive parameter menu.
- Press and release the **NAVIGATE** key to display the value of the parameter to be edited.
- Change to the required value using the **UP** and **DOWN** keys.
- Press and release the **NAVIGATE** key once more to store the change.
- Press and hold the **NAVIGATE** key for more than 1s to return to real-time mode. The display shows "Stop" if the drive is stopped or the real-time information (e.g. speed, current or power) if the drive is running.

DRIVE OPERATION

To change parameter group

Ensure that extended parameter group access is enabled. The default extended parameter access code is 101 and this should be entered in P-14 to enable the extended parameter group access. Enter parameter edit mode with parameter number PX-XX displayed. Press **NAVIGATE** button and then simultaneously press and release the **UP** or **DOWN** key to change the parameter group number until the required parameter group is displayed.

Locking access to the parameters

- To prevent unauthorised access to the parameters via the V-DISPLAY set the following parameter values :
P-38 = 1

Once this parameter has been set, access to parameters via the V-DISPLAY will be prevented.

- The operational information (e.g. speed, current, power etc.) can be still accessed as normal and the drive can still be controlled from the keypad.
- To unlock parameter access, change parameter listed above back to 0 via the drive keypad directly.

Pre-setting target speed in keypad mode

Set the following parameter values

P-12 = 1 or 2

Setting a value of 1 enables keypad mode with forward direction only, whilst a value of 2 enables keypad mode with forward and reverse rotation.

Ensure the following parameters are also set to enable the drive to start from the keypad speed:

P-31 = 0 or 1

Whilst the drive is stopped, press the **STOP** key. The value of the digital potentiometer will be displayed, indicating target speed. Use the **UP** and **DOWN** keys to select the required target speed.

Press the **STOP** key to return to the real time display showing "Stop", or the **START** key to start the drive ramping up to the target speed.

To vary the speed in real time in keypad control mode

Press the **START** key. The drive will ramp up to the preset speed set in the digital potentiometer (assuming P-31 = 1).

Press **UP** to increase speed.

The drive will run forward, increasing speed until the **UP** button is released. The maximum speed is the speed set in:

P-01

Press **DOWN** to decrease speed.

The drive will decrease speed until the **STOP** button is released. The minimum speed is the speed set in:

P-02

Press the **STOP** key to stop the drive.

The drive will decelerate to stop at the selected deceleration ramp.

The display will finally show "Stop" at which point the drive is disabled.

Pressing the **START** key once more results in the drive running back up to the speed at which it was previously running (assuming P-31 = 1).

To reverse direction of rotation with P-12 = 2

Set the following parameter values to select keypad mode with reverse direction enabled:

P-12 = 2

Press the **START** key. The drive ramps up to the preset speed as set in the digital potentiometer (assuming P-31 = 1).

Press **UP** or **DOWN** to increase or decrease the speed.

Press the **START** key again. The motor will reverse its direction of rotation.

Press the **STOP** key to decelerate the motor to standstill.

Whenever the drive is started, it will start with a positive speed unless the direction is negated by the digital inputs on the user terminals.

CHANGING THE DISPLAY LANGUAGE

V-DISPLAY supports multiple languages for the displayed text. To select a different language, simultaneously press the **Start** and **Up** keys. A list of available languages will be displayed, which can be selected using the **Up** and **Down** keys. To activate the chosen language, press the **Navigate** key.

DRIVE FAULT MESSAGES AND TRIP CODES

In the event of a drive fault or trip, the V-DISPLAY will display the fault code information from the connected drive. For a full list of the trip codes, and diagnosis and remedy information, please refer to the relevant drive User Guide.

V-DISPLAY DISPLAY MESSAGES

V-DISPLAY uses various display messages to indicate different working status. See the following table for more information.

Message	Explanation
Scanning for Drive xx	The V-DISPLAY is searching for the drive with address 'xx' in the network.
Load...	The V-DISPLAY has found the drive in the network and is loading the initialisation information from the drive.
SC-OBS	The communication link between the drive and V-DISPLAY has failed.
Select Language	Displayed in the language selection screen, with a list of available languages. Press the Navigate key to select a language
Select drive address xx	Displayed when selecting the address of the drive that the V-DISPLAY should try to communicate with. Press the Stop key to select the drive address.
Select V-DISPLAY ID	Displayed when selecting the V-DISPLAY ID (1 or 2) so that two V-DISPLAYs can be connected to a single drive, or network of multiple drives.

TROUBLE SHOOTING

Symptom	Explanation
Select drive address xx displayed after 'SCAN..' message	The V-DISPLAY failed to successfully communicate with the specified drive address in the network. Check that the RJ45 data cable connection is correct. Check that the drive with address XX is available in the network. If XX > 1 and only one V-DISPLAY is connected, then check the V-DISPLAY device number, make sure the number is 1.
Display 'Err-id' on power up	This normally occurs when there are two V-DISPLAY units in the same drive network and both of them have the same device number. Check and change the device number of one V-DISPLAY.
Display 'Err-id' during normal operation	This normally occurs when the user plugs a second V-DISPLAY into the drive network. Change the device number of one of the V-DISPLAY units.
Display 'SC-OBS'	Communication link between the V-DISPLAY and drive has failed during operation. Check the electrical connection, and make sure the cable is connected correctly between the V-DISPLAY and the drive. Press 'STOP' button to enable the V-DISPLAY to search for the drive again.