



CSRN-XHE 82-302

HIGH EFFICIENCY "ROOF TOP" AIR COOLED HEAT PUMP

- REDUCED ENERGY CONSUMPTION
- COMPACT DIMENSIONS
- ENERGY RECOVERY STANDARD
(CONSTRUCTION CONFIGURATION C)



CSRN-XHE 82 - 302 (R-410A)

Size	Cooling [kW]	Heating [kW]
82	32.5	32.6
102	37.0	37.3
122	46.4	45.3
162	53.3	53.1
182	64.8	63.9
222	73.7	72.9
262	91.8	90.0
302	101	98.7

Performance data are referred to operation with 30% of fresh air intake and same amount of air exhaust.

The CSRN-XHE series of autonomous roof-top air conditioners, air-air heat pump, is a turning point in this type of unit. Intended for use in small and medium sized areas with average crowds (supermarkets, stores, offices, small production areas), it includes the very latest in technology, featuring:

VERSATILITY OF USE

The wide range of versions, options and accessories allow unique integration and flexibility of choice, regardless of the intended use and the external climate.

EASE OF POSITIONING AND INSTALLATION

The units are exceptionally compact, perfect for positioning on especially crowded roofs. Attention to client needs and care for details has led to the creation of a machine that can be quickly installed and immediately commissioned.

REDUCED OPERATING COSTS

These are now guaranteed thanks to the high efficiency of the innovative refrigeration circuit for operation at partial load, of the free-cooling and of the heat recovery, standard on all models equipped with air expulsion, of the optional electrostatic air filters.

GENERAL DESCRIPTION

The CSRN-XHE autonomous roof-top air conditioners are high-efficiency air-air heat pumps with completely automatic operation. Based on user settings, the unit provides complete air treatment through ventilation, filtering, cooling, heating, complete or partial addition of fresh air, possibility to control humidity. These machines are extremely compact and resistant to atmospheric agents, suitable for outdoor installation on a flat roof, on a platform or on the ground. The distribution of treated air (to be handled by the client) takes place via supply and return ducts and suitable distribution devices such as air outlets or nozzles. They are therefore perfect for air conditioning of medium-volume rooms with average traffic, such as commercial surfaces, offices, and small production areas.

VERSATILITY OF USE

The wide range of models and the possibility to choose the constructive configurations make it possible to select the product that is best suited to the needs of each installation and to integrate the unit into various architectonic contexts. The selection of accessories completes the possibility to customize the product according to the needs of the client.

EXTREME COMPACTNESS

The original layout of the sections that make up the machine substantially reduces its footprint, making it easier to position and leaving more space available for parking, additional equipment rooms or other uses. This also reduces the time required for the positioning of the ducts on the various sides of the unit, since its great compactness allows its complete rotation (which is very difficult with traditional units with in-line extension).


REDUCTION OF CONSUMPTION AND OPERATING COSTS

The roof-top units of the XHE series were created with the objective of always operating at maximum energy savings through an extremely intelligent and advanced control of power provided only when it is needed, especially during frequent conditions of operation at partial load. The use of the free-cooling device and the adoption of thermodynamic recovery on the expelled air make it possible to further reduce operating costs. Since ventilation represents one of the greatest factors of energy consumption, special attention has been given to the efficiency of the ventilation system through careful selection of components and limitations of internal pressure drops. The limitation of the emissions of carbon dioxide and respect for the environment are guiding thoughts of Clivet which, through the implementation of modern technical solutions, pursues the reduction of energy consumption.

EASY MAINTENANCE

The entire series is designed with highly reliable industrial components that are easily accessible and available if maintenance is required. It is also equipped with self-diagnosis and safety devices that ensure its proper operation while at the same time protecting users.

VERSATILE POSITIONING: ON FLAT ROOF, ON PLATFORM ON GROUND

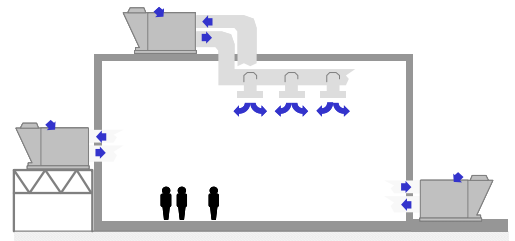

APPLICATION EXAMPLES



PLUG FANS EC

The units are equipped in supply and in expulsion with radial plug fans with reversed blades directly coupled to high-performance brushless DC motors.



The plug fans differ from traditional centrifugal fans in that there are no belts or pulleys. This results in increased efficiency and makes it possible to dynamically vary the speed.

You can change the number of fan revs directly from the keypad to adapt the static pressure to the pressure drop of the system.



NEW GENERATION OF AXIAL FANS FOR THE EXTERNAL SECTION

The need for continuous improvement in machine performance has led to collaboration with specialized European laboratories for the development of more efficient axial fans. The result of this research has made it possible to develop an innovative winglet-type profile at the end of the blade. The adoption of the new profiles has made it possible to obtain substantial results in noise limitation, with an average reduction of 6 dB(A), and energy savings, with a reduction in consumption of 10%.

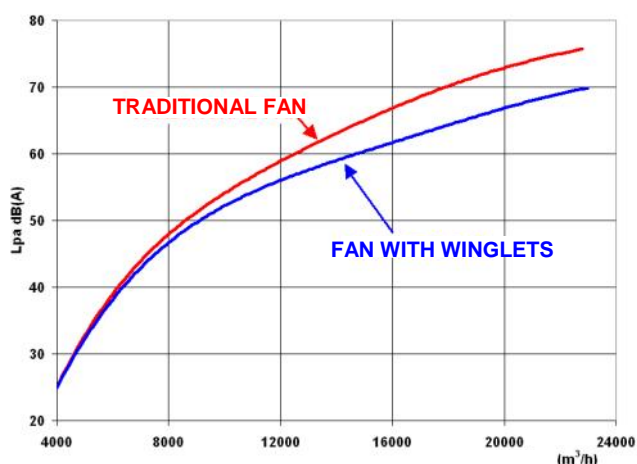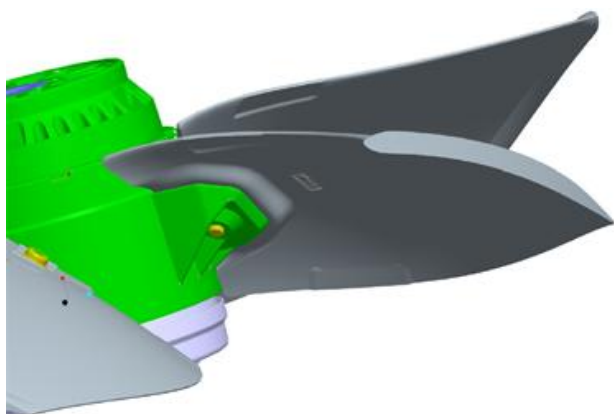

AIR FILTERING

Standard units are standard equipped with a suitable filtering section composed of pleated filters, class G4, with an ample surface. They are easily accessible for periodic maintenance.




OUTSIDE TEMPERATURE PROBE

The measurement of the temperature of outside air is an essential parameter of heat adjustment. It takes place via a probe located in a special compartment that connects the external environment and the return duct (always in negative pressure).

Clivet has chosen this solution to ensure correct measurement of temperature since the probe is constantly in contact with a minimum flow of air.

On request, the temperature probe can be integrated with the optional humidity probe).

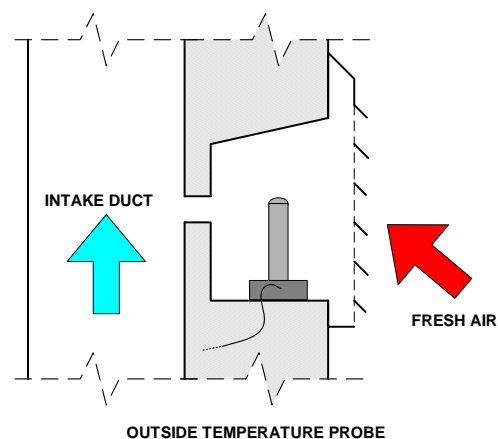


ELECTRONIC EXPANSION VALVE

The electronic expansion valve is an essential component of the refrigerant circuit. It offers a number of advantages as compared to the traditional thermostatic valve. These include:

- reduction of overheating temperature (greater efficiency of refrigerant circuit)
- improved compressor working conditions (COP optimized)
- reduction of output temperature of the compressor
- reduction of pressure at condenser (less energy absorbed by compressors)
- adaptation to all load conditions and transitories without causing swinging at partial loads

All this aids in increasing the efficiency of the load for any thermal load condition and to extend the life cycle.

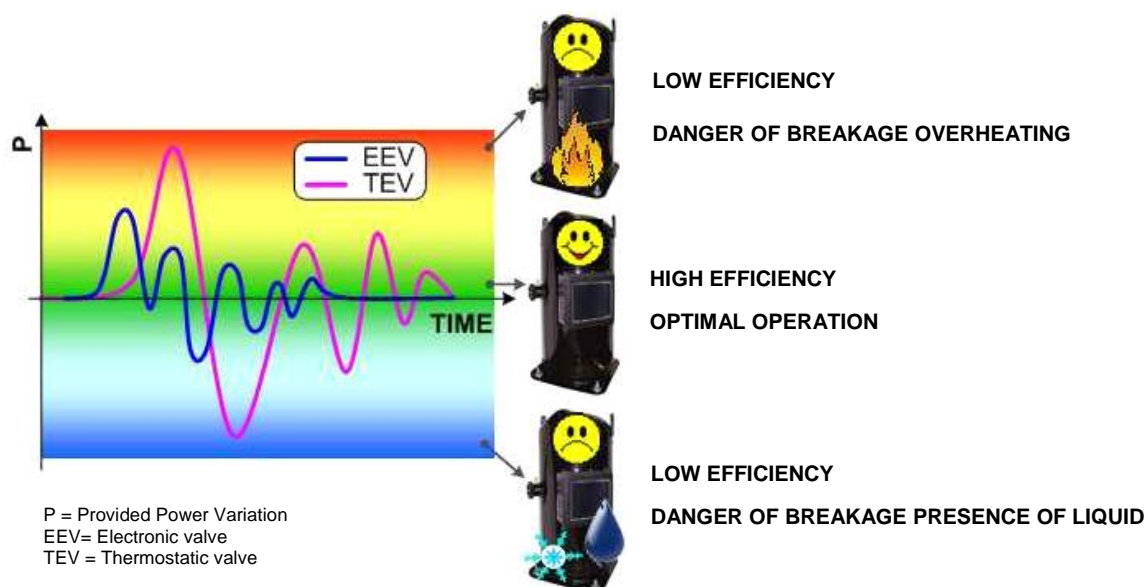

UPDATED ELECTRONIC CONTROL

The operation of the unit is fully automatic thanks to the Clivet Talk electronic adjustment system. This is a modular device, of automatic origins, with high speed and reliability and control logic specifically designed for this type of product.



The user interface is easy to use. This allows better use of available resources, extending the life cycle of the components and thus reducing maintenance costs. With the micro-processor keypad, it is possible to perform daily/weekly programming of the set-point, as well as start-up or shutdown of the machine.

The unit can also be connected to supervision systems using clean contacts or by serial with the standards of communication most commonly available on the market.



VERY HIGH EFFICIENCY AT PARTIAL LOAD


In air conditioning projects, the choice of the unit is made based on the maximum load of the room to be served. In practice, over the course of the year these operating conditions are limited to short periods of time, whereas operation at partial loads is the actual normal operating condition. The need to adapt the power provided to the load requested becomes essential in limiting energy consumption. This is why we have decided to couple two scroll compressors of different power on a single refrigeration circuit, thus obtaining very high efficiency. The electronic control that the machine is equipped with divides compressor operation into three steps of power (1/3, 2/3, 3/3). This limits the oscillation of the air temperature, and provides perfect adaptation to partial load, offering substantial energy savings.

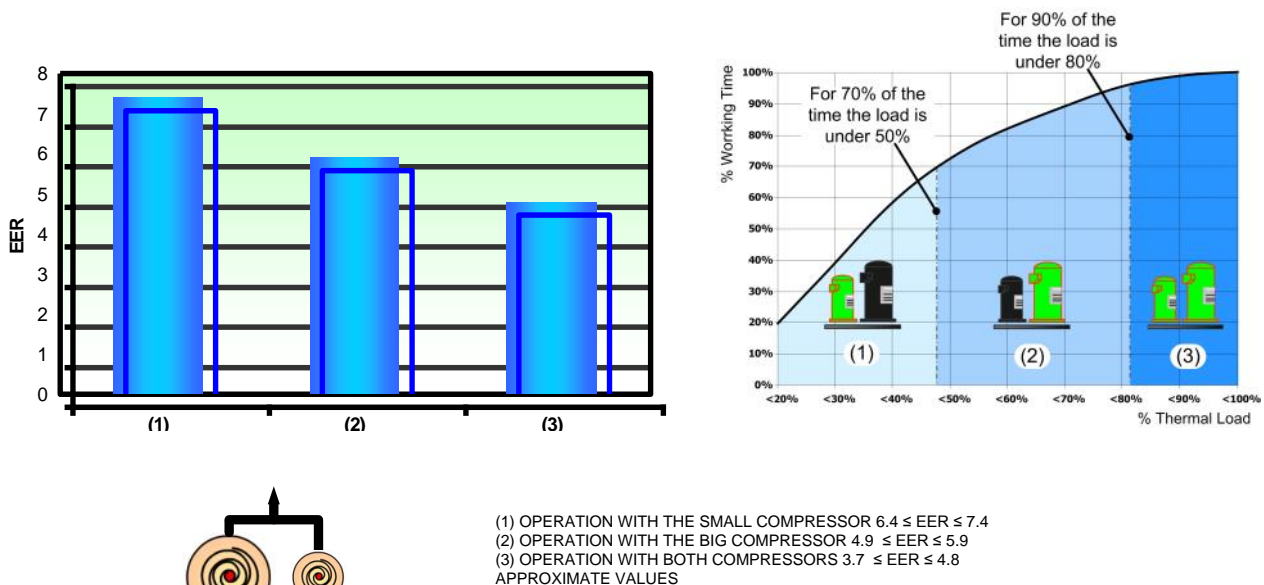

SELF-ADAPTABILITY

Thanks to the automatic adjustment of the operating parameters based on the system load conditions, the unit is capable of optimizing its own efficiency, reducing the resulting consumption and extending the life-cycle of the components.

The temperature range to be maintained in the room can be set by the user (manual set-point) or managed by the machine logic (automatic set-point). When AUTOMATIC mode is set, the working set-points are calculated automatically and dynamically by the thermal control device based on the outside temperature and other parameters set during commissioning of the machine, thus avoiding thermal shock between the treated room and the exterior.

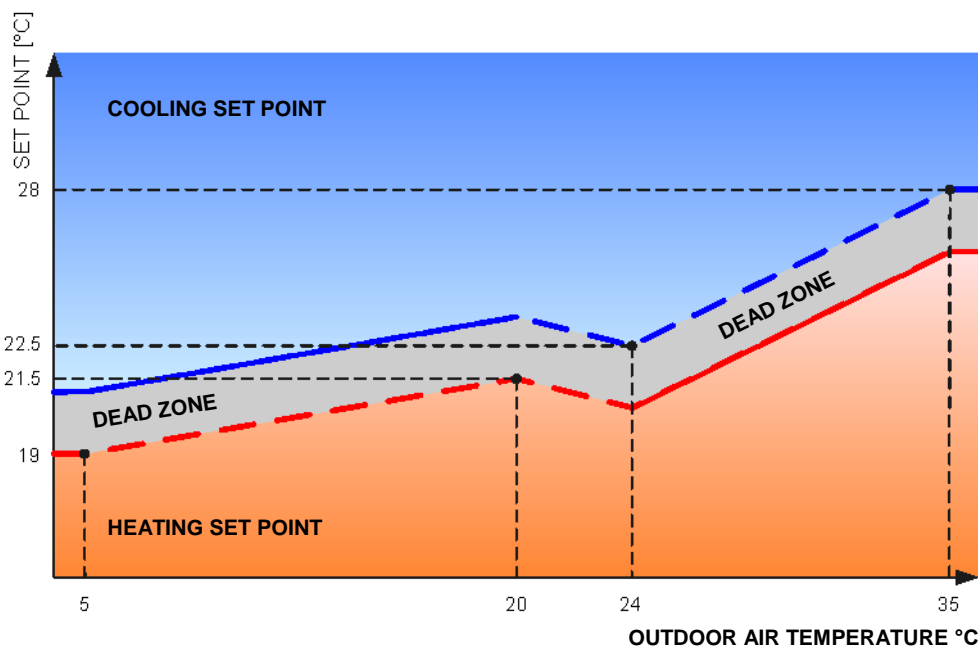

THE GRAPH SHOWS THE TREND OF THE CURVES OF THE HOT SET POINT (BOTTOM LINE) AND OF THE COLD SET POINT (UPPER LINE) BASED ON THE OUTSIDE TEMPERATURE. THE HIGHLIGHTED TEMPERATURE VALUES ARE THOSE SET AS DEFAULT, BUT THEY MAY BE CHANGED ACCORDING TO CLIENT NEEDS.

ICE PROTECTION SYSTEM

ICE PROTECTION SYSTEM is a special measure for the refrigeration circuit that reduces the risk of the formation of ice at the base of the external coil. A liquid under-cooling circuit maintains the temperature of the lower part of the coil, preventing the formation of a block of ice and avoiding risk of breakage due to freezing.



SMART MANAGEMENT OF DEFROSTS


During operation in heat-pump mode, the defrost cycles are managed with an advanced, predictive logic that reduces both frequency and duration. The innovative control system makes it possible to activate defrost cycles and to adjust their duration based on actual needs, by measuring not only the outside temperature but also the gradient of evaporation pressure. As a result, overall performance of the machine is improved and there is a reduction in the negative effect that defrost cycles have on supply air temperatures.



DEMAND LIMIT

The Demand Limit function is a logic that controls the machine's resources dedicated to limiting the input power from the electrical mains (for example when there are special agreements between the user and the operator of the electrical mains) or to selecting the thermal resources to be used based on special needs of the client. The Demand Limit device can control and manage the available steps of thermal power by means of the receipt of an external analogue signal, 0-10V/4-20mA.

The control logic does not act on the ventilation which is therefore always ensured. The greater the input signal to the Demand Limit, the less the thermal power available for the system. In the extreme condition of pilot signal at 100%, the system can also shut off the last power step.

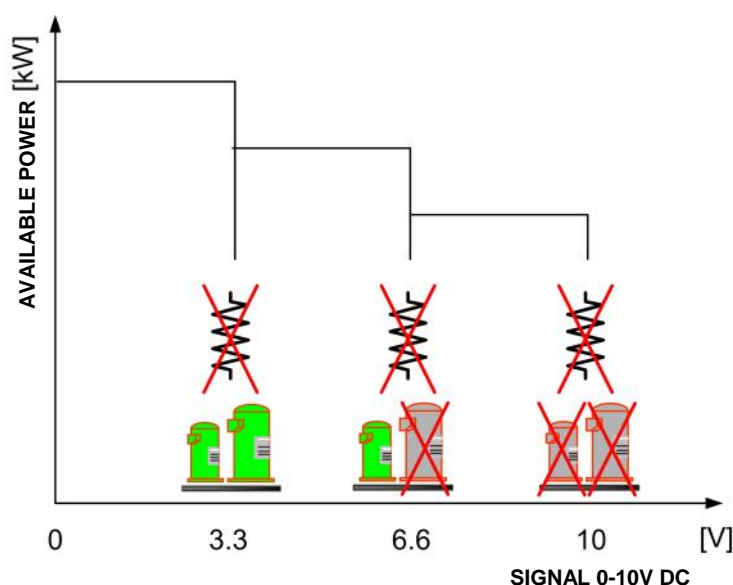

AS THE DEMAND LIMIT SIGNAL INCREASES, THE POWER STEPS ARE GRADUALLY DISABLED. WHEN THE SIGNAL IS AT 100%, ALL AVAILABLE RESOURCES ARE DISABLED.

 AUXILIARY ELECTRIC HEATING ELEMENTS

ACTIVE ENERGY RECOVERY OF EXPELLED AIR (ONLY FOR C VERSION)

The energy contained in the expelled air is recovered by forcing the air flow to pass through the external packaged finned heat exchanger. This makes it possible to reduce the electrical energy absorbed by the compressors, to increase the overall efficiency of the unit and to extend its operating limits.

This thermodynamic recovery system does not increase electrical energy consumption for ventilation, as instead happens for recovery with crossed or rotating flows. Greater use of electricity, caused by the enormous pressure drops on the air side in recovery systems with crossed or rotating flows, often nullifies the amount of energy recovered and even exceeds it in some cases.



THERMAL FREE COOLING (ONLY FOR C VERSION)

As soon as external conditions allow it, the unit is capable of automatically activating free-cooling mode, which, by keeping the compressors off and drawing in suitably filtered fresh air, cools the served room. The fresh air flow can be varied based on actual needs. This operating mode is especially useful in spring and autumn or with high ambient loads. It allows substantial reduction of the unit's energy consumption and wear of the compressors.



STANDARD UNIT SPECIFICATIONS

COMPRESSOR

scroll compressor complete with: overload thermal protection, high refrigerant discharge temperature, rubber antivibration mounts, oil charge.

A oil heater is automatically switched on at the compressor shut-down to prevent oil dilution by the refrigerant.

The compressors are connected in tandem on a single refrigerator circuit.

They have bi-phase equalization of the oil and are equipped with cut-off bi-cocks

STRUCTURE

The basement is assembled with a painted galvanized steel frame. The internal structure is made of "ALUZINK" bent galvanized steel. The alloy that protects the Aluzink allow an excellent corrosion proofing thanks to the galvanic protection typical of the combination aluminium-zinc.

PANELLING

Panels of the compressor panel in steel sheet metal, painted using polyester powders, colour RAL 9001 and covered on the inside with ashlar sound-absorbent material.

Sandwich panels in the air treatment section with dual walls in steel sheet metal with polyurethane insulation (40 kg/m³), thickness of outer sheet metal 6/10 mm galvanized and painted using polyester powders colour RAL 9001, polyurethane thickness with thermal conductivity coefficient 0.022W/mK, thickness of internal sheet metal 5/10 mm hot galvanized. The panel is also provided with a PVC profile for thermal insulation and a EPDM rubber gasket that ensures the hermetic seal.

All panelling can easily be removed to allow complete accessibility to internal components.

INTERNAL EXCHANGER

direct expansion finned exchanger, made from copper pipes in staggered rows and mechanically expanded to the fin collars. The fins are made from aluminium with a corrugated surface and adequately distanced to ensure the maximum heat exchange efficiency.

EXTERNAL EXCHANGER

Direct expansion finned exchanger, made from copper pipes in staggered rows and mechanically expanded to the fin collars. The fins are made from aluminium with a corrugated surface and adequately distanced to ensure the maximum heat exchange efficiency.

Correct power supply to the expansion valve is ensured by the under-cooling circuit. This circuit also prevents the formation of ice at the base of the heat exchanger during winter operation.

FAN

Internal section

Plug fans without scroll with reverse blades driven by electronically-controlled "brushless" dc motors with direct coupling. No transmission sizing is needed.

External section

helical fans with shaped aluminium blades, directly coupled to the three-phase electric motor, with built-in thermal overload protection, minimum IP 54 construction. Mounted in aerodynamic housings to increase efficiency and minimise noise levels, and fitted with safety grills.

REFRIGERANT CIRCUIT

The circuit is complete with:

- refrigerant charge
- sight glass with moisture indicator
- high pressure switch
- low pressure switch
- filter dryer
- electronic expansion valve
- non-return valve
- 4-way reverse cycle valve
- liquid receiver
- liquid separator
- high pressure safety valve
- low pressure safety valve

FILTRATION

fresh air intake side

Pleated filter for greater filtering surface, made up of galvanized plate frame with galvanized and electric-welded protective mesh, and regenerable filtering media made from polyester fibre sized with synthetic resins. G4 efficiency according to CEN-EN 779 standard (Eurovent class EU4/5 - average efficiency 90.1% ASHRAE 52-76 Atm). Self-extinguishing (resistance to fire class 1 - DIN 53438).

ambient air suction side

Pleated filter for greater filtering surface, made up of galvanized plate frame with galvanized and electric-welded protective mesh, and regenerable filtering media made from polyester fibre sized with synthetic resins. G4 efficiency according to CEN-EN 779 standard (Eurovent class EU4/5 - average efficiency 90.1% ASHRAE 52-76 Atm). Self-extinguishing (resistance to fire class 1 - DIN 53438).

TRAY

condensate collecting tray in aluminum alloy 1050 H24 with anti-condensate insulation, welded and equipped with threaded discharge coupling

ELECTRICAL PANEL

The electrical panel is positioned inside the units, with access through a swing door that is opened by a special key.

the Power Section includes:

- main door lock isolator switch
- compressor circuit breaker
- compressor power supply remote control switch
- fan motor thermal protections of internal section and external section
- circuit breaker to protect auxiliary circuit

microprocessor control section:

- treated air temperature control
- daily, weekly programmer of temperature setpoint and unit on/off
- compressor overload protection and timer
- self-diagnosis system with immediate display of the error code
- demand limit
- clean contacts for remote ON-OFF, cumulative alarm, fan status, compressor status, summer/winter mode
- control keypad, including:

display to indicate operating status and mode
display of the set values and the error codes
menu button to display the parameter index
ALARM button to access the alarm management functions
status button to display the status list
unit operation or ventilation only selection button
On/Off and manual reset button for overload device activation
UP and DOWN buttons to increase and decrease the values

C VERSION

exhaust fan

Plug fans without scroll with reverse blades driven by electronically-controlled "brushless" dc motors with direct coupling. No transmission sizing is needed.

ACCESSORIES

- copper / copper evaporator coils
- copper / copper condenser coils
- water heating coil
- modulating three-way valve
- hot gas re-heating coil
- Copper / copper hot gas re-heating coil
- constant value flow rate adjuster
- electrode boiler steam humidifier
- water to waste evaporating wet-deck humidifier
- auxiliary electric heaters.
- Air quality sensor for CO₂ p.p.m. control
- Air quality sensor for CO₂ and VOC p.p.m. control
- Heating module with modulating condensing gas burner
- bag filters section F7 class
- High efficiency electrostatic filters additional section
- serial port RS485 with MODBUS protocol
- serial port RS485 with LONWORK protocol
- phase monitor
- power factor correction capacitors (cosfi > 0.9)
- free-cooling with independent comparison of temperature and absolute humidity (only for C version)
- Device for reducing consumption of the outdoor section variable speed fans (phase-cut)
- Variable fan speed control for operation at low ambient temperature
- ECOBreeze
- differential pressure switch for dirty air filters
- high and low pressure gauges
- smoke detector
- Remote control with remote microprocessor control (separately supplied accessories)
- Rubber antivibration mounts (separately supplied accessories)

TEST

unit manufactured according to the ISO 9001 quality standards and subject to functional testing at the end of the production line

AIR FLOW: STANDARD


GENERAL TECHNICAL SPECIFICATIONS

Size			82	102	122	162	182	222	262	302
COOLING										
Cooling capacity	1	kW	32.5	37	46.4	53.3	64.8	73.7	91.8	100.8
Sensible capacity	1	kW	23.3	26.5	33.8	39.4	46.3	52.2	67.5	72.8
Compressor power input	1	kW	8.3	9.9	11.6	13.1	15	18.6	20.5	24
EER	1		3.9	3.75	4	4.07	4.32	3.97	4.47	4.2
HEATING										
Heat output	2	kW	32.6	37.3	45.3	53.1	63.9	72.9	90	98.7
Compressor power input	2	kW	6.7	7.9	8.5	10.4	12.1	14.1	16.3	18.3
COP	2		4.88	4.74	5.31	5.11	5.28	5.17	5.52	5.39
COMPRESSOR										
Type of compressors	3		Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
No. of Compressors		Nr	2	2	2	2	2	2	2	2
Std Capacity control steps		Nr	3	3	3	3	3	3	3	3
Refrigerant circuits		Nr	1	1	1	1	1	1	1	1
AIR HANDLING SECTION FANS (OUTLET)										
Type of fans	4		RAD	RAD	RAD	RAD	RAD	RAD	RAD	RAD
Number of fans		Nr	1	1	1	1	1	1	2	2
Fan diameter		mm	450	500	500	560	630	630	500	560
Type of motor			CC	CC	CC	CC	CC	CC	CC	CC
Air flow		l/s	1500	1700	2220	2500	3060	3610	4440	5000
Installed unit power		kW	1.1	2.7	2.7	3.1	3.2	3.2	2.7	3.1
Max outside static pressure	5	Pa	280	600	450	520	450	370	460	510
FANS (EXPULSION)										
Type of fans	4		RAD	RAD	RAD	RAD	RAD	RAD	RAD	RAD
Number of fans		Nr	1	1	1	1	1	1	1	1
Fan diameter		mm	450	450	450	450	500	500	630	630
Type of motor			CC	CC	CC	CC	CC	CC	CC	CC
Installed unit power		kW	1.1	1.1	1.1	1.1	2.7	2.7	3.2	3.2
EXTERNAL SECTION FANS										
Type of fans	6		AX	AX	AX	AX	AX	AX	AX	AX
Number of fans		Nr	1	1	1	1	2	2	2	2
Fan diameter		mm	630	630	800	800	710	710	800	800
Fan RPM		rpm	1330	1330	660	880	900	900	880	880
Standard air flow		l/s	3611	3611	4440	5700	6670	6670	11400	11400
Installed unit power		kW	1.3	1.3	1.3	2	1	1	2	2
POWER SUPPLY										
Standard power supply		V	400/3/50	400/3/50	400/3/50	400/3/50	400/3/50	400/3/50	400/3/50	400/3/50

Performance data are referred to operation with 30% of fresh air intake and same amount of air exhaust. (construction configuration C)

- (1) Ambient temperature 27°C/19.5 WB
external exchanger air intake 35°C
EER referred only to compressors
(2) Ambient air 20°C D.B.; fresh air 7°C D.B./6.1 W.B.
COP referred only to compressors
(3) SCROLL = scroll compressor
(4) RAD = radial ventilation
(5) Net outside static pressure to win the outlet and intake onboard pressure drops
(6) AX = axial-flow fan

OPERATING LIMITS (COOLING)

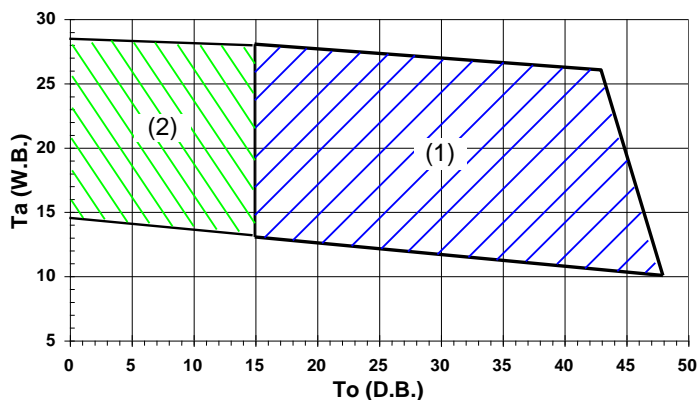

THE LIMITS ARE INDICATIVE AND HAVE BEEN CALCULATED CONSIDERING:

- VALUES GENERAL AND NOT SPECIFICATIONS,
 - STANDARD AIR FLOW-RATE,
 - NON-CRITICAL POSITIONING AND CORRECT USE OF THE UNIT,
 - OPERATION AT FULL LOAD
- WITH UNIT OPERATING IN INTAKE OF OUTSIDE AIR CALCULATE THE TEMPERATURES OF MIXES WHICH ARE GENERATED FROM THE EXCHANGERS' INLET TO KNOW THE LIMITS.
- TO = TEMPERATURE OF AIR ENTERING THE EXTERNAL EXCHANGER D.B.(°C)
DB = DRY BULB
TA = INTERNAL EXCHANGER INLET AIR TEMPERATURE W.B. (°C)
WB = WET BULB
- (1) THE DASHED AREA REFERS TO THE FIELD OF UNITS OPERATION STANDARD
(2) IN THE CROSS-HATCHED AREA IS IDENTIFIED THE UTILITY FIELD FOR UNIT WITH LOW TEMPERATURE DEVICE

CONSTRUCTIONAL CONFIGURATION: MIXING BOX FOR RECYCLE /FRESH AIR (B)

ELECTRICAL DATA

Size		82	102	122	162	182	222	262	302
F.L.A. - FULL LOAD CURRENT AT MAX ADMISSIBLE CONDITIONS									
F.L.A. - Compressor 1	A	10.2	14.3	14.3	16.4	22.6	30.6	30.6	30.6
F.L.A. - Compressor 2	A	9.8	9.8	14.3	15.2	15.2	15.2	22.6	30.6
F.L.A. - Single External Fan	A	2.5	2.5	2.3	4.1	2.5	2.5	4.1	4.1
F.L.A. - Single supply fan	A	2.2	4.3	4.3	4.9	4.9	4.9	4.3	4.9
F.L.A. - Total	A	25.2	31.4	35.7	41.1	48.2	56.2	70.5	79.7
L.R.A. LOCKED ROTOR AMPERES									
L.R.A. - Compressor 1	A	64	101	101	111	118	173	173	173
L.R.A. - Compressor 2	A	64	64	101	95	95	95	118	173
F.L.I. FULL LOAD POWER INPUT AT MAX ADMISSIBLE CONDITION									
F.L.I. - Compressor 1	kW	6	8.3	8.3	10.1	13.2	17	17	17
F.L.I. - Compressor 2	kW	5.9	5.9	8.3	8.9	8.9	8.9	13.2	17
F.L.I. - Single External Fan	kW	1.3	1.3	1.2	1.9	1.1	1.1	1.9	1.9
F.L.I. - Single supply fan	kW	1	2.7	2.7	3.1	3.2	3.2	2.7	3.1
F.L.I. - Total	kW	14.5	18.5	20.8	24.3	27.7	31.5	39.7	44.3
M.I.C. MAXIMUM INRUSH CURRENT									
M.I.C. - Value	A	78.8	117.9	122.4	135.7	143.6	198.6	212.9	222.1

Data referred to standard units.
power supply: 400/3/50 Hz +/-6%

voltage unbalance: max 2 %
Values not including accessories

CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/RECIRCULATED/FRESH AIR INTAKE BOX (C)

ELECTRICAL DATA

Size		82	102	122	162	182	222	262	302
F.L.A. - FULL LOAD CURRENT AT MAX ADMISSIBLE CONDITIONS									
F.L.A. - Compressor 1	A	10.2	14.3	14.3	16.4	22.6	30.6	30.6	30.6
F.L.A. - Compressor 2	A	9.8	9.8	14.3	15.2	15.2	15.2	22.6	30.6
F.L.A. - Single External Fan	A	2.5	2.5	2.3	4.1	2.5	2.5	4.1	4.1
F.L.A. - Single supply fan	A	2.2	4.3	4.3	4.9	4.9	4.9	4.3	4.9
F.L.A. - Single exhaust air fan	A	2.2	2.2	2.2	2.2	4.3	4.3	4.9	4.9
F.L.A. - Total	A	27.4	33.6	37.9	43.3	52.5	60.5	75.4	84.6
L.R.A. LOCKED ROTOR AMPERES									
L.R.A. - Compressor 1	A	64	101	101	111	118	173	173	173
L.R.A. - Compressor 2	A	64	64	101	95	95	95	118	173
F.L.I. FULL LOAD POWER INPUT AT MAX ADMISSIBLE CONDITION									
F.L.I. - Compressor 1	kW	6	8.3	8.3	10.1	13.2	17	17	17
F.L.I. - Compressor 2	kW	5.9	5.9	8.3	8.9	8.9	8.9	13.2	17
F.L.I. - Single External Fan	kW	1.3	1.3	1.2	1.9	1.1	1.1	1.9	1.9
F.L.I. - Single supply fan	kW	1	2.7	2.7	3.1	3.2	3.2	2.7	3.1
F.L.I. - Single exhaust air fan	kW	1	1	1	1	2.7	2.7	3.2	3.2
F.L.I. - Total	kW	15.5	19.5	21.8	25.3	30.4	34.2	42.9	47.5
M.I.C. MAXIMUM INRUSH CURRENT									
M.I.C. - Value	A	81	120.1	124.6	137.9	147.9	202.9	217.8	227

Data referred to standard units.
power supply: 400/3/50 Hz +/-6%

voltage unbalance: max 2 %
Values not including accessories

ELECTRICAL INPUT OF OPTIONAL COMPONENTS

To obtain the electrical input of the unit including accessories, add the standard data in Electrical Data table to those for the selected accessories.

SIZE		82	102	122	162	182	222	262	302
F.L.A. FULL LOAD CURRENT									
F.L.A. EH07 - 3 kW electric heaters	A	4,8	4,8	-	-	-	-	-	-
F.L.A. EH10 - 6 kW electric heaters	A	8,7	8,7	8,7	8,7	-	-	-	-
F.L.A. EH12 - 9 kW electric heaters	A	13	13	13	13	-	-	-	-
F.L.A. EH14 - 12 kW electric heaters	A	-	-	17,3	17,3	17,3	17,3	-	-
F.L.A. EH17 - 18 kW electric heaters	A	-	-	26	26	26	26	26	26
F.L.A. EH20 - 24 kW electric heaters	A	-	-	-	-	34,6	34,6	34,6	34,6
F.L.A. EH24 - 36 kW electric heaters	A	-	-	-	-	-	-	52	52
F.L.A. HSE3 - Electrode boiler steam humidifier from 3 kg/h	A	3,2	3,2	3,2	3,2	3,2	3,2	3,2	3,2
F.L.A. HSE5 - Electrode boiler steam humidifier from 5 kg/h	A	8,7	8,7	8,7	8,7	8,7	8,7	8,7	8,7
F.L.A. HSE8 - Electrode boiler steam humidifier from 8 kg/h	A	8,7	8,7	8,7	8,7	8,7	8,7	8,7	8,7
F.L.A. HSE9 - Electrode boiler steam humidifier from 15 kg/h	A	-	-	16,0	16,1	16,2	16,2	16,2	16,2
F.L.A. FES - High efficiency H10 electrostatic air filter	A	0,6	0,6	1,1	1,1	1,5	1,5	1,5	2,2
F.L.I. ABSORBED POWER									
F.L.I. EH07 - 3 kW electric heaters	kW	3,2	3,2	-	-	-	-	-	-
F.L.I. EH10 - 6 kW electric heaters	kW	6	6	6	6	-	-	-	-
F.L.I. EH12 - 9 kW electric heaters	kW	9	9	9	9	-	-	-	-
F.L.I. EH14 - 12 kW electric heaters	kW	-	-	12	12	12	12	-	-
F.L.I. EH17 - 18 kW electric heaters	kW	-	-	18	18	18	18	18	18
F.L.I. EH20 - 24 kW electric heaters	kW	-	-	-	-	24	24	24	24
F.L.I. EH24 - 36 kW electric heaters	kW	-	-	-	-	-	-	36	36
F.L.I. HSE3 - Electrode boiler steam humidifier from 3 kg/h	kW	2,3	2,3	2,3	2,3	2,3	2,3	2,3	2,3
F.L.I. HSE5 - Electrode boiler steam humidifier from 5 kg/h	kW	6,0	6,0	6,0	6,0	6,0	6,0	6,0	6,0
F.L.I. HSE8 - Electrode boiler steam humidifier from 8 kg/h	kW	6,0	6,0	6,0	6,0	6,0	6,0	6,0	6,0
F.L.I. HSE9 - Electrode boiler steam humidifier from 15 kg/h	kW	-	-	11,3	11,3	11,3	11,3	11,3	11,3
F.L.I. FES - High efficiency H10 electrostatic air filter	kW	0,15	0,15	0,25	0,25	0,33	0,33	0,33	0,5

SOUND LEVELS


Size	Sound Power Level (dB)								Sound pressure level	Sound power level
	Octave band (Hz)									
	63	125	250	500	1000	2000	4000	8000		
82	83	78	80	76	76	73	65	55	62	80
102	83	76	80	76	78	72	65	55	62	80
122	86	80	83	78	78	73	67	57	63	82
162	86	79	83	81	80	72	67	59	65	83
182	88	89	90	82	80	76	69	67	67	86
222	88	89	90	82	80	76	71	63	67	86
262	90	89	89	82	81	78	72	67	68	87
302	90	83	89	85	85	81	74	69	69	88

The sound levels are referred to units working at full load in nominal conditions. The sound pressure level is referred at a distance of 1 m. from the ducted unit surface working in free field conditions. External static pressure 50 Pa.

(standard UNI EN ISO 3744)

Please note that when the unit is installed in conditions other than nominal test conditions (e.g. near walls or obstacles in general), the sound levels may undergo substantial variations.

OPERATING LIMITS (HEATING)

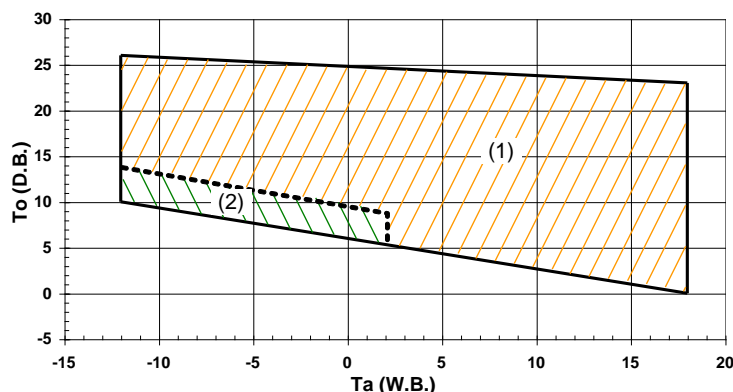

THE LIMITS ARE INDICATIVE AND HAVE BEEN CALCULATED CONSIDERING:

- VALUES GENERAL AND NOT SPECIFICATIONS,
- STANDARD AIR FLOW-RATE,
- NON-CRITICAL POSITIONING AND CORRECT USE OF THE UNIT,
- OPERATION AT FULL LOAD

WITH UNIT OPERATING IN INTAKE OF OUTSIDE AIR CALCULATE THE TEMPERATURES OF MIXES WHICH ARE GENERATED FROM THE EXCHANGERS' INLET TO KNOW THE LIMITS.

TO = TEMPERATURE OF AIR ENTERING THE INTERNAL EXCHANGER D.B. (°C)

DB = DRY BULB

TA = EXTERNAL EXCHANGER INLET AIR TEMPERATURE W.B. (°C)

WB = WET BULB

(1) THE DASHED AREA REFERS TO THE FIELD OF UNITS OPERATION STANDARD

(2) INSIDE THE DOTTED AREA, THE UNIT CAN OPERATE ONLY FOR A LIMITED PERIOD OF TIME (MAX 1 HOUR)

IN EXTENDED OPERATING MODE, IN HEAT PUMP OPERATION WITH AN OUTSIDE AIR TEMPERATURE OF LESS THAN 6°C, THE UNIT PERFORMS DEFROSTS BY REVERSING THE CYCLE, SO AS TO ELIMINATE THE ICE THAT FORMS ON THE SURFACES OF THE OUTSIDE EXCHANGER; IN ADDITION, IN THE EVENT OF NEGATIVE TEMPERATURES, THE WATER RESULTING FROM THE DEFROSTS MUST BE DRAINED SO AS TO AVOID THE ACCUMULATION OF ICE NEAR THE BASE OF THE UNIT. MAKE SURE THAT THIS DOES NOT CONSTITUTE A DANGER FOR PEOPLE OR THINGS.

PRESSURE DROPS OF OPTIONAL COMPONENTS

The value of static pressure available on the supply and return duct is obtained by subtracting from the available net maximum pressure (see general table of technical data) the pressure drops of any accessories.

SIZE			82	102	122	162	182	222	262	302
PRESSURE DROP										
CHW2	2 rows hot water coil	Pa	23	28	32	38	34	47	36	46
CPHG	Hot gas re-heating coil	Pa	10	15	15	20	10	15	10	20
GH01	Gas re-heating module from 54 kW	Pa	60	70	60	70	-	-	-	-
GH02	Gas re-heating module from 72 kW	Pa	-	-	60	70	60	70	-	-
GH03	Gas re-heating module from 96 kW	Pa	-	-	-	-	60	70	60	70
GH05	Gas re-heating module from 150 kW	Pa	-	-	-	-	-	-	60	70
F7	High efficiency F7 air filter	1 Pa	90	100	95	100	90	95	95	100
FES	High efficiency H10 electrostatic air filter	Pa	15	20	20	25	15	20	15	25
HWS	Water to waste evaporating wet-deck humidifier	Pa	10	15	15	20	10	15	10	20

The values shown are to be considered approximate for units operating power in normal use with standard air flow rate.

(1) Pressure drops with filters with average dirtiness

Size			82	102	122	162	182	222	262	302
AIR HANDLING SECTION FANS (OUTLET)										
Air flow		l/s	1500	1700	2220	2500	3060	3610	4440	5000
Max outside static pressure	1	Pa	280	600	450	520	450	370	460	510

(1) Net outside static pressure to win the outlet and intake onboard pressure drops

COOLING PERFORMANCE

Size	Ta (°C) DB/WB	OUTDOOR AIR TEMPERATURE °C																	
		25			30			32			35			40			44		
		kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs
82	22 / 16	30.4	6.50	22.5	30.6	7.15	21.8	30.7	7.45	21.6	30.8	7.95	21.2	30.8	8.90	20.5	30.8	9.77	20.0
	24 / 17	31.1	6.55	24.0	31.2	7.29	23.3	31.2	7.60	23.0	31.2	8.09	22.6	31.3	8.96	21.9	31.4	9.70	21.4
	26 / 19	32.4	6.66	24.0	32.3	7.50	23.3	32.2	7.82	23.0	32.2	8.29	22.6	32.3	9.05	21.9	32.4	9.63	21.4
	27 / 19.5	32.7	6.69	24.7	32.6	7.54	24.0	32.5	7.86	23.7	32.5	8.33	23.3	32.5	9.07	22.6	32.6	9.63	22.1
	28 / 21	33.6	6.79	23.6	33.5	7.62	22.9	33.4	7.94	22.6	33.4	8.40	22.2	33.3	9.13	21.5	33.3	9.67	21.0
	30 / 22	34.2	6.86	24.3	34.1	7.65	23.7	34.1	7.96	23.4	34.0	8.42	23.0	33.8	9.16	22.3			
102	22 / 16	34.3	7.76	25.2	34.3	8.72	24.5	34.3	9.09	24.2	34.5	9.65	23.7	34.8	10.6	23.0	35.2	11.3	22.4
	24 / 17	35.0	7.85	26.9	35.2	8.76	26.2	35.2	9.14	25.9	35.3	9.70	25.5	35.4	10.7	24.7	35.4	11.5	24.2
	26 / 19	36.5	8.03	27.2	36.7	8.91	26.4	36.7	9.27	26.1	36.7	9.84	25.7	36.5	10.8	25.0	36.2	11.7	24.4
	27 / 19.5	36.8	8.07	28.0	37.0	8.95	27.3	37.0	9.32	27.0	37.0	9.88	26.5	36.8	10.9	25.8	36.5	11.7	25.2
	28 / 21	37.9	8.22	26.4	37.9	9.12	25.6	37.9	9.48	25.3	37.9	10.0	24.8	37.7	10.9	24.1	37.5	11.7	23.4
	30 / 22	38.7	8.31	26.6	38.5	9.25	25.8	38.4	9.61	25.5	38.4	10.1	25.0	38.3	11.0	24.2	38.4	11.6	23.6
122	22 / 16	43.7	9.07	32.8	43.7	10.0	31.8	43.7	10.4	31.4	43.8	11.1	30.8	44.0	12.4	29.8	44.3	13.5	29.0
	24 / 17	44.4	9.16	34.9	44.4	10.2	33.9	44.5	10.6	33.5	44.5	11.3	32.9	44.6	12.5	31.9	44.6	13.6	31.1
	26 / 19	45.9	9.36	34.8	46.0	10.4	33.8	46.0	10.8	33.4	46.0	11.5	32.8	45.9	12.7	31.8	45.7	13.7	31.0
	27 / 19.5	46.3	9.41	35.8	46.4	10.4	34.8	46.4	10.9	34.4	46.4	11.6	33.8	46.2	12.7	32.8	46.0	13.7	32.1
	28 / 21	47.8	9.56	34.2	47.7	10.6	33.3	47.6	11.0	32.9	47.5	11.7	32.4	47.4	12.9	31.5	47.3	13.9	30.8
	30 / 22	48.9	9.67	35.8	48.6	10.7	34.9	48.5	11.1	34.6	48.4	11.8	34.1	48.3	13.0	33.3			
162	22 / 16	49.9	10.4	37.1	49.7	11.5	36.1	49.7	12.0	35.7	49.8	12.8	35.1	50.3	14.1	34.1	51.0	15.4	33.3
	24 / 17	50.8	10.5	39.8	50.7	11.7	38.8	50.7	12.1	38.4	50.8	12.9	37.8	51.3	14.2	36.7	51.9	15.2	35.9
	26 / 19	52.8	10.7	40.0	52.7	11.9	39.0	52.7	12.4	38.5	52.8	13.1	37.9	53.2	14.3	36.8	53.6	15.2	35.9
	27 / 19.5	53.3	10.7	41.6	53.2	11.9	40.5	53.2	12.4	40.0	53.3	13.1	39.4	53.6	14.3	38.3	53.9	15.3	37.4
	28 / 21	54.9	10.9	40.5	54.7	12.1	39.3	54.7	12.6	38.8	54.7	13.3	38.0	54.8	14.6	36.8	54.9	15.6	35.9
	30 / 22	56.0	11.0	43.9	55.7	12.2	42.6	55.6	12.6	42.1	55.5	13.4	41.3	55.5	14.7	40.0	55.5	15.9	38.9
182	22 / 16	60.8	12.0	45.4	61.0	13.3	44.0	61.1	13.8	43.5	61.2	14.6	42.6	61.4	16.0	41.2	61.7	17.2	40.1
	24 / 17	62.0	12.1	48.3	62.1	13.4	46.9	62.1	13.9	46.4	62.2	14.7	45.5	62.4	16.1	44.2	62.6	17.3	43.1
	26 / 19	64.5	12.3	47.7	64.4	13.6	46.4	64.3	14.1	45.8	64.3	14.9	45.0	64.3	16.3	43.6	64.4	17.4	42.5
	27 / 19.5	65.1	12.4	49.1	64.9	13.6	47.7	64.9	14.2	47.1	64.8	15.0	46.3	64.8	16.3	44.9	64.8	17.5	43.9
	28 / 21	67.0	12.6	47.5	66.8	13.8	46.1	66.7	14.3	45.5	66.5	15.1	44.7	66.2	16.5	43.3	65.8	17.7	42.2
	30 / 22	68.2	12.8	50.6	68.1	14.0	49.1	68.0	14.5	48.6	67.7	15.3	47.7	67.1	16.7	46.2			
222	22 / 16	69.1	14.7	52.0	69.1	16.3	50.6	69.1	17.0	50.0	69.3	18.0	49.1	69.6	19.8	47.7	70.0	21.4	46.5
	24 / 17	70.5	14.9	54.8	70.4	16.5	53.4	70.4	17.2	52.8	70.5	18.2	52.0	70.8	20.0	50.6	71.1	21.5	49.5
	26 / 19	73.2	15.2	53.5	73.0	16.8	52.1	73.0	17.5	51.6	73.0	18.5	50.8	73.2	20.2	49.5	73.4	21.7	48.4
	27 / 19.5	73.9	15.3	54.9	73.7	16.9	53.6	73.7	17.5	53.0	73.7	18.6	52.2	73.8	20.3	50.9	73.9	21.8	49.8
	28 / 21	76.0	15.5	53.8	75.8	17.1	52.5	75.7	17.7	51.9	75.6	18.7	51.1	75.6	20.5	49.8	75.6	21.9	48.7
	30 / 22	77.4	15.6	58.9	77.2	17.2	57.5	77.1	17.9	56.9	77.0	18.9	56.1	76.8	20.6	54.7	76.7	22.0	53.6
262	22 / 16	85.8	16.5	64.6	85.6	18.2	62.8	85.7	19.0	62.0	86.1	20.1	60.9	87.4	21.9	59.0	88.9	23.4	57.5
	24 / 17	87.5	16.6	69.1	87.5	18.4	67.3	87.5	19.1	66.6	87.8	20.2	65.5	88.4	22.1	63.7	89.1	23.7	62.2
	26 / 19	90.8	16.9	68.8	91.1	18.6	67.1	91.1	19.4	66.4	91.0	20.5	65.4	90.7	22.4	63.6	90.2	24.1	62.2
	27 / 19.5	91.6	17.0	71.0	91.9	18.7	69.2	91.9	19.4	68.5	91.8	20.5	67.5	91.3	22.5	65.8	90.7	24.2	64.4
	28 / 21	94.0	17.3	67.5	94.4	18.9	65.8	94.4	19.6	65.1	94.2	20.7	64.0	93.4	22.7	62.3	92.4	24.4	60.8
	30 / 22	95.5	17.6	70.3	95.9	19.1	68.5	95.9	19.8	67.8	95.7	20.8	66.7	94.9	22.8	64.9			

Ta = ambient air temperature D.B/W.B

DB = dry bulb

WB = wet bulb

kWf = Cooling capacity in kW

kWe = Compressor power input in kW

kWs = sensible cooling capacity (kW)

not all cooling yields take into account the heat dissipated by the fan motors

AIR FLOW: STANDARD

COOLING PERFORMANCE

Size	Ta (°C) DB/WB	OUTDOOR AIR TEMPERATURE °C																	
		25			30			32			35			40			44		
		kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs
302	22 / 16	94.9	19.1	71.7	94.9	21.1	69.7	95.0	22.0	68.9	95.2	23.3	67.7	95.7	25.7	65.7	96.3	27.6	64.1
	24 / 17	96.4	19.3	75.7	96.3	21.3	73.8	96.4	22.2	73.0	96.7	23.5	71.9	97.5	25.8	69.9	98.5	27.8	68.4
	26 / 19	99.8	19.7	74.4	99.5	21.7	72.5	99.6	22.6	71.8	99.9	23.9	70.7	100.9	26.2	68.8	102.2	28.1	67.4
	27 / 19.5	100.7	19.8	76.5	100.4	21.8	74.6	100.5	22.7	73.9	100.8	24.0	72.8	101.7	26.3	71.0	102.9	28.2	69.5
	28 / 21	103.7	20.1	74.4	103.4	22.1	72.5	103.4	22.9	71.8	103.5	24.2	70.7	104.1	26.5	68.9	104.8	28.4	67.4
	30 / 22	105.9	20.3	80.6	105.6	22.2	78.7	105.6	23.1	78.0	105.5	24.4	76.8	105.6	26.6	75.0	105.7	28.5	73.5

Ta = ambient air temperature D.B/W.B
DB = dry bulb
WB = wet bulb
kWf = Cooling capacity in kW
kWe = Compressor power input in kW
kWs = sensible cooling capacity (kW)
not all cooling yields take into account the heat dissipated by the fan motors

AIR FLOW: STANDARD

HEATING PERFORMANCE

Size	Ta (°C) DB/WB	RETURN AIR TEMPERATURE (D.B.)													
		10		15		18		19		20		21		25	
		kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe
82	-5 / -5.4	25.4	4.39	25.2	4.72	25.3	4.99	25.4	5.08	25.6	5.18	25.7	5.29	26.5	5.77
	0 / -0.6	27.9	4.77	28.0	5.23	28.2	5.54	28.3	5.64	28.3	5.75	28.4	5.86	28.7	6.34
	5 / 3.9	30.7	5.25	31.0	5.79	31.1	6.13	31.1	6.24	31.2	6.36	31.2	6.48	31.3	6.97
	7 / 6.1	32.4	5.54	32.5	6.09	32.6	6.44	32.6	6.56	32.6	6.68	32.6	6.81	32.8	7.32
	10 / 8.2	34.0	5.84	34.0	6.39	34.0	6.76	34.0	6.88	34.0	7.01	34.1	7.14	34.2	7.68
	15 / 13	38.3	6.63	37.6	7.16	37.5	7.54	37.5	7.67	37.5	7.81	37.5	7.95	37.9	8.58
102	-5 / -5.4	30.0	5.40	29.2	5.73	29.1	6.01	29.2	6.12	29.2	6.23	29.4	6.35	30.1	6.89
	0 / -0.6	32.4	5.75	32.2	6.24	32.3	6.59	32.4	6.71	32.5	6.84	32.6	6.98	33.1	7.56
	5 / 3.9	35.2	6.22	35.4	6.83	35.5	7.23	35.6	7.37	35.6	7.51	35.7	7.65	36.1	8.26
	7 / 6.1	36.8	6.50	37.0	7.15	37.1	7.57	37.2	7.72	37.3	7.86	37.3	8.01	37.6	8.63
	10 / 8.2	38.4	6.80	38.6	7.49	38.8	7.92	38.8	8.07	38.9	8.22	38.9	8.37	39.1	9.00
	15 / 13	42.5	7.60	42.6	8.34	42.6	8.80	42.6	8.95	42.6	9.11	42.6	9.27	42.7	9.91
122	-5 / -5.4			37.4	6.44	36.9	6.72	36.8	6.82	36.8	6.94	36.8	7.05	37.5	7.59
	0 / -0.6	41.2	6.44	40.0	6.89	39.7	7.23	39.7	7.35	39.8	7.49	39.9	7.62	40.7	8.24
	5 / 3.9	43.9	6.91	43.2	7.47	43.2	7.87	43.2	8.01	43.3	8.16	43.4	8.31	44.2	8.97
	7 / 6.1	45.6	7.20	45.2	7.81	45.2	8.23	45.3	8.38	45.3	8.54	45.4	8.69	46.1	9.37
	10 / 8.2	47.5	7.51	47.2	8.18	47.3	8.62	47.3	8.77	47.4	8.93	47.5	9.10	48.0	9.78
	15 / 13	52.5	8.36	52.7	9.14	52.7	9.63	52.8	9.79	52.8	9.96	52.8	10.1	52.8	10.8
162	-5 / -5.4			41.4	7.80	41.5	8.15	41.5	8.27	41.5	8.40	41.5	8.53	41.4	9.07
	0 / -0.6	45.8	7.77	46.0	8.41	46.1	8.84	46.1	8.98	46.2	9.13	46.2	9.29	46.3	9.93
	5 / 3.9	50.4	8.37	50.6	9.12	50.7	9.60	50.7	9.77	50.8	9.94	50.8	10.1	51.1	10.8
	7 / 6.1	52.8	8.73	52.9	9.51	53.0	10.0	53.1	10.2	53.1	10.4	53.2	10.5	53.4	11.3
	10 / 8.2	55.1	9.10	55.2	9.92	55.3	10.4	55.3	10.6	55.4	10.8	55.4	11.0	55.6	11.8
	15 / 13	60.9	10.1	60.7	10.9	60.7	11.5	60.7	11.7	60.7	11.9	60.7	12.1	60.8	12.9
182	-5 / -5.4			51.1	9.24	50.1	9.59	50.1	9.73	50.1	9.88	50.3	10.0	52.3	10.8
	0 / -0.6	57.6	9.29	55.8	9.88	55.5	10.3	55.5	10.5	55.6	10.7	55.8	10.9	57.2	11.7
	5 / 3.9	61.3	9.86	60.9	10.6	61.0	11.2	61.0	11.4	61.1	11.6	61.3	11.8	62.0	12.6
	7 / 6.1	63.7	10.2	63.7	11.1	63.8	11.7	63.9	11.9	63.9	12.1	64.0	12.3	64.6	13.1
	10 / 8.2	66.3	10.6	66.4	11.5	66.6	12.1	66.6	12.3	66.7	12.5	66.8	12.8	67.1	13.6
	15 / 13	73.4	11.7	73.3	12.7	73.3	13.3	73.2	13.5	73.2	13.8	73.2	14.0	73.1	14.9
222	-5 / -5.4			57.3	10.7	57.7	11.2	57.9	11.4	58.0	11.6	58.2	11.8	58.9	12.6
	0 / -0.6	62.7	10.6	63.0	11.5	63.3	12.1	63.5	12.3	63.6	12.5	63.7	12.7	64.4	13.6
	5 / 3.9	69.2	11.5	69.3	12.5	69.5	13.1	69.6	13.3	69.7	13.5	69.8	13.8	70.3	14.7
	7 / 6.1	72.7	12.0	72.7	13.0	72.8	13.6	72.9	13.9	72.9	14.1	73.0	14.3	73.4	15.3
	10 / 8.2	76.3	12.5	76.2	13.6	76.2	14.2	76.2	14.5	76.2	14.7	76.3	14.9	76.4	15.9
	15 / 13	85.1	13.8	84.8	15.0	84.5	15.7	84.5	15.9	84.4	16.2	84.3	16.5	84.0	17.5
262	-5 / -5.4			72.8	12.8	72.6	13.3	72.6	13.5	72.6	13.7	72.6	13.9	72.9	14.7
	0 / -0.6	76.4	12.4	78.3	13.5	79.0	14.2	79.1	14.4	79.3	14.6	79.3	14.8	79.3	15.7
	5 / 3.9	82.2	13.2	85.0	14.4	85.9	15.2	86.1	15.4	86.3	15.7	86.4	15.9	86.2	16.9
	7 / 6.1	86.1	13.7	88.8	15.0	89.7	15.8	89.9	16.0	90.0	16.3	90.1	16.6	89.8	17.6
	10 / 8.2	90.6	14.2	92.7	15.6	93.5	16.4	93.6	16.6	93.7	16.9	93.7	17.2	93.5	18.3
	15 / 13	103.1	15.8	103.0	17.1	102.9	17.9	102.8	18.2	102.8	18.5	102.7	18.8	102.4	20.0

Ta = Outside air temperature (°C)

DB = dry bulb

WB = wet bulb

kWt = Heating capacity (kW)

with coils free of ice

kWe = Compressor power input in kW

not all thermal yields take into account the heat dissipated by the fan motors

AIR FLOW: STANDARD

HEATING PERFORMANCE

Size	Ta (°C) DB/WB	RETURN AIR TEMPERATURE (D.B.)													
		10		15		18		19		20		21		25	
		kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe
302	-5 / -5.4			79.9	14.2	81.6	15.0	82.1	15.2	82.6	15.5	83.0	15.7	84.2	16.7
	0 / -0.6	84.4	13.9	86.5	15.2	87.5	15.9	87.7	16.2	88.0	16.4	88.1	16.7	88.6	17.8
	5 / 3.9	93.1	15.1	94.1	16.3	94.6	17.1	94.7	17.4	94.8	17.6	94.8	17.9	94.9	19.1
	7 / 6.1	97.7	15.7	98.4	16.9	98.6	17.8	98.7	18.0	98.7	18.3	98.7	18.6	98.7	19.8
	10 / 8.2	102.3	16.3	102.7	17.6	102.8	18.5	102.8	18.7	102.9	19.0	102.9	19.3	102.8	20.6
	15 / 13	113.6	17.9	113.7	19.3	113.7	20.2	113.7	20.6	113.8	20.9	113.8	21.2	113.9	22.7

Ta = Outside air temperature (°C)

DB = dry bulb

WB = wet bulb

kWt = Heating capacity (kW)

with coils free of ice

kWe = Compressor power input in kW

not all thermal yields take into account the heat dissipated by the fan motors

INTEGRATED HEATING CAPACITIES

Air temperature external exchanger inlet °C (D.B. / W.B.)	-5 / -5.4	0 / -0.6	5 / 3.9	OTHERS
Heating capacity multiplication coefficient	0.89	0.88	0.94	1

To obtain the integrated heating capacities (the real heating capacity considering the defrost cycles too), multiply the kWt value in the heating performance tables by the following coefficient.

DB = dry bulb

WB = wet bulb

In case of below zero air ambient temperature with a long period of heat pump operating mode it is necessary to help the evacuation of the water produced during the defrost cycle; this to avoid the formation of ice in the unit basement. Pay attention that the evacuation will not create inconveniences to things or persons.

AIR FLOW: REDUCED

Size			82	102	122	162	182	222	262	302
AIR HANDLING SECTION FANS (OUTLET)										
Air flow		l/s	1200	1360	1800	2000	2500	3050	3750	4150
Max outside static pressure	1	Pa	430	650	580	580	550	460	580	580

(1) Net outside static pressure to win the outlet and intake onboard pressure drops

COOLING PERFORMANCE

Size	Ta (°C) DB/WB	OUTDOOR AIR TEMPERATURE °C																	
		25			30			32			35			40			44		
		kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs
82	24 / 17	29.2	6.50	21.8	29.9	7.29	21.2	30.0	7.62	20.9	30.2	8.12	20.6	30.4	8.97	20.0	30.4	9.68	19.5
	26 / 19	31.0	6.57	21.7	31.0	7.39	21.1	31.0	7.73	20.8	31.0	8.23	20.5	31.0	9.07	19.9	31.1	9.75	19.4
	27 / 19.5	31.4	6.59	22.2	31.2	7.42	21.6	31.2	7.75	21.4	31.2	8.25	21.0	31.2	9.09	20.5	31.3	9.76	20.0
	28 / 21	32.2	6.68	21.3	32.1	7.51	20.7	32.1	7.84	20.5	32.0	8.34	20.1	32.0	9.16	19.5	32.0	9.81	19.0
	30 / 22	32.7	6.76	22.1	32.7	7.58	21.5	32.7	7.91	21.2	32.7	8.39	20.8	32.6	9.20	20.2	32.5	9.84	19.7
	32 / 23.5	33.1	6.91	21.7	33.6	7.69	21.0	33.7	8.01	20.7	33.8	8.48	20.3	33.7	9.26	19.6	33.3	9.88	19.1
102	24 / 17	33.3	7.75	24.5	33.7	8.72	23.8	33.8	9.10	23.5	34.0	9.68	23.0	34.1	10.6	22.2	34.2	11.4	21.6
	26 / 19	34.9	7.89	24.3	35.0	8.83	23.6	35.1	9.21	23.3	35.2	9.79	22.8	35.3	10.8	22.0	35.3	11.6	21.4
	27 / 19.5	35.2	7.92	25.0	35.4	8.87	24.2	35.4	9.25	23.9	35.5	9.83	23.4	35.6	10.8	22.7	35.6	11.6	22.1
	28 / 21	36.3	8.05	24.0	36.4	8.99	23.3	36.4	9.37	23.0	36.4	9.95	22.6	36.4	10.9	21.9	36.4	11.7	21.3
	30 / 22	37.1	8.14	25.2	37.1	9.08	24.5	37.1	9.46	24.3	37.1	10.0	23.8	37.0	11.0	23.2	37.0	11.8	22.6
	32 / 23.5	38.1	8.29	25.6	38.1	9.24	25.0	38.1	9.62	24.7	38.0	10.2	24.4	37.9	11.2	23.8	37.7	11.9	23.3
122	24 / 17	42.6	9.04	31.6	42.5	10.1	30.7	42.6	10.5	30.4	42.8	11.2	29.9	43.5	12.4	29.0	44.2	13.4	28.3
	26 / 19	44.4	9.21	31.2	44.3	10.3	30.3	44.2	10.7	30.0	44.2	11.4	29.5	44.1	12.6	28.6	44.0	13.6	28.0
	27 / 19.5	44.8	9.26	32.0	44.7	10.3	31.2	44.6	10.8	30.8	44.5	11.4	30.3	44.3	12.6	29.5	44.1	13.6	28.8
	28 / 21	46.2	9.40	31.3	46.1	10.5	30.4	46.0	10.9	30.1	45.8	11.6	29.5	45.3	12.8	28.6	44.8	13.8	27.9
	30 / 22	47.2	9.50	33.7	47.0	10.6	32.7	46.9	11.0	32.4	46.7	11.7	31.8	46.2	12.9	30.9	45.6	13.9	30.2
	32 / 23.5	48.6	9.66	36.3	48.4	10.7	35.3	48.3	11.2	34.9	48.1	11.9	34.3	47.7	13.1	33.3			
162	24 / 17	48.3	10.4	36.2	49.1	11.5	35.2	49.3	12.0	34.7	49.5	12.8	34.1	49.5	14.2	33.1	49.3	15.4	32.2
	26 / 19	50.5	10.5	35.9	50.4	11.7	34.9	50.4	12.2	34.4	50.6	12.9	33.8	51.1	14.3	32.8	51.7	15.5	31.9
	27 / 19.5	51.0	10.6	36.8	50.8	11.7	35.8	50.8	12.2	35.4	51.0	13.0	34.8	51.5	14.4	33.7	52.2	15.5	32.9
	28 / 21	52.6	10.7	35.3	52.2	11.9	34.3	52.2	12.4	33.9	52.3	13.1	33.3	52.7	14.5	32.3	53.3	15.7	31.5
	30 / 22	53.7	10.8	36.8	53.3	12.0	35.9	53.3	12.5	35.5	53.3	13.3	34.9	53.5	14.6	34.0	53.9	15.7	33.2
	32 / 23.5	55.3	11.0	36.7	55.2	12.2	35.8	55.1	12.7	35.4	55.0	13.5	34.9	54.7	14.8	34.0	54.4	15.9	33.3
182	24 / 17	59.5	12.1	44.2	59.8	13.4	42.9	59.8	13.9	42.4	59.7	14.8	41.7	59.3	16.3	40.4	58.8	17.7	39.4
	26 / 19	62.0	12.3	44.2	62.1	13.5	42.9	62.0	14.0	42.4	61.8	14.9	41.7	61.2	16.5	40.4	60.5	17.9	39.4
	27 / 19.5	62.6	12.3	45.4	62.7	13.6	44.1	62.6	14.1	43.6	62.4	15.0	42.9	61.7	16.5	41.6	60.9	17.9	40.6
	28 / 21	64.6	12.5	43.7	64.6	13.8	42.2	64.5	14.3	41.7	64.2	15.2	40.8	63.3	16.7	39.4	62.3	17.9	38.3
	30 / 22	65.9	12.6	45.3	66.0	14.0	43.7	65.9	14.5	43.1	65.5	15.4	42.2	64.5	16.7	40.6	63.2	17.8	39.4
	32 / 23.5	67.9	12.7	44.0	68.2	14.3	42.2	68.0	14.9	41.4	67.6	15.7	40.3	66.3	16.8	38.5			
222	24 / 17	68.2	14.8	50.8	68.5	16.4	49.4	68.5	17.1	48.8	68.6	18.1	48.0	68.5	19.9	46.6	68.3	21.4	45.5
	26 / 19	71.0	15.1	51.1	70.9	16.7	49.7	70.9	17.3	49.1	70.9	18.4	48.3	71.2	20.2	46.9	71.5	21.7	45.8
	27 / 19.5	71.6	15.1	52.5	71.5	16.8	51.1	71.5	17.4	50.5	71.5	18.5	49.7	71.8	20.2	48.3	72.2	21.7	47.2
	28 / 21	73.6	15.4	50.6	73.4	17.0	49.2	73.3	17.7	48.7	73.4	18.7	47.9	73.7	20.4	46.5	74.0	21.9	45.4
	30 / 22	74.8	15.5	53.0	74.6	17.2	51.7	74.6	17.8	51.1	74.6	18.8	50.3	74.8	20.6	49.0	75.1	22.0	47.9
	32 / 23.5	76.6	15.8	53.8	76.6	17.4	52.4	76.6	18.1	51.9	76.6	19.1	51.1	76.4	20.7	49.7	76.3	22.0	48.7
262	24 / 17	84.7	16.5	63.7	85.1	18.3	62.5	85.1	19.0	62.0	85.1	20.2	61.2	84.9	22.3	60.0	84.5	24.1	59.0
	26 / 19	88.2	16.9	63.0	88.2	18.6	61.8	88.2	19.3	61.3	88.2	20.4	60.6	88.2	22.5	59.4	88.2	24.3	58.5
	27 / 19.5	89.1	17.0	64.6	89.0	18.6	63.4	88.9	19.4	62.9	88.9	20.5	62.2	89.0	22.6	60.9	89.1	24.3	59.9
	28 / 21	91.8	17.2	62.2	91.3	18.9	60.7	91.2	19.7	60.1	91.1	20.8	59.1	91.3	22.7	57.6	91.6	24.4	56.4
	30 / 22	93.7	17.3	65.3	92.9	19.1	63.5	92.7	19.9	62.8	92.5	21.0	61.7	92.7	22.8	59.8	93.2	24.3	58.4
	32 / 23.5	96.5	17.4	66.3	95.2	19.5	63.8	94.9	20.3	62.9	94.6	21.4	61.4	94.7	23.0	58.9			

Ta = ambient air temperature D.B/W.B

DB = dry bulb

WB = wet bulb

kWf = Cooling capacity in kW

kWe = Compressor power input in kW

kWs = sensible cooling capacity (kW)

not all cooling yields take into account the heat dissipated by the fan motors

AIR FLOW: REDUCED

COOLING PERFORMANCE

Size	Ta (°C) DB/WB	OUTDOOR AIR TEMPERATURE °C																	
		25			30			32			35			40			44		
		kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs
302	24 / 17	92.7	19.2	70.2	93.2	21.2	68.2	93.3	22.1	67.4	93.5	23.5	66.2	93.6	26.0	64.2	93.5	28.2	62.6
	26 / 19	96.3	19.5	69.7	96.1	21.6	67.8	96.1	22.5	67.0	96.4	23.9	65.9	97.3	26.3	64.0	98.4	28.3	62.5
	27 / 19.5	97.2	19.6	71.6	96.9	21.7	69.7	97.0	22.6	68.9	97.3	24.0	67.8	98.2	26.4	65.9	99.4	28.4	64.4
	28 / 21	100.3	19.9	68.8	99.9	22.0	67.0	99.9	22.8	66.3	100.1	24.2	65.2	100.9	26.6	63.4	102.0	28.6	61.9
	30 / 22	102.5	20.0	72.3	102.2	22.1	70.5	102.2	23.0	69.8	102.2	24.4	68.7	102.6	26.7	66.9	103.2	28.7	65.5
	32 / 23.5	105.9	20.3	72.8	106.0	22.4	71.1	106.0	23.3	70.4	105.8	24.6	69.3	105.1	27.0	67.6	104.4	29.0	66.2

Ta = ambient air temperature D.B/W.B
DB = dry bulb
WB = wet bulb
kWf = Cooling capacity in kW
kWe = Compressor power input in kW
kWs = sensible cooling capacity (kW)
not all cooling yields take into account the heat dissipated by the fan motors

AIR FLOW: REDUCED

HEATING PERFORMANCE

Size	Ta (°C) DB/WB	RETURN AIR TEMPERATURE (D.B.)													
		10		15		18		19		20		21		25	
		kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe
82	-5 / -5.4	24.3	4.54	25.0	5.07	25.3	5.40	25.3	5.51	25.4	5.62	25.5	5.74	25.7	6.20
	0 / -0.6	27.7	5.20	27.8	5.70	27.9	6.05	28.0	6.18	28.1	6.31	28.2	6.44	28.7	7.01
	5 / 3.9	30.9	5.88	30.6	6.39	30.7	6.76	30.7	6.89	30.8	7.03	30.9	7.18	31.5	7.80
	7 / 6.1	32.5	6.23	32.1	6.76	32.1	7.14	32.2	7.27	32.2	7.42	32.3	7.56	32.8	8.20
	10 / 8.2	34.1	6.57	33.6	7.13	33.6	7.52	33.6	7.66	33.6	7.80	33.7	7.95	34.0	8.58
	15 / 13	37.6	7.40	37.2	8.06	37.1	8.47	37.0	8.61	37.0	8.75	36.9	8.89	36.7	9.47
102	-5 / -5.4	29.0	5.70	28.8	6.18	28.9	6.52	28.9	6.64	29.0	6.77	29.0	6.90	29.4	7.46
	0 / -0.6	32.2	6.30	31.9	6.84	31.9	7.22	31.9	7.36	32.0	7.50	32.0	7.64	32.4	8.27
	5 / 3.9	35.1	6.91	35.0	7.56	35.0	7.99	35.1	8.14	35.1	8.29	35.1	8.45	35.4	9.11
	7 / 6.1	36.4	7.22	36.6	7.95	36.7	8.41	36.7	8.56	36.7	8.72	36.8	8.88	37.0	9.55
	10 / 8.2	37.7	7.54	38.1	8.34	38.3	8.83	38.3	8.99	38.4	9.15	38.4	9.32	38.5	9.98
	15 / 13	40.5	8.29	41.8	9.31	42.2	9.88	42.3	10.1	42.4	10.2	42.4	10.4	42.2	11.1
122	-5 / -5.4	34.6	6.15	34.5	6.64	34.6	6.99	34.7	7.12	34.7	7.25	34.8	7.38	35.3	7.95
	0 / -0.6	38.6	6.73	38.6	7.33	38.7	7.74	38.7	7.88	38.8	8.02	38.8	8.17	39.2	8.80
	5 / 3.9	42.7	7.42	42.7	8.11	42.7	8.55	42.8	8.71	42.8	8.87	42.9	9.03	43.1	9.69
	7 / 6.1	44.8	7.81	44.8	8.53	44.8	9.00	44.9	9.16	44.9	9.32	44.9	9.48	45.0	10.2
	10 / 8.2	47.0	8.21	46.9	8.97	46.9	9.44	46.9	9.61	46.9	9.77	46.9	9.94	46.9	10.6
	15 / 13	52.2	9.25	51.9	10.1	51.8	10.6	51.7	10.7	51.7	10.9	51.7	11.1	51.5	11.8
162	-5 / -5.4	40.6	7.73	40.4	8.29	40.5	8.70	40.6	8.84	40.7	9.00	40.8	9.15	41.4	9.84
	0 / -0.6	45.2	8.38	45.2	9.10	45.3	9.57	45.4	9.74	45.4	9.90	45.5	10.1	45.7	10.8
	5 / 3.9	49.8	9.15	49.9	9.98	50.0	10.5	50.0	10.7	50.0	10.9	50.0	11.0	50.1	11.8
	7 / 6.1	52.2	9.58	52.2	10.4	52.2	11.0	52.3	11.2	52.3	11.4	52.3	11.6	52.4	12.4
	10 / 8.2	54.5	10.0	54.5	10.9	54.5	11.5	54.5	11.7	54.5	11.9	54.5	12.1	54.6	12.9
	15 / 13	60.1	11.2	59.6	12.1	59.6	12.7	59.6	12.9	59.6	13.1	59.7	13.4	60.1	14.3
182	-5 / -5.4	49.5	9.04	49.7	9.75	49.8	10.2	49.9	10.4	49.9	10.5	50.0	10.7	50.3	11.4
	0 / -0.6	54.6	9.73	54.8	10.6	54.9	11.1	55.0	11.3	55.0	11.5	55.1	11.7	55.3	12.5
	5 / 3.9	60.0	10.6	60.1	11.5	60.2	12.1	60.2	12.3	60.2	12.5	60.2	12.7	60.3	13.6
	7 / 6.1	62.8	11.0	62.8	12.0	62.9	12.6	62.9	12.8	62.9	13.0	62.9	13.3	63.0	14.2
	10 / 8.2	65.7	11.5	65.5	12.5	65.5	13.2	65.5	13.4	65.5	13.6	65.5	13.8	65.5	14.8
	15 / 13	72.6	12.8	72.1	13.8	71.9	14.5	71.8	14.7	71.8	15.0	71.8	15.2	71.8	16.2
222	-5 / -5.4	52.0	10.1	54.4	11.1	55.7	11.7	56.0	11.9	56.4	12.1	56.7	12.3	57.8	13.2
	0 / -0.6	60.8	11.1	62.0	12.1	62.6	12.7	62.8	13.0	63.0	13.2	63.2	13.4	63.9	14.4
	5 / 3.9	68.7	12.2	69.0	13.2	69.2	13.9	69.3	14.1	69.4	14.4	69.5	14.6	69.9	15.7
	7 / 6.1	72.4	12.7	72.4	13.8	72.5	14.5	72.5	14.8	72.6	15.0	72.6	15.3	72.9	16.4
	10 / 8.2	75.8	13.3	75.7	14.4	75.6	15.2	75.7	15.4	75.7	15.7	75.7	16.0	75.8	17.1
	15 / 13	83.4	14.7	83.1	16.0	82.9	16.8	82.9	17.1	82.9	17.4	82.8	17.6	82.7	18.8
262	-5 / -5.4	70.1	12.3	69.8	13.1	69.8	13.7	69.8	13.9	69.9	14.1	69.9	14.3	70.3	15.2
	0 / -0.6	76.7	13.1	77.0	14.1	77.1	14.8	77.1	15.0	77.1	15.3	77.2	15.5	77.2	16.5
	5 / 3.9	84.3	14.1	84.4	15.3	84.5	16.0	84.5	16.3	84.5	16.6	84.5	16.8	84.6	17.9
	7 / 6.1	88.4	14.8	88.3	15.9	88.3	16.7	88.3	17.0	88.3	17.3	88.4	17.5	88.4	18.7
	10 / 8.2	92.7	15.4	92.2	16.6	92.1	17.4	92.1	17.7	92.1	18.0	92.1	18.3	92.3	19.5
	15 / 13	103.5	17.1	101.7	18.3	101.2	19.2	101.1	19.5	101.1	19.8	101.2	20.1	101.8	21.5

Ta = Outside air temperature (°C)

DB = dry bulb

WB = wet bulb

kWt = Heating capacity (kW)

with coils free of ice

kWe = Compressor power input in kW

not all thermal yields take into account the heat dissipated by the fan motors

AIR FLOW: REDUCED

HEATING PERFORMANCE

Size	Ta (°C) DB/WB	RETURN AIR TEMPERATURE (D.B.)													
		10		15		18		19		20		21		25	
		kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe
302	-5 / -5.4	75.2	13.6	75.3	14.7	75.6	15.3	75.7	15.6	75.9	15.8	76.1	16.0	77.2	17.0
	0 / -0.6	84.3	14.8	84.4	15.9	84.7	16.7	84.8	17.0	84.9	17.2	85.1	17.5	85.8	18.7
	5 / 3.9	93.3	16.1	93.3	17.4	93.5	18.2	93.6	18.5	93.7	18.8	93.7	19.1	94.2	20.4
	7 / 6.1	97.8	16.8	97.8	18.1	97.9	19.0	98.0	19.3	98.0	19.6	98.1	19.9	98.4	21.3
	10 / 8.2	102.3	17.5	102.2	18.9	102.2	19.8	102.2	20.1	102.2	20.5	102.2	20.8	102.4	22.2
	15 / 13	113.0	19.2	112.5	20.8	112.2	21.9	112.1	22.2	112.1	22.6	112.0	22.9	111.8	24.4

Ta = Outside air temperature (°C)

DB = dry bulb

WB = wet bulb

kWt = Heating capacity (kW)

with coils free of ice

kWe = Compressor power input in kW

not all thermal yields take into account the heat dissipated by the fan motors

INTEGRATED HEATING CAPACITIES

Air temperature external exchanger inlet °C (D.B. / W.B.)	-5 / -5.4	0 / -0.6	5 / 3.9	OTHERS
Heating capacity multiplication coefficient	0.89	0.88	0.94	1

To obtain the integrated heating capacities (the real heating capacity considering the defrost cycles too), multiply the kWt value in the heating performance tables by the following coefficient.

DB = dry bulb

WB = wet bulb

In case of below zero air ambient temperature with a long period of heat pump operating mode it is necessary to help the evacuation of the water produced during the defrost cycle; this to avoid the formation of ice in the unit basement. Pay attention that the evacuation will not create inconveniences to things or persons.

AIR FLOW: HIGH

Size			82	102	122	162	182	222	262	302
AIR HANDLING SECTION FANS (OUTLET)										
Air flow		l/s	1650	2040	2500	2650	3600	3900	5150	5250
Max outside static pressure	1	Pa	160	550	300	450	280	250	300	400

(1) Net outside static pressure to win the outlet and intake onboard pressure drops

COOLING PERFORMANCE

Size	Ta (°C) DB/WB	OUTDOOR AIR TEMPERATURE °C																	
		25			30			32			35			40			44		
		kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs
82	16 / 12	28.9	6.15	21.1	29.2	6.91	20.2	29.3	7.23	19.8	29.4	7.72	19.3	29.5	8.59	18.4	29.6	9.31	17.7
	20 / 14	30.0	6.34	23.7	30.3	7.06	23.0	30.4	7.37	22.7	30.4	7.86	22.2	30.4	8.74	21.5	30.3	9.50	20.9
	24 / 17	31.7	6.59	24.9	31.9	7.30	24.3	32.0	7.60	24.0	32.0	8.08	23.6	31.9	8.92	23.0	31.7	9.64	22.4
	26 / 19	32.9	6.72	24.7	33.0	7.46	24.1	33.0	7.76	23.8	33.0	8.22	23.4	32.9	9.01	22.8	32.7	9.66	22.2
	27 / 19.5	33.2	6.75	25.5	33.2	7.50	24.8	33.2	7.80	24.6	33.2	8.26	24.2	33.1	9.03	23.5	33.0	9.65	23.0
	28 / 21	34.1	6.83	24.5	34.0	7.62	23.8	34.0	7.93	23.6	33.9	8.37	23.1	33.9	9.08	22.4	33.9	9.61	21.9
102	16 / 12	33.0	7.44	22.9	33.2	8.33	21.9	33.3	8.69	21.6	33.6	9.24	21.0	34.0	10.2	20.1	34.5	10.9	19.3
	20 / 14	34.1	7.63	27.3	34.3	8.51	26.5	34.4	8.87	26.2	34.6	9.41	25.7	35.0	10.3	24.8	35.4	11.1	24.2
	24 / 17	36.0	7.92	29.0	36.1	8.79	28.2	36.2	9.15	27.9	36.3	9.69	27.5	36.5	10.6	26.8	36.7	11.4	26.2
	26 / 19	37.4	8.11	28.6	37.5	8.99	27.9	37.6	9.34	27.6	37.6	9.88	27.2	37.7	10.8	26.4	37.7	11.5	25.9
	27 / 19.5	37.8	8.15	29.4	37.9	9.04	28.7	37.9	9.39	28.4	38.0	9.93	28.0	38.0	10.8	27.3	37.9	11.6	26.7
	28 / 21	39.0	8.29	28.4	39.1	9.19	27.6	39.1	9.55	27.3	39.0	10.1	26.9	38.9	11.0	26.2	38.7	11.7	25.6
122	16 / 12	41.3	8.57	29.1	41.8	9.56	27.9	42.0	9.97	27.3	42.2	10.6	26.6	42.5	11.7	25.3	42.6	12.6	24.3
	20 / 14	42.8	8.84	34.5	43.2	9.80	33.4	43.4	10.2	33.0	43.5	10.9	32.3	43.7	12.0	31.2	43.8	13.0	30.4
	24 / 17	45.3	9.21	36.6	45.5	10.2	35.7	45.6	10.6	35.3	45.7	11.2	34.7	45.7	12.4	33.8	45.6	13.4	33.1
	26 / 19	47.0	9.46	36.2	47.2	10.4	35.3	47.2	10.8	34.9	47.2	11.5	34.4	47.1	12.6	33.5	46.9	13.6	32.8
	27 / 19.5	47.5	9.51	37.3	47.6	10.5	36.4	47.6	10.9	36.1	47.6	11.5	35.6	47.4	12.7	34.7	47.2	13.7	34.0
	28 / 21	48.9	9.69	35.9	48.9	10.6	35.0	48.9	11.0	34.6	48.8	11.7	34.1	48.5	12.8	33.2			
162	16 / 12	47.0	9.97	33.3	47.3	11.0	32.2	47.4	11.5	31.8	47.6	12.2	31.1	48.0	13.5	30.0	48.4	14.7	29.1
	20 / 14	48.7	10.2	38.3	48.8	11.3	37.3	48.9	11.7	36.9	49.0	12.5	36.3	49.4	13.8	35.3	49.7	15.0	34.5
	24 / 17	51.4	10.5	40.2	51.4	11.6	39.2	51.4	12.1	38.8	51.4	12.9	38.3	51.6	14.2	37.3	51.9	15.3	36.5
	26 / 19	53.4	10.7	39.9	53.3	11.8	38.9	53.3	12.3	38.5	53.2	13.1	37.8	53.3	14.4	36.8	53.4	15.5	36.0
	27 / 19.5	54.0	10.7	41.0	53.8	11.9	40.0	53.7	12.4	39.6	53.7	13.1	39.0	53.7	14.5	37.9	53.8	15.6	37.1
	28 / 21	55.6	10.9	39.9	55.3	12.0	38.7	55.3	12.5	38.3	55.2	13.3	37.6	55.1	14.6	36.5	55.1	15.7	35.6
182	16 / 12	57.8	11.6	42.5	58.7	12.9	40.6	58.9	13.4	39.8	59.1	14.2	38.7	59.0	15.6	36.8	58.6	16.9	35.2
	20 / 14	60.1	11.9	49.0	60.9	13.1	47.3	61.0	13.6	46.6	61.0	14.4	45.6	60.7	15.9	43.9	59.9	17.2	42.6
	24 / 17	63.7	12.2	52.2	64.2	13.5	50.7	64.2	14.0	50.1	64.0	14.8	49.3	63.3	16.3	47.8	62.4	17.5	46.6
	26 / 19	66.2	12.5	51.8	66.4	13.7	50.4	66.3	14.2	49.8	66.0	15.0	49.0	65.2	16.5	47.6	64.2	17.7	46.5
	27 / 19.5	66.8	12.5	53.4	66.9	13.8	52.0	66.8	14.3	51.5	66.5	15.1	50.7	65.7	16.5	49.3	64.7	17.7	48.1
	28 / 21	68.7	12.7	51.0	68.6	14.0	49.6	68.4	14.5	49.1	68.1	15.3	48.2	67.2	16.6	46.8			
222	16 / 12	65.8	14.1	46.3	66.3	15.6	44.8	66.5	16.2	44.3	66.8	17.2	43.4	67.3	18.9	42.0	67.8	20.4	40.9
	20 / 14	68.1	14.5	52.9	68.3	16.0	51.5	68.4	16.6	50.9	68.6	17.6	50.1	69.2	19.3	48.6	69.7	20.8	47.5
	24 / 17	71.8	14.9	56.3	71.7	16.5	54.9	71.7	17.1	54.3	71.8	18.1	53.4	72.2	19.9	52.0	72.7	21.3	50.8
	26 / 19	74.4	15.3	56.2	74.2	16.8	54.8	74.2	17.5	54.2	74.2	18.4	53.3	74.4	20.1	51.8	74.8	21.5	50.7
	27 / 19.5	75.0	15.3	58.0	74.9	16.9	56.6	74.8	17.5	56.0	74.9	18.5	55.1	75.0	20.2	53.7	75.3	21.6	52.5
	28 / 21	77.1	15.6	56.1	76.9	17.1	54.6	76.9	17.8	54.0	76.8	18.7	53.2	76.8	20.4	51.7	76.9	21.7	50.5
262	16 / 12	81.5	16.0	58.5	81.5	17.8	57.2	81.6	18.5	56.7	82.0	19.7	55.9	83.2	21.6	54.6	84.5	23.2	53.6
	20 / 14	84.6	16.4	69.4	84.6	18.1	67.5	84.8	18.8	66.7	85.1	19.9	65.6	86.1	21.8	63.7	87.2	23.4	62.2
	24 / 17	89.6	16.9	73.9	89.5	18.5	71.9	89.6	19.2	71.0	89.7	20.3	69.8	90.2	22.2	67.8	90.8	23.8	66.1
	26 / 19	93.0	17.2	73.3	92.8	18.8	71.7	92.8	19.5	71.0	92.7	20.6	70.0	92.7	22.5	68.3	92.8	24.1	66.9
	27 / 19.5	93.9	17.2	75.9	93.7	18.9	74.3	93.6	19.6	73.7	93.5	20.7	72.8	93.4	22.6	71.3	93.3	24.2	70.0
	28 / 21	96.6	17.4	73.1	96.2	19.1	72.1	96.0	19.8	71.8	95.7	20.9	71.2	95.2	22.9	70.3			

Ta = ambient air temperature D.B/W.B

DB = dry bulb

WB = wet bulb

kWf = Cooling capacity in kW

kWe = Compressor power input in kW

kWs = sensible cooling capacity (kW)

not all cooling yields take into account the heat dissipated by the fan motors

AIR FLOW: HIGH

COOLING PERFORMANCE

Size	Ta (°C) DB/WB	OUTDOOR AIR TEMPERATURE °C																	
		25			30			32			35			40			44		
		kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs	kWf	kWe	kWs
302	16 / 12	88.6	18.4	64.1	89.5	20.3	61.7	89.9	21.2	60.8	90.4	22.5	59.3	91.3	24.8	57.0	92.0	26.9	55.1
	20 / 14	91.8	18.8	73.7	92.2	20.8	71.6	92.4	21.7	70.7	92.8	23.0	69.4	93.6	25.4	67.2	94.5	27.4	65.5
	24 / 17	97.1	19.4	78.6	96.9	21.5	77.0	97.0	22.3	76.3	97.2	23.7	75.3	98.0	26.0	73.6	99.0	27.9	72.3
	26 / 19	100.9	19.8	76.7	100.6	21.8	75.5	100.6	22.7	75.0	100.8	24.0	74.3	101.5	26.3	73.1	102.5	28.2	72.1
	27 / 19.5	101.9	19.9	78.4	101.6	21.9	77.4	101.6	22.8	77.0	101.8	24.1	76.3	102.5	26.3	75.3	103.5	28.2	74.4
	28 / 21	105.0	20.1	72.1	104.7	22.1	71.5	104.7	23.0	71.3	104.8	24.3	70.9	105.5	26.5	70.3	106.5	28.3	69.8

Ta = ambient air temperature D.B/W.B
DB = dry bulb
WB = wet bulb
kWf = Cooling capacity in kW
kWe = Compressor power input in kW
kWs = sensible cooling capacity (kW)
not all cooling yields take into account the heat dissipated by the fan motors

AIR FLOW: HIGH

HEATING PERFORMANCE

Size	Ta (°C) DB/WB	RETURN AIR TEMPERATURE (D.B.)													
		10		15		18		19		20		21		25	
		kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe
82	-5 / -5.4			25.2	4.54	25.3	4.81	25.4	4.91	25.6	5.01	25.8	5.12	26.9	5.61
	0 / -0.6	28.4	4.64	28.2	5.05	28.4	5.35	28.5	5.46	28.6	5.57	28.7	5.68	29.4	6.18
	5 / 3.9	31.2	5.11	31.2	5.59	31.4	5.92	31.4	6.03	31.5	6.15	31.6	6.27	32.0	6.79
	7 / 6.1	32.7	5.36	32.8	5.88	32.9	6.21	32.9	6.33	33.0	6.45	33.0	6.58	33.3	7.10
	10 / 8.2	34.1	5.62	34.2	6.16	34.3	6.51	34.4	6.63	34.4	6.76	34.5	6.88	34.7	7.41
	15 / 13	37.7	6.24	37.7	6.85	37.8	7.23	37.8	7.36	37.8	7.49	37.8	7.63	37.8	8.18
102	-5 / -5.4			30.6	5.55	30.2	5.77	30.1	5.85	30.0	5.93	29.9	6.02	29.5	6.41
	0 / -0.6	31.7	5.32	32.9	5.91	33.3	6.25	33.3	6.37	33.4	6.48	33.4	6.60	33.2	7.05
	5 / 3.9	33.7	5.64	35.6	6.37	36.3	6.79	36.5	6.93	36.6	7.06	36.7	7.20	36.6	7.71
	7 / 6.1	35.3	5.88	37.1	6.64	37.9	7.08	38.0	7.23	38.1	7.37	38.2	7.51	38.3	8.06
	10 / 8.2	37.1	6.17	38.7	6.93	39.4	7.38	39.5	7.53	39.6	7.67	39.7	7.82	39.8	8.39
	15 / 13	42.7	7.01	42.9	7.69	43.0	8.13	43.0	8.27	43.1	8.43	43.2	8.58	43.4	9.21
122	-5 / -5.4			36.5	6.14	36.8	6.45	36.9	6.56	37.0	6.68	37.1	6.79	37.6	7.29
	0 / -0.6	39.7	6.09	40.1	6.63	40.4	7.00	40.5	7.13	40.6	7.26	40.7	7.39	41.2	7.95
	5 / 3.9	43.5	6.58	43.9	7.21	44.1	7.61	44.2	7.75	44.3	7.90	44.4	8.04	44.9	8.65
	7 / 6.1	45.5	6.87	45.9	7.53	46.1	7.95	46.2	8.10	46.3	8.25	46.4	8.40	46.8	9.03
	10 / 8.2	47.5	7.17	47.9	7.85	48.1	8.29	48.2	8.45	48.3	8.60	48.3	8.76	48.7	9.41
	15 / 13	52.6	7.95	52.8	8.69	52.9	9.16	53.0	9.33	53.0	9.49	53.1	9.66	53.3	10.3
162	-5 / -5.4			41.5	7.66	41.8	8.02	41.9	8.16	42.2	8.30	42.4	8.46	43.9	9.16
	0 / -0.6	45.9	7.64	46.5	8.29	46.9	8.72	47.0	8.87	47.1	9.03	47.2	9.18	47.6	9.84
	5 / 3.9	50.3	8.19	51.3	8.99	51.6	9.47	51.6	9.63	51.7	9.80	51.7	9.96	51.5	10.6
	7 / 6.1	52.7	8.53	53.6	9.36	53.9	9.87	53.9	10.0	53.9	10.2	53.9	10.4	53.6	11.0
	10 / 8.2	55.1	8.88	55.9	9.75	56.1	10.3	56.1	10.4	56.1	10.6	56.1	10.8	55.7	11.5
	15 / 13	61.2	9.84	61.1	10.7	61.0	11.2	61.0	11.4	61.0	11.6	61.0	11.8	61.0	12.6
182	-5 / -5.4			50.1	8.82	50.1	9.18	50.1	9.31	50.1	9.44	50.1	9.58	50.1	10.1
	0 / -0.6	55.4	8.74	55.6	9.41	55.8	9.86	55.9	10.0	56.0	10.2	56.1	10.3	56.4	11.0
	5 / 3.9	61.0	9.34	61.3	10.1	61.5	10.6	61.6	10.8	61.7	11.0	61.9	11.2	62.4	11.9
	7 / 6.1	64.0	9.68	64.2	10.5	64.5	11.0	64.5	11.2	64.6	11.4	64.8	11.6	65.2	12.4
	10 / 8.2	67.0	10.0	67.1	10.9	67.3	11.5	67.4	11.6	67.5	11.8	67.6	12.0	68.0	12.9
	15 / 13	74.3	11.0	74.1	11.9	74.1	12.5	74.1	12.7	74.1	12.9	74.1	13.1	74.2	14.0
222	-5 / -5.4			58.7	10.6	59.3	11.1	59.5	11.3	59.7	11.5	60.0	11.7	61.1	12.5
	0 / -0.6	63.3	10.4	64.2	11.3	65.0	11.9	65.3	12.1	65.6	12.3	65.9	12.5	67.3	13.5
	5 / 3.9	69.2	11.2	70.1	12.2	70.8	12.8	71.1	13.0	71.4	13.3	71.7	13.5	73.2	14.5
	7 / 6.1	72.4	11.6	73.1	12.6	73.8	13.3	74.1	13.6	74.4	13.8	74.7	14.1	76.1	15.1
	10 / 8.2	75.7	12.1	76.2	13.1	76.8	13.8	77.0	14.1	77.3	14.3	77.6	14.6	79.0	15.7
	15 / 13	84.0	13.3	83.7	14.4	84.0	15.1	84.1	15.4	84.3	15.7	84.5	15.9	85.5	17.1
262	-5 / -5.4			70.3	12.2	70.7	12.7	70.9	12.9	70.9	13.0	71.0	13.2	71.1	14.0
	0 / -0.6	77.3	12.0	78.0	12.9	78.4	13.5	78.6	13.7	78.7	13.9	78.8	14.2	79.3	15.1
	5 / 3.9	85.3	12.9	85.8	13.9	86.2	14.5	86.4	14.7	86.5	15.0	86.6	15.2	87.2	16.2
	7 / 6.1	89.4	13.3	89.9	14.4	90.2	15.1	90.4	15.3	90.5	15.5	90.6	15.8	91.2	16.8
	10 / 8.2	93.5	13.8	93.9	14.9	94.2	15.6	94.3	15.9	94.4	16.1	94.5	16.4	95.0	17.4
	15 / 13	103.2	15.0	103.6	16.2	103.8	17.0	103.8	17.3	103.8	17.6	103.8	17.8	103.8	19.0

Ta = Outside air temperature (°C)

DB = dry bulb

WB = wet bulb

kWt = Heating capacity (kW)

with coils free of ice

kWe = Compressor power input in kW

not all thermal yields take into account the heat dissipated by the fan motors

AIR FLOW: HIGH

HEATING PERFORMANCE

Size	Ta (°C) DB/WB	RETURN AIR TEMPERATURE (D.B.)													
		10		15		18		19		20		21		25	
		kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe	kWt	kWe
302	-5 / -5.4			78.1	13.9	78.6	14.6	78.8	14.8	79.0	15.0	79.2	15.2	80.1	16.2
	0 / -0.6	85.6	13.9	86.2	14.9	86.7	15.6	86.8	15.9	87.0	16.1	87.2	16.4	88.1	17.5
	5 / 3.9	94.2	14.9	94.6	16.1	94.9	16.9	95.1	17.1	95.2	17.4	95.4	17.7	96.2	18.9
	7 / 6.1	98.7	15.5	99.0	16.7	99.2	17.5	99.4	17.8	99.5	18.1	99.7	18.4	100.4	19.6
	10 / 8.2	103.2	16.1	103.3	17.3	103.5	18.2	103.6	18.5	103.7	18.8	103.9	19.1	104.5	20.4
	15 / 13	114.1	17.5	113.8	18.9	113.9	19.9	113.9	20.2	114.0	20.5	114.0	20.9	114.5	22.3

Ta = Outside air temperature (°C)

DB = dry bulb

WB = wet bulb

kWt = Heating capacity (kW)

with coils free of ice

kWe = Compressor power input in kW

not all thermal yields take into account the heat dissipated by the fan motors

INTEGRATED HEATING CAPACITIES

Air temperature external exchanger inlet °C (D.B. / W.B.)	-5 / -5.4	0 / -0.6	5 / 3.9	OTHERS
Heating capacity multiplication coefficient	0.89	0.88	0.94	1

To obtain the integrated heating capacities (the real heating capacity considering the defrost cycles too), multiply the kWt value in the heating performance tables by the following coefficient.

DB = dry bulb

WB = wet bulb

In case of below zero air ambient temperature with a long period of heat pump operating mode it is necessary to help the evacuation of the water produced during the defrost cycle; this to avoid the formation of ice in the unit basement. Pay attention that the evacuation will not create inconveniences to things or persons.

ACCESSORIES

FCE - ENTHALPY FREE-COOLING (ONLY FOR C VERSION)


When external conditions allow it, the unit is capable of automatically activating free-cooling mode, which, by keeping the compressors off and drawing in suitably filtered fresh air, cools the served room. The fresh air flow can be varied based on actual needs. This operating mode is especially useful in spring and autumn or with high ambient loads. It allows substantial reduction of the unit's energy consumption and wear of the compressors by placing air directly into the room. The settings are determined automatically by comparing the temperature and humidity outside and in the served room.

CHW2 - TWO-ROW HOT WATER COIL

Option recommended for very cold climates since it allows heating of the served room. The battery is equipped with a thermostat for the anti-freeze function. The anti-freeze function is always active, even when the unit is in standby. If necessary, it forces opening of the valve to the maximum allowable value for allow passage of water in the coil and to prevent the formation of ice.


In heat pump mode, the hot water coil may allow both pre-heating of the inlet air to the main coil, as well as integration of the capacity provided by the heat pump. As an alternative, it may intervene in complete substitution of the thermal capacity provided by the compressors. This is possible by setting a turning point, i.e. a temperature limit of the fresh air below which use of the compressors is blocked, and the water coil is used as the sole resource. If the water coil provides pre-heating of the air, the control logic reduces its power to a preset value, which keeps the compressors from working with condensation temperatures that are too high. If instead the water coil is used as the main resource (e.g. because the compressors are not available), the maximum power will be provided.

HOT WATER COIL PRESSURE DROP: AIR SIDE

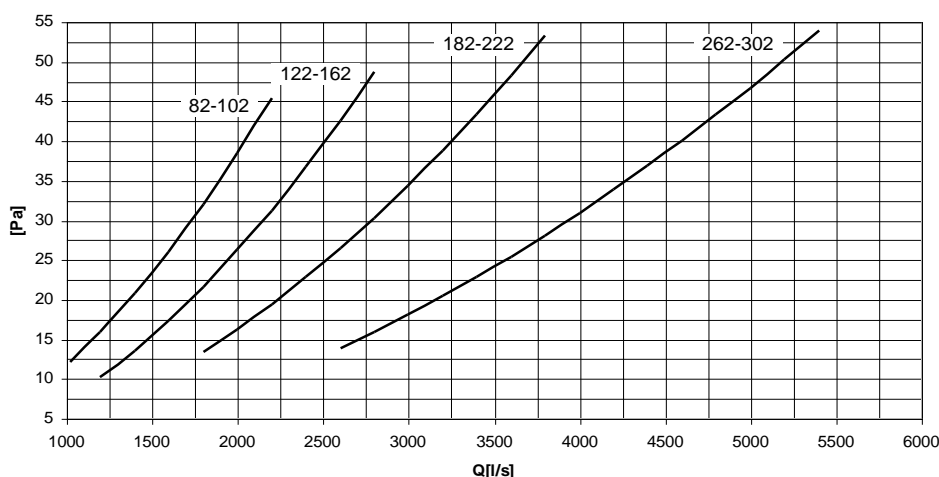

THE AIR SIDE PRESSURE DROPS ARE RELATIVE TO THE MEDIUM AIR TEMPERATURE OF 20°C AND ARE TO BE ADDED TO THE PRESSURE DROPS DUE TO DUCTS, TERMINAL DEVICES AND ANY OTHER COMPONENT THAT CAUSES A DROP IN WORKING DISCHARGE HEAD.
 $Q [L/S]$ = AIR FLOW RATE

HOT WATER COIL PRESSURE DROP: WATER SIDE

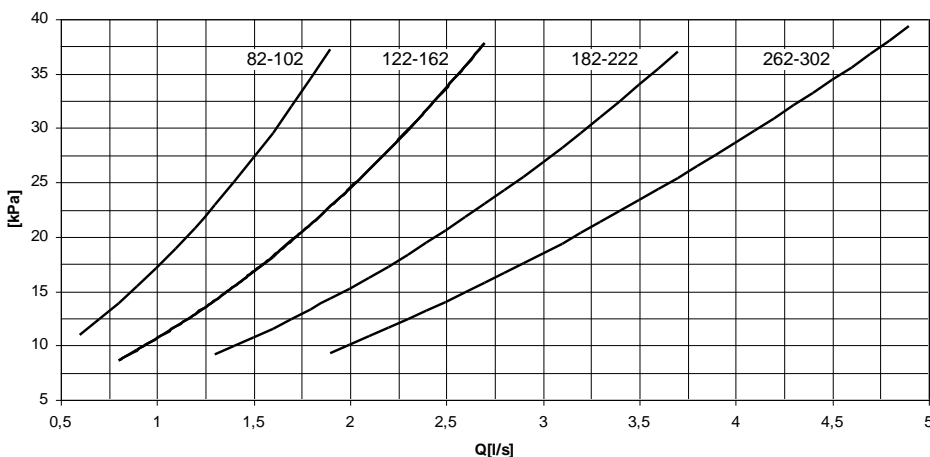

PRESSURE DROPS ON THE WATER SIDE ARE CALCULATED CONSIDERING AN AVERAGE WATER TEMPERATURE OF 65°C
 $Q [L/S]$ = WATER-FLOW RATE



This option reduces the available static pressure (air side).



The component requires connection to the hot water plumbing system (to be provided for by the client).

PERFORMANCES OF HOT WATER COIL (2 ROWS)

Size		Ti/To (°C)									
		80,0 / 65,0	70,0 / 50,0	60,0 / 40,0	80,0 / 65,0	70,0 / 50,0	60,0 / 40,0	80,0 / 65,0	70,0 / 50,0	60,0 / 40,0	
		kWt	kWt	kWt	kWt	kWt	kWt	kWt	kWt	kWt	
82	Qo (l/s)	1200			1500			1650			
	Ta (°C)	5	53,80	42,92	34,41	62,41	49,69	39,81	66,42	52,83	42,29
		10	49,30	38,50	30,08	57,20	44,55	34,75	60,88	47,35	36,91
		15	44,89	34,16	25,79	52,08	39,56	29,78	55,43	42,02	31,63
		18	42,27	31,59	23,23	49,06	36,52	26,81	52,21	38,85	28,48
		20	40,55	29,89	21,54	47,05	34,55	24,84	50,08	36,72	26,37
102	Qo (l/s)	1360			1700			2040			
	Ta (°C)	5	58,50	46,62	37,34	53,80	42,92	34,41	76,08	60,39	48,26
		10	53,61	41,82	32,62	49,30	38,50	30,08	69,74	54,17	42,15
		15	48,82	37,07	27,98	44,89	34,16	25,79	63,51	48,00	36,07
		18	45,98	34,27	25,19	42,27	31,59	23,23	59,82	44,38	32,45
		20	44,10	32,42	23,34	40,55	29,89	21,54	57,38	41,98	30,06
122	Qo (l/s)	1800			2220			2500			
	Ta (°C)	5	83,85	66,28	52,79	96,47	76,04	60,44	104,24	82,01	65,13
		10	77,04	59,52	46,08	88,56	68,25	52,72	95,76	73,67	56,83
		15	70,25	52,84	39,41	80,84	60,58	45,07	87,32	65,31	48,52
		18	66,26	48,88	35,42	76,20	55,97	40,47	82,36	60,37	43,57
		20	63,56	46,20	32,77	73,15	52,92	37,41	79,05	57,09	40,25
162	Qo (l/s)	2000			2500			2650			
	Ta (°C)	5	90,03	71,04	56,52	104,24	82,01	65,13	108,22	85,04	67,54
		10	82,68	63,80	49,33	95,76	73,67	56,83	99,42	76,39	58,90
		15	75,39	56,61	42,17	87,32	65,31	48,52	90,64	67,75	50,29
		18	71,08	52,33	37,91	82,36	60,37	43,57	85,50	62,60	45,15
		20	68,27	49,49	35,04	79,05	57,09	40,25	82,07	59,19	41,72
182	Qo (l/s)	2500			3060			3600			
	Ta (°C)	5	114,14	89,57	70,96	130,50	102,12	80,74	144,86	113,15	89,38
		10	104,78	80,35	61,79	119,72	91,62	70,30	133,06	101,44	77,70
		15	95,52	71,18	52,68	109,14	81,09	59,85	121,28	89,86	66,17
		18	90,01	65,72	47,24	102,92	74,87	53,61	114,25	82,87	59,20
		20	86,36	62,10	43,59	98,75	70,69	49,45	109,62	78,26	54,60
222	Qo (l/s)	3050			3610			3900			
	Ta (°C)	5	130,22	101,91	80,57	145,11	113,35	89,53	152,51	118,97	93,84
		10	119,46	91,36	70,16	133,30	101,61	77,83	139,97	106,59	81,58
		15	108,99	80,92	59,73	121,50	90,01	66,28	127,65	94,38	69,42
		18	102,62	74,71	53,50	114,45	83,01	59,30	120,23	87,12	62,17
		20	98,54	70,54	49,35	109,82	78,39	54,69	115,32	82,21	57,26
262	Qo (l/s)	3750			4440			5150			
	Ta (°C)	5	169,00	132,74	105,18	188,84	147,95	117,07	207,87	162,55	128,43
		10	155,06	119,00	91,59	173,43	132,72	101,94	190,80	145,68	111,72
		15	141,43	105,52	78,13	158,12	117,54	86,85	174,02	129,06	95,17
		18	133,30	97,39	70,05	149,03	108,52	77,88	163,89	119,08	85,22
		20	127,93	92,04	64,68	142,99	102,55	71,83	157,25	112,48	78,61
302	Qo (l/s)	4150			5000			5250			
	Ta (°C)	5	180,70	141,69	112,19	203,98	159,61	126,12	210,44	164,49	129,95
		10	165,82	127,06	97,75	187,24	143,02	109,72	193,14	147,43	113,05
		15	151,19	112,59	83,29	170,83	126,72	93,49	176,17	130,60	96,28
		18	142,57	103,99	74,65	160,93	116,92	83,71	165,95	120,61	86,21
		20	136,87	98,21	68,89	154,38	110,44	77,22	159,30	113,82	79,52

Ta = air temperature entering the air handling coil (°C)


Ti/To = water temperature inlet/outlet (°C)

Qo = air flow (l/s)

kWt = Heating capacity (kW)

3WVM - MODULATING 3-WAY VALVE

To be used in conjunction with the hot water coil (optional). It is controlled by the on-board microprocessor by means of a 0-10V signal and allows fully automatic adjustment of the hot water coil. The valve with modulating actuator is provided already installed and wired on the machine.

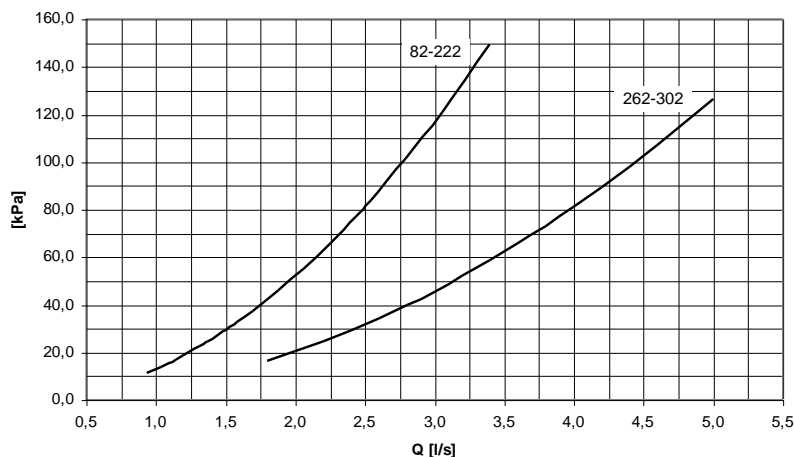

PRESSURE DROP
MODULATING THREE-WAY VALVE
Q[L/S]= WATER-FLOW RATE



HSE- STEAM HUMIDIFIER WITH IMMERGED ELECTRODES

This device is perfect for the winter period when it is necessary to add humidity to the room without cooling the air flow. The modulating automatic adjustment makes it possible to adapt the production of steam and the related operating costs to meet actual needs. Available in different powers, the device is suitable for use with unsoftened water of medium conductivity. It is complete with water filling solenoid valve, disposable cylinder, water drainage solenoid valve, distribution nozzle, electronic control card with functions of verification of water level, verification of conductivity, anti-foam, manual override of water drainage. To ensure the utmost hygiene, the cylinder is automatically drained after a certain period of inactivity. The device includes an automatically activated anti-freeze device. A supply probe is used to monitor the humidity level. It is installed and wired on-board the machine.

The accessory is installed inside the unit and is connected to the electrical panel of the machine.



COMBINATION SELECTRODE BOILER STEAM HUMIDIFIER

Size	82	102	122	162	182	222	262	302
3 kg/h	✓	✓	✓	✓	✓	✓	✓	✓
5 kg/h	✓	✓	✓	✓	✓	✓	✓	✓
8 kg/h	✓	✓	✓	✓	✓	✓	✓	✓
15 kg/h	✗	✗	✓	✓	✓	✓	✓	✓

⚠ This operation involves variation of the main electrical data of the machine.

⚠ This accessory requires the presence of a water circuit and drain on board the machine. Provided by the customer


HWS - WATER TO WASTE EVAPORATING WET-DECK HUMIDIFIER

This option is recommended when quick, efficient humidification of the served room is required. Humidification of the air mixture occurs by passing the air flow through a honeycomb package that is kept humid at all times by a series of nozzles that inject water in small drops. The reserve of water for treatment is taken directly from the water mains. During operation, the pure water vapour is mixed with the air currents. The remaining part, enriched with mineral salts, is collected in the tub and eliminated. The constant exchange of water ensures cleaning of the evaporation septum and provides maximum limitation of the formation and proliferation of Legionnaire's Disease. With this option, energy consumption for water evaporation is limited. Whenever the packaged humidifier is active, in addition to humidifying, adiabatic cooling of the air takes place, which is constantly compensated for by the thermal control device. Direct connection to the plumbing system eliminates the need for special water treatment and easy control of the humidification process by means of the measuring and adjusting device of the water flow rate provided standard.

The accessory is installed inside the unit and is connected to the electrical panel of the machine.

⚙ This option reduces the available static pressure (air side).

⚠ This accessory requires the presence of a water circuit and drain on board the machine. Provided by the customer

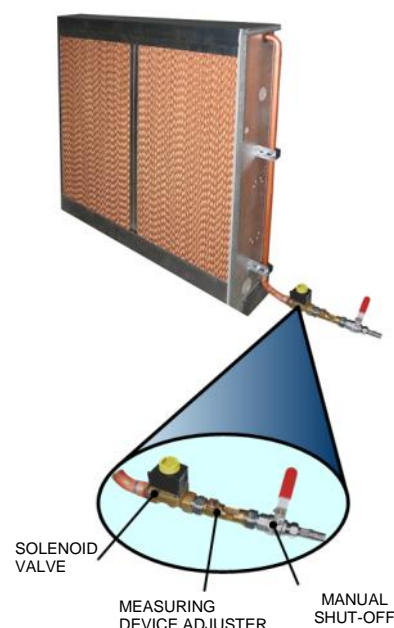

Size		82	102	122	162	182	222	262	302
Ta (°C) D.B.	Ta (°C) W.B.	Kg/h	Kg/h	Kg/h	Kg/h	Kg/h	Kg/h	Kg/h	Kg/h
30	15,1	31	35	46	52	63	75	92	104
35	17,6	39	44	58	65	79	94	115	130
40	19,8	47	54	70	79	97	114	140	158

Ta D.B.= dry bulb temperature of inlet air to the wet deck.

Ta W.B.= wet bulb temperature of inlet air to the wet deck.


Approximate values of the maximum rate of steam released by the wet deck humidifier to the air to obtain controlled thermal and humidity conditions in supply. The data refer to a unit with standard air flow rate in supply.

EH - ELECTRIC HEATERS.

This option is advisable for cold climates. Available in various powers, it allows heating of the served room. The electrical heating elements are managed by a thermal control device with two power settings.

The fins are made of aluminium, with a size suitable to ensure high efficiency and maintain low power density on the surfaces to limit overheating. The low temperature of the heating elements increases their lifespan and limits the effect of air ionization.


In heat pump mode, the heating elements may be automatically activated to preheat the inlet air to the main coil, for example during operation with high percentages of fresh air. This extends the operating limits of the machine. The electrical heating elements can be used to boost the yield of the heat pump. The thermal control device is capable of simultaneously activating the pre-heating and integration functions. Also, the electrical heating elements can be used to reduce the time required for defrosting.

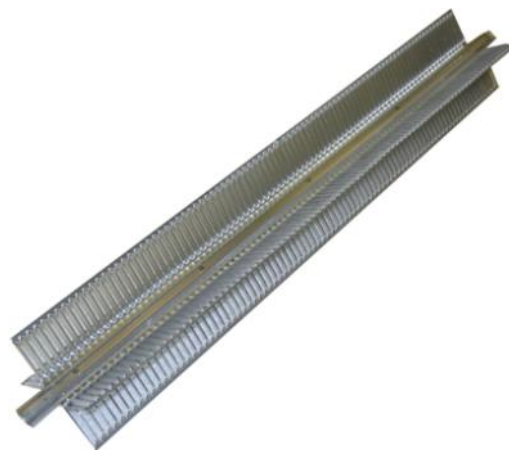

Size	82	102	122	162	182	222	262	302
3 kW	✓	✓	✗	✗	✗	✗	✗	✗
6 kW	✓	✓	✓	✓	✗	✗	✗	✗
9 kW	✓	✓	✓	✓	✗	✗	✗	✗
12 kW	✗	✗	✓	✓	✓	✓	✗	✗
18 kW	✗	✗	✓	✓	✓	✓	✓	✓
24kW	✗	✗	✗	✗	✓	✓	✓	✓
36kW	✗	✗	✗	✗	✗	✗	✓	✓

⚠ This operation involves variation of the main electrical data of the machine.

⚠ hot water coil and electric heaters cannot be mounted at the same time

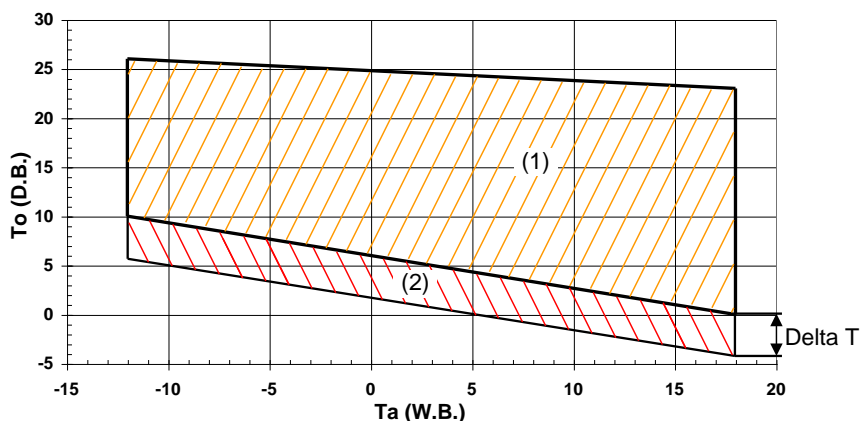

THE LIMITS ARE INDICATIVE AND HAVE BEEN CALCULATED CONSIDERING:

- VALUES GENERAL AND NOT SPECIFICATIONS,
 - STANDARD AIR FLOW-RATE,
 - NON-CRITICAL POSITIONING AND CORRECT USE OF THE UNIT,
 - OPERATION AT FULL LOAD
- WITH UNIT OPERATING IN INTAKE OF OUTSIDE AIR CALCULATE THE TEMPERATURES OF MIXES WHICH ARE GENERATED FROM THE EXCHANGERS' INLET TO KNOW THE LIMITS.
- TO = TEMPERATURE OF AIR ENTERING THE INTERNAL EXCHANGER D.B.(°C)
 DB = DRY BULB
 TA = EXTERNAL EXCHANGER INLET AIR TEMPERATURE W.B. (°C)
 WB = WET BULB
- (1) THE DASHED AREA REFERS TO THE FIELD OF UNITS OPERATION STANDARD
 (2) EXTENSION OF THE FIELD OF OPERATION WITH PRE-HEATING HEATING ELEMENTS. TO OBTAIN THE LOWER LIMIT CURVE, CONSIDER AS THE TEMPERATURE DIFFERENCE (DELTA T) THE VALUE SHOWN IN THE TABLE "EXTENSION OF OPERATING LIMITS WITH PRE-HEATING ELEMENTS".

EXTENSION OF OPERATING LIMITS WITH PRE-HEATING ELEMENTS

Size	Air flow rate [l/s]	Temperature differential (Delta T) of the air that passes through the electrical heating elements [°C]	3 kW	6 kW	9 kW	12 kW	18 kW	24 kW	36 kW
82	1500		1,6	3,3	4,9	-	-	-	-
102	1700		1,5	2,9	4,4	-	-	-	-
122	2220		-	2,2	3,3	4,5	6,7	-	-
162	2500		-	2,0	3,0	4,0	5,9	-	-
182	3060		-	-	-	3,2	4,8	4,8	-
222	3610		-	-	-	2,7	4,1	4,1	-
262	4440		-	-	-	-	3,3	3,3	3,3
302	5000		-	-	-	-	3,0	3,0	3,0

The pre-heating elements make it possible to increase the temperature of the air mixture entering treatment (temperature To) and make it possible to work with lower temperature limits of the mixture entering the internal heat exchanger, extending the operating range of the machine in winter operation. The table of extension of limits of operation shows the temperature differences (Delta T) to be subtracted from the lower limits of the temperature of the air entering the internal heat exchanger (To) in order to obtain the new limit of operation.

GH - GAS BURNER

This option is advisable for very cold climates. The gas module is available in various powers and allows heating of the served room.

Perfect for situations in which climatic conditions make heat pump operation inconvenient or even unsuitable. The gas module must be capable of working as an alternative to the heat pump.

Therefore it must be sized with the same thermal power as the design.


Thanks to the technology of condensation with premixing and very high-efficiency modulation (up to 105% based on the net calorific value), consumption is extremely limited and further reduced during operation at partial loads. Emissions into the atmosphere are minimal, completely free of nitrogen monoxide and with a low content of CO₂ which remains constant in the entire working range, as opposed to atmospheric burners. The heating module includes a condensation hot air generator with modulating adjustment, fuelled with methane gas or LPG, and is complete with a steel flue pipe kit and all safety and adjustment devices. The flue pipe kit requires assembly and is to be installed at the worksite. The module is provided standard set up for methane gas. A kit is provided for changeover to LPG.



This option reduces the available static pressure (air side).

The component requires a supply of gas (gas connection to be provided by the client). Note the presence of the flue pipe and the need to comply with legal requirements in positioning the machine.

GAS CONNECTION DIAGRAM

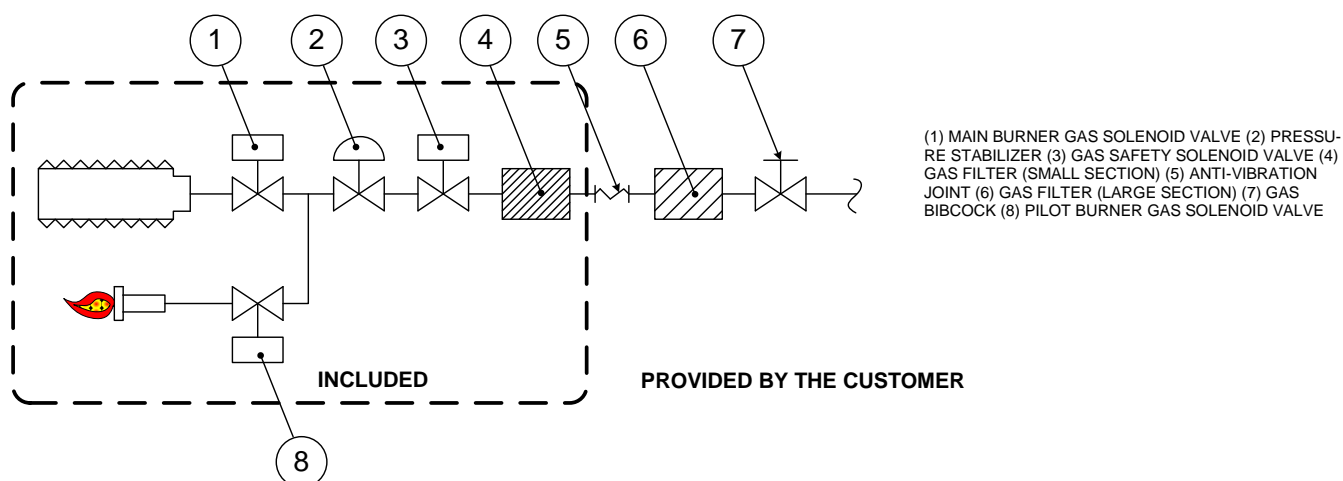

Size	82	102	122	162	182	222	262	302
54 kW	✓	✓	✓	✓	✗	✗	✗	✗
72 kW	✗	✗	✓	✓	✓	✓	✗	✗
96 kW	✗	✗	✗	✗	✓	✓	✓	✓
150 kW	✗	✗	✗	✗	✗	✗	✓	✓

GAS CONSUMPTION

Size			54 kW	72 kW	96 kW	150 kW
METHANE GAS						
SUPPLY PRESSURE G20 methane		mbar	20 (MIN. 17 MAX. 25)			
GAS CONSUMPTION (15°C-1013mbar)		m³/h	1,64 - 6,14	2,33 - 8,26	3,18 - 10,38	4,50 - 15,80
GAS CONNECTION DIAMETER			ISO 7/1- 3/4"M	ISO 7/1- 1"M	ISO 7/1- 1"M	ISO 7/1- 1"M
LPG						
SUPPLY PRESSURE G31		mbar	37			
GAS CONSUMPTION (15°C-1013mbar) GAS		m³/h	0,98 - 3,64	1,39 - 4,89	1,88 - 6,14	2,76 - 9,71
CONNECTION DIAMETER			ISO 7/1- 3/4"M	ISO 7/1- 1"M	ISO 7/1- 1"M	ISO 7/1- 1"M

AIR FILTERING

This is an essential function for proper maintenance of conditions of well-being and hygiene in the served rooms. For this reason it is the subject of precise standards based on the specific applications. The units are standard equipped with filters with an efficiency of G4 on the treatment section. They have an ample surface and low pressure drops. The second filtering stage is available through innovative, high-efficiency filters, electro-static, automatically controlled, class H10. Thanks to the minimum pressure drops and the possibility to wash them, they substantially reduce consumption and hence ventilation costs, while at the same time ensuring excellent performance. As an alternative the more traditional high-efficiency F7 rigid pocket filters are available.

F7- HIGH EFFICIENCY F7 AIR FILTER


The multi-dihedral filters with rigid pockets, class F7, are filtering components that are in addition to the standard G4 filters, for more effective filtering. They are widely used in civil air conditioning systems and in industrial applications that require suitable performance concerning fine dusts and particles with dimensions greater than μm . Class F7 filters are made of fibreglass paper, pleated with constant calibrated spacing, mounted on frames with a sturdy structure in extruded moulded polyester; the ample filtering surface reduces air side pressure drops. Class F7 filters must be replaced after reaching their limits of dirtiness with scheduled periodic maintenance. It is possible to provide as an accessory the dirty filters differential switch, which informs the user that the admissible limit of dirtiness has been reached so as not to excessively reduce the air flow rate with respect to the nominal value.




 This option reduces the available static pressure (air side).

FES - AIR FILTER, ELECTRO-STATIC, HIGH-EFFICIENCY, H10

Class H10 high-efficiency filters are additional filtering components with an active electrostatic system. Solid or liquid particles contained in the air flow are trapped by an electrical field. The air flow through the filter is affected in two main phases: release of an electrical charge to the particles (ionization), and capture of the particles by electrostatic deposit (captivation). On a periodic basis, the filters must be washed to remove the captured particles. The filters are capable of trapping fine dusts, some types of viruses and micro-organisms (anti-bacterial action) with very modest pressure drops. The range of use normally includes fine powders that measure less than $1 \mu\text{m}$. Typical pollutants are cigarette smoke ($0.5 \div 0.3 \mu\text{m}$), oily vapours ($1 \div 0.2 \mu\text{m}$), PM10 (particles $< 10 \mu\text{m}$), PM2.5 (particles $< 2.5 \mu\text{m}$), PM1 (particles $< 1 \mu\text{m}$), etc. Dirtiness of the electric filter is signalled by a sensor that makes it possible to schedule periodic maintenance, which can be easily performed by washing in water with a special non-aggressive detergent for aluminium. The greater initial cost, as compared to a traditional pocket filter, is recovered quickly since the electrostatic filters last for the entire life of the machine, whereas pocket filters require periodic replacement.

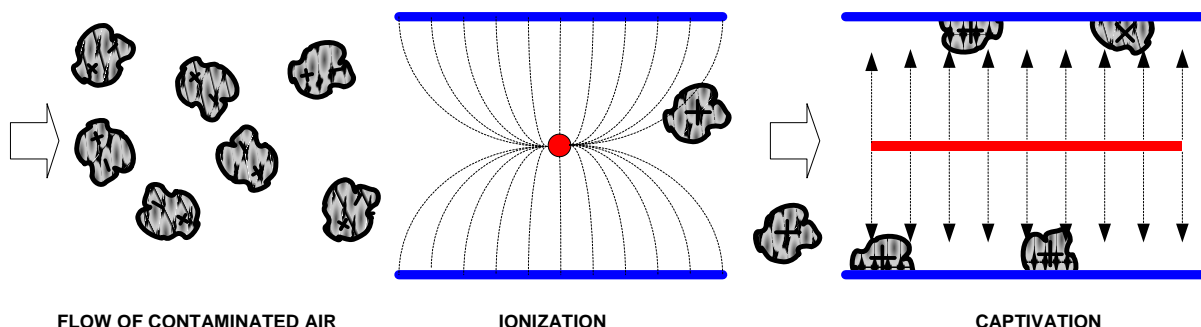

 This option reduces the available static pressure (air side).


 This operation involves variation of the main electrical data of the machine.

COMPARISON OF OPERATING COSTS: A CASE STUDY

The high-efficiency electrostatic filters allow very rapid return of the initial investment as compared with a traditional filtering system, thanks to the reduction of electrical consumption of the ventilation sections and the greatly reduced maintenance costs, since the filters do not require periodic replacement.

A typical case study shows how return on investment occurs in just a few months. In the heavy-duty use of a shopping centre, this occurs by the second year with respect to a traditional system with pocket, F7, high-efficiency second stage filtering. This also greatly reduces environmental impact, both due to more rational use of energy, and because no special waste is produced, such as the used traditional pocket filters.

Analysis of costs (electrostatic filters - pocket filters)

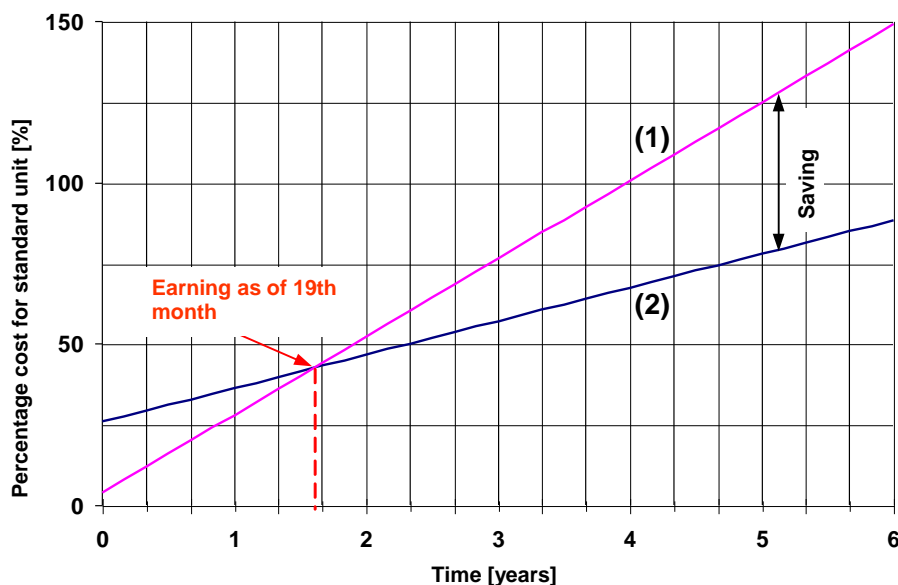

(1) COST FOR PURCHASE AND OPERATION OF THE SECOND FILTERING STAGE, TRADITIONAL TYPE, WITH POCKETS, EFFICIENCY F7


(2) COST FOR PURCHASE AND OPERATION OF THE SECOND FILTERING STAGE, ELECTROSTATIC TYPE, WITH POCKETS, EFFICIENCY H10

IN ORDER, THE PERCENTAGE OF COST INCREASES ARE PRESENTED FOR A STANDARD UNIT WITH SINGLE FILTERING STAGE OF G4 EFFICIENCY.

OPERATION INCLUDES GREATER COSTS FOR VENTILATION AND MAINTENANCE. PERFORMANCE OF ELECTROSTATIC FILTER:
- -25% ON VENTILATION COSTS
- -90% ON COSTS OF MAINTENANCE

EXAMPLE BASED ON MEDIUM SIZED UNITS USED ON A SHOPPING CENTRE THAT IS OPEN 12 HOURS A DAY, 6 DAYS A WEEK, AND SUBJECT TO ROUTINE MAINTENANCE 3 TIMES A YEAR

The values are to be considered approximate.

 The H10 class electrostatic filters and the F7 pocket filters cannot be included simultaneously on the machine.


PSAF - DIFFERENTIAL PRESSURE SWITCH FOR DIRTY AIR FILTERS

It makes it possible to detect and signal (with a suitable alarm) when the dirtiness of the air filter reaches its maximum level. This provides the machine operator with information on when filter maintenance is required. The detection signal is installed in the unit. It is already connected to the electrical panel and pre-calibrated in the factory. Calibration can be modified by a specialized service centre during the commissioning phase.



CPHG - HOT GAS RE-HEATING COIL

This option is recommended during the summer when dehumidification of the room is required. The flow of air to enter the room may contain a higher level of humidity than desired. The dehumidification process is used to reduce it. The air flow is first cooled in the treatment coil with separation of condensation. It is then freely post-heated to maintain the desired condition of comfort in the room served. The post-heating coil is located behind the treatment coil and is activated by drawing a flow of hot gas down the line from the compressors through the action of a dedicated solenoid valve. The process starts working based on the humidity set-point established by the user. With respect to traditional devices, such as electrical heating elements or hot water coils, the use of the post-heating coil does not consume any energy. It also lowers the condensation temperature, which provides two positive effects: the power absorbed by the compressors is considerably reduced, and at the same time the cooling power is increased with greater EER.

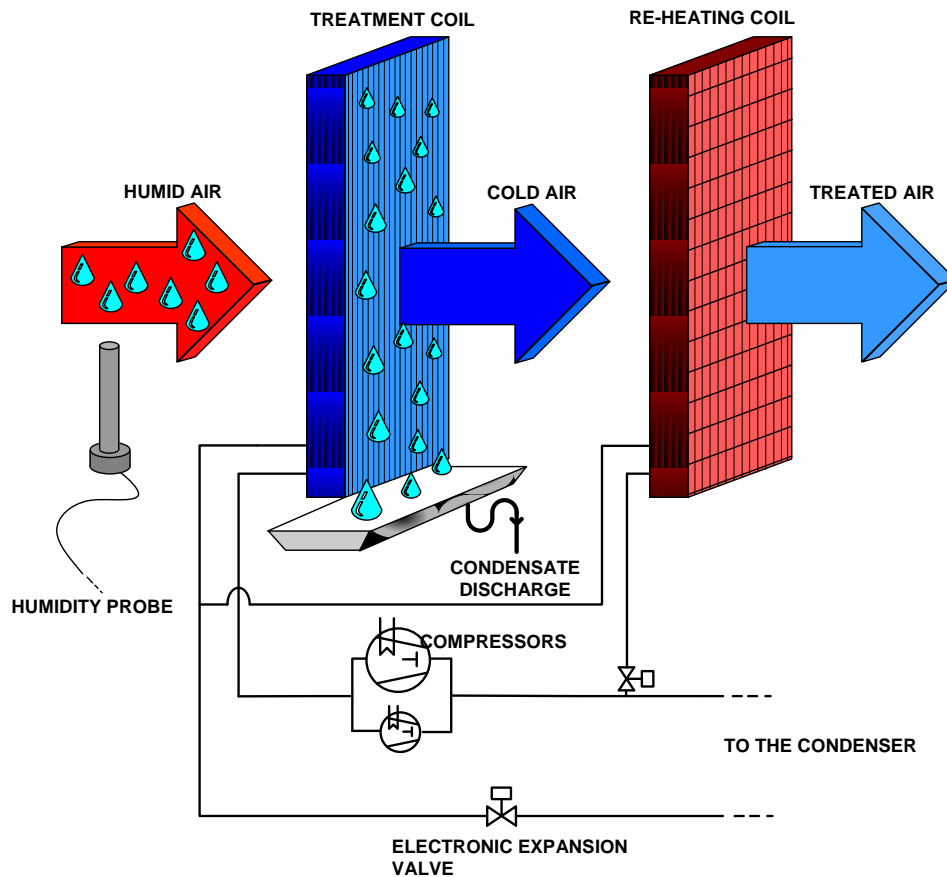

 This option reduces the available static pressure (air side).

PERFORMANCE HOT GAS RE-HEATING COIL

Size		Ambient return air temperature D.B.														
		22 kWt	24 kWt	26 kWt	29 kWt	32 kWt	22 kWt	24 kWt	26 kWt	29 kWt	32 kWt	22 kWt	24 kWt	26 kWt	29 kWt	32 kWt
82	Qo (l/s)	1200					1500					1800				
	Ta (°C)	10	15.53	16.71	18.45	19.66	21.44	17.70	19.05	21.04	22.42	24.46	19.63	21.13	23.34	24.89
		12	14.38	15.55	17.29	18.48	20.26	16.38	17.73	19.71	21.08	23.11	18.17	19.67	21.87	23.40
		14	13.23	14.39	16.12	17.31	19.08	15.07	16.41	18.39	19.75	21.77	16.72	18.20	20.40	21.92
		16	12.09	13.24	14.97	16.15	17.91	13.77	15.10	17.07	18.42	20.44	15.27	16.75	18.94	20.45
		18	10.96	12.10	13.82	14.99	16.75	12.48	13.79	15.76	17.10	19.11	13.83	15.30	17.48	18.99
		20	9.83	10.97	12.67	13.84	15.59	11.20	12.49	14.45	15.79	17.79	12.41	13.86	16.03	17.53
102	Qo (l/s)	1360					1700					2040				
	Ta (°C)	10	16.72	17.99	19.87	21.18	23.10	19.01	20.46	22.60	24.09	26.27	21.03	22.65	25.01	26.67
		12	15.48	16.74	18.62	19.91	21.83	17.59	19.04	21.17	22.65	24.83	19.47	21.08	23.44	25.09
		14	14.24	15.50	17.36	18.65	20.56	16.19	17.62	19.75	21.22	23.40	17.91	19.51	21.87	23.51
		16	13.01	14.26	16.12	17.40	19.30	14.79	16.22	18.33	19.80	21.97	16.37	17.95	20.30	21.93
		18	11.80	13.03	14.88	16.15	18.04	13.40	14.82	16.92	18.38	20.54	14.83	16.40	18.74	20.36
		20	10.58	11.81	13.65	14.91	16.79	12.03	13.42	15.52	16.97	19.12	13.30	14.85	17.19	18.80
122	Qo (l/s)	1800					2220					2500				
	Ta (°C)	10	14.31	15.40	17.04	18.15	19.82	16.22	17.47	19.33	20.59	22.49	17.39	18.73	20.72	22.09
		12	13.23	14.31	15.93	17.04	18.70	14.99	16.22	18.07	19.33	21.22	16.06	17.39	19.38	20.73
		14	12.14	13.22	14.84	15.94	17.59	13.76	14.98	16.83	18.08	19.96	14.75	16.06	18.04	19.39
		16	11.07	12.14	13.75	14.84	16.49	12.54	13.75	15.59	16.83	18.71	13.44	14.74	16.71	18.05
		18	10.00	11.07	12.66	13.75	15.39	11.32	12.54	14.35	15.60	17.46	12.13	13.44	15.39	16.72
		20	8.93	10.00	11.59	12.67	14.30	10.12	11.33	13.13	14.37	16.22	10.84	12.14	14.07	15.40
162	Qo (l/s)	2000					2500					2650				
	Ta (°C)	10	15.25	16.41	18.16	19.35	21.13	17.39	18.73	20.72	22.09	24.12	17.98	19.37	21.43	22.85
		12	14.09	15.24	16.98	18.17	19.94	16.06	17.39	19.38	20.73	22.76	16.61	17.98	20.04	21.45
		14	12.94	14.08	15.81	16.99	18.75	14.75	16.06	18.04	19.39	21.41	15.24	16.61	18.66	20.05
		16	11.79	12.94	14.65	15.82	17.58	13.44	14.74	16.71	18.05	20.06	13.90	15.24	17.28	18.67
		18	10.65	11.79	13.49	14.66	16.40	12.13	13.44	15.39	16.72	18.72	12.55	13.90	15.91	17.30
		20	9.52	10.65	12.35	13.50	15.24	10.84	12.14	14.07	15.40	17.39	11.20	12.55	14.56	15.93
182	Qo (l/s)	2500					3060					3600				
	Ta (°C)	10	19.82	21.33	23.58	25.12	27.41	22.35	24.06	26.61	28.35	30.95	24.56	26.45	29.25	31.18
		12	18.32	19.82	22.06	23.59	25.88	20.66	22.36	24.89	26.63	29.22	22.70	24.57	27.37	29.28
		14	16.84	18.32	20.55	22.07	24.35	18.98	20.67	23.19	24.91	27.49	20.85	22.71	25.49	27.39
		16	15.36	16.83	19.05	20.57	22.83	17.32	18.98	21.50	23.21	25.78	19.01	20.86	23.63	25.52
		18	13.89	15.37	17.56	19.07	21.33	15.66	17.33	19.81	21.52	24.07	17.20	19.02	21.78	23.66
		20	12.43	13.89	16.09	17.58	19.83	14.01	15.67	18.14	19.84	22.37	15.38	17.21	19.93	21.80
222	Qo (l/s)	3050					3610					3900				
	Ta (°C)	10	22.31	24.01	26.56	28.30	30.89	24.60	26.49	29.30	31.23	34.09	25.71	27.68	30.62	32.64
		12	20.62	22.31	24.85	26.57	29.16	22.73	24.61	27.41	29.33	32.18	23.76	25.72	28.65	30.66
		14	18.94	20.63	23.15	24.87	27.44	20.88	22.75	25.53	27.44	30.28	21.82	23.77	26.69	28.68
		16	17.29	18.95	21.46	23.17	25.73	19.04	20.89	23.67	25.56	28.39	19.91	21.84	24.74	26.72
		18	15.63	17.30	19.78	21.48	24.02	17.23	19.05	21.81	23.70	26.51	18.00	19.91	22.80	24.77
		20	13.98	15.64	18.10	19.80	22.33	15.41	17.24	19.97	21.84	24.65	16.09	18.01	20.87	22.83
262	Qo (l/s)	3750					4440					5150				
	Ta (°C)	10	29.60	31.85	35.20	37.50	40.93	32.71	35.21	38.93	41.48	45.28	35.65	38.39	42.44	45.24
		12	27.37	29.61	32.94	35.23	38.64	30.25	32.73	36.43	38.97	42.75	32.96	35.68	39.72	42.50
		14	25.15	27.37	30.70	32.97	36.37	27.80	30.27	33.95	36.47	40.24	30.29	32.99	37.01	39.77
		16	22.97	25.16	28.47	30.73	34.11	25.39	27.81	31.48	33.98	37.73	27.63	30.31	34.32	37.06
		18	20.78	22.98	26.25	28.50	31.87	22.96	25.38	29.03	31.52	35.25	25.01	27.65	31.64	34.37
		20	18.60	20.79	24.05	26.28	29.63	20.55	22.97	26.59	29.06	32.77	22.38	25.03	28.98	31.68
302	Qo (l/s)	4150					5000					5250				
	Ta (°C)	10	31.44	33.84	37.41	39.86	43.50	35.05	37.74	41.73	44.47	48.54	36.04	38.81	42.91	45.74
		12	29.07	31.45	35.01	37.44	41.07	32.41	35.08	39.05	41.78	45.83	33.32	36.08	40.16	42.97
		14	26.72	29.08	32.62	35.04	38.66	29.78	32.43	36.39	39.10	43.14	30.62	33.35	37.42	40.21
		16	24.40	26.72	30.25	32.65	36.25	27.16	29.80	33.74	36.43	40.46	27.93	30.65	34.70	37.47
		18	22.07	24.39	27.89	30.28	33.87	24.59	27.18	31.11	33.78	37.78	25.29	27.96	31.99	34.75
		20	19.75	22.08	25.54	27.92	31.49	22.01	24.61	28.49	31.15	35.13	22.63	25.30	29.29	32.04

Ta = outlet air temperature from the treatment coil and entering the post-heating coil


Qo = air flow rate (l/s)

kWt = thermal power provided (kW)

The post-heating coil is supplied with hot gas released between the supply of the compressor and the condensation coil. Since the temperature of the hot condensation gas is related to the outside air temperature, the approximate powers of the post-heating coil are expressed based on the outside air temperature.

PCOS - CONSTANT VALUE FLOW RATE ADJUSTER

This device adjusts the speed of the fans to keep a constant flow rate, adapting to system losses and compensation for the filters as they get dirty. It is composed of a pressure sensor located in the supply section which measures the pressure, and a differential pressure switch that transforms the value into an electrical signal, based on the parameters detected the machine intervenes, adjusting the speed of the motors to re-establish the set flow rate value.

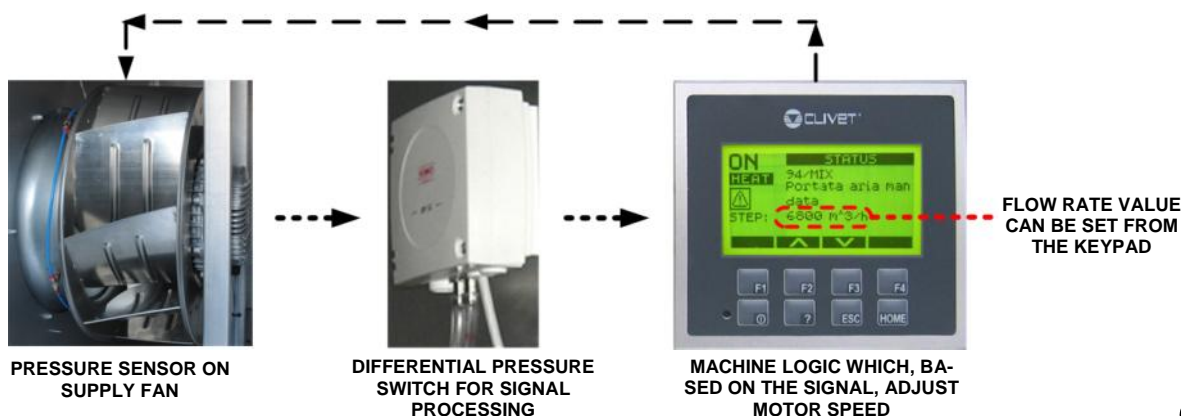

PAQC - AIR QUALITY SENSOR FOR CO2 P.P.M. CONTROL

This option is recommended for areas with highly variable rates of traffic. The probe measure the amount of CO₂ in the environment and sends the machine a 0/10V proportional signal. Based on the received signal, the machine manages the input of the correct amount of refresh air, preventing wasted energy and money due to a treatment of fresh air in excess of actual needs.

The probe is installed and wired on board the machine and is located in the unit's supply duct.



PAQCV - AIR QUALITY SENSOR FOR CO2 AND VOC P.P.M. CONTROL

The option is recommended in areas with tobacco smoke, formaldehyde (from solvents, deodorants, glues, paints, detergents), food preparation, etc. The probe measure the amount of CO₂ and VOC (volatile organic compounds) in the environment and sends the machine a 0/10V proportional signal. Based on the received signal, the machine manages the input of the correct amount of refresh air, preventing wasted energy and money due to a treatment of fresh air in excess of actual needs.

The probe is installed and wired on board the machine and is located in the unit's supply duct.



CREFP - DEVICE TO REDUCE CONSUMPTION OF FANS OF THE EXTERNAL SECTION

The device makes it possible to control the external axial fans, adjusting their speed of rotation based on the condensation pressure. When fresh air temperature is low, a minimum air flow rate is required to hold down the condensation pressure. Therefore, at low fresh air temperatures, fan rotation speed is reduced, resulting in reduced energy consumption (low temperature device).

In certain applications where the external temperature is low and it is not possible to draw in fresh air to cool the served room (free cooling), the phase cut device allow the unit to operate correctly.



In heat pump mode, this device reduces the speed of rotation of the fans when external air temperatures are high (high temperature device).

CREFB - DEVICE FOR REDUCTION OF FAN CONSUMPTION ECOBREEZE

This option is recommended for substantial reduction in the consumption of electrical energy for ventilation and to limit noise emissions in the external section of the machine. The Eco-Breeze logic makes it possible to run the external axial fans with variable rotation speed based on the condensation pressure. When fresh air temperature is low, a minimum air flow rate is required to hold down the condensation pressure. Therefore, at low fresh air temperatures, fan rotation speed is reduced, resulting in reduced electricity consumption and noise emission (summer operation).

In operation in heat pump mode with low outside temperature, ventilation is reduced to the external coil so as not to exceed the evaporation pressure limits for correct operation of the unit, with the added benefit of reduced electrical consumption and noise.

The Eco-Breeze option uses special fans driven by brushless electric motors with complete electronic control and very high efficiency.

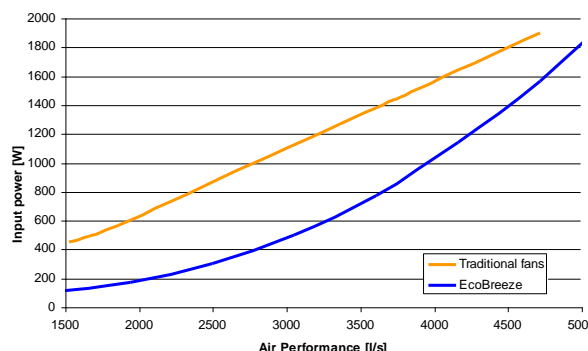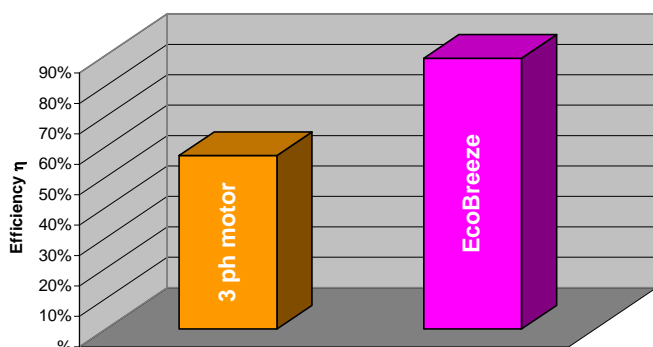

MHP - HIGH AND LOW PRESSURE GAUGES


It allows measurement of the pressure of the refrigerant at the supply and return of the compressors, making these parameters easier to check by technicians assigned to operate the machine. The two liquid pressure gauges and corresponding pressure sockets are installed on the machine in an easily accessible location.



AMRX - RUBBER ANTIVIBRATION MOUNTS

The rubber anti-vibration devices are fastened in housings on the longitudinal members. They reduce the vibrations caused by the machine, reducing the noises transmitted by the support structures. These elastic bodies soften axial and tangential stresses. Their mechanical and physical characteristics remain nearly unchanged over time thanks to the highly resistant material they are made of.

As an alternative to the rubber anti-vibration devices, it is possible to use neoprene rubberized strips on the longitudinal support members.

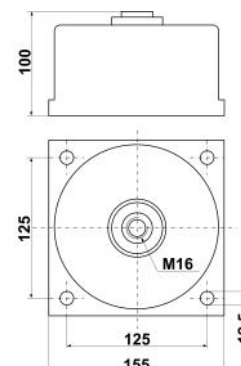

 separately supplied accessories

DESM - SMOKE DETECTOR

This option allows detection of smoke in the room by analyzing the return air. The Tyndal-effect increased sensitivity smoke detector is perfect for ventilation ducts since it is capable of detecting rarefied smoke in high-speed air flows. Smoke detection occurs using a photo-optical system with a labyrinth chamber. The alarm signal is processed by an on-board micro-processor which verifies the condition and sends a message to the machine controller such as smoke alarm, failure, or service required.

The device is composed of a Venturi tube, installed inside the return duct, and a control unit with a sensor that is located on the outside duct. Assembly and wiring are done at the factory.



CONTROL LOGICS IN THE EVENT OF ALARM SIGNAL

Machine logics	Description	Vers. B	Vers. C
Complete shutdown	Supply fan	Off	Off
	Exhaust fan	-	Off
	Fresh air Shutter	Open	Closed
	Discharge damper	-	Closed
Room kept de-pressurized	Supply fan	-	Off
	Exhaust fan	-	On
	Fresh air Shutter	-	Closed
	Discharge damper	-	Open
Room kept pressurized	Supply fan	On	On
	Exhaust fan	-	Off
	Fresh air Shutter	Open	Open
	Discharge damper	-	Closed

The machine logic manages the signal from the smoke detector installed in the return section or by a fire detection unit, implementing one of the actions shown in the table which can be set as a parameter. If there is an alarm signal and according to the set logic, the compressors are always shut off. The roof-top units may not be used as smoke extractors.

PM - PHASE MONITOR

The phase monitor makes it possible to check the correct connection of the phases and their imbalance in units powered with a tri-phase system. If the connection of the phases is not correct, or the limit is exceeded for imbalance between phases, the monitor acts on the control circuit, which orders shutdown of the machine.

PFCP - POWER FACTOR CORRECTION CAPACITORS (COSFI > 0.9)

The component is necessary to lower the phase difference between current and voltage in the electromagnetic components of the machine, such as asynchronous motors. By re-phasing it is possible to reduce the intensity of the line current by reducing a part of the power of the mains (reactive power). This leads to an economic benefit which the energy provider grants to the final user. The component makes it possible to bring the cosfi power factor to values which on average are greater than 0.9.



MOB - SERIAL PORT RS485 WITH MODBUS PROTOCOL

It allows serial connection of supervision systems, using ModBus as the communication protocol. It allows access to the complete list of operating variables, controls and alarms.



LON - SERIAL PORT RS485 WITH LONWORK PROTOCOL

It allows serial connection of supervision systems, using LonWork as the communication protocol. It allows access to a list of operating variables, control and alarms compliant with the Echelon standard.



RCMRX - REMOTE CONTROL WITH REMOTE MICROPROCESSOR CONTROL

Device which allows complete control of the machine from a remote location. It is easily wall-mounted, and has the same appearance and functions as the user interface on board the unit (user-friendly software). To be connected during commissioning of the machine at a maximum distance of 100 m.



 separately supplied accessories

CMS - CLIVET MANAGEMENT SYSTEM (CMS) CLIVET SUPERVISING SYSTEM (CMS)


Clivet Management System (CMS) is a Clivet supervision system that allow to schedule and manage all the installed Clivet conditioning units, optimizing their functional working and the others systems in order to reduce the energy consumption.

Thanks to the simple use of the software and to the tridimensional graphic interface, it is possible to change complex activities of system operating into simple activities made by the customer.

Clivet management system let to visualize the maintenance state of the conditioning units, valuate and manage the alarms. The user makes operation on the supervision workstation or on the PLC (Programmable Logic Controller) interface display.

The exchange data between workstation, units, control electronic devices, remote managing electronic devices is made on serial bus networks by communication standard protocol RS485, or on local network LAN (Local Area Network) Ethernet TCP/IP.

The control software let to verify the conditioning unit and to make the on-line assistance directly from Clivet factory using the telephone network.

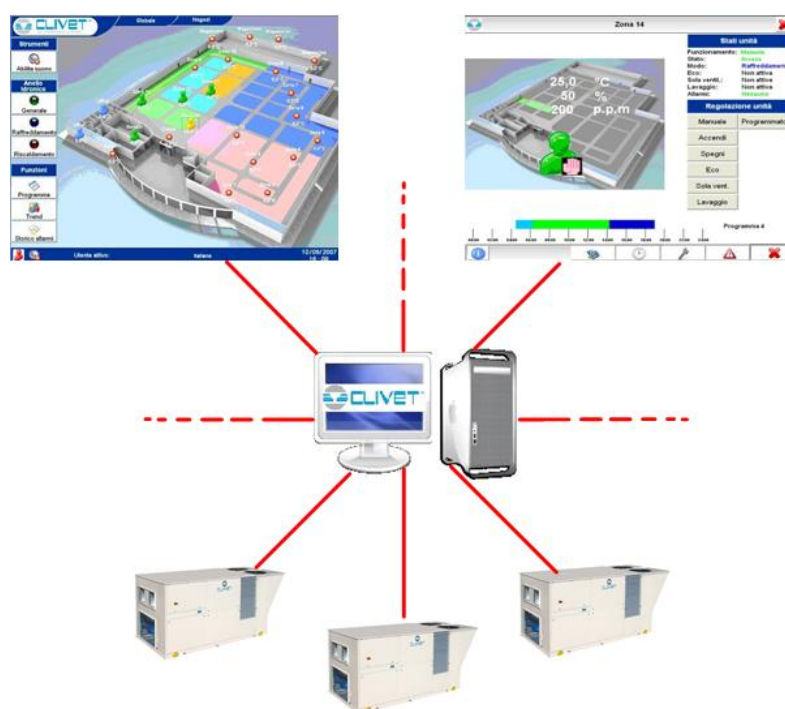

CSRN-XHE OPTIONS			
OPTION	DESCRIPTION	VERSION B	VERSION C
Versions			
RE1	Active energy recovery of expelled air	-	●
FC	Thermal free cooling	-	●
FCE	Enthalpy free cooling	-	○
Configurations			
CB	Configuration with fresh air mixing and recycling box	●	-
CC	Configuration with exhaust air fan and mixing box	-	●
PCOS	Constant value flow rate adjuster	○	○
CREFP	Device for fan consumption reduction of the external section with variable speed (phase-cutting)	○	○
CREFB	Device for reduction of fan consumption EcoBreeze	○	○
CHW2	2 rows hot water coil	○	○
3WVM	Modulating three-way valve	○	○
EH	Electric heaters	○	○
GH	Gas burner	○	○
Refrigerant Circuit			
EVE	Electronic expansion valve	●	●
MHP	High and low pressure gauges	○	○
CPHG	Hot gas re-heating coil	○	○
Ducting Circuit			
FPG4	Pleated air filter class G4 (EN779 norm)	●	●
F7	High efficiency F7 air filter	○	○
FES	High efficiency H10 electrostatic air filter	○	○
PSAF	Differential pressure switch for dirty air filters	○	○
HSE	Electrode boiler steam humidifier	○	○
HWS	Water to waste evaporating wet-deck humidifier	○	○
SERM	On/off motorized air outlet damper	○	-
SERMD	Modulating air outlet damper	○*	●
Electric Circuit			
RCMRX	Remote control with remote microprocessor control	○	○
MOB	Serial port RS485 with MODBUS protocol	○	○
LON	Serial port RS485 with LONWORK protocol	○	○
PAQC	Air quality sensor for CO2 p.p.m. control	○	○
PAQCV	Air quality sensor for CO2 and VOC p.p.m. control	○	○
DESM	Smoke detector	○	○
PM	Phase monitor	○	○
PFCP	Power factor correction capacitors (cosfi > 0.9)	○	○
AMRX	Rubber antivibration mounts	○	○

- ACCESSORIES STANDARD
- ACCESSORIES OPTIONAL
- ACCESSORY NOT INCLUDED
- * ACCESSORY NECESSARY WITH SELECTION OF AIR QUALITY PROBE

FUNCTIONAL CLEARANCES

When placing the unit, it is necessary to comply with the functional spaces indicated in the dimensions. Compliance with fictional spaces is essential to:


- ensure proper operation of the unit
- allow maintenance technicians easy access to the equipment compartments
- protect authorized operators and exposed persons.

If several units are placed near one another, the functional spaces between machines must be doubled.

DIMENSIONAL DRAWING

SIZE 82-102

DIMENSIONAL DRAWING(1)

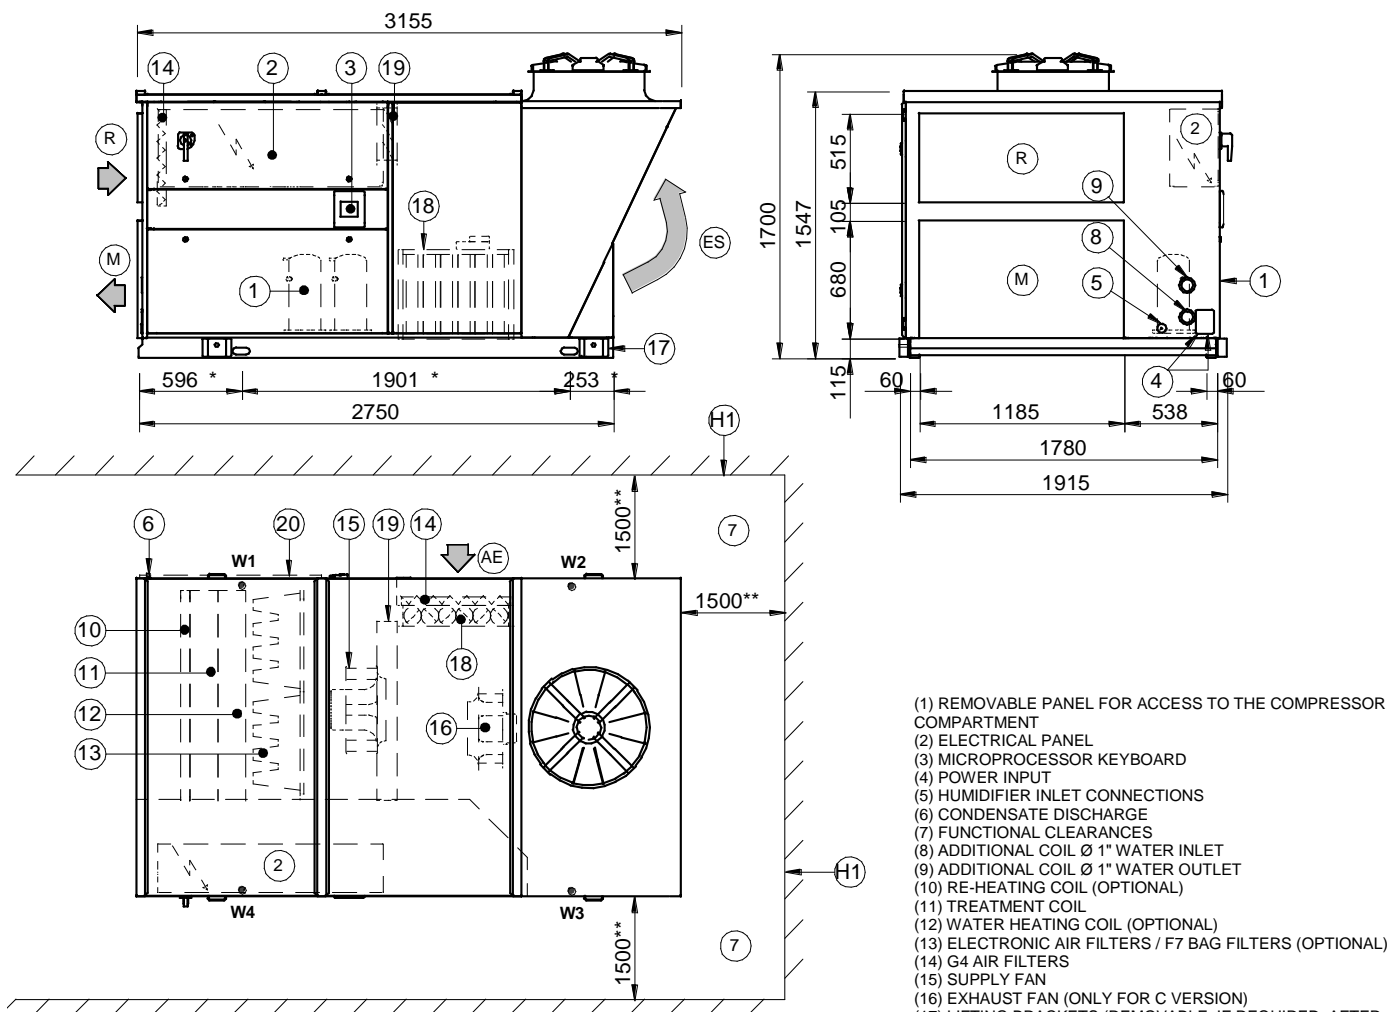

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) ADDITIONAL COIL Ø 1" WATER INLET
- (9) ADDITIONAL COIL Ø 1" WATER OUTLET
- (10) RE-HEATING COIL (OPTIONAL)
- (11) TREATMENT COIL
- (12) WATER HEATING COIL (OPTIONAL)
- (13) ELECTRONIC AIR FILTERS / F7 BAG FILTERS (OPTIONAL)
- (14) G4 AIR FILTERS
- (15) SUPPLY FAN
- (16) EXHAUST FAN (ONLY FOR C VERSION)
- (17) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (18) FRESH AIR SHUTTER
- (19) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (20) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE
- (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)

Size		82	102
W1	kg	223	232
W2	kg	205	213
W3	kg	269	280
W4	kg	283	295
Shipping weight	kg	980	1020


CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/RECIRCULATED/FRESH AIR INTAKE BOX (C)

Size		82	102
W1	kg	227	235
W2	kg	223	232
W3	kg	289	300
W4	kg	291	303
Shipping weight	kg	1030	1070

DIMENSIONAL DRAWING

SIZE 82-102 GAS MODULE 54 kW

DIMENSIONAL DRAWING(2)

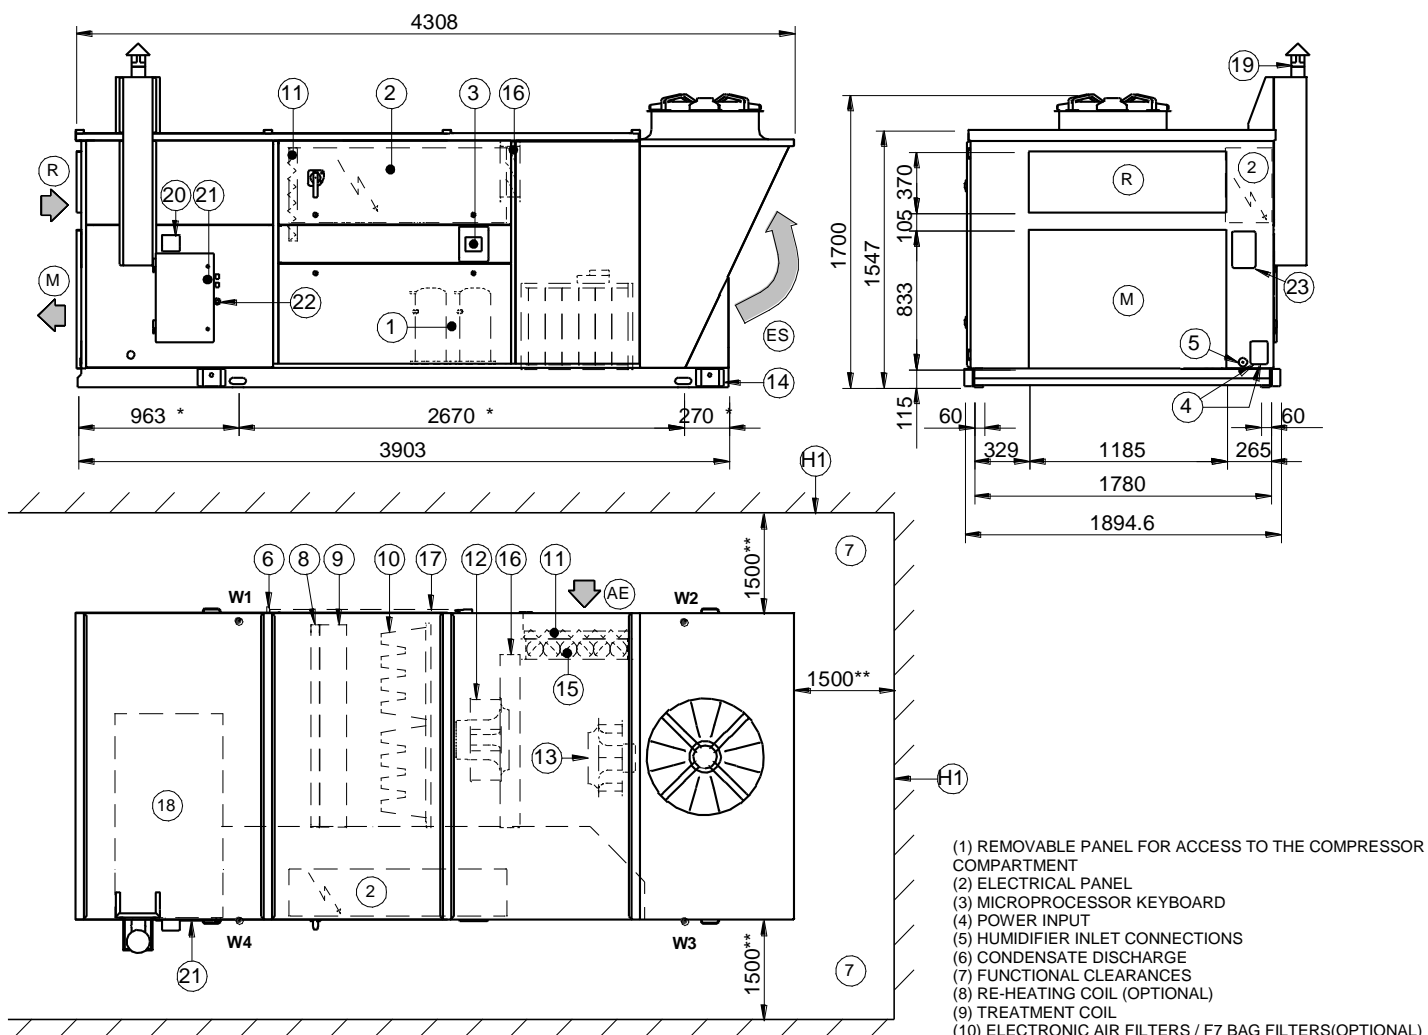

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) RE-HEATING COIL (OPTIONAL)
- (9) TREATMENT COIL
- (10) ELECTRONIC AIR FILTERS / F7 BAG FILTERS(OPTIONAL)
- (11) G4 AIR FILTERS
- (12) SUPPLY FAN
- (13) EXHAUST FAN (ONLY FOR C VERSION)
- (14) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (15) FRESH AIR SHUTTER
- (16) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (17) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (18) GAS MODULE
- (19) DISCHARGE WASTE GAS
- (20) INTAKING AIR BURNER
- (21) GAS BURNER COMPARTMENT
- (22) GAS MODULE SUPPLY (1" GAS)
- (23) SAFETY THERMOSTAT INSPECTION COMPARTMENT
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE
- (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)

Size		82	102
W1	kg	309	318
W2	kg	203	212
W3	kg	265	276
W4	kg	383	394
Shipping weight	kg	1160	1200


CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/ RECIRCULATED/FRESH AIR INTAKE BOX (C)

Size		82	102
W1	kg	305	317
W2	kg	212	225
W3	kg	292	300
W4	kg	401	408
Shipping weight	kg	1210	1250

DIMENSIONAL DRAWING

SIZE 122-162

DIMENSIONAL DRAWING(3)

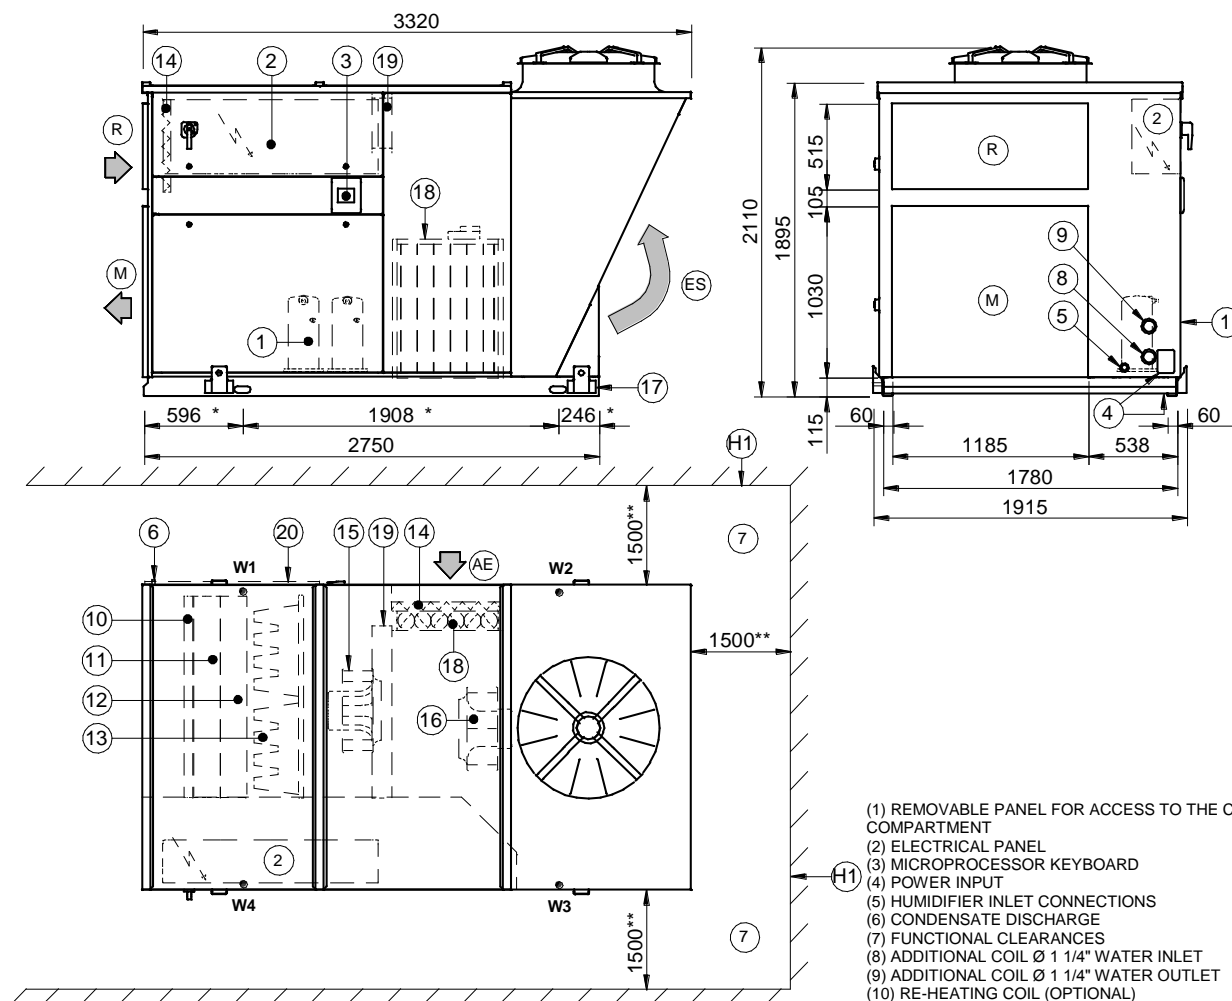

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) ADDITIONAL COIL Ø 1 1/4" WATER INLET
- (9) ADDITIONAL COIL Ø 1 1/4" WATER OUTLET
- (10) RE-HEATING COIL (OPTIONAL)
- (11) TREATMENT COIL
- (12) WATER HEATING COIL (OPTIONAL)
- (13) ELECTRONIC AIR FILTERS / F7 BAG FILTERS (OPTIONAL)
- (14) G4 AIR FILTERS
- (15) SUPPLY FAN
- (16) EXHAUST FAN (ONLY FOR C VERSION)
- (17) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (18) FRESH AIR SHUTTER
- (19) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (20) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE
- (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)

Size		122	162
W1	kg	252	263
W2	kg	231	242
W3	kg	301	315
W4	kg	316	330
Shipping weight	kg	1100	1150


CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/ RECIRCULATED/FRESH AIR INTAKE BOX (C)

Size		122	162
W1	kg	248	263
W2	kg	242	257
W3	kg	333	343
W4	kg	337	347
Shipping weight	kg	1160	1210

DIMENSIONAL DRAWING

SIZE 122-162 GAS MODULE 54-72 kW

DIMENSIONAL DRAWING(4)

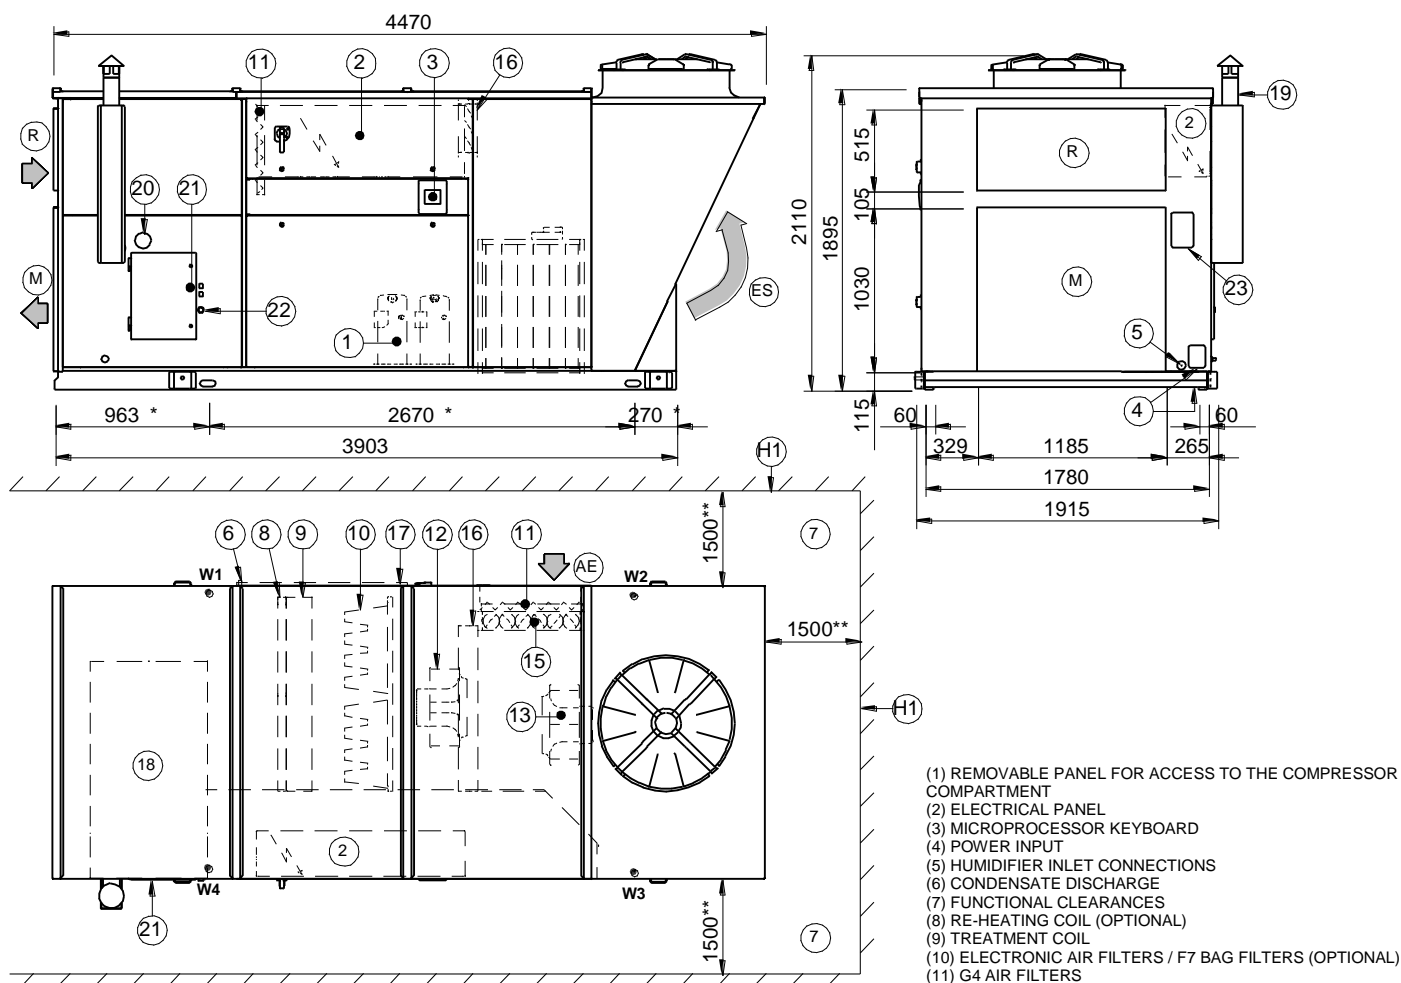

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)

Size		122	162
W1	kg	352	363
W2	kg	231	242
W3	kg	301	315
W4	kg	436	450
Shipping weight	kg	1320	1370

CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/ RECIRCULATED/FRESH AIR INTAKE BOX (C)


Size		122	162
W1	kg	348	363
W2	kg	242	257
W3	kg	333	343
W4	kg	457	467
Shipping weight	kg	1380	1430

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) RE-HEATING COIL (OPTIONAL)
- (9) TREATMENT COIL
- (10) ELECTRONIC AIR FILTERS / F7 BAG FILTERS (OPTIONAL)
- (11) G4 AIR FILTERS
- (12) SUPPLY FAN
- (13) EXHAUST FAN (ONLY FOR C VERSION)
- (14) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (15) FRESH AIR SHUTTER
- (16) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (17) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (18) GAS MODULE
- (19) DISCHARGE WASTE GAS
- (20) INTAKING AIR BURNER
- (21) GAS BURNER COMPARTMENT
- (22) GAS MODULE SUPPLY (1" GAS)
- (23) SAFETY THERMOSTAT INSPECTION COMPARTMENT
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE
- (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

DIMENSIONAL DRAWING

SIZE 182-222

DIMENSIONAL DRAWING(5)

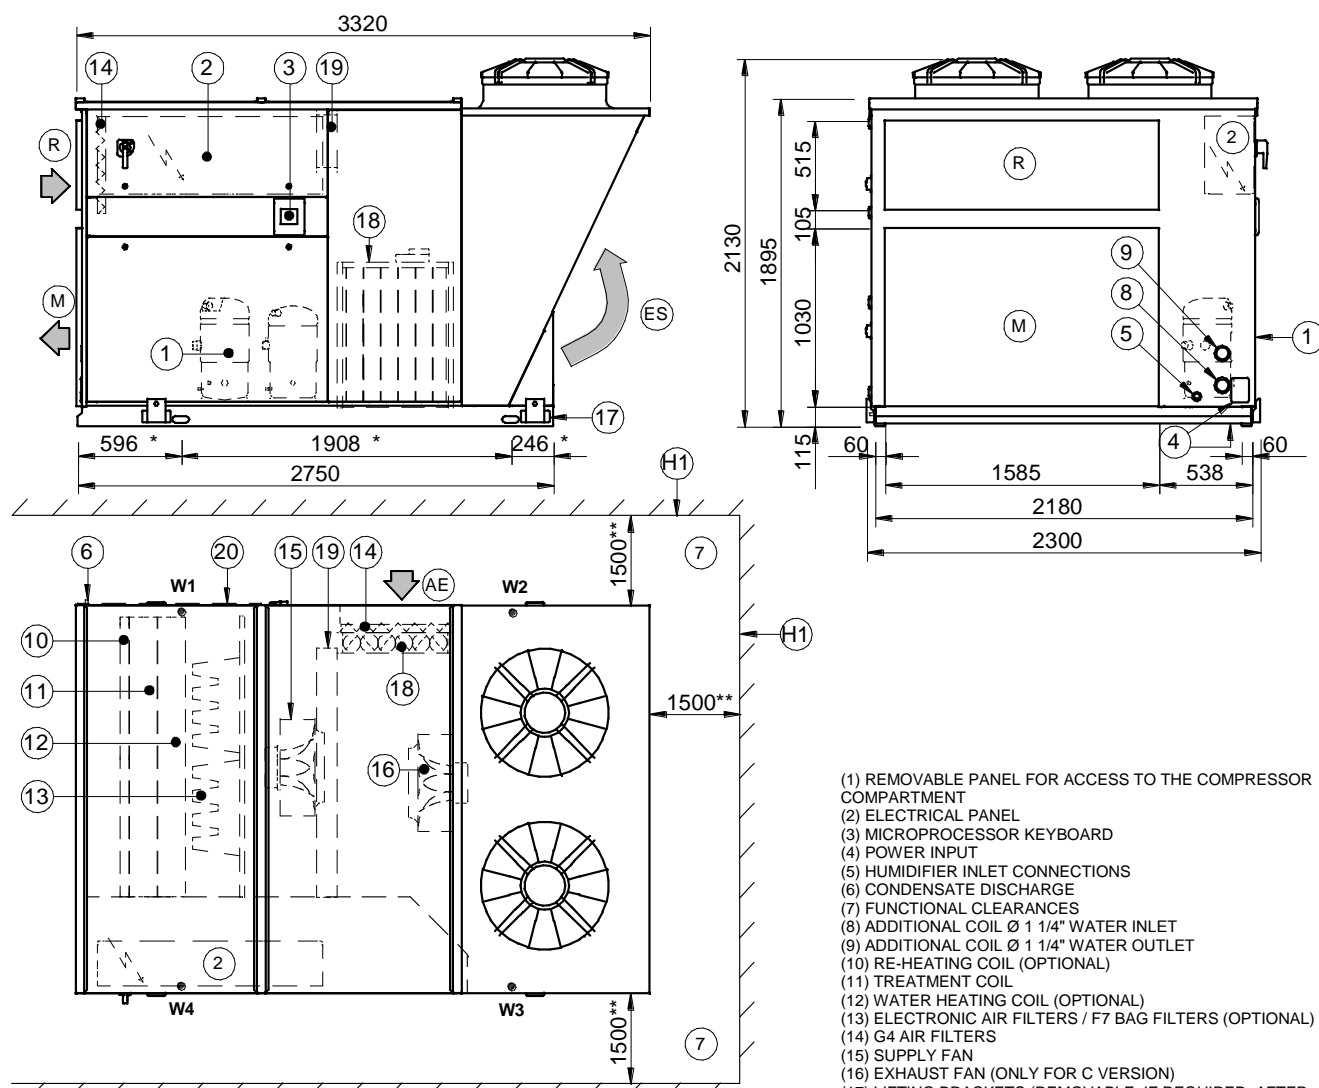

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) ADDITIONAL COIL Ø 1 1/4" WATER INLET
- (9) ADDITIONAL COIL Ø 1 1/4" WATER OUTLET
- (10) RE-HEATING COIL (OPTIONAL)
- (11) TREATMENT COIL
- (12) WATER HEATING COIL (OPTIONAL)
- (13) ELECTRONIC AIR FILTERS / F7 BAG FILTERS (OPTIONAL)
- (14) G4 AIR FILTERS
- (15) SUPPLY FAN
- (16) EXHAUST FAN (ONLY FOR C VERSION)
- (17) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (18) FRESH AIR SHUTTER
- (19) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (20) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE
- (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)

Size		182	222
W1	kg	305	316
W2	kg	280	290
W3	kg	363	378
W4	kg	382	396
Shipping weight	kg	1330	1380


CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/RECIRCULATED/FRESH AIR INTAKE BOX (C)

Size		182	222
W1	kg	313	323
W2	kg	307	317
W3	kg	394	409
W4	kg	401	416
Shipping weight	kg	1415	1465

DIMENSIONAL DRAWING

SIZE 182-222 GAS MODULE 72-96 kW

DIMENSIONAL DRAWING(6)

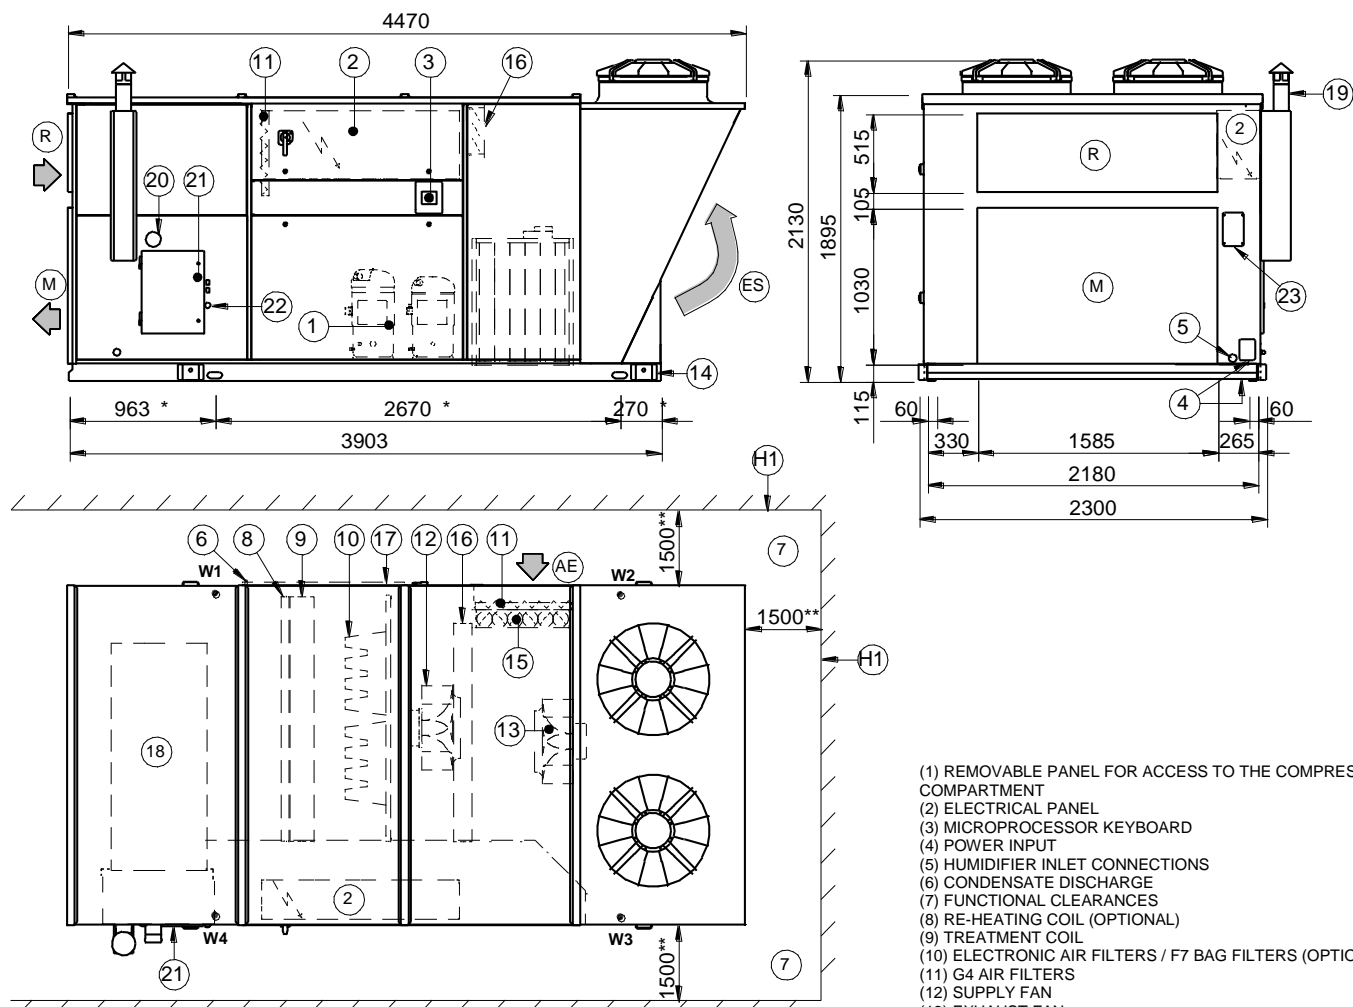

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) RE-HEATING COIL (OPTIONAL)
- (9) TREATMENT COIL
- (10) ELECTRONIC AIR FILTERS / F7 BAG FILTERS (OPTIONAL)
- (11) G4 AIR FILTERS
- (12) SUPPLY FAN
- (13) EXHAUST FAN (ONLY FOR C VERSION)
- (14) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (15) FRESH AIR SHUTTER
- (16) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (17) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (18) GAS MODULE
- (19) DISCHARGE WASTE GAS
- (20) INTAKING AIR BURNER
- (21) GAS BURNER COMPARTMENT
- (22) GAS MODULE SUPPLY (1" GAS)
- (23) SAFETY THERMOSTAT INSPECTION COMPARTMENT
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE
- (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)

Size		182	222
W1	kg	480	491
W2	kg	280	290
W3	kg	363	378
W4	kg	587	601
Shipping weight	kg	1710	1760


CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/ RECIRCULATED/FRESH AIR INTAKE BOX (C)

Size		182	222
W1	kg	488	498
W2	kg	307	317
W3	kg	394	409
W4	kg	606	621
Shipping weight	kg	1795	1845

DIMENSIONAL DRAWING

SIZE 262-302

DIMENSIONAL DRAWING(7)

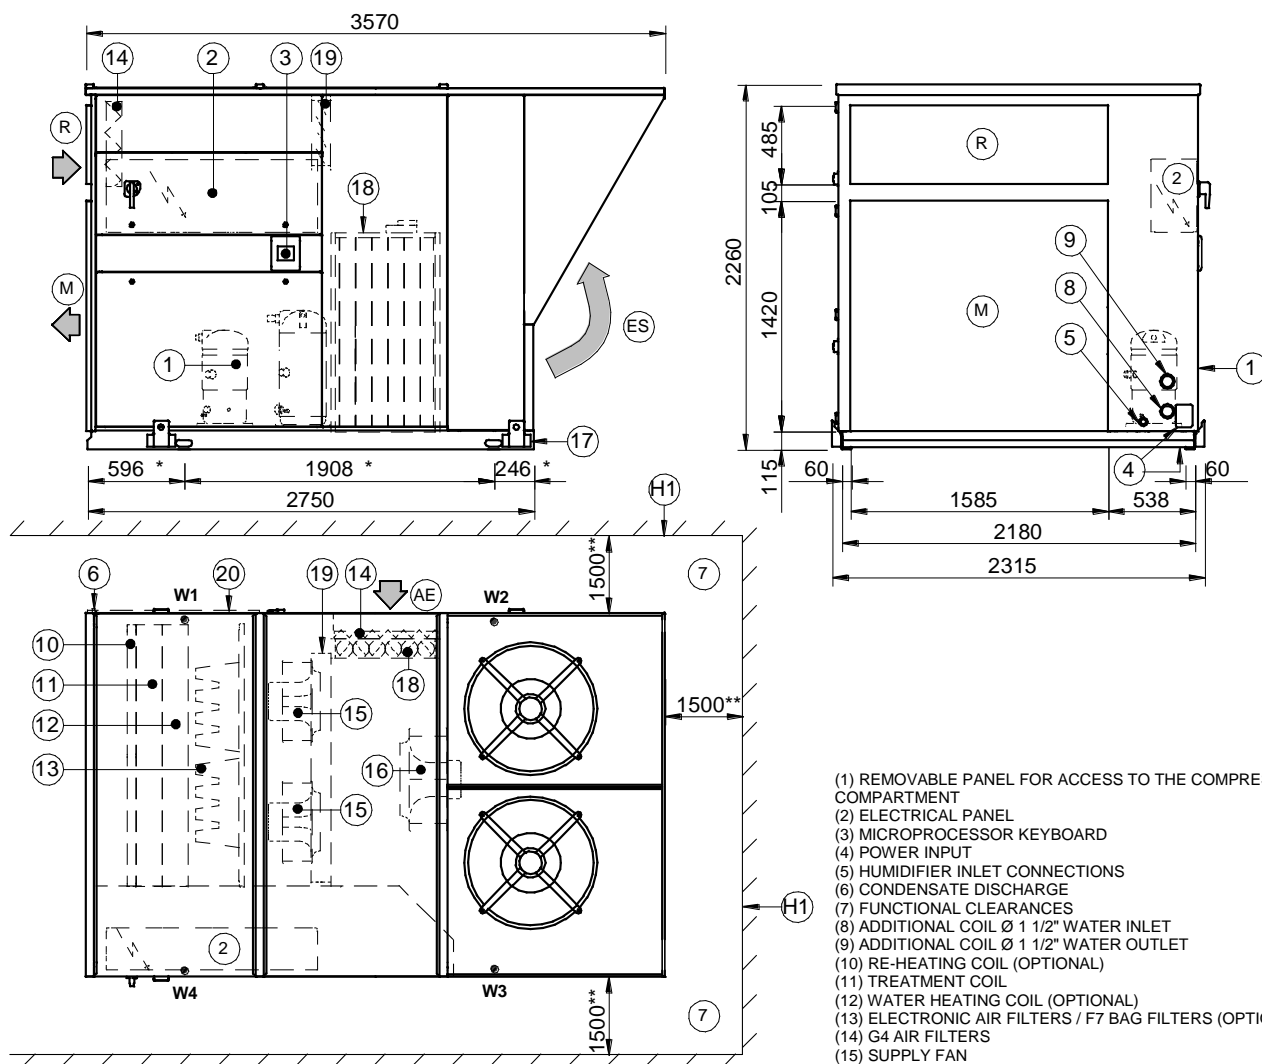

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) ADDITIONAL COIL Ø 1 1/2" WATER INLET
- (9) ADDITIONAL COIL Ø 1 1/2" WATER OUTLET
- (10) RE-HEATING COIL (OPTIONAL)
- (11) TREATMENT COIL
- (12) WATER HEATING COIL (OPTIONAL)
- (13) ELECTRONIC AIR FILTERS / F7 BAG FILTERS (OPTIONAL)
- (14) G4 AIR FILTERS
- (15) SUPPLY FAN
- (16) EXHAUST FAN (ONLY FOR C VERSION)
- (17) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (18) FRESH AIR SHUTTER
- (19) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (20) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)


Size		262	302
W1	kg	358	369
W2	kg	342	353
W3	kg	422	436
W4	kg	438	452
Shipping weight	kg	1560	1610

CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/ RECIRCULATED/FRESH AIR INTAKE BOX (C)

Size		262	302
W1	kg	374	385
W2	kg	369	380
W3	kg	454	468
W4	kg	458	472
Shipping weight	kg	1655	1705

DIMENSIONAL DRAWING

SIZE 262-302 GAS MODULE 96-150 kW DIMENSIONAL DRAWING(8)

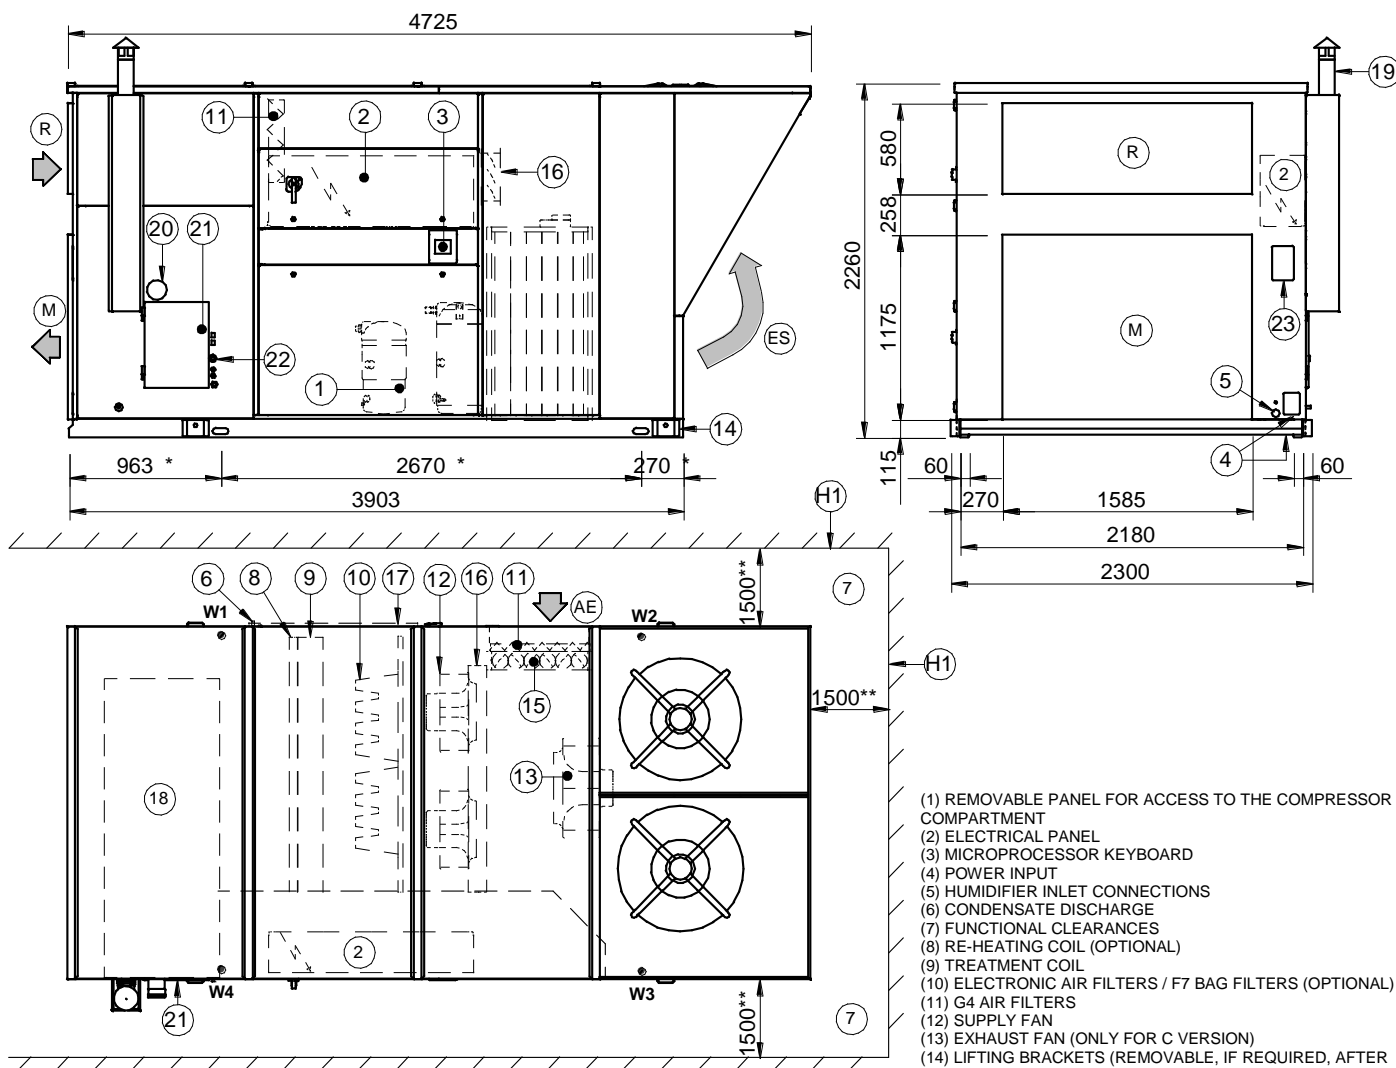

- (1) REMOVABLE PANEL FOR ACCESS TO THE COMPRESSOR COMPARTMENT
- (2) ELECTRICAL PANEL
- (3) MICROPROCESSOR KEYBOARD
- (4) POWER INPUT
- (5) HUMIDIFIER INLET CONNECTIONS
- (6) CONDENSATE DISCHARGE
- (7) FUNCTIONAL CLEARANCES
- (8) RE-HEATING COIL (OPTIONAL)
- (9) TREATMENT COIL
- (10) ELECTRONIC AIR FILTERS / F7 BAG FILTERS (OPTIONAL)
- (11) G4 AIR FILTERS
- (12) SUPPLY FAN
- (13) EXHAUST FAN (ONLY FOR C VERSION)
- (14) LIFTING BRACKETS (REMOVABLE, IF REQUIRED, AFTER POSITIONING THE UNIT)
- (15) FRESH AIR SHUTTER
- (16) OVER PRESSURE DAMPER AIR EXHAUST (ONLY FOR C VERSION)
- (17) ACCESS FOR INSPECTION OF COILS, FILTERS, HEATING ELEMENTS
- (18) GAS MODULE
- (19) DISCHARGE WASTE GAS
- (20) INTAKING AIR BURNER
- (21) GAS BURNER COMPARTMENT
- (22) GAS MODULE SUPPLY (1" GAS)
- (23) SAFETY THERMOSTAT INSPECTION COMPARTMENT
- (R) AMBIENT AIR INTAKE
- (M) AMBIENT AIR DISTRIBUTION
- (AE) FRESH AIR INTAKE
- (ES) AIR EXHAUST (ONLY FOR C VERSION)
- (H1) WALL WITH SAME HEIGHT AS UNIT ON A MAXIMUM OF THREE SIDES
- (*) VIBRATION MOUNTS POSITION
- (**) SUGGESTED CLEARANCE

WEIGHT DISTRIBUTION

CONSTRUCTIONAL CONFIGURATION: RECIRCULATED/OUTSIDE AIR MIXING BOX (B)

Size		182	222
W1	kg	488	498
W2	kg	307	317
W3	kg	394	409
W4	kg	606	621
Shipping weight	kg	1795	1845

CONSTRUCTIONAL CONFIGURATION: FREE COOLING VERSION WITH EXTRACT/ RECIRCULATED/FRESH AIR INTAKE BOX (C)

Size		262	302
W1	kg	574	585
W2	kg	369	380
W3	kg	454	468
W4	kg	683	697
Shipping weight	kg	2080	2130

CLIVET SPA Feltre (BL) ITALY Tel. + 39 0439 3131 Fax + 39 0439 313300 info@clivet.it	CLIVET UK LTD Fareham (Hampshire) U.K. Tel. + 44 (0) 1489 572238 Fax + 44 (0) 1489 573033 info@clivet-uk.co.uk	CLIVET SAS Verrières le Buisson - FRANCE Tel. + 33 (0)1 69 20 25 75 Fax + 33 (0)1 69 20 60 76 info.fr@clivet.com	CLIVET ESPAÑA S.A. Madrid - SPAIN Tel. + 34 91 6658280 Fax + 34 91 6657806 info@clivet.es	CLIVET GmbH Norderstedt - GERMANY Tel. +49 (0) 40 32 59 57-0 Fax +49 (0) 40 32 59 57-194 info.de@clivet.com	CLIVET NEDERLAND B.V. Amersfoort - Netherlands Tel. + 31 (0) 33 7503420 Fax + 31 (0) 33 7503424 info@clivet.nl	CLIVET RUSSIA Moscow - RUSSIA Tel. +74956462009 Fax +74956462009 info.ru@clivet.com	CLIVET MIDEAST FZC Dubai - UAE Tel. +97 14 3518501 Fax +97 14 3518502 info@clivetme.com	CLIVET TF AIR SYSTEMS (P) LTD. Malur - INDIA Tel. +91 8151 232683/5 Fax +91-8151-232684 info@clivetfa.com
--	--	--	---	---	--	---	---	---