


ControlNet™ NetChecker

1788-CNCHKR

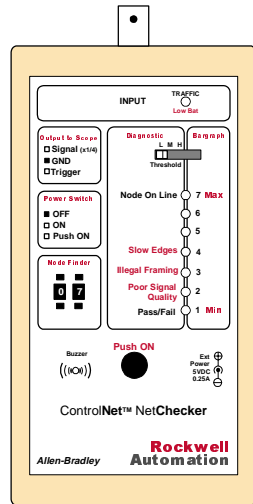

User Manual

Throughout this manual we use notes to make you aware of safety considerations:

ATTENTION

Identifies information about practices or circumstances that can lead to personal injury or death, property damage or economic loss.

Attention statements help you to:

- identify a hazard
- avoid a hazard
- recognize the consequences

IMPORTANT

Identifies information that is critical for successful application and understanding of the product.

ControlNet is a trademark of ControlNet International, Ltd.

NetChecker is a trademark of Rockwell Automation

European Communities (EC) Directive Compliance

If this product has the CE mark, it is approved for installation within the European Union and EEA regions and has been designed and tested to meet the following directive.

EMC Directive

This product is tested to meet the Council Directive 89/336/EC Electromagnetic Compatibility (EMC) by applying the following standards, in whole or in part, documented in a technical construction file:

- EN 50081-2 EMC — Generic Emission Standard, Part 2 — Industrial Environment
- EN 50082-2 EMC — Generic Immunity Standard, Part 2 — Industrial Environment

This product is intended for use in an industrial environment

Table of Contents

Product Overview	1
NetChecker Specifications	3
TRAFFIC LED	4
Modes of Network Analysis	4
Diagnostic Mode	4
Threshold Settings	5
LED Functions	5
Buzzer	7
Node Finder and Oscilloscope Output	7
Bargraph Mode	7
Bargraph Scale	8
Viewing a Node Signal Level in Bargraph Mode	8
Performing a Global Survey of Signal Levels	9
Oscilloscope Output in Bargraph Mode	9
Operation	10
Installing the Batteries	10
Conserving Battery Power	10
Using a Wall Adapter to Power the NetChecker	10
Connecting to the Network	11
Selecting Testpoints on the Network	11
Network Diagnostics	12
How to Begin Checking Your Network	12
Faults and Their Origins	12
Poor Signal Quality	14
Illegal Framing	15
Slow Edges	16
Examples	17
Checking the Signal Level Using the Threshold Setting	17
Checking the Signal Level Using the Bargraph	18
Additional Tips	19
Intermittent Problems	19
Continuous Network Monitoring	19

Example Waveforms

Ideal Transmitted Packet on ControlNet (as seen at transmitting node)	A-1
Ideal Received Packet on ControlNet (as seen at receiving node).	A-2
Typical Waveforms	A-2
Example of Waveform Seen When Network is Improperly Terminated	A-3
Effect of Attenuation on Signal Edges	A-4

Product Overview

The 1788-CNCHKR NetChecker is a hand-held tool for testing active ControlNet™ networks. It is pocket-sized and battery-powered for field use. The NetChecker helps commissioning and troubleshooting ControlNet installations by verifying signals on the ControlNet cabling. Using it, installers are able to find shorts, termination faults, etc. The tool is designed to evaluate the quality of the signal on the coaxial medium; it does not interpret the content of messages, except for the addresses of the nodes issuing messages.


The NetChecker checks several electrical characteristics of the signal:

- level of distortion
- noise or signal reflections
- rising and falling edges
- minimum message duration
- minimum between-message duration
- peak-to-peak amplitude
- violations to Manchester signal encoding

An evaluation of the signal quality is made using a combination of criteria on all the above characteristics. Most of the criteria used are fixed by design and therefore cannot be modified by the user. The input signal from the network is converted to a 2-level digital signal using a voltage reference. This voltage reference (or threshold) is the only criteria that can be modified by the user by means of a slide switch (SW3). The results of the signal analysis are displayed by bi-color LEDs.

Additional features include a Node Finder and an Oscilloscope Output. The Node Finder detects the presence of a given node on the network. The user enters the node address on thumbwheel switches. The Oscilloscope Output provides a trigger and an electrically isolated network signal for displaying messages from a specified node on an oscilloscope.

The NetChecker is designed to be connected to a network via either a standard tap or the provided BNC “T” and cable. The NetChecker is a passive instrument; it does not send any signal on the network under test.

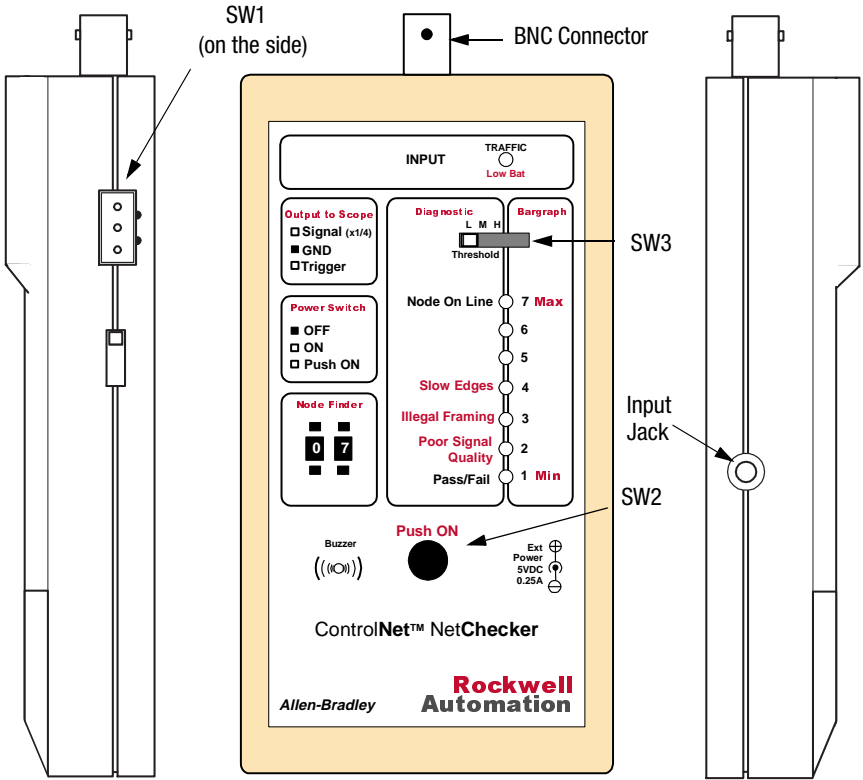

LEFT

1788-CNCHKR ControlNet™
NETCHECKER

RIGHT

NetChecker Specifications

Dimensions	152 x 83 x 33.5 mm (BNC connector not included) 164 x 83 33.5 mm (BNC connector included)
Weight (with batteries)	250 grams (8.18 oz.)
Environmental	Operating Temperature: 0 to 50° C Storage Temperature: -40° to +85° C
Slide Switch SW1:	3-position power switch: <ul style="list-style-type: none"> • OFF disconnects the batteries. • ON turns on the tool permanently. • Push ON provides momentary power.
Push Switch SW2:	Momentary switch to turn on the instrument when SW1 is in the Push ON position.
Slide Switch SW3:	4-position function switch: <ul style="list-style-type: none"> • Positions L, M, H select the Diagnostic Mode and Low, Medium and High Thresholds. • The rightmost position selects the Bargraph Mode.
BNC Connector:	Signal input. Connects to the network trunk cable via a standard tap or the provided cable and BNC "T". The NetChecker is electrically isolated from the network by a transformer.
Display:	8 bi-color (Red/Green) LEDs: <ul style="list-style-type: none"> • LEDs numbered 1 to 7 are dual-function for Diagnostic or Bargraph Modes • LED named TRAFFIC also indicates Low Battery condition.
Thumbwheel Switches:	2-digit decimal switches for entering the address of the Node to find (0 to 99).
DC Jack:	External DC power from AC adapter (nominal 5VDC, max 5.5V @ 0.25A). Jack should have 3.5mm external diameter (+) and 1.35mm internal diameter (-).
Oscilloscope Connector:	3-pin Phoenix connector with Network, Ground, and Trigger Signals.
Buzzer:	Piezo Buzzer provides an audible indication of detected faults.
Batteries:	2 alkaline batteries 1.5V AA/LR6 size located in the battery compartment on the back of the tool. Batteries are provided uninstalled with the tool. A phillips head screwdriver is required to install or replace the batteries.
Battery Life	6 hours continuous use
Accessories:	<ul style="list-style-type: none"> • 3-pin plug connector to fit in the Oscilloscope Output • BNC "T" connector • BNC male to BNC female coaxial cable (1 meter long) • User Manual 1788-UM001A-US-P.

NetChecker Specifications

<p>Agency Certification (When product or packaging is so marked)</p> <p style="text-align: center;">CE</p>	<ul style="list-style-type: none"> • EN 55011, Radiated Emission Class A • ENV 50204, Radiated immunity from digital radio • IEC 1000-4-2, ESD susceptibility • IEC 1000-4-3, Radiated immunity • IEC 1000-4-4, EFT/B immunity • IEC 1000-4-6, conducted RF immunity
---	--

TRAFFIC LED

This bi-color LED at the top of the instrument has two functions:

- **Green (Network Activity):** When the NetChecker is connected to an active network and powered on this LED will turn green to indicate there is activity on the network. Only messages in which a Start Delimiter is detected in the header (and thus are considered valid) can cause this LED to turn green.
- **Red (Low Battery):** If the batteries are low the LED will turn red, whether or not the tool is connected to a network.

Modes of Network Analysis

The NetChecker offers two modes of analysis to evaluate a network:

- **Diagnostic Mode** provides a global network evaluation. It is selected when slide switch SW3 is in the L, M, or H position.
- **Bargraph Mode** provides a quick view of the signal level on the network, either global (from all nodes) or from a selected node. It is selected when slide switch SW3 is in its rightmost position.

Diagnostic Mode

In Diagnostic Mode positions L, M, and H on slide switch SW3 select one of three fixed voltage references (or thresholds) used by the NetChecker to convert the analog input signal to a binary signal.

Threshold Settings

Sensitivity to Noise	SW3 Position	Reference Voltage (mV)	Volts (peak-to-peak)
Most Sensitive	L	300	0.6
Moderately Sensitive	M	450	0.9
Least Sensitive	H	600	1.2

The L (Low) Reference Voltage setting is the most sensitive to input signal or noise. When the L position is selected any input signal exceeding +/-300mV will be converted to a logical “1” and processed by the NetChecker. All input signals between +300mV and -300mV will be converted to a logical “0” and ignored. Note that this sensitivity range is deliberately set above the absolute minimum peak-to-peak voltage required by the ControlNet specification (510mVpp).

The M (Medium) and H (High) positions provide higher voltage references and less sensitivity as shown in the table.

LED Functions

When slide switch SW3 is in the Diagnostic (left) area of the front panel the LEDs have the following functions:

- The **Pass/Fail** LED indicates the overall quality of the signal on the coaxial cable. Green when the input signal is clean, this LED will turn progressively red if one or more of the criteria of quality are violated.
- The **Poor Signal Quality** LED blinks red when the message signal is distorted and/or when the between-messages gap is polluted by noise so that the NetChecker is uncertain if the signal received is a valid message or noise. Distortion and noise are generally the result of reflections of signal on the cable caused by impedance mismatches. The Poor Signal Quality fault detection is dependent on the threshold settings L, M, and H on SW3.

Note that there are a number of violations to the Manchester encoding in the ControlNet frame (in Start and End Delimiters). The NetChecker can detect if there are fewer or more violations than expected. In the case of very large distortion of the signal the NetChecker may interpret that there are unexpected violations although the message was generated correctly by the originator node.

- The **Illegal Framing** LED blinks red when erratic message detection occurs. The NetChecker verifies the duration of messages and generates a fault if any message is shorter than 7 bytes (NULL message length). In addition, the time gap between messages must not be less than 6 bytes. These errors are generally caused by high noise level or signal reflection at the end of the messages or during the time gap between messages. These faults are the result of large impedance mismatches on the network. This fault detection is dependent on the threshold settings L, M, and H on SW3.
- The **Slow Edges** LED blinks red when the NetChecker has identified a weak signal with poor rise/fall times. This may result from high signal attenuation caused by bad coaxial cable, excessive cable length, or an overloaded network. This fault detection is not dependent on the threshold settings on SW3.
- The **Node On Line** LED turns green if a node having the address entered in the Node Finder is detected on the network and the signal received from it is good. The LED will turn red or appear yellow (rapidly flashing red and green) if the messages received from this node exhibit one or more of the faults signaled by the fault LEDs.

Note that when this LED is red, it generally does not mean that the node itself is bad but rather that the signal received by the NetChecker from this node is affected by a problem on the network. An impedance mismatch may cause some nodes to be received as good (Node On Line LED green) while others are received as bad (Node On Line LED red). Testing at another point on the network will show that nodes that were received as bad are now received as good or vice versa. If a Node really is bad it will appear bad everywhere on the network. The NetChecker can only rely on the signal it receives at one point on the network. That is why a network should always be checked at several points.

Buzzer

The Buzzer sounds any time a fault is detected.

Node Finder and Oscilloscope Output

The address (Mac ID) of the message originator is the only information from a message that can be decoded by the NetChecker. This address is compared to the address entered on the two thumbwheels (the possible node addresses range from 01 to 99). Depending on the setting of SW3, the comparator either activates the Node On Line LED (Diagnostic mode) or enables the display of the level of signal received from the node (Bargraph mode).

The Node Finder also provides a synchronization signal for viewing the messages from a given node with a digital storage oscilloscope (DSO). This signal (“Trigger”) is provided on the 3-pin connector on the left side of the NetChecker. The connector pin labeled “Signal” delivers the signal from the network via an input transformer with a 1:4 isolation stage. The NetChecker ground is provided on the center pin.

The Trigger signal rises at the end of the transmission of the originator address (MacID) if the address matches the number on the thumbwheels (set the oscilloscope trigger to rising edge). We recommend fastening small pieces of solid copper wire (1 inch long 18-22AWG) to the terminal block for attachment of the oscilloscope’s probes (preferably high impedance 10:1 probes). Also remember that the peak-to-peak voltage on the Signal pin is one fourth the peak-to-peak voltage on the network.

Bargraph Mode

When slide switch SW3 is in its rightmost position, the Bargraph mode is enabled and LEDs 1 to 7 function as a maximum/minimum signal level indicator. This indicator displays the level of the signal from the node selected by the Node Finder. When the Node Finder is set to 00, it provides a global view of the signal level (maximum and minimum) of all the messages seen on the network.

In Bargraph mode, the Poor Signal Quality and Illegal Framing detections are performed with the threshold defaulted to M (Medium). If Poor Signal Quality or Illegal Framing are detected, they are signalled only by the buzzer. The Slow Edges detection is not performed in Bargraph mode.

Bargraph Scale

The Bargraph is not a precision voltmeter. The LEDs are numbered from 1 (lowest peak-to-peak voltage or Vpp) to 7 (highest Vpp). Also note that the scale is not linear. The following table shows the approximate peak-to-peak voltages indicated by each LED.

LED	Vpp Level	LED GREEN if	LED RED if
7	9.5	no green state	signal level > 9.5 Vpp
6	7.5	7.5 Vpp < signal level < 9.5 Vpp	no red state
5	5.75	5.75 Vpp < signal level < 7.5 Vpp	
4	4.5	4.5 Vpp < signal level < 5.75 Vpp	
3	3.25	3.25 Vpp < signal level < 4.5 Vpp	
2	2	2 Vpp < signal level < 3.25 Vpp	
1	0.75	0.75 Vpp < signal level < 2 Vpp	signal level < 0.75 Vpp

LED 7 will turn red if the signal level exceeds 9.5 Vpp. Otherwise, it will be off. LED 1 can have one of three states: red if the signal input is less than 0.75 Vpp, green if the signal input is between 0.75 and 2Vpp, and off under any other condition. LEDs 2 to 6 can only be green or off.

Only two LEDs on the Bargraph can be turned on at the same time, one indicating the maximum level and the other indicating the minimum. If the maximum and the minimum levels are the same, only one LED will turn on.

Viewing a Node Signal Level in Bargraph Mode

To check the signal level from a particular node, set SW3 to the rightmost position and set the address of the node on the Node Finder thumbwheels. Note that the Bargraph indication is the level seen at the point of test, so a low or high indication does not necessarily mean that the node itself is faulty. If all of the LEDs are off, the NetChecker does not detect any signal from a node having the address entered.

IMPORTANT

In networks in which repeaters are used, the level read on the Bargraph for nodes that are behind a repeater (i.e., on another trunk cable than the one being tested) is the level of signal **from the repeater**.

Performing a Global Survey of Signal Levels

To perform a global survey of the signal levels of all messages on a network, set SW3 to its rightmost position and set the Node Finder thumbwheels to 00 (zero). The NetChecker will display two green LEDs, indicating the strongest and the weakest levels encountered on the network. The maximum and the minimum levels indicated remain latched until NetChecker power is cycled.

Oscilloscope Output in Bargraph Mode

In Node Signal Level Bargraph mode, the Oscilloscope Output is operational in the same way as in Diagnostic mode. In Global Bargraph mode, however, no trigger signal is provided since there can be no ControlNet node at address 00.

Operation

Installing the Batteries

Use a Phillips head screwdriver to remove the two screws from the battery cover on the back of the NetChecker. Install the two 1.5V AA batteries supplied as indicated in the compartment. Batteries installed incorrectly may damage the instrument. Use only alkaline batteries for replacement.

Conserving Battery Power

To conserve battery power when using the NetChecker, set power switch SW1 to the “Push ON” position, then press and hold the Push ON button for just the time necessary (a few seconds) to read the LEDs. If you need your hands free, set SW1 to the “ON” position (middle) so that the NetChecker remains powered on. Remember to put SW1 back to the OFF position when you are done.

Using a Wall Adapter to Power the NetChecker

The NetChecker may also be powered by a wall adapter connected to the External Power connector on the side of the tool. The adapter should produce a regulated 5 VDC @ 0.25A (5.5 volts max). The internal batteries are disconnected when the adapter’s jack is inserted in the connector. The NetChecker remains operating as long as power is provided (switches SW1 and SW2 are not active in the external power mode; however, it is better to leave SW1 in the OFF position).

ATTENTION

Make sure that your adapter is CE compliant and that the system formed by the NetChecker plus the adapter is also CE compliant.

Connecting to the Network

Connect the NetChecker to the network using either a standard controlNet tap or the BNC “T” and cable provided. If you do not want to open the network, you can install some free taps for testing. With a redundant network, you can temporarily disconnect one of a node’s taps from the network and test from this. Recognize, however, that you are removing a node from the network. Test that node later from a different location on the network.

When you press the ON switch, the TRAFFIC LED should turn green to indicate that messages are being detected. The greater the volume of traffic seen on the network, the brighter the LED will be illuminated. If the LED remains off, the network is either inactive or the tested segment of cable is disconnected from the network. Check the cable and the connectors.

Selecting Testpoints on the Network

Good diagnostic results verify that the network signal is clean at the **point of test** only. Because the defects caused by a single impedance mismatch are variable along the cable *and are also related to the node that is transmitting*, a network segment should be tested at several points. For example, test near the two ends of the cable and at one or more points along the cable, depending on the cable length and the number of nodes. If repeaters are used, every segment between repeaters should be checked. On a redundant network, check both of the cables.

The NetChecker can indicate that there is a problem on the tested network, but it cannot indicate where the problem originated. However, it can help to locate intermittent defects (see **Additional Tips** on page -19). Keep in mind that the source of a problem may be far away from the point of analysis.

TIP



A bad diagnostic result does not necessarily mean that the network is not functional. However, it may require a closer check of wiring, component quality, connectors, impedance matching, etc.

Network Diagnostics

This section describes procedures for evaluating the quality of the ControlNet network.

How to Begin Checking Your Network

Start checking in Diagnostic mode. You can start checking at any of the three threshold settings (L, M, and H), but be sure to perform the test at all three settings. Then set SW3 to the Bargraph (rightmost) position and examine the global signal level on the network by setting the Node Finder thumbwheels to 00.

If you obtained the following results, the NetChecker did not detect any problem at the testpoint.

LED	State
TRAFFIC	Green
Pass/Fail	Green
Fault LEDs	All Off
Buzzer	Does not sound.
Bargraph indication	Within range of 2 to 6

} for all thresholds, L, M, and H

Refer to the table in the following section to determine the overall state of your network.

Faults and Their Origins

The NetChecker checks for Poor Signal Quality, Illegal Framing, and Slow Edges. If a fault is detected when checking in the Diagnostic mode, the buzzer will sound and one or more of the three fault LEDs will blink red.

The detection of Poor Signal Quality and Illegal Framing depends on the threshold setting on SW3. Generally, faults that are detected at the L (Low) threshold level will disappear or be seen less frequently as the threshold is increased. However, in some cases where the received signal has a low level (less than 2 on the Bargraph scale), faults may appear or their recurrence may increase as the threshold is raised.

Use the table below as a guideline when evaluating your network:

Threshold (SW3)			Network quality at the point of test
L	M	H	
No Fault	No Fault	No Fault	Very clean
Fault	No Fault	No Fault	Clean. Acceptable
Fault	Fault	No Fault	May be acceptable after cabling inspection
Fault	Fault	Fault	Network needs inspection

IMPORTANT

If faults are reported for all three threshold levels then it is highly probable there is a severe problem on the network.

The third type of fault detection, Slow Edges, checks for a low signal with poor rising and falling edges caused by an abnormal attenuation of the signal. This fault detection is not dependent on the threshold setting of SW3.

When analyzing a network the NetChecker indication may differ from one point of test to another. A network may be acceptable if the NetChecker reports faults with a low (or even medium) threshold setting at some points, but a network that exhibits faults everywhere should be inspected.

Try to evaluate residual problems using the Node Finder and an oscilloscope to ensure that the signals meet the ControlNet requirements. Examine the nodes that are reported faulted (the Node On Line LED appears red or yellow) and analyze the messages: the faults may come from signal distortion, signal weakness, poor edges, noise, or signal reflections.

TIP



Remember that the NetChecker's purpose is to alert for possible problems with network cabling and that its sensitivity is greater than required by the ControlNet specification.

Poor Signal Quality

Poor Signal Quality has the following indications.

LED	State
TRAFFIC	Green
Slow Edges	May also be blinking Red
Illegal Framing	May also be blinking Red
Poor Signal Quality	Blinking Red
Pass/Fail	Yellow or Red
Buzzer	Sounds

A blinking Poor Signal Quality LED often indicates that signal reflections are present on the network. If you receive this indication, check the network for impedance mismatches: inadequate coaxial cable used for all or part of the trunk cable, no termination or wrong termination, high contact resistance, or intermittent contact in BNC connectors near the taps. Generally, the faults are reported at the lower threshold settings and disappear or decrease at the higher settings.

Use the Bargraph mode to verify the minimum signal level. If the signal level is low (2 or less on the Bargraph scale), check the trunk cable length versus the number of nodes and compare it to the ControlNet specification. Terminate any unused taps with a dummy load (1786-TCAP). Also ensure that no BNC connector is in contact with any conductive material such as a metal wireway or DIN rail.

IMPORTANT

An unused drop cable should be terminated by a dummy load (1786-TCAP). Do not use a 75 ohm termination along with a bullet connector. The impedance here is not 75 ohms.

In disorders caused by impedance mismatches, Poor Signal Quality may be reported along with Illegal Framing (and possibly Slow Edges) for all the threshold settings. This indicates large impedance mismatches caused by an open trunk cable or a short-circuit. In such cases, the Node Finder may have difficulty detecting the presence of some nodes on the network because of the high amount of distortion.

In cases where the received signal has a low level (less than 2 on the Bargraph scale) with distortion and/or poor edges, the faults may appear or their recurrence may increase as the threshold is increased. Make sure that the cable length versus number of nodes does not exceed the ControlNet specification. Check for possible high signal attenuation caused by inadequate coaxial media used for the trunk cable or segments. High resistance at the contact points of the BNC connectors on the trunk cable may also add abnormal signal attenuation.

Illegal Framing

Illegal Framing has the following indications.

LED	State
TRAFFIC	Green
Slow Edges	May also be blinking Red
Illegal Framing	Blinking Red
Poor signal Quality	May also be blinking Red
Pass/Fail	Yellow or Red
Buzzer	Sounds

Illegal Framing occurs if short messages or short between-message gaps have been detected. Illegal Framing detection is dependent on the threshold setting (SW3); generally, recurrence decreases as the threshold is made higher. This fault is often reported along with Poor Signal Quality.

Illegal Framing most likely indicates a high level of signal reflections on the network (see previous section), but can also be caused by a faulty node. A faulty node can be suspected if:

- only Illegal Framing is reported
- it is not affected by the threshold setting
- the fault is reported everywhere on the network but the Bargraph shows correct signal levels.

In this case, try to identify the node with the Node Finder. Check the Node On-Line LED for each of the known addresses of your network. The faulty node is signalled by the Node On-Line LED turning red.

Slow Edges

Slow Edges has the following indications.

LED	State
TRAFFIC	Green
Slow Edges	Blinking Red
Illegal Framing	May also be blinking Red
Poor signal Quality	May also be blinking Red
Pass/Fail	Yellow or Red
Buzzer	Sounds

Slow Edges is generally reported when a weak input signal with poor (slow) rising/falling edges is identified. This may occur with signals received from remote stations on long networks with a large number of nodes. In this case, Slow Edges detection is not influenced by the threshold setting on SW3.

Make sure that the cable length versus number of nodes meets the ControlNet specification. Check for possible high signal attenuation caused by inadequate coaxial media used for the trunk cable or segments. High resistance at the contact points of the BNC connectors on the trunk cable may add abnormal signal attenuation. A small amount of Slow Edges can be tolerated on long networks provided that the Bargraph shows that the minimum level is correct.

Slow Edges may also be reported along with Poor Signal Quality and Illegal Framing in the case of strong impedance mismatches on the network causing a high amount of distortion. In this situation, the threshold setting may influence the recurrence of the faults.


Examples

The figures below show examples of the reporting by the NetChecker.

Checking the Signal Level Using the Threshold Setting


In the example at left, the NetChecker reports no fault at the highest sensitivity (Low Threshold). The network is OK at the point of test. The LED “Node On Line” is green because there is a node transmitting at address 07.

The example at right shows faults reported at High Threshold. Generally, this indicates a high level of reflections on the network: the network may not be correctly terminated, is accidentally open or shorted, there is bad contact in a BNC connector, etc. The LED “Node On Line” is off because there is no node at address 11.

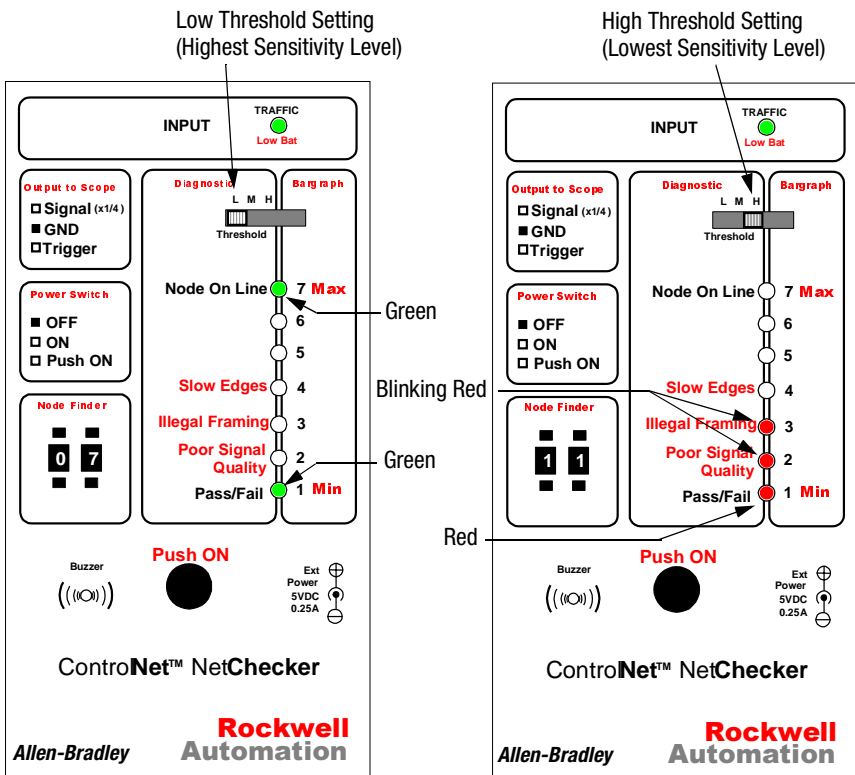


Checking the Signal Level Using the Bargraph

Set slide switch SW3 to its Bargraph (rightmost) position and set the Node Finder to zero to get a global level indication. Press the ON switch and make sure that the TRAFFIC LED is green. Generally, the Bargraph displays two green LEDs indicating the maximum and the minimum level of signal seen at the point of test on the network. Normally, these should be in the range of LEDs 2 to 6.

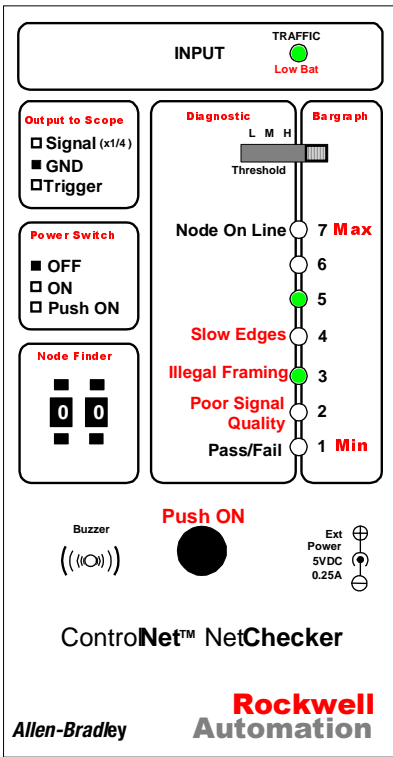

Bargraph: Global Mode

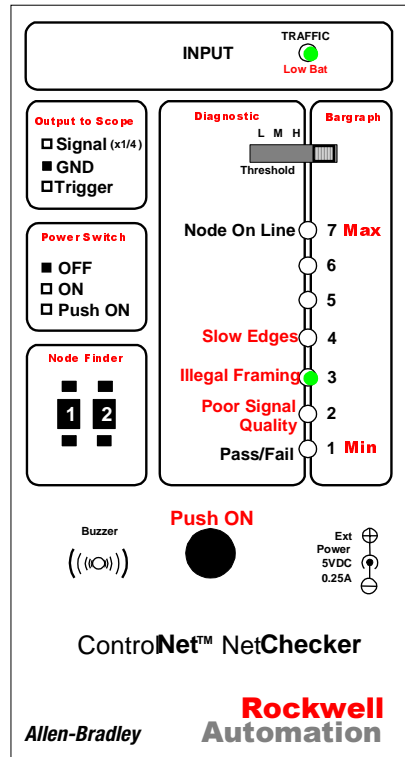

Bargraph: Node Level

If LED 1 is green, the minimum level is between 0.75Vpp and 2Vpp (this is still acceptable). If LED 1 is red, however, at least one signal is being received at a level less than 750mVpp. To identify the node(s) that are producing the low signal(s) scan all of the node addresses on the network with the Node Finder. If it is necessary to ensure that the signal at each node input meets the ControlNet Receive Mask specification (510mVpp at minimum), verify the minimum level with an oscilloscope connected to the NetChecker.

If LED 7 (top of the scale) turns red, a level of signal greater than 9.5Vpp was detected. This may indicate a strong mismatch on the network. Check if terminations are present.

Additional Tips

Intermittent Problems

Various intermittent problems are often caused by the BNC connectors on the trunk cable (e.g., center pin not crimped causing an unreliable contact). The NetChecker in Diagnostic mode is a valuable tool to help locate such problems. Read the NetChecker while subjecting each trunk connector or tap to a moderate mechanical stress. If faults are reported, the BNC connector has not been mounted correctly and must be replaced.

Continuous Network Monitoring


To provide continuous monitoring, the NetChecker powered by an AC wall adapter can be installed temporarily or permanently on the network. The NetChecker will signal immediately any degradation of the signal quality at the media level even if the network is still performing correctly. The NetChecker should be set in Diagnostic mode.

Example Waveforms

This Appendix shows examples of the types of waveforms that may be seen on a ControlNet network.


Ideal Transmitted Packet on ControlNet (as seen at transmitting node)

5 Mbps, Manchester Encoded
Transmit Level: 8.2 Vpp +/-1.3V

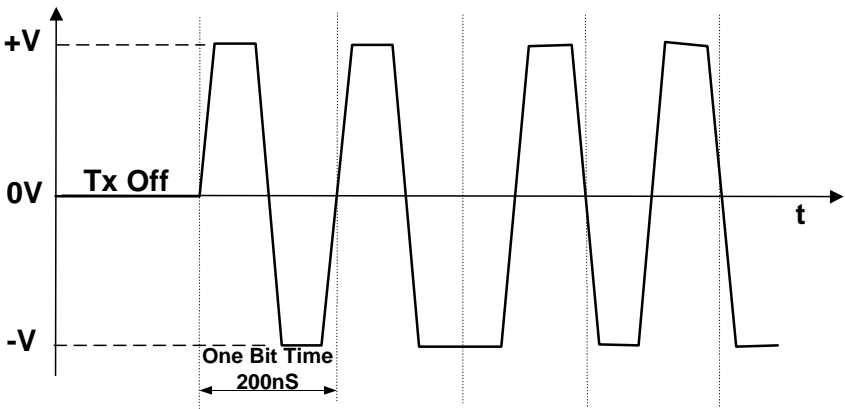


Waveform on Cable


Ideal Received Packet on ControlNet (as seen at receiving node)

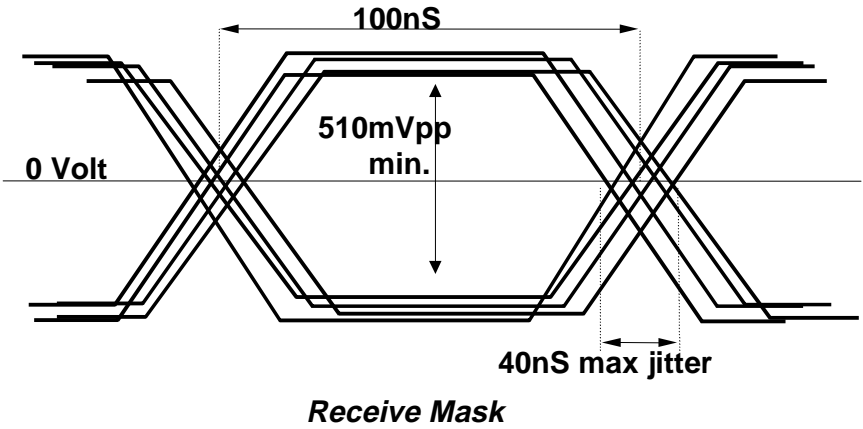

Typical Waveforms

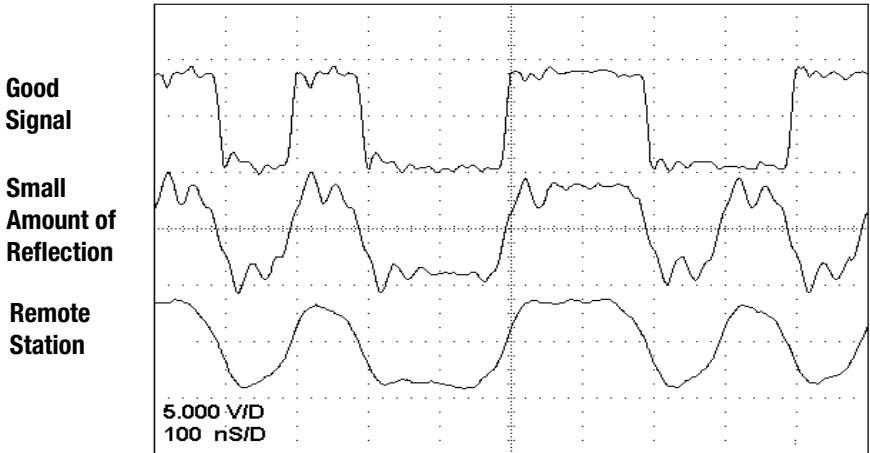

Example of Waveform Seen When Network is Improperly Terminated

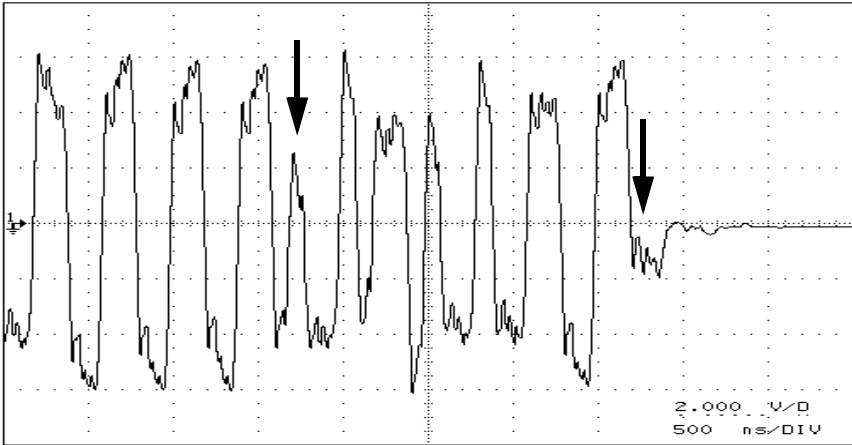


- **impedance mismatches cause reflections on the media:**
 - network not correctly terminated.
 - impedance of coaxial cable not equal to 75Ω .
 - high resistance of contact in connectors.
 - incorrect network architecture.

IMPORTANT

Remember: Each coaxial segment must be terminated with a 1786-TCAP terminator at each end.

Effect of Attenuation on Signal Edges

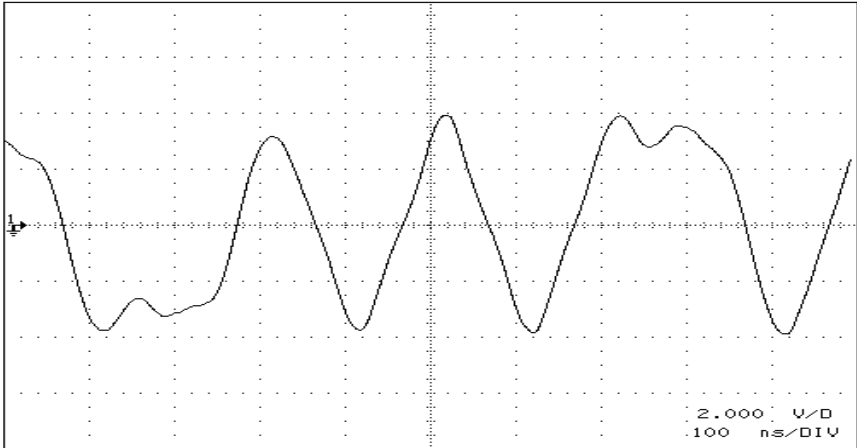

- **excessive attenuation causes losses of signal:**
 - **poor quality coaxial cable**
 - resistance too high
 - losses in dielectric
 - **overloaded network**
 - too long trunk segment
 - excessive number of nodes per segment
 - **impedance mismatches**

Reach us now at www.rockwellautomation.com

Wherever you need us, Rockwell Automation brings together leading brands in industrial automation including Allen-Bradley controls, Reliance Electric power transmission products, Dodge mechanical power transmission components, and Rockwell Software. Rockwell Automation's unique, flexible approach to helping customers achieve a competitive advantage is supported by thousands of authorized partners, distributors and system integrators around the world.

Americas Headquarters, 1201 South Second Street, Milwaukee, WI 53204, USA, Tel: (1) 414 382-2000, Fax: (1) 414 382-4444
European Headquarters SA/NV, avenue Hermann Debroux, 46, 1160 Brussels, Belgium, Tel: (32) 2 663 06 00, Fax: (32) 2 663 06 40
Asia Pacific Headquarters, 27/F Citicorp Centre, 18 Whitfield Road, Causeway Bay, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846



**Rockwell
Automation**

Publication 1788-UM001A-US-P - November 1999

PN 957236-84

© 1999 Rockwell International Corporation. Printed in USA.