

ST 3000 Smart Transmitter Series 900 Remote Diaphragm Seals Models Specifications 34-ST-03-57 March 2013



Introduction

In 1983, Honeywell introduced the first Smart Pressure Transmitter—the ST 3000®. In 1989, Honeywell launched the first all digital, bi-directional protocol for smart field devices. Today, its ST 3000 Series 900 Remote Seal Transmitters continue to bring proven “smart” technology to a wide spectrum of pressure measurement applications. For applications in which the transmitter must be mounted remotely from the process, Honeywell offers the remote seal line of gauge, absolute and differential pressure transmitters. Typical applications include level measurement in pressurized vessels in the chemical and hydrocarbon processing industries. A second application is flow measurement for slurries and high viscosity fluids in the chemical industry. Honeywell remote seal transmitters are available with secondary fill fluids for corrosive or high temperature process fluids.



Figure 1—Series 900 Remote Seal Pressure Transmitters feature proven piezoresistive sensors and advanced seal technology with standard weld connections.

Models		
STR93D	0 to 100 psid	0 to 7 bar
STR94G	0 to 500 psig	0 to 35 bar

All ST 3000 transmitters can be ordered to provide one of the following output communication options.

Communications options
4-20 mA
Honeywell Digitally Enhanced (DE)
HART® (versions 5.x or 6.x)
FOUNDATION™ Fieldbus

The devices provide comprehensive self-diagnostics to help users maintain high uptime, meet regulatory requirements, and attain high quality standards. S900 transmitters allow smart performance at analog prices. Accurate, reliable and stable, Series 900 transmitters offer greater turndown ratio than conventional transmitters.

All ST 3000 transmitters can provide a 4-20 mA output, Honeywell Digitally Enhanced (DE) output, HART® output, or FOUNDATION™ Fieldbus output. When digitally integrated with Honeywell’s Process Knowledge System™, EXPERION PKS™ ST 3000 instruments provide a more accurate process variable as well as advanced diagnostics.

Honeywell’s cost-effective ST3000 S900 transmitters lead the industry in reliability and stability:

- Stability
- Reliability

ST3000 S900 Transmitter Benefits

Stability = ±0.01% per year

Reliability = 470 years MTBF

Description of Diaphragm Seals

Diaphragm seals are traditionally used when a standard pressure transmitter should not be exposed to the process pressure directly. Diaphragm seals typically protect the pressure transmitter from one or more damaging aspects of the process media. Consideration for using a diaphragm seal should be made in the following circumstances.

- High Process Temperature
- Process Media is Viscous or Contains Suspended Solids
- Process Media is Subject to Solidifying
- Process Media is Corrosive
- Process Application Requires Sanitary Connections
- Process Application Subjects the Measuring Instrument to Hydrogen Permeation
- Tank Level Applications with Maintenance Intensive Wet Legs
- Tank Application with Density or Interface Measurements
- Measuring Instrument Requires Remote Mounting

The following diaphragm seals are standard from Honeywell (please call your local salesperson if you do not see the product you need for your application)



Figure 2—Flush Flange Seals

Flush Flange Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, ANSI Class 300 and DIN DN80-PN40 process connections. Flush flange seals can also be provided with Lowers. Lowers are essentially calibration rings, which allow flushing connections if needed.



Figure 3—Flange Seal with Extended Diaphragm

Flange Seal with Extended Diaphragm can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" ANSI Class 150, ANSI Class 300, DIN DN80-PN40 and DIN DN100-PN40 process connections. 2", 4" and 6" extension lengths are available.



Figure 4—Pancake Seals

Pancake Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, 300 and 600 process connections.



Figure 5—Chemical Tee "Taylor" Wedge

Chemical Tee "Taylor" Wedge seals can be used with differential pressure transmitters and are available with Taylor Wedge 5" O.D. process connection.



Figure 6—Seals with Threaded Process Connections

Seals with Threaded Process Connections can be used with differential, gauge and absolute pressure transmitters and are available with 1/2", 3/4" and 1" NPT Female process connections.



Figure 7— Sanitary Seals

Sanitary Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" Tri-Clover-Tri-Clamp process connections.



Figure 8— Saddle Seals

Saddle Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" (6 bolt or 8 bolt designs) process connections.



Figure 9— Calibration Rings

Calibration Rings are available with Flush Flange Seals and Pancake Seals. Flushing ports (1/4" or 1/2") are available with calibration rings.



Figure 10— Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries

Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries are available with Honeywell Remote Seal Solutions.



Figure 11— 2" Stainless Steel Nipples

2" Stainless Steel Nipples are available for Close-Coupled remote seal solutions.



Figure 12— Welded Meter Body for All-Welded Remote Seal Solution

Welded Meter Body for All-Welded Remote Seal Solution. The welded ST 3000 meter body is an important part of an All-Welded Remote Seal Solution, which is commonly used in Vacuum applications.

Description

The ST 3000 transmitter can replace any 4 to 20 mA output transmitter in use today and operates over a standard two-wire system.

The measuring means is a piezoresistive sensor, which actually contains three sensors in one. It uses a differential pressure sensor, a temperature sensor and a static pressure sensor in delivering the most comprehensive compensated output signal available today.

Microprocessor-based electronics provide higher span-turndown ratio, improved temperature and pressure compensation, and improved accuracy.

The transmitter's meter body and electronics housing resist shock, vibration, corrosion, and moisture. The electronics housing contains a compartment for the single-board electronics, which is isolated from an integral junction box. The single-board electronics is replaceable and interchangeable with any other ST 3000 Series 100 or Series 900 model transmitters.

Features

- Choice of linear or square root output conformity is a simple configuration selection.
- Direct digital integration with Experion PKS and other control systems provides local measurement accuracy to the system level without adding typical A/D and D/A converter inaccuracies.
- Unique piezoresistive sensor automatically compensates input for real-world temperature and static pressure variations.
- Added "smart" features include configuring lower and upper range values, simulating accurate analog output, and selecting preprogrammed engineering units for display.
- Smart transmitter capabilities with local or remote interfacing means significant manpower efficiency improvements in commissioning, start-up, and ongoing maintenance functions.
- ST 3000 transmitters feature full Dual-Seal certification based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.01 requirements without the use of additional seal protection elements.
- ST 3000 transmitters are available fully compliant to SIL 2/3 requirements as a standard option.

Advanced Diagnostics

ST 3000 is now available for both HART[®] 6 and Foundation[™] Fieldbus with advanced diagnostics that minimize unplanned plant outages, minimize maintenance costs and by providing the industry's most reliable transmitter.

- Provide advanced warning of possible failure events and avoid costly shutdowns.
- Three levels of failure reporting
- Comprehensive list of on-board diagnostics (Ref. ST 3000 User manual with HART[®] 6, 34-ST-25-17 Rev: June 09 and Foundation[™] Fieldbus option manual 34-ST-25-15 Rev: June 09)

Operating Conditions – All Models

Parameter	Reference Condition (at zero static)		Rated Condition		Operative Limits		Transportation and Storage							
	°C	°F	°C	°F	°C	°F	°C	°F						
Ambient Temperature	25±1	77±2	-25 to 70	-13 to 158	-40 to 85	-40 to 185	-55 to 125	-67 to 257						
Process Interface Temperature	25±1	77±2	See Figure 13				-55 to 125	-67 to 257						
Humidity %RH	10 to 55		0 to 100		0 to 100		0 to 100							
Vacuum Region, Minimum Pressure mmHg absolute inH ₂ O absolute	Atmospheric Atmospheric		See Figure 13											
Supply Voltage, Current, and Load Resistance	Voltage Range: 10.8 to 42.4 Vdc at terminals Current Range: 3.0 to 21.8 mA Load Resistance: 0 to 1,440 ohms (as shown in Figure 14)													
Maximum Allowable Working Pressure (MAWP)⁴ (ST 3000 products are rated to Maximum Allowable Working Pressure. MAWP depends on Approval Agency and transmitter materials of construction.)	MAWP is minimum of Body Rating or Seal Rating (See Model Selection Guide for Seal MAWP) <table> <tr> <td>Body</td> <td>MAWP</td> </tr> <tr> <td>STR93D</td> <td>750 psig (52 bar)</td> </tr> <tr> <td>STR94G</td> <td>500 psig (35 bar)</td> </tr> </table>								Body	MAWP	STR93D	750 psig (52 bar)	STR94G	500 psig (35 bar)
Body	MAWP													
STR93D	750 psig (52 bar)													
STR94G	500 psig (35 bar)													

¹ For CTFE fill fluid, the rating is -15 to 110°C (5 to 230°F)

² Short term equals 2 hours at 70°C (158°F)

³ MAWP applies for temperature range -40 to 125°C. However, Static Pressure Limit is de-rated to 3,000 psi from -26°C to -40°C. Use of graphite o-rings de-rates transmitter to 3,625 psi. Use of adaptor with graphite o-rings de-rates transmitter to 3,000 psi.

⁴ Consult factory for MAWP of ST 3000 transmitters with CSA approval.

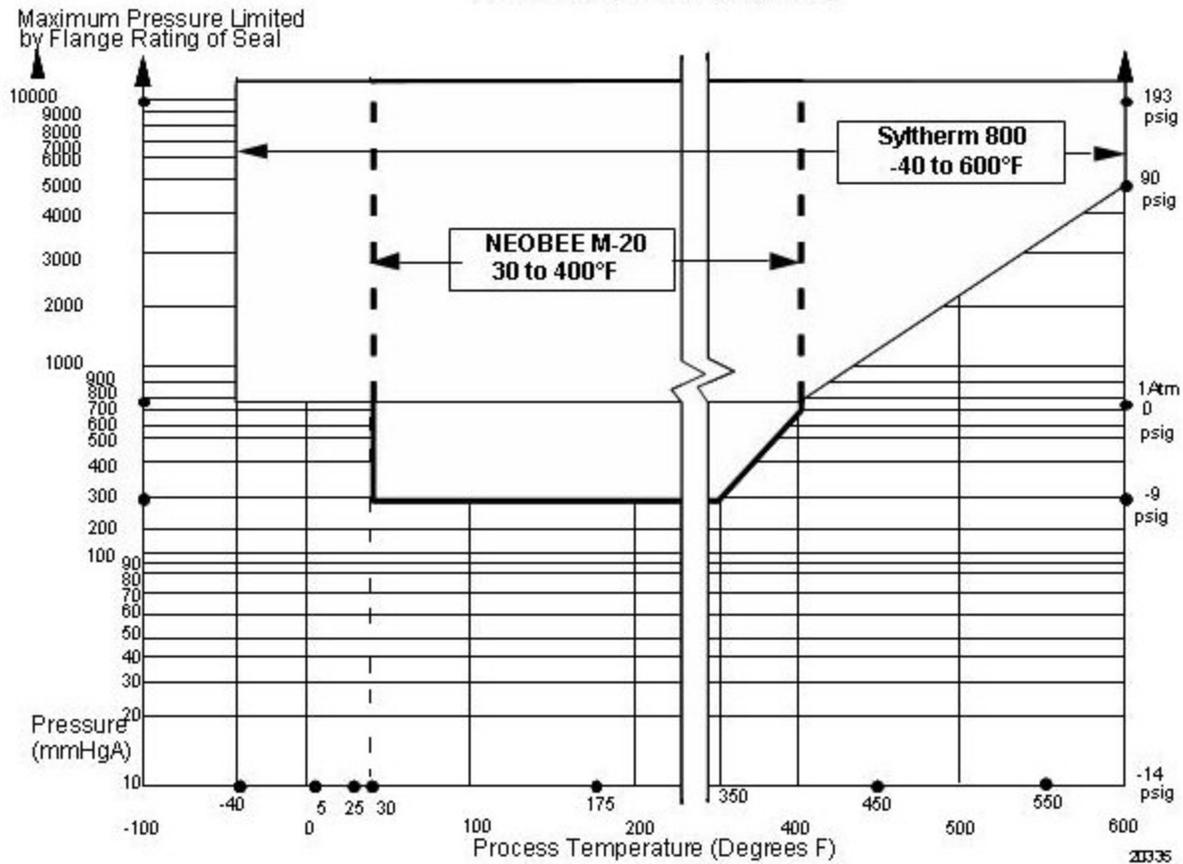
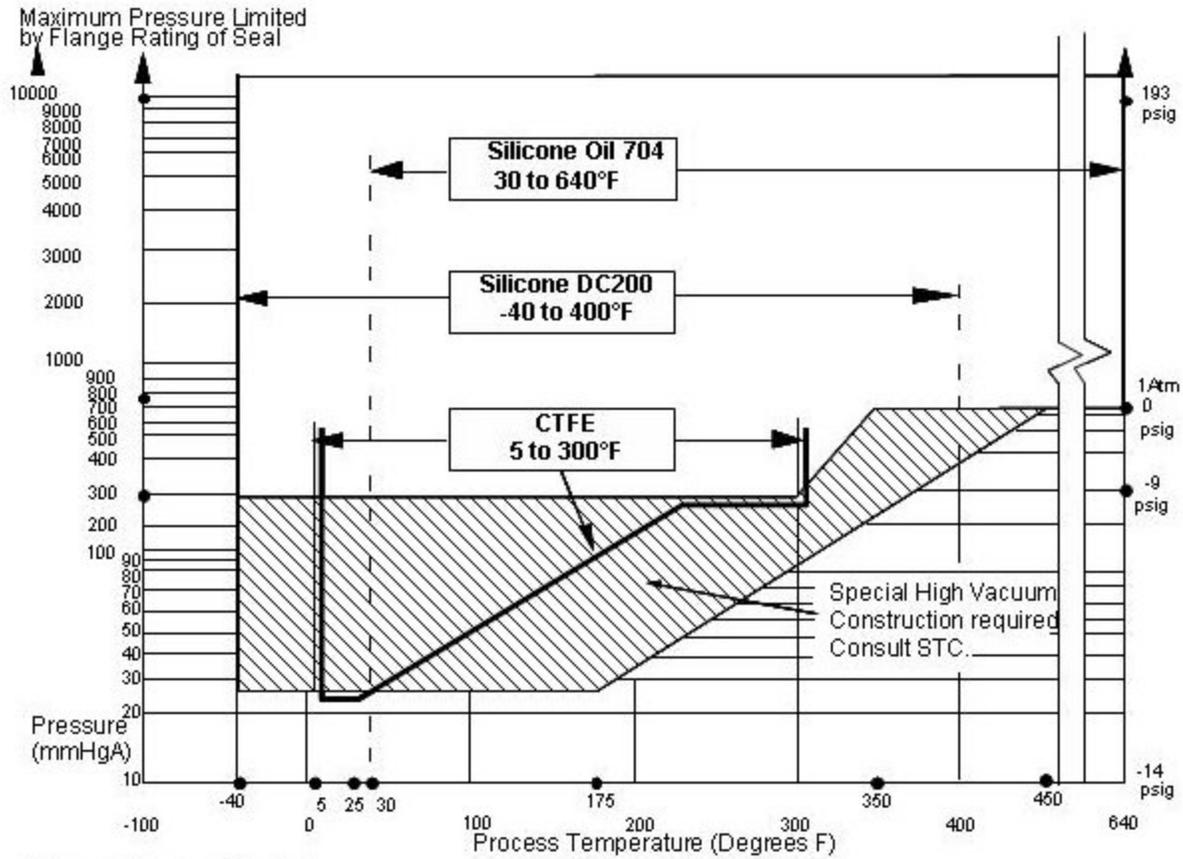


Figure 13—ST 3000 Remote Seals operable limits for pressure versus temperature

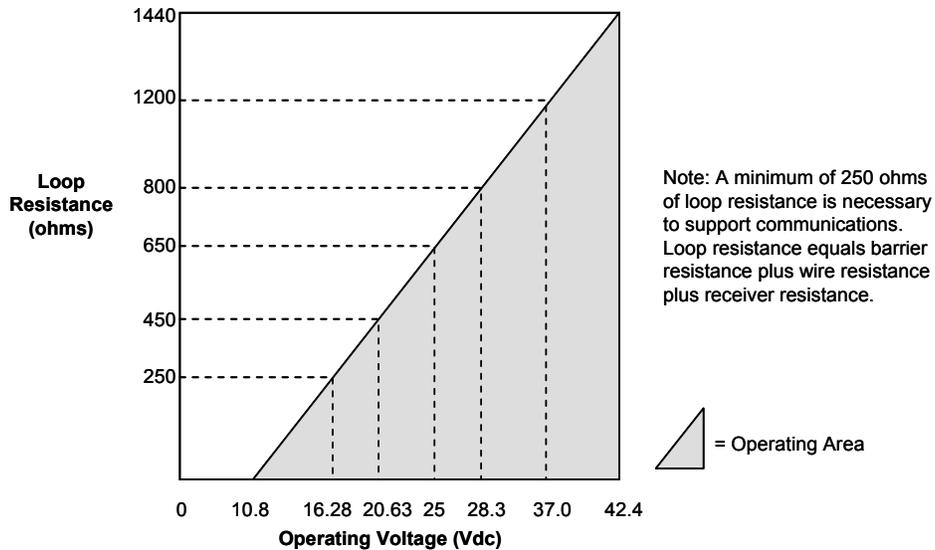


Figure 14—Supply voltage and loop resistance chart

Performance Under Rated Conditions* - Model STR93D (0 to 100 psi/7 bar)

Parameter	Description	
Upper Range Limit	psi bar	100 7
Minimum Span	psi bar	0.9 0.063
Turndown Ratio	110 to 1	
Zero Elevation and Suppression	No limit except minimum span within ±100% URL.	
Accuracy (Reference – Includes combined effects of linearity, hysteresis, and repeatability) <ul style="list-style-type: none"> Accuracy includes residual error after averaging successive readings. For FOUNDATION™ Fieldbus use Digital Mode specifications. For HART® use Analog Mode specifications. 	In Analog Mode: ±0.20% of calibrated span or upper range value (URV), whichever is greater, terminal based. For URV below reference point (50 inH ₂ O), accuracy equals: $\pm \left[0.10 + 0.10 \left(\frac{50 \text{ inH}_2\text{O}}{\text{span inH}_2\text{O}} \right) \right] \text{ or } \pm \left[0.10 + 0.10 \left(\frac{125 \text{ mbar}}{\text{span mbar}} \right) \right] \text{ in \% of span}$ In Digital Mode: ±0.175% of calibrated span or upper range value (URV), whichever is greater, terminal based. For URV below reference point (50 inH ₂ O), accuracy equals: $\pm \left[0.075 + 0.10 \left(\frac{50 \text{ inH}_2\text{O}}{\text{span inH}_2\text{O}} \right) \right] \text{ or } \pm \left[0.075 + 0.10 \left(\frac{125 \text{ mbar}}{\text{span mbar}} \right) \right] \text{ in \% of span}$	
Combined Zero and Span Temperature Effect per 28°C (50°F)**	In Analog Mode: ±1.5% of span. For URV below reference point (200 inH ₂ O), effect equals: $\pm \left[0.30 + 1.2 \left(\frac{200 \text{ inH}_2\text{O}}{\text{span inH}_2\text{O}} \right) \right] \text{ or } \pm \left[0.30 + 1.2 \left(\frac{500 \text{ mbar}}{\text{span mbar}} \right) \right] \text{ in \% of span}$ In Digital Mode: ±1.475% of span. For URV below reference point (200 inH ₂ O), effect equals: $\pm \left[0.275 + 1.2 \left(\frac{200 \text{ inH}_2\text{O}}{\text{span inH}_2\text{O}} \right) \right] \text{ or } \pm \left[0.275 + 1.2 \left(\frac{500 \text{ mbar}}{\text{span mbar}} \right) \right] \text{ in \% of span}$	

* Performance specifications are based on reference conditions of 25°C (77°F), zero (0) static pressure, 10 to 55% RH, and 316L Stainless Steel barrier diaphragm.

** Specification applies to transmitters with 2 seals only. Apply 1.5 times factor to temperature effect for capillary lengths greater than 10 feet or for 2-inch sanitary seals.

Performance Under Rated Conditions* - Models STR94G (0 to 500 psi/35 bar)

Parameter	Description	
Upper Range Limit	psi bar	500 35
Minimum Span	psi bar	20 1.4
Turndown Ratio	100 to 1	
Zero Elevation and Suppression	No limit except minimum span from absolute 0 (zero) to +100% URL.	
Accuracy (Reference – Includes combined effects of linearity, hysteresis, and repeatability) <ul style="list-style-type: none"> • Accuracy includes residual error after averaging successive readings. • For FOUNDATION™ Fieldbus use Digital Mode specifications. • For HART® use Analog Mode specifications. 	In Analog Mode: ±0.10% of calibrated span or upper range value (URV), whichever is greater, terminal based. In Digital Mode: ±0.075% of calibrated span or upper range value (URV), whichever is greater, terminal based.	

* Performance specifications are based on reference conditions of 25°C (77°F), zero (0) static pressure, 10 to 55% RH, and 316L Stainless Steel barrier diaphragm.

Transmitter Minimum Span and Maximum Capillary Length
--

Minimum recommended span for STR93D DP Transmitter with two Remote Seals

Diaphragm Size	Capillary							Capillary Length maximum
	5'	10'	15'	20'	25'	30'	35'	
2.0	15 psig	20 psig	25 psig	-	-	-	-	15'
2.4	150 iwc	200 iwc	250 iwc	300 iwc	350 iwc	400 iwc	450 iwc	35'
2.9	50 iwc	75 iwc	100 iwc	125 iwc	150 iwc	175 iwc	200 iwc	35'
3.5	25 iwc	25 iwc	25 iwc	28 iwc	32 iwc	36 iwc	40 iwc	35'
4.1	25 iwc	25 iwc	25 iwc	25 iwc	25 iwc	27 iwc	30 iwc	35'

Minimum recommended span for STR94G or STR93D DP Transmitter with one Remote Seal

Diaphragm Size	Direct Mount	Capillary						Capillary Length maximum
		5'	10'	15'	20'	30'	35'	
2.0	25 psi	30 psi	40 psi	50 psi	-	-	-	15'
2.4	10 psi	15 psi	20 psi	25 psi	30 psi	40 psi	50 psi	35'
2.9	8 psi	9 psi	10 psi	11 psi	12 psi	14 psi	15 psi	35'
3.5	2 psi	2 psi	3 psi	4 psi	5 psi	7 psi	8 psi	35'
4.1	0.9 psi	0.9 psi	1 psi	2 psi	3 psi	4 psi	5 psi	35'

Minimum span is the higher of the value from the table above or the value defined under Performance Conditions for the range transmitter

Figure 15— Maximum capillary length and diaphragm size chart.

Certifications

	Type of Protection	Comm. Option	Field Parameters	Temperature Codes
FM ApprovalsSM	Explosionproof: Class I, Division 1, Groups A, B, C, D locations Dust Ignition Proof: Class II, III, Division 1, Groups E, F, G locations, Enclosure Type 4X	All	All	T5 Ta = 93°C
	Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D, E, F, G locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42.4V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
		4-20 mA / HART®	Vmax = 30V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
	Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D, E, F, G locations; Class 1, Zone 0, AEx ia Group IIC, Enclosure Type 4X / IP 66/67	Fieldbus – Entity (Not FISCO)	Vmax = 32V Imax = 120mA Ci = 4.2nF Li = 0 Pi = 0.84W	T4 Ta = 40°C T3 Ta = 93°C
		Fieldbus – Entity (Not FISCO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C
		FISCO	Vmax = 17.5V Imax = 380mA Ci = 4.2nF Li = 0 Pi = 5.32W	T4 Ta = 40°C T3 Ta = 93°C
	Nonincendive: Class I, Division 2, Groups A, B, C, D locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42.4V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
		4-20 mA / HART	Vmax = 30V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
	Nonincendive: Class I, Division 2, Groups A, B, C, D; Suitable for: Class II, Division 2, Groups F&G; Class III, Division 2; Class I, Zone 2, Group IIC, Enclosure Type 4X / IP 66/67	Fieldbus – Entity (Not FNICO)	Vmax = 32V Imax = 120mA Ci = 4.2nF Li = 0 Pi = 0.84W	T4 Ta = 40°C T3 Ta = 93°C
		Fieldbus – Entity (Not FNICO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C
		FNICO	Vmax = 32V Ci = 4.2nF Li = 0	T4 Ta = 40°C T3 Ta = 93°C

* Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

FM ApprovalsSM is a service mark of FM Global

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes	
Canadian Standards Association (CSA)	Explosion Proof: Class I, Division 1, Groups B, C, D locations Dust Ignition Proof: Class II, III, Division 1, Groups E, F, G locations, Enclosure Type 4X	All	All	T4 Ta = 93°C	
	Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D, E, F, G locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		4-20 mA / HART®	Vmax = 42V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		Fieldbus – Entity (Not FISCO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C	
	Nonincendive: Class I, Division 2, Groups A, B, C, D locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42.4V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		4-20 mA / HART®	Vmax = 30V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		Fieldbus – Entity (Not FNICO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C	
	Canadian Registration Number (CRN):	All ST 3000 models except STG19L, STG99L, STG170 and STG180 have been registered in all provinces and territories in Canada and are marked CRN: 0F8914.5C.			

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
IECEX International Electrotechnical Commission (LCIE)	Flameproof, Zone 1: Ex d IIC, Enclosure IP 66/67	All	All	T5 Ta = -50 to 93°C T6 Ta = -50 to 78°C
	Intrinsically Safe, Zone 0/1: Ex ia IIC, Enclosure IP 66/67	4-20 mA / DE	U _i = 30V I _i = 100mA C _i = 4.2nF L _i = * P _i = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	U _i = 30V I _i = 100mA C _i = 4.2nF L _i = * P _i = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	U _i = 24V I _i = 250mA C _i = 4.2nF L _i = 0 P _i = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

* L_i = 0 except L_i = 150µH when Option ME, Analog Meter, is selected.

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
SAEx (South Africa)	Flameproof, Zone 1: Ex d IIC, Enclosure IP 66/67	All	All	T5 Ta = -50 to 93°C T6 Ta = -50 to 78°C
	Intrinsically Safe, Zone 0/1: Ex ia IIC, Enclosure IP 66/67	4-20 mA / DE	U _i = 30V I _i = 100mA C _i = 4.2nF L _i = * P _i = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	U _i = 30V I _i = 100mA C _i = 4.2nF L _i = * P _i = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	U _i = 24V I _i = 250mA C _i = 4.2nF L _i = 0 P _i = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C
	Multiple Marking: Flameproof, Zone 1: Ex d IIC, Enclosure IP 66/67 Intrinsically Safe, Zone 0/1: Ex ia IIC, Enclosure IP 66/67 The user must determine the type of protection required for installation of the equipment. The user shall then check the box [√] adjacent to the type of protection used on the equipment certification nameplate. Once a type of protection has been checked on the nameplate, subsequently the equipment shall not be reinstalled using any of the other certification types.	4-20 mA / DE	U _i = 30V I _i = 100mA C _i = 4.2nF L _i = * P _i = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	U _i = 30V I _i = 100mA C _i = 4.2nF L _i = * P _i = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	U _i = 24V I _i = 250mA C _i = 4.2nF L _i = 0 P _i = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

* L_i = 0 except L_i = 150µH when Option ME, Analog Meter, is selected.

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
ATEX (LCIE)	Flameproof, Zone 0: ⊕ II 1 D, Ex tD Enclosure IP 66/67	All	All	A20 IP6X T95°C Ta = 93°C or T80°C Ta = 78°C
	Flameproof, Zone 1: ⊕ II 2 GD, Ex d IIC, Ex tD Enclosure IP 66/67	All	All	T5 Ta = -50 to +93°C T6 Ta = -50 to +78°C, A21 IP6X T95°C Ta = 93°C or T80°C Ta = 78°C
	Intrinsically Safe, Zone 0/1: ⊕ II 1 G, Ex ia IIC, Enclosure IP 66/67	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C
	Non-Sparking, Zone 2: ⊕ II 3 G, Ex nA IIC (Honeywell), Enclosure IP 66/67	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FNICO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C
	Multiple Marking: Flameproof, Zone 1: ⊕ II 2 G, Ex d IIC Intrinsically Safe, Zone 0/1: ⊕ II 1 G, Ex ia IIC Non-Sparking, Zone 2: ⊕ II 3 G, Ex nA IIC NOTE: The user must determine the type of protection required for installation of the equipment. The user shall then check the box [√] adjacent to the type of protection used on the equipment certification nameplate. Once a type of protection has been checked on the nameplate, subsequently the equipment shall not be reinstalled using any of the other certification types.	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO/FNICO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

* Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
INMETRO (CERTUSP) Brazil	Flameproof, Zone 1: BR-Ex d IIC Enclosure IP 66/67	All	All	T5 Ta = -50 to 93°C T6 Ta = -50 to 78°C
	Intrinsically Safe, Zone 0/1: BR-Ex ia IIC Enclosure IP 66/67	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART®	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

* Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

ST 3000 Pressure Transmitter Marine Certificate (MT Option)	This certificate defines the certifications covered for the ST 3000 Pressure Transmitter family of products, including the SMV 3000 Smart Multivariable Transmitter. It represents the compilation of the five certificates Honeywell currently has covering the certification of these products into marine applications. For ST 3000 Smart Pressure Transmitter and SMV 3000 Smart Multivariable Transmitter
	American Bureau of Shipping (ABS) - 2009 Steel Vessel Rules 1-1-4/3.7, 4-6-2/5.15, 4-8-3/13 & 13.5, 4-8-4/27.5.1, 4-9-7/13. Certificate number: 04-HS417416-PDA
	Bureau Veritas (BV) - Product Code: 389:1H. Certificate number: 12660/B0 BV
	Det Norske Veritas (DNV) - Location Classes: Temperature D, Humidity B, Vibration A, EMC B, Enclosure C. For salt spray exposure; enclosure of 316 SST or 2-part epoxy protection with 316 SST bolts to be applied. Certificate number: A-11476
	Korean Register of Shipping (KR) - Certificate number: LOX17743-AE001
	Lloyd's Register (LR) - Certificate number: 02/60001(E1) & (E2)

<p>European Pressure Equipment Directive (PED) (97/23/EC)</p>	<p>The ST 3000 Smart Pressure Transmitters are in conformity with the essential requirements of the Pressure Equipment Directive.</p> <p>Honeywell ST 3000 Smart Pressure Transmitters are designed and manufactured in accordance with the applicable portions of Annex I, Essential Safety Requirements, and sound engineering practices. These transmitters have no pressurized internal volume, or have a pressurized internal volume rated less than 200 bar (2,900 psig), and/or have a maximum volume of less than 0.1 liter (Article 3, 1.1.(a) first indent, Group 1 fluids). Therefore, these transmitters are not subject to the essential requirements of the directive 97/23/EC (PED, Annex I) and shall not have the CE mark applied.</p> <p>For transmitters rated > 200 bar (2,900 psig) < 1,000 bar (14,500 psig) Honeywell maintains a technical file in accordance with Annex III, Module A, (internal production control) when the CE mark is required. Transmitter Attachments: Diaphragm Seals, Process Flanges and Manifolds comply with Sound Engineering Practice.</p> <p>NOTE: Pressure transmitters that are part of safety equipment for the protection of piping (systems) or vessel(s) from exceeding allowable pressure limits, (equipment with safety functions in accordance with Pressure Equipment Directive 97/23/EC article 1, 2.1.3), require separate examination.</p> <p>A formal statement from TÜV Industry Service Group of TÜV America, Inc., a division of TÜV Süddeutschland, a Notified Body regarding the Pressure Equipment Directive, can be found at www.honeywell.com. A hard copy may be obtained by contacting a Honeywell representative.</p>
<p>CE Mark</p>	<p><i>Electro Magnetic Compatibility (EMC) (2004/108/EC)</i> All Models: EN 50081-1: 1992; EN 50082-2:1995; EN 61326-1:1997 + A1, A2, and A3 – Industrial Locations</p>
<p>Dual Seal Certification</p>	<p>Dual Seal Certification based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.01 requirements without the use of additional seal protection elements.</p>
<p>Recommended Frequency of Calibration</p>	<p>Honeywell recommends verifying the calibration of these devices once every four years.</p>
<p>Approved Manufacturing Locations</p>	<p>Honeywell Process Solutions - York, PA USA Honeywell (Tianjin) Limited – Tianjin, P.R. China Honeywell Automation India Ltd – Pune 411013 India</p>

Foundation™ Fieldbus is a trademark of the Fieldbus Foundation.

HART® is a registered trademark of HART Communications Foundation.

Hastelloy® C-276 is a registered trademark of Haynes International.

Monel® 400 is a registered trademark of Special Metals Corporation.


ST 3000® and Experion® are registered trademarks of Honeywell International Inc.

Viton® is a registered trademark of DuPont

Teflon® is a registered trademark of DuPont.

DC® 200 is a registered trademark of Dow Corning.

FM ApprovalsSM is a service mark of FM Global

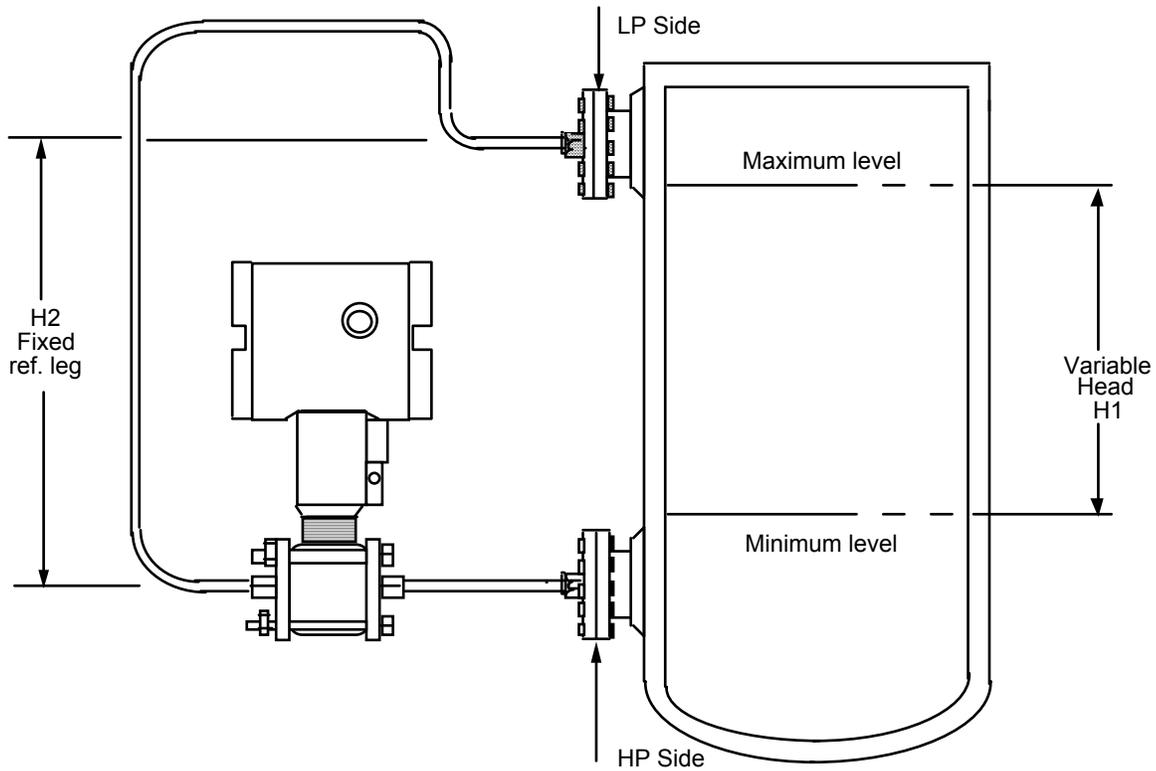Mounting

NOTE: Lower flange seal should not be mounted over 22 feet below the transmitter for silicone fill fluid (11 feet for CTFE fill fluid) with tank at one atmosphere. The combination of tank vacuum and high pressure capillary head effect should not exceed 9 psi vacuum (300 mmHg absolute).

Consult Honeywell for installation of STR93D

Figure 16 – Typical mounting arrangement for ST 3000 Transmitter with Remote Diaphragm Seals

Application Data

Liquid Level: Closed Tank

Determine the minimum and maximum pressure differentials to be measured (Figure 17).

$$P_{Min} = (SG_p \times a) - (SG_f \times d)$$

= LRV when HP at bottom of tank
 = -URV when LP at bottom of tank

$$P_{Max} = (SG_p \times b) - (SG_f \times d)$$

= URV when HP at bottom of tank
 = -LRV when LP at bottom of tank

Where:

minimum level = 4mA
 maximum level = 20 mA


a = distance between bottom tap and minimum level

b = distance between bottom tap and maximum level


d = distance between taps

SG_f = Specific Gravity of capillary fill fluid (See Page 9 for values.)


SG_p = Specific Gravity of process fluid

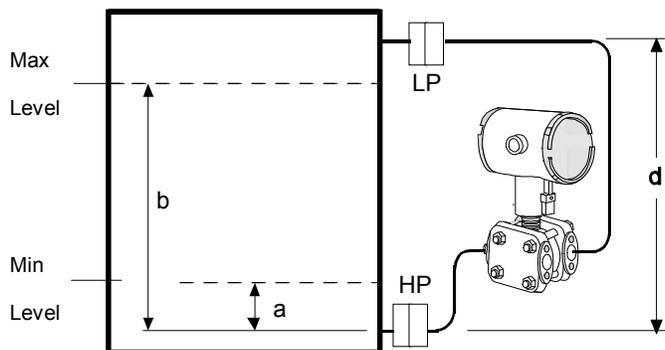

⚠ Transmitter above datum

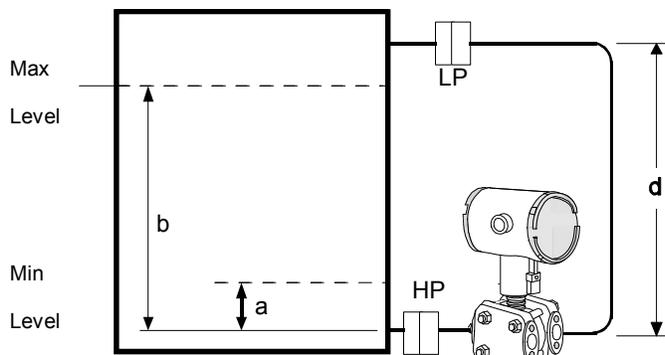

⚠ Transmitter at datum

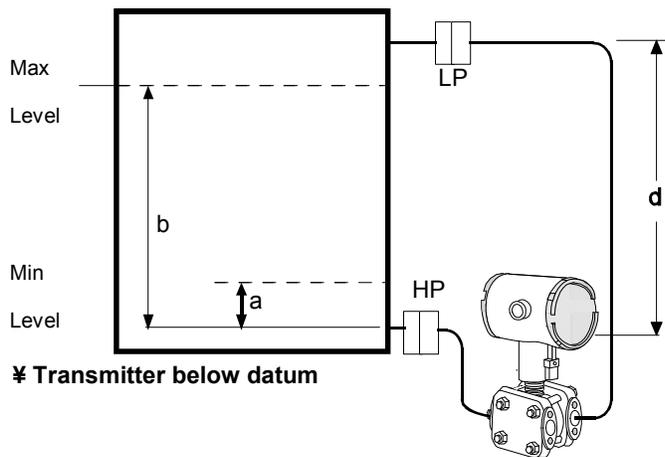

⚠ Transmitter below datum

Figure 17—Closed tank liquid level measurement distance 24253

Density or Interface

Calculate the minimum and maximum pressure differentials to be measured (Figure 18).

$P_{\min} = (SG_{\min} - SG_f) \times (d)$;
minimum density, 4mA output

$P_{\max} = (SG_{\max} - SG_f) \times (d)$;
maximum density, 20mA output

Where:

d = distance between the taps

SG_{\max} = maximum Specific Gravity

SG_{\min} = minimum Specific Gravity

SG_f = Specific Gravity of capillary fill fluid (See Page 9 for values.)


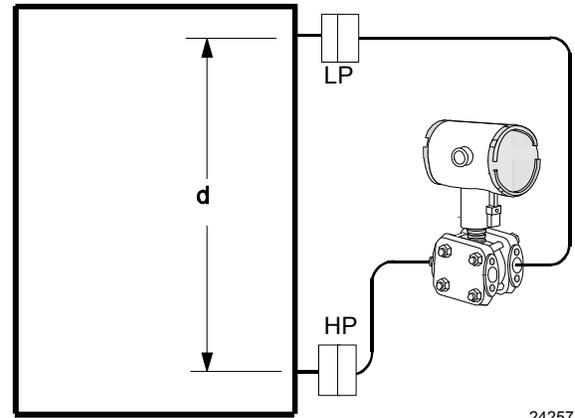




Figure 18—Density, direct acting transmitter configuration

Reference Dimensions


millimeters
inches

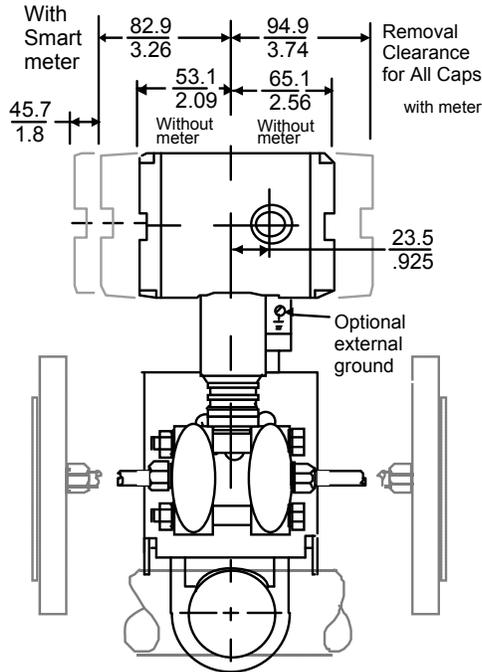

STR93D DP/I Remote Seal with Horizontal Pipe Mount

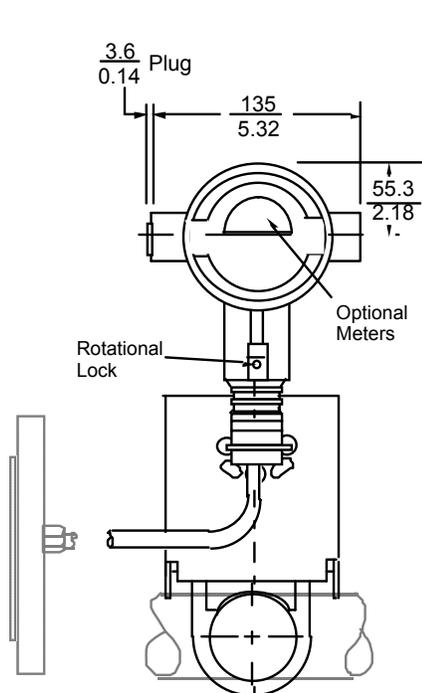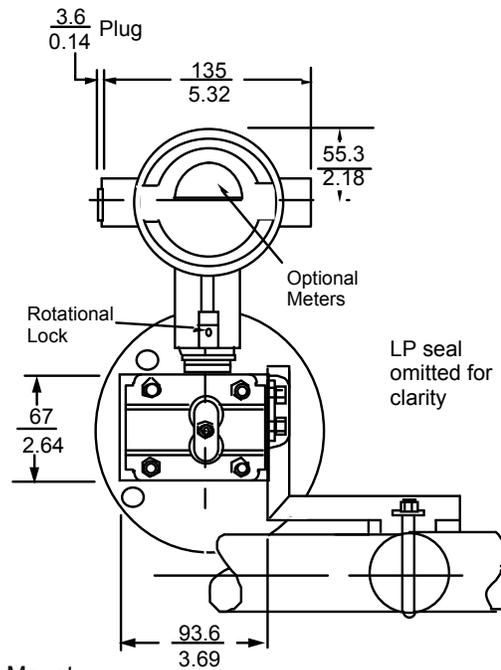

STR94G LGP/I Remote Seal with Horizontal Pipe Mount

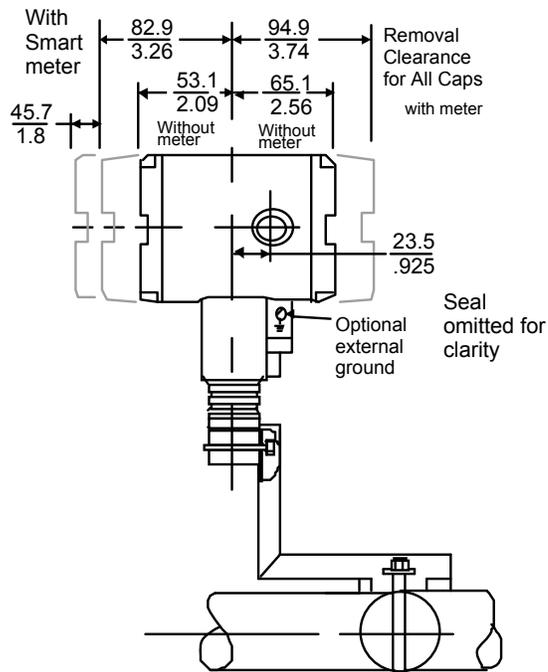



24272

Figure 19—Approximate horizontal mounting dimensions for Remote Seal Transmitter

Dimensions are for reference only and may be subject to change. For specific information contact Honeywell customer service per the contact information located with in this document.

Reference Dimensions

millimeters
inches

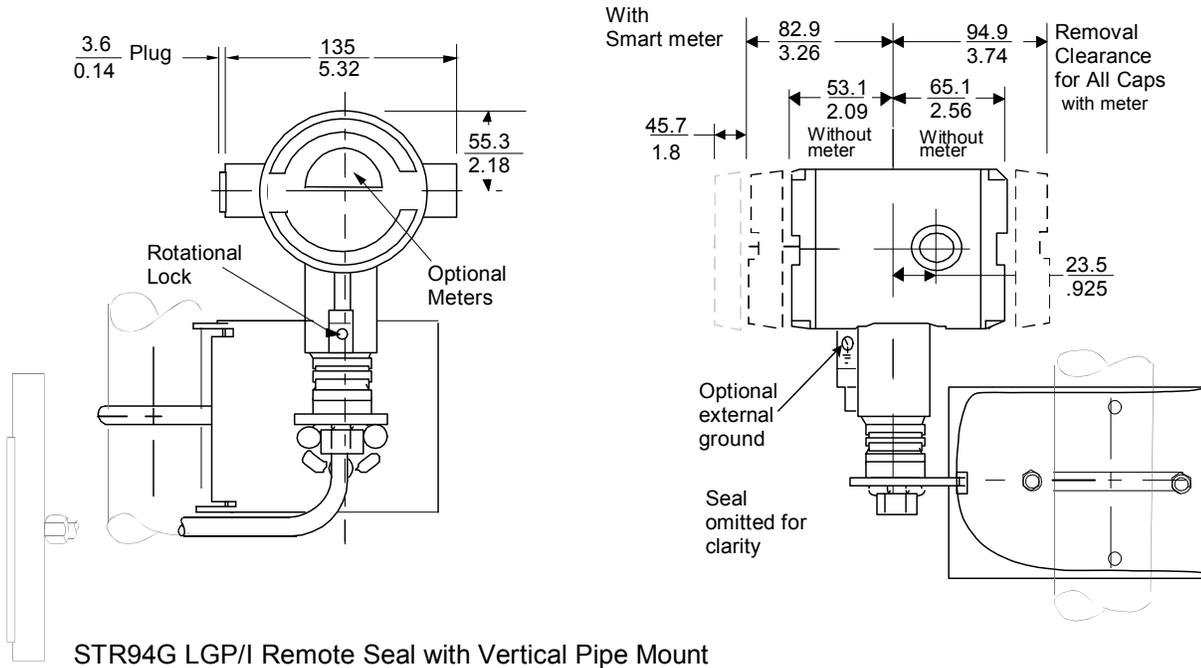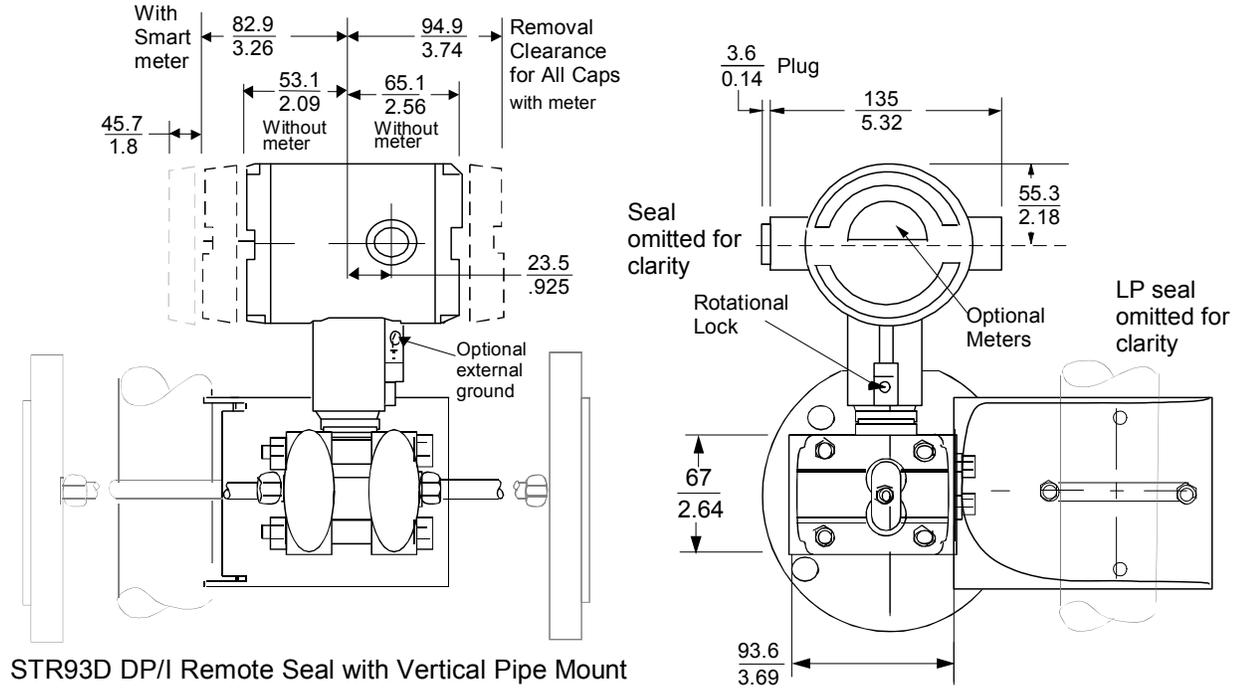

24273


Figure 20—Approximate vertical mounting dimensions for Remote Seal Transmitter

Dimensions are for reference only and may be subject to change. For specific information contact Honeywell customer service per the contact information located with in this document.

Dimensions and Drawings


Flush Flanged Seal

Type	ANSI/DIN Rating	Flange Material	Wetted Materials		Construction See figure	↔	↕	
			Diaphragm	Body		A	B	
Flush Flanged Seal	3" Class 150#	CS	SS	SS	D	7.5	1.37	
			Hastelloy C	SS	C			
			Hastelloy C	Hastelloy C	D			
			Monel	Monel	D			
				Tantalum	SS	C		
	3" Class 300#	SS	SS	SS	N/A	B	7.50	0.94
				Hastelloy C	SS	A		
				Hastelloy C	Hastelloy C	D		
				Monel	Monel	D		
				Tantalum	SS	C		1.37
	3" Class 600#	CS	SS	SS	SS	D	8.25	1.56
				Hastelloy C	SS	C		
Hastelloy C				Hastelloy C	D			
Monel				Monel	D			
			Tantalum	SS	C			
3" Class 600#	SS	SS	SS	N/A	B	8.25	1.12	
			Hastelloy C	SS	A			
			Hastelloy C	Hastelloy C	D			
			Monel	Monel	D			
			Tantalum	SS	C		1.56	
DN80-PN40	CS	SS	SS	SS	D	7.87	1.32	
			Hastelloy C	SS	C			
			Hastelloy C	Hastelloy C	D			
			Monel	Monel	D			
			Tantalum	SS	C			
DN80-PN40	SS	SS	SS	N/A	B	7.87	0.94	
			Hastelloy C	SS	A			
			Hastelloy C	Hastelloy C	D			
			Monel	Monel	D			
			Tantalum	SS	C		1.32	

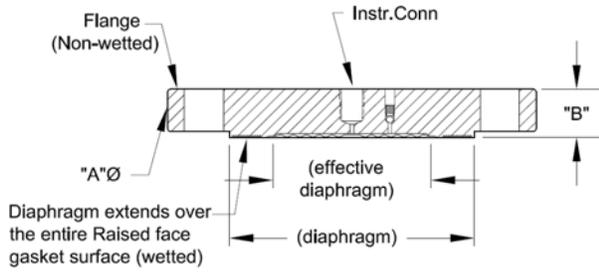


Configuration "HS"

Figure "A"

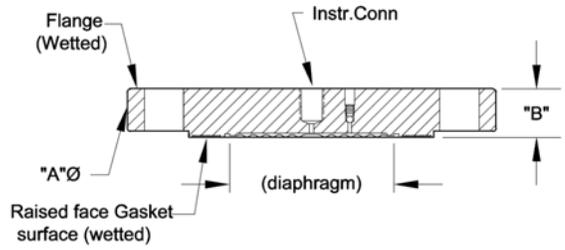


Configuration "HT"

Figure "B"

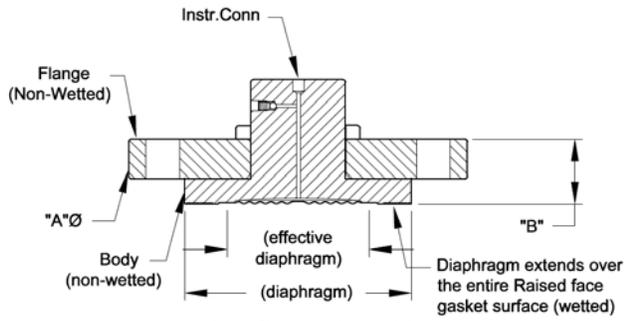

Configuration "IS"

Figure "C"

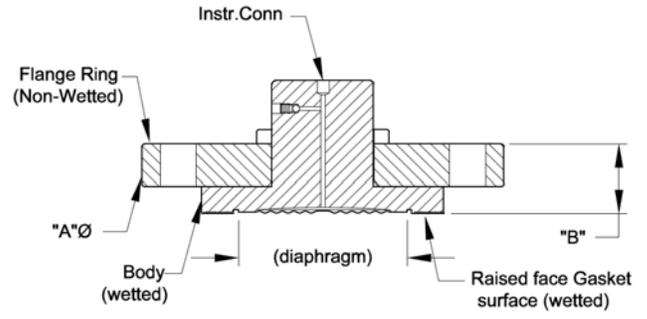

Configuration "IT"


Figure "D"

Dimensions and Drawings


Flush Flanged Seal with Lower

Type	ANSI/DIN Rating	Size	Dimension	2.4" Diaph. Dia. (in.)	2.9" Diaph. Dia. (in.)	4.1" Diaph. Dia. (in.)
Flush Flanged Seal with Lower	Class 150#	1/2"	A	3.50	4.00	5.25
			B0	1.72	1.72	1.84
			B1	1.72	1.72	1.84
			B2	2.22	2.22	2.34
		1"	B0	4.25	4.00	5.25
			B1	1.12	1.72	1.84
			B2	1.62	1.72	1.84
		1-1/2"	B0	5.00	5.00	5.25
			B1	2.50	2.50	1.78
			B2	3.00	3.00	2.12
			B2	3.50	3.40	2.12
		2"	A	6.00	6.00	6.00
			B0	2.50	2.50	2.12
			B1	3.00	3.00	2.12
			B2	3.50	3.40	2.12
	3"	A	7.50	7.50	7.50	
		B0	2.58	2.88	2.80	
		B1	2.88	2.88	3.00	
		B2	3.50	3.40	3.40	
	Class 300#	1"	A	4.88	4.00	5.25
			B0	2.50	1.72	1.88
			B1	3.00	1.72	2.12
			B2	3.50	2.22	2.12
		1-1/2"	A	6.12	6.12	5.25
B0			2.50	2.50	2.12	
B1			3.00	3.00	2.12	
B2			3.50	3.40	2.12	
2"		A	6.50	6.50	6.50	
		B0	2.50	2.50	2.70	
		B1	3.00	3.00	3.00	
		B2	3.50	3.40	3.50	
3"	A	8.25	8.25	8.25		
	B0	3.48	3.48	3.20		
	B1	3.48	3.48	3.60		
	B2	4.10	4.00	4.00		
Class 600#	1"	A	4.88	4.50	5.25	
		B0	2.50	2.15	2.26	
		B1	3.00	2.15	2.26	
		B2	3.50	2.40	2.50	
	1-1/2"	A	6.12	6.12	5.25	
		B0	2.50	1.53	2.50	
		B1	3.00	2.09	3.00	
		B2	3.50	2.49	3.50	
	2"	A	6.50	6.50	6.50	
		B0	3.10	3.10	3.30	
		B1	3.60	3.60	3.60	
		B2	4.10	4.00	4.10	
	3"	A	8.25	8.25	8.25	
		B0	3.48	3.48	3.20	
		B1	3.48	3.48	3.60	
		B2	4.10	4.00	4.00	

- B0 Without Flush
 B1 B Dimension with 1/4 NPT Flushing Connection
 B2 B dimension with 1/2 NPT Flushing Connection

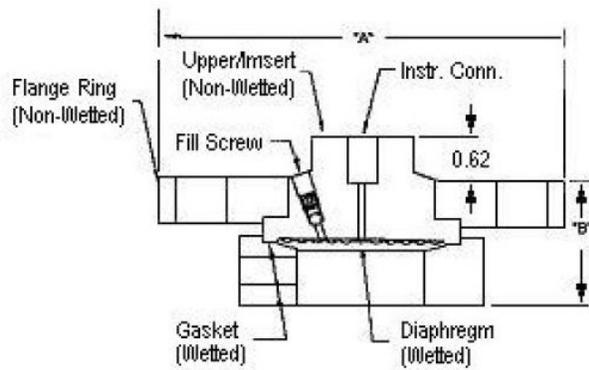

Flush Flanged Seal with Lower

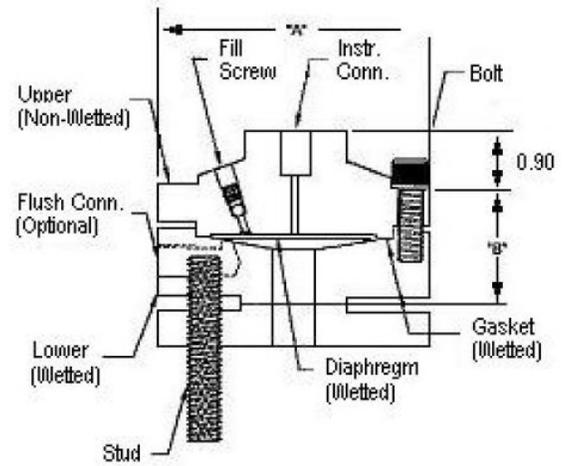

Flush Flanged Seal with Lower


Note: 0.90 dimension is 0.70 for 4.1" Dia. Diaphragm

Dimensions and Drawings

Flanged Seal with Extended Diaphragm

Type	ANSI/DIN Rating	Dimension	2.8" Diaphragm Dia. (in.)	3.5" Diaphragm Dia. (in.)
Flanged Seal with Extended Diaphragm	3" Class 150#	A	7.50	-
		B	0.94	-
		C	2.80	-
	3" Class 300#	A	8.25	-
		B	1.12	-
		C	2.80	-
	DIN DN80-PN40	A	7.87	-
		B	0.94	-
		C	2.80	-
	4" Class 150#	A	-	9.00
		B	-	0.94
		C	-	3.70
4" Class 300#	A	-	10.00	
	B	-	1.25	
	C	-	3.70	
DIN DN80-PN40	A	-	9.25	
	B	-	0.94	
	C	-	3.70	


Designed to meet with schedule 40 pipe

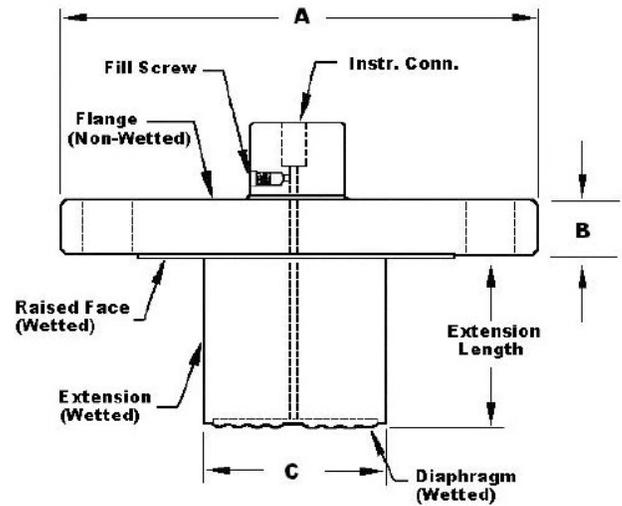

Flange Extended Seal

Pancake Seal


Type	ANSI/DIN	Dimension	3.5" Diaph. (in.)
Pancake Seal	Class 150#, 300#, 600# DN80-PN40	A	5.00
		B	1.08

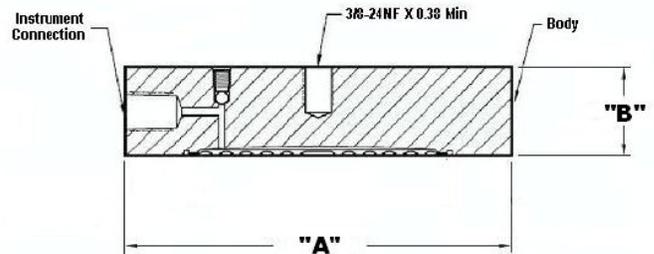

Pancake Flange Seal

Chemical Tee "Taylor Wedge" Seal

Type	Size	Dimension	3.5" Diaph. (in.)
Chemical Tee "Taylor Wedge" Seal	750 psi	A	5.00
		B	0.50

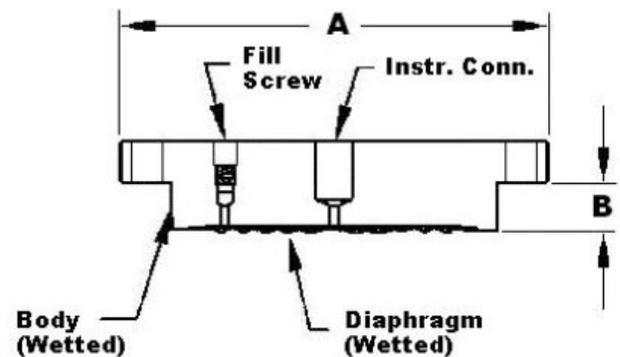


Chemical Tee "Taylor Wedge" Seal

Seal with Threaded Process Connection

Type	Size	Dimension	2.4" Diaphragm Dia. (in.)	2.9" Diaphragm Dia. (in.)	4.1" Diaphragm Dia. (in.)
Threaded Process Conn. Seal	1/4" or 1/2"	A	3.50	4.00	5.25
		B0	1.88	1.88	1.79
		B1	1.88	1.88	1.79
	3/4" or 1"	A	3.50	4.00	5.25
		B0	1.88	1.88	1.79
		B1	1.88	1.88	1.79
		B2	8.25	2.18	2.14


B0 Without Flush
 B1 B Dimension with 1/4 NPT Flushing Connection
 B2 B dimension with 1/2 NPT Flushing Connection

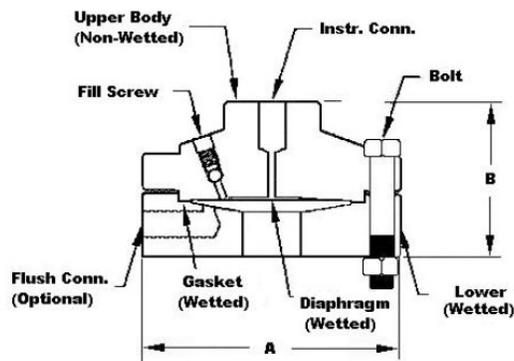

Threaded Process Connection Seal

Sanitary Seal

Type	Size	Dimension	1.9" Diaphragm Dia. (in.)	2.4" Diaphragm Dia. (in.)	2.9" Diaphragm Dia. (in.)	4.1" Diaphragm Dia. (in.)
Sanitary Seal	2"	A	2.50	-	-	-
		B	1.42	-	-	-
	2- 1/2"	A	-	3.00	-	-
		B	-	1.28	-	-
	3"	A	-	-	3.57	-
		B	-	-	1.38	-
4"	A	-	-	-	4.68	
	B	-	-	-	1.60	

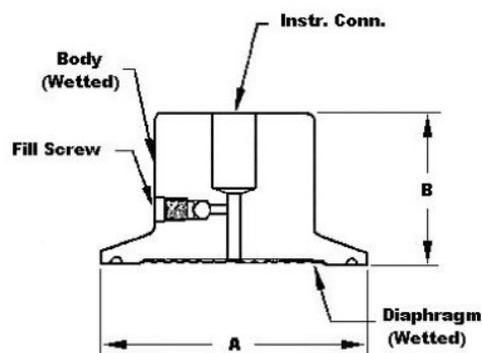


Sanitary Seal


Saddle Seal

Type	Size	Dimension	2.4" Diaph. (in.)
Saddle Seal	3"	A B	3.50 2.90
	4" or larger	A B	3.50 3.04

Note: Specify 6 or 8 bolt pattern

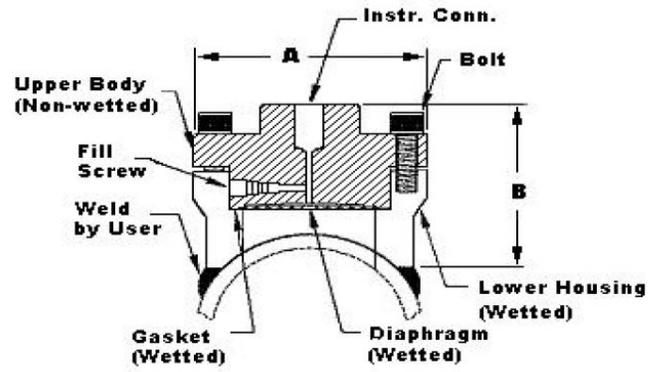


3" Saddle Seal

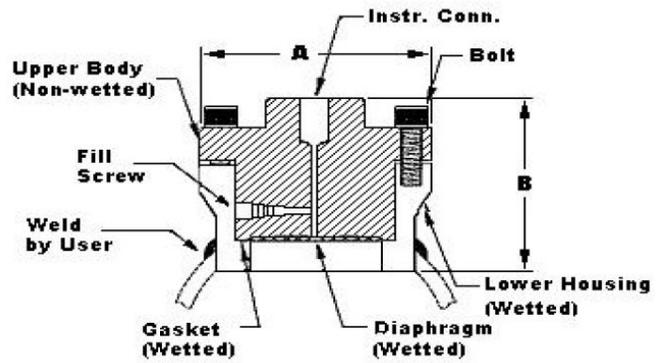

4" Saddle Seal

Calibration Rings

Type	Size	Rating	Dimension	1/4 NPT	1/2 NPT
Calibration Ring	3"	150# / 800#	A	5.00	5.00
			B	1.00	1.50
			C	3.00	3.00

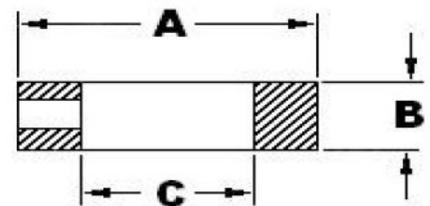

Calibration Ring

Options

- **High Accuracy (Option HA)**
Extends applicable S100 models to $\pm 0.025\%$ analog reference accuracy.
- **Angle Mounting Bracket (Options MB, MX, SB, SX, FB)**
The angle mounting bracket is available in either zinc-plated carbon steel or stainless steel and is suitable for horizontal or vertical mounting on a two inch (50 millimeter) pipe, as well as wall mounting. An optional flat mounting bracket is also available in carbon steel for two inch (50 millimeter) pipe mounting. An option also exists for Marine approved mounting brackets used with Marine certification options.
- **Indicating Meter (Options ME and SM)**
Two integral meter options are available. An analog meter (option ME) is available with a dual 0 to 10 square root and 0 to 100% linear scale. The Smart Meter (option SM) provides an LCD display for both analog and digital output and can be configured to display pressure in selected engineering units.
- **HART[®] Output Protocol (Options HC and H6)**
Optional electronic modules for the ST 3000 provide HART[®] Protocol compatibility in either HART[®] 5.x or 6.x formats. Transmitters with a HART[®] Option are compatible with any HART[®] enabled system that provides 5.x or 6.x format support.
- **Foundation[™] Fieldbus Output (Option FF)**
Equips transmitter with FF protocol for use in 31.25 kbit/s FF networks. See document 34-ST-03-72 for additional information on ST 3000 Fieldbus transmitters.
- **SIL2/SIL3 Certification (Option SL)**
This ST 3000 product is available for use with safety systems. With the SL option, we are fully certified to SIL 2 capability for single transmitters and SIL 3 capability for multiple transmitter use through TÜV Nord Sys Tec GmbH & Co. KG. We are in compliance with the following SIL standards:

 - IEC 61508-1: 1998
 - IEC 61508-2: 2000
 - IEC 61508-3: 1998
- **Lightning Protection (Option LP)**
A terminal block is available with circuitry that protects the transmitter from transient surges induced by nearby lightning strikes.
- **NAMUR NE43 Compliance (Option NE)**
This option provides software that meets the NAMUR NE43 requirements for failsafe software. Transmitter failure information is generated when the measuring information is no longer valid.

Transmitter failure values are ≤ 3.6 mA and ≥ 21.0 mA.

The normal ST 3000 ranges are ≤ 3.8 mA and ≥ 20.8 mA.
- **Write Protection (Options WP and WX)**
Provides the capability to hardwire write-protect installed transmitter configurations.
- **Stainless Steel Tagging (Option TG)**
Up to 30 characters can be added on the stainless steel nameplate mounted on the transmitter's electronics housing at no extra cost. A stainless steel wired on tag with additional data of up to 4 lines of 28 characters is also available. The number of characters for tagging includes spaces.
- **Transmitter Configuration (Options TC and FC)**
With Option TC, the factory can configure the analog, DE or HART[®] transmitter's linear/square root extraction, damping time, LRV, URV and mode (analog/digital) and enter an ID tag of up to eight characters and scratchpad information as specified.

With Option FC, the Device ID, Transmitter Tag, Unit Level Node Address, Output Mode and Damping Time Constants can be specified.
- **Custom Calibration and ID in Memory (Option CC)**
The factory can calibrate any range within the scope of the transmitter's range and enter an ID tag of up to eight characters in the transmitter's memory.
- **Indicator Configuration (Option CI)**
Provides custom configuration of Smart Meters.
- **Lifetime Warranty (Option WL)**
Extends limited 1-year warranty policy to 15 years for ST 3000 S100 pressure transmitters. See Honeywell Terms and Conditions.

Model Selection Guides are subject to change and are inserted into the specifications as guidance only. Prior to specifying or ordering a model check for the latest revision Model Selection Guides which are published at: <http://hpsweb.honeywell.com/Cultures/en-US/Products/Instrumentation/ProductModelSelectionGuides/default.htm>

Model Selection Guide



34-ST-16U-34
Issue 47
Page 1 of 11

**ST 3000 Smart Transmitter
(DP & GP) Remote Seals
Series 900**

Model Selection Guide



Instructions

- Select the desired Key Number. The arrow to the right marks the selection available.
- Make selections from each Table (I, II and IV), using the column below the proper arrow.
- Select as many Table III options as desired plus a communications option selection.
- A (*) denotes unrestricted availability. A letter denotes restricted availability.
- Restrictions follow Table IV.

Key Number	I	II	III (Optional)	IV
_____	_____	_____	_____	XXXX

KEY NUMBER

Description	Selection	Avail.
0-25" to 0-2,700" H₂O / 0-62.2 to 0-7,000 mbar Body Rating*: 750 psi (51.7 bar) Compound Characterized	STR93D	↓
0-5 to 0-500 psig / 0-0.35 to 0-35 bar Body Rating*: 500 psi (35 bar)	STR94G	↓

* Remote seal system pressure rating is body rating or seal rating, whichever is less.

Important Note: Base STR models no longer include a default communications option. All units now require the selection of a communication option from Table III (AN, DE, HC, H6 or FF).

TABLE I - METER BODY

	Description	Selection		
Number of Seals	1 Remote Seal (<i>High Side</i>)	1 __	•	•
	2 Remote Seals	2 __	•	
	1 Remote Seal (<i>Low Side</i>)	3 __	•	
	Value Added Model (<i>VAM unit</i>)	5 __	8	8
Fill Fluid (<i>Meter Body</i>)	DC [®] 200 Silicone	_ 1 _	•	•
	CTFE	_ 2 _	q	q
Construction	Non-Wetted Material			
In-Line Gauge	316 SS	__ A		•
	316 SS for Close-Couple	__ D		y
Dual Head DP	316 SS Heads	__ A	•	
	316 SS Heads for Close-Couple connection	__ D	y	
	316 SS with all-welded meter body	__ C		7

See Specification Sheet 34-ST-03-57 for figures on construction.



In-Line Gauge



Dual Head DP



All Welded

34-ST-16U-34
Issue 47
Page 2 of 11

TABLE II - SEALS

Format for Seal Selection:					Availability		
Specify 12 characters					STR9xx		
<div style="display: flex; justify-content: space-around; align-items: center;"> Common Required Seal </div>							
Note: The first 3 characters are common to all seals. When selecting required seal, you must specify only the 9 selections within the required seal.							
					Selection	3D	4G
Secondary Fill	No Fill Fluid				0	3	3
	Silicone DC [®] 200				1	•	•
	CTFE				2	•	•
	Silicone Oil 704				3	•	•
	Neobee [®] M20 ²				4	•	•
	Syltherm [®] 800 ³				5	•	•
 Connection of Remote Seal to Meter Body	No Capillary, No Nipple				0	3	3
	Capillary Length	5 feet	1.5 m	SS Armor	A	•	•
		10 feet	3.0 m		B	•	•
		15 feet	4.5 m		C	•	•
		20 feet	6.1 m		D	•	•
		25 feet	7.5 m		E	•	•
		35 feet	10.7 m		F	•	•
	Capillary Length	5 feet	1.5 m	PVC Coated SS Armor	G	•	•
		10 feet	3.0 m		H	•	•
		15 feet	4.5 m		J	•	•
		20 feet	6.1 m		K	•	•
		25 feet	7.5 m		L	•	•
35 feet		10.7 m	M		•	•	
2 inch long SS nipple close-coupled					2	z	z
No Selection					0	•	•
No Seal Attached to Core Transmitter					0000000000	3	3
 Flush Flanged Seal	Diaphragm Diameter	Flange Size	Flange Pressure Rating ¹		Selection		
	3.5"	3"	ANSI Class 150		AFA		
		80mm	ANSI Class 300		AFC		
			DIN DN80-PN40		AFM		
	Wetted Material		Diaphragm	Upper Insert	Selection		
			316L SS	316L SS	AA		
			Hastelloy [®] C-276	316L SS	AB		
			Hastelloy [®] C-276	Hastelloy [®] C-276	AC		
			Monel 400 [®]	Monel 400 [®]	AE		
			Tantalum ⁵	316L SS	AF		
	Flange Material		CS (Nickel Plated)		1		
			316L SS		2		
Seal-Capillary Connection		Center Seal		1			
		Side Seal		2			
 Calibration Rings		None		A			
		316L SS		B			
		Hastelloy [®] C-276		C			
		Monel 400 [®]		D			

Table II continued next page

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

² Limited vacuum availability.

³ Minimum static pressure requirement. No vacuum allowed. See Specifications Figure 15.

⁵ Tantalum Upper insert has Tantalum wetted parts and 316 SS or CS non-wetted parts

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE II - SEALS (continued)

		Availability			
		STR9xx			
			3D 4G		
 <p>Flush Flanged Seal</p>	Flushing Connections and Plugs ⁴ <i>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</i>	None	0	•	•
		One 1/4" with plastic plug	H	6	6
		One 1/4" with metal plug	J	6	6
		Two 1/4" with plastic plugs	M	6	6
		Two 1/4" with metal plugs	N	6	6
		One 1/2" with plastic plug	P	6	6
		One 1/2" with metal plug	Q	6	6
		Two 1/2" with plastic plugs	R	6	6
		Two 1/2" with metal plugs	S	6	6

Table II continued below

						Availability	
						STR9xx	
							3D 4G
 <p>Flush Flanged Seal with Lower</p>	2.4"	1"	ANSI 150	22	--- BCA ---	•	•
			ANSI 300	22	--- BCC ---	•	•
		1-1/2"	ANSI 150	22	--- BGA ---	•	•
			ANSI 300	22	--- BGC ---	•	•
		2"	ANSI 150	22	--- BDA ---	•	•
			ANSI 300	22	--- BDC ---	•	•
		3"	ANSI 150	22	--- BFA ---	•	•
			ANSI 300	22	--- BFC ---	•	•
	2.9"	1/2"	ANSI 150	23	--- CAA ---	•	•
			ANSI 300	23	--- CCA ---	•	•
		1-1/2"	ANSI 150	22	--- CGA ---	•	•
			ANSI 300	22	--- CGC ---	•	•
	4.1"	2"	ANSI 150	22	--- CDA ---	•	•
			ANSI 300	22	--- CDC ---	•	•
		1/2"	ANSI 150	23	--- DAA ---	•	•
			ANSI 300	23	--- DCA ---	•	•
		1-1/2"	ANSI 150	23	--- DGA ---	•	•
			ANSI 300	23	--- DGC ---	•	•
	2"	ANSI 150	23	--- DDA ---	•	•	
		ANSI 300	22	--- DDC ---	•	•	
3"	ANSI 150	22	--- DFA ---	•	•		
	ANSI 300	22	--- DFC ---	•	•		

Table II continued next page

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-34
Issue 47
Page 4 of 11

TABLE II - SEALS (continued)

					Availability	
					STR9xx	
					3D	4G
<p>Flush Flanged Seal with Lower (continued)</p>	Wetted Material	Diaphragm	Lower	Selection		
		316L SS	316L SS	----- BA -----	•	•
		Hastelloy® C-276	316L SS	----- BB -----	•	•
		Hastelloy® C-276	Hastelloy® C-276	----- BC -----	•	•
		Monel 400®	Monel 400®	----- BE -----	•	•
		Tantalum	316L SS	----- BF -----	1	1
		Tantalum	Hastelloy® C-276	----- BG -----	1	1
		Tantalum	Tantalum Clad	----- BH -----	10	10
	Non-Wetted Material (upper, upper insert)	Upper	Upper Insert	Selection		
		316L SS	316L SS	----- 4 -----	•	•
	Carbon Steel	316L SS	----- 5 -----	•	•	
	Bolts ⁶	No Selection		----- 0 -----	•	•
	Flushing Connections and Plugs ⁴	None		----- 0 -----	•	•
		One 1/4" with plastic plug		----- H -----	•	•
		One 1/4" with metal plug		----- J -----	•	•
		Two 1/4" with plastic plugs		----- M -----	•	•
		Two 1/4" with metal plugs		----- N -----	•	•
		One 1/2" with plastic plug		----- P -----	•	•
		One 1/2" with metal plug		----- Q -----	•	•
		Two 1/2" with plastic plugs		----- R -----	•	•
		Two 1/2" with metal plugs		----- S -----	•	•
	Gasket	Klinger® C-4401 (non-asbestos)		----- K -----	c	c
		Grafoil®		----- G -----	•	•
		Teflon®		----- T -----	c	c
		Gylon® 3510		----- L -----	d	d
<p>Flange Seal with Extended Diaphragm</p>	Diaphragm Diameter	Flange Size	Flange Pressure Rating ¹	Selection		
	2.8"	3" (2.8" OD extension)	ANSI Class 150	--- EFA ---	•	•
			ANSI Class 300	--- EFC ---	•	•
			DIN DN80-PN40	--- EFM ---	•	•
	3.5"	4" (3.70" OD extension)	ANSI Class 150	--- FGA ---	•	•
			ANSI Class 300	--- FGC ---	•	•
			DIN DN100-PN40	--- FGP ---	•	•
	Wetted Material	Diaphragm	Ext. Tube	Selection		
		316L SS	316L SS	----- EA -----	•	•
		Hastelloy® C-276	316L SS	----- EB -----	•	•
	Hastelloy® C-276	Hastelloy® C-276	----- EC -----	•	•	
Flange Material	CS (Nickel Plated)		----- 7 -----	•	•	
	316L SS		----- 8 -----	•	•	
Bolts	No Selection		----- 0 -----	•	•	
Extension Length	2"		----- 2 -----	•	•	
	4"		----- 4 -----	•	•	
	6"		----- 6 -----	•	•	
No Selection	No Selection		----- 0 -----	•	•	

Table II continued next page

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

⁶ Bolt material will be same as Upper Material. However, if Table III bolt/nut option is chosen, seal bolt material will be the same.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

Availability
STR9xx ↓ ↓
3D 4G

TABLE II - SEALS (continued)


	Diaphragm Diameter	Flange Size	Flange Pressure Rating Dependent on Customer Flange ¹		Selection	3D	4G	
			Diaphragm	Body				Selection
 Pancake Seal 	3.5"	3"	ANSI Class 150/300/600		___ GFA ___	•	•	
	Wetted Material			316L SS	316L SS	___ GA ___	•	•
				Hastelloy® C-276	316L SS	___ GB ___	•	•
				Hastelloy® C-276	Hastelloy® C-276	___ GC ___	•	•
				Monel 400®	Monel 400®	___ GE ___	•	•
				Tantalum	Tantalum ⁷	___ GG ___	1	1
	Non-Wetted Materials		No Selection		___ 0 ___	•	•	
	No Selection		No Selection		___ 0 ___	•	•	
	Calibration Rings		None		___ A ___	•	•	
	 Flushing Connections and Plugs ⁴ <i>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</i>		316L SS		___ B ___	5	5	
Hastelloy® C-276			___ C ___	5	5			
Monel 400®			___ D ___	5	5			
None			___ 0 ___	•	•			
Flushing Connections and Plugs ⁴ <i>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</i>		One 1/4" with plastic plug		___ H ___	6	6		
		One 1/4" with metal plug		___ J ___	6	6		
		Two 1/4" with plastic plugs		___ M ___	6	6		
		Two 1/4" with metal plugs		___ N ___	6	6		
		One 1/2" with plastic plug		___ P ___	6	6		
		One 1/2" with metal plug		___ Q ___	6	6		
Flushing Connections and Plugs ⁴ <i>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</i>		Two 1/2" with plastic plugs		___ R ___	6	6		
		Two 1/2" with metal plugs		___ S ___	6	6		

Table II continued below

Availability
STR9xx ↓ ↓
3D 4G

TABLE II - SEALS (continued)

	Diaphragm Diameter	Flange Size	Flange Pressure Rating ¹		Selection	3D	4G	
			Diaphragm	Body				Selection
 Chemical Tee "Taylor" Wedge	3.5"	Taylor Wedge 5" O.D.	750 psi		___ HM0 ___	v		
	Wetted Material			316L SS	316L SS	___ HA ___	•	
				Hastelloy® C-276	316L SS	___ HB ___	•	
				Hastelloy® C-276	Hastelloy® C-276	___ HC ___	•	
	Non-Wetted Material		No Selection		___ 0 ___	•		
	Bolts		No Selection		___ 0 ___	•		
	Styles		No Selection		___ 0 ___	•		
No Selection		No Selection		___ 0 ___	•			

Table II continued next page

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

⁷ Tantalum Body has Tantalum wetted parts and 316 SS non-wetted parts

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-34
Issue 47
Page 6 of 11

TABLE II - SEALS (continued)

	Diaphragm Diameter	Threaded Process Connection Size (NPT Female)	Seal Pressure Rating *		Selection	Availability		
			C.S. Bolts	304 SS Bolts		3D	4G	
								STR9xx
 <p>Seal with Threaded Process Connection</p>	2.4"	1/2 NPT	2,500 psi	1,250 psi	--- J J G ---	•	•	
		3/4 NPT			--- J K G ---	•	•	
		1 NPT			--- J L G ---	•	•	
	2.9"	1/2 NPT	2,500 psi	1,250 psi	--- K J G ---	•	•	
		3/4 NPT			--- K K G ---	•	•	
		1 NPT			--- K L G ---	•	•	
	4.1"	1/2 NPT	1,500 psi	750 psi	--- L J G ---	•	•	
		3/4 NPT			--- L K G ---	•	•	
		1 NPT			--- L L G ---	•	•	
	Wetted Material	Diaphragm	Lower		Selection			
		316L SS	Carbon Steel		--- J A ---	•	•	
		316L SS	316L SS		--- J B ---	•	•	
		Hastelloy® C-276	316L SS		--- J C ---	•	•	
		Hastelloy® C-276	Hastelloy® C-276		--- J D ---	•	•	
		Monel 400®	Monel 400®		--- J E ---	•	•	
		Tantalum	316L SS		--- J F ---	1	1	
		Tantalum	Hastelloy® C-276		--- J G ---	1	1	
	Non-Wetted Material (upper)	CS (Nickel Plated)			--- A ---	•	•	
		Stainless Steel			--- C ---	w	w	
	Bolts ⁸	Carbon Steel			--- C ---	1	1	
304 SS			--- D ---	•	•			
Flushing Connections and Plugs ⁴ <i>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</i>	None			--- 0 ---	•	•		
	One 1/4" with plastic plug			--- H ---	•	•		
	One 1/4" with metal plug			--- J ---	•	•		
	Two 1/4" with plastic plugs			--- M ---	•	•		
	Two 1/4" with metal plugs			--- N ---	•	•		
	One 1/2" with plastic plug			--- P ---	11	11		
	One 1/2" with metal plug			--- Q ---	11	11		
	Two 1/2" with plastic plugs			--- R ---	11	11		
Two 1/2" with metal plugs			--- S ---	11	11			
Gasket	Klinger® C-4401 (non-asbestos)			--- K ---	c	c		
	Grafoil®			--- G ---	•	•		
	Teflon®			--- T ---	c	c		
	Gylon® 3510			--- L ---	d	d		

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

⁸ If Table III Bolt/Nut option is chosen, Seal bolts will ship as same material, and MAWP may change.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE II - SEALS (continued)

						Availability		
						3D	4G	
		Diaphragm Diameter	Flange Size	Pressure Rating		Selection		
 <p>Sanitary Seal ⁹</p>	1.9"	2"	Customer clamp rating or 600 psi, whichever is less		___ MD0 ___	25	24	
	2.4"	2-1/2"			___ NE0 ___	24	24	
	2.9"	3"			___ PF0 ___	24	24	
	4.1"	4"			___ QG0 ___	24	24	
	Wetted Material		Diaphragm	Body	Selection			
			316L SS	316L SS	___ N A ___	•	•	
	Non-Wetted Material		No Selection		___ 0 ___	•	•	
Bolts		No Selection		___ 0 ___	•	•		
Styles		Tri-Clover Tri-Clamp [®]		___ 8 ___	•	•		
Gasket		No Selection		___ 0 ___	•	•		
 <p>Saddle Seal</p>	Diaphragm Diameter	Size and Bolt Pattern	Seal Pressure Rating **		Selection			
			C.S. Bolts	304 SS Bolts				
	2.4" 8-Bolt Design	for 3" Pipe ≥ 4" pipe	1,500 psi	1,500 psi	___ RFK ___	•	•	
					___ RGK ___	•	•	
	2.4" 6-Bolt Design	for 3" Pipe ≥ 4" pipe	1,250 psi	1,250 psi	___ RPK ___	•	•	
					___ RQK ___	•	•	
	Wetted Material		Diaphragm	Lower Housing	Selection			
			316L SS	Carbon Steel	___ RA ___	•	•	
			316L SS	316L SS	___ RB ___	•	•	
			Hastelloy [®] C-276	316L SS	___ RC ___	•	•	
			Hastelloy [®] C-276	Hastelloy [®] C-276	___ RD ___	•	•	
		316L SS	N/A-Body Only ¹⁰	___ SB ___	•	•		
		Hastelloy [®] C-276	N/A-Body Only ¹⁰	___ SC ___	•	•		
Non-Wetted Material		Body	Bolts ^{8, 10}	Selection				
		Carbon Steel	Carbon Steel	___ B ___	1	1		
		316L SS	304 SS	___ C ___	•	•		
No Selection		No Selection		___ 0 ___	•	•		
Styles		No Selection		___ 0 ___	•	•		
Gasket		Klinger [®] C-4401 (non-asbestos)		___ K ___	•	•		
		Grafoil [®]		___ G ___	•	•		
		Teflon [®]		___ T ___	•	•		
		Gylon [®] 3510		___ L ___	•	•		

⁸ If Table III Bolt/Nut option is chosen, Seal bolts will ship as same material, and MAWP may change.

⁹ All sanitary seals have dairy grade 3A approval.

¹⁰ Bolts are not included with "body only" selection.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-34

Issue 47

Page 8 of 11

TABLE III - OPTIONS

	STR9xx Selection	Availability			
		3D	4G		
Communication Options (Must choose a communications option)					
Analog only (can be configured using appropriate Honeywell DE tool)	AN	•	•	b	
DE Protocol communications	DE	•	•		
HART® 5.x Protocol compatible electronics	HC	•	•		
HART® 6.x Protocol compatible electronics	H6	•	•		
FOUNDATION™ Fieldbus Communications	FF	r	r		
Indicating Meter Options					
Analog Meter (0-100 Even 0-10 Square Root)	ME	•	•	b	
Smart Meter	SM	•	•		
Custom Configuration of Smart Meter	CI	m	m		
Local Zero	LZ	x	x		
Local Zero and Span	ZS	s	s		
Transmitter Housing & Electronics Options					
No housing conduit plugs or adaptors come standard with the ST 3000. For certain approval codes, you must select a certified conduit plug from below and it will come packaged in the box with your transmitter.					
316 SS ⁵ Electronics Housing - (with M20 Conduit Connections)	SH	n	n	b	
316 SS ⁵ Electronics Housing - (with M20 to 1/2 NPT 316 SS Conduit Adapter for use with FM and CSA Approval codes)	A3	i	i		
1/2 NPT Male to M20 Female 316 SS Certified Conduit Adapter (ATEX, CSA & IECEx)	A1	•	•		
1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter (ATEX, CSA & IECEx)	A2	•	•		
M20 Male to 1/2 NPT Female 316 SS Certified Conduit Adaptor (ATEX, CSA & IECEx)	A4	•	•		
1/2 NPT Zinc-plated Certified Conduit Plug (ATEX, CSA & IECEx)	A5	•	•		
1/2 NPT 316 SS Certified Conduit Plug (ATEX, CSA & IECEx)	A6	•	•		
M20 316 SS Certified Conduit Plug (ATEX, CSA & IECEx)	A7	•	•		
1/2 NPT Non-certified Conduit plug (Zinc-plated carbon steel, general use)	A8	•	•		
NAMUR Failsafe Software	NE	15	15		
SIL 2 - TÜV Certified transmitter (requires HC or H6 and WP options)	SL	14	14		
Lightning Protection	LP	•	•	b	
Custom Calibration and I.D. in Memory	CC	•	•		
Transmitter Configuration - (non-Fieldbus)	TC	15	15		
Transmitter Configuration - (Fieldbus)	FC	21	21		
Write Protection (Delivered in the "enabled" position)	WP	•	•		
Write Protection (Delivered in the "disabled" position)	WX	•	•		
Stainless Steel Customer Wired-On Tag (4 lines, 26 characters per line, customer supplied information)	TG	•	•		
Stainless Steel Customer Wired-On Tag (blank)	TB	•	•		
Meter Body Options (Carbon Steel standard)					
A286 SS (NACE) Bolts and 304 SS (NACE) Nuts for Heads	CR	•	•		b
316 SS Bolts and 316 SS Nuts for Process Heads	SS	•	•		
B7M Bolts and Nuts for Process Heads	B7	•	•		
Remote Seal Options					
Gold Plated Seal Diaphragm (1 Seal)	G1	j	j	b	
Gold Plated Seal Diaphragm (2 Seals)	G2	j	j		
Teflon Coated Seal Diaphragm (1 Seal) - only for anti-sticking	N1	j	j		
Teflon Coated Seal Diaphragms (2 Seals) - only for anti-sticking	N2	j	j		
Transmitter Mounting Bracket Options					
Angle Mounting Bracket - Carbon Steel	MB	•	•	b	
Marine Approved Angle Mounting Bracket - Carbon Steel	MX	•	•		
Angle Mounting Bracket - 304 SS	SB	•	•		
Marine Approved Angle Mounting Bracket - 304 SS	SX	•	•		
Flat Mounting Bracket - Carbon Steel	FB	•	•		
Services/Certificates Options					
Users Manual Paper Copy (Standard, HC/H6 or FF ships accordingly)	UM	•	•	b	
Clean Transmitter & Seals for Oxygen or Chlorine Service with Certificate	0X	h	h		
Over-Pressure Leak Test with Certificate (F3392)	TP	•	•		
Calibration Test Report and Certificate of Conformance (F3399)	F1	•	•		
Certificate of Conformance (F3391)	F3	•	•		
Certificate of Origin (F0195)	F5	•	•		
SIL Certificate (SIL 2/3) (FC33337)	FE	22	22		
NACE Certificate (Process-Wetted & Non-Process Wetted) (FC33339)	F7	o	•		
NACE Certificate for welded meter bodies only (F0198)	F8	16	•		
NACE Certificate (Process-Wetted) (FC33338)	FG	•	•		
Material Traceability Certification per EN 10204 3.1 (FC33341)	FX	•	•		
Marine Type Approvals (DNV, ABS, BV, KR & LR)	MT	2	2		

Table III continued next page

⁵ Supplied as 316 SS or as Grade CF8M, the casting equivalent of 316 SS.


TABLE III - OPTIONS (continued)			STR9xx Selection	3D	4G
Warranty Options					
Additional Warranty - 1 year			W1	•	•
Additional Warranty - 2 years			W2	•	•
Additional Warranty - 3 years			W3	•	•
Additional Warranty - 4 years			W4	•	•
Approval Body	Approval Type	Location or Classification	Selection	3D	4G
No hazardous location approvals			9X	•	•
FM Approvals SM	Explosion Proof	Class I, Div. 1, Groups A,B,C,D	1C	•	•
	Dust-Ignitionproof	Class II, III Div. 1, Groups E,F,G			
	Non-Incendive	Class I, Div. 2, Groups A,B,C,D			
	Intrinsically Safe	Class I, II, III, Div. 1, Groups A,B,C,D,E,F,G			
ATEX ¹⁰ (LCIE)	Intrinsically Safe, Zone 0	 Ex ia IIC T4 (Ta = -50°C to +93°C); T5 (Ta = -50°C to +85°C); T6 (Ta = -50°C to +70°C) Enclosure IP 66/67	3S	•	•
	Intrinsically Safe, Zone 1	 Ex ia IIC T4 (Ta = -50°C to +93°C); T5 (Ta = -50°C to +85°C); T6 (Ta = -50°C to +70°C) Enclosure IP 66/67			
	Dust-tight Enclosure, Zone 0	 Ex td A20 IP6X T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C) Enclosure IP 66/67	33	26	26
	Flameproof and Dust-tight Enclosure, Zone 1	 Ex d IIC T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C) Supply 11- 42Vdc Ex td A21 IP6X T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C) Enclosure IP 66/67			
	Non-Sparking, Zone 2	 Ex nA, IIC T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C); Zone 2 Supply < 42Vdc, 23mA Ex td A22 IP6X T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C) (Honeywell). Enclosure IP 66/67			
	Multiple Marking ¹¹ Int. Safe, Zone 0/1 and Dust-tight Enclosure, or Flameproof, Zone 1 and and Dust-tight Enclosure, or Non-Sparking, Zone 2	 Ex ia IIC T4 (Ta = -50°C to +93°C); T5 (Ta = -50°C to +85°C); T6 (Ta = -50°C to +70°C); Ui = 30V; li = 100mA Ex td A20 IP6X T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C)	3C	26	26
 Ex d IIC T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C) Supply 11- 42Vdc Ex td A21 IP6X T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C)					
 Ex nA, IIC T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C); Zone 2 Supply < 42Vdc, 23mA Ex td A22 IP6X T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C) (Honeywell) Enclosure IP 66/67					

Table III Approvals continued next page

STR9xx

TABLE III - Approvals Options (continued)				3D	4G
Approval Body	Approval Type	Location or Classification	Selection		
Canadian Standards Association (CSA)	Explosion Proof	Class I, Div. 1, Groups B,C,D	2J	26	26
	Dust-Ignitionproof	Class II, III, Div. 1, Groups E,F,G			
	Intrinsically Safe	Class I, II, III, Div. 1, Groups A,B,C,D,E,F,G			
IECEX	Flameproof, Zone 1	Ex d IIC; T5 (Ta = -40 to +93°C), T6 (Ta = -40 to +78°C)	CA	26	26
	Intrinsically Safe, Zone 0/1	Ex ia IIC; T3, T4, T5, T6 See Spec for detailed temperature codes by Communications option			
SAEx (South Africa)	Intrinsically Safe, Zone 0/1	Ex ia IIC T4, T5, T6	Z2	•	•
	Flameproof, Zone 1	Ex d IIC T5, T6 Enclosure IP 66/67	ZD	•	•
	Multiple Marking ¹¹ Int. Safe, Zone 0/1, or Flameproof, Zone 1	Ex ia IIC T4, T5, T6 Ex d IIC T5, T6 Enclosure IP 66/67	ZA	•	•
CERTUSP INMETRO (Brazil)	Flameproof, Zone 1	BR- Ex d IIC T5, T6	6D	•	•
	Intrinsically Safe, Zone 0/1	BR- Ex ia IIC; T4, T5, T6 (See CERTUSP certificate for detailed temperature codes by Communications option)	6S	•	•

¹⁰ See ATEX installation requirements in the ST 3000 User's Manual

¹¹ The user must determine the type of protection required for installation of the equipment. The user shall then check the box [V] adjacent to the type of protection used on the equipment certification nameplate. Once a type of protection has been checked on the nameplate, subsequently the equipment shall not be reinstalled using any of the other certification types.

TABLE IV	Selection		
Factory Identification	X X X X	•	•

RESTRICTIONS

Restriction Letter	Available Only With		Not Available With	
	Table	Selection	Table	Selection
b		Select only one option from this group		
c			II	----- BF ----- ----- BG ----- ----- BH ----- ----- JF ----- ----- JG -----
d	II	----- BF ----- ----- BG ----- ----- JF ----- ----- JG -----		
h	I, II	_ 2 _ - 2		
i	III	1C or 2J		
j			II	----- AF ----- ----- BF ----- ----- BG ----- ----- BH ----- ----- GG ----- ----- JF ----- ----- JG -----
m	III	SM		
n			III	1C, 2J
o	III	CR		
q	II	0 ----- 2 ----- 4 -----		
r	III	FISCO/FNICO compliance available only with 1C	III	TC, ME or FISCO/FNICO compliance not available with 3C, 3N, 33, 3S, 2J, CA, Z2, ZD, ZA, 6D & 6S
s			III	FF, ME
v	I	2 __		
w			II	----- JA -----
x	III	FF, SM		

Restrictions continued next page

RESTRICTIONS - (continued)

Restriction Letter	Available Only With		Not Available With	
	Table	Selection	Table	Selection
y			I	2
			III	MB, SB, FB
	II	2		
z	I	__ D		
1			III	F7
2	III	MX, SX	III	FB, MB, SB
3	I	5 __		
5			II	_____ 0
6			II	_____ A _
7			I	1 __, 3 __
			III	CR
8			III	CC, G1, G2, N1, N2, 0X, TP, MT, F1, TC, FC
9	II	_____ AA2 _____		
		_____ AB2 _____		
10	II	_____ 0 _	II	_____ T
			III	F7
11			II	_____ JJG _____
				_____ JKG _____
				_____ JLG _____
				_____ CAA _____
				_____ CCA _____
				_____ CCC _____
14	III	HC or H6 and WP	III	FF
15			III	FF
16	I	__ C		
21	III	FF		
22	III	SL		
24	III		I & II	2 _ _ - 2 _ _ _ _ _
25	II	_ A _ _ _ _ _ _ _ _ ,		
		_ G _ _ _ _ _ _ _ _ ,		
		_ 2 _ _ _ _ _ _ _ _		
26	III	This approval code requires the selection of a certified conduit plug: A5, A6 or A7		

FM ApprovalsSM is a service mark of FM Global
 Hastelloy[®] is a registered trademark of Haynes International
 Monel 400[®] is a registered trademark of Special Metals Corporation.
 HART[®] is a registered trademark of HART Communication Foundation.
 FOUNDATIONTM Fieldbus is a registered trademark of Fieldbus Foundation.
 Teflon[®] is a registered trademark of DuPont.
 Neobee[®] is a registered trademark of Stepan Company.
 Syltherm[®] 800 is a Trademark of Dow Corning Corporation
 Klingsil[®] C-4401 is a registered trademark of THERMOSEAL, INC
 GRAFOIL[®] is a registered trademarks of GrafTech International Holdings Inc
 Gylon[®] 3510 is registered trademark of Garlock Sealing Technologies
 Tri-Clover Tri-Clamp[®] is a registered trademark of Alfa-Laval
 DC[®] 200 and DC[®] 704 are registered trademarks of Dow Corning

Sales and Service

For application assistance, current specifications, pricing, or name of the nearest Authorized Distributor, contact one of the offices below.

ASIA PACIFIC

(TAC) hfs-tac-support@honeywell.com

Australia

Honeywell Limited
Phone: +(61) 7-3846 1255
FAX: +(61) 7-3840 6481
Toll Free 1300-36-39-36
Toll Free Fax:
1300-36-04-70

China – PRC - Shanghai

Honeywell China Inc.
Phone: (86-21) 5257-4568
Fax: (86-21) 6237-2826

Singapore

Honeywell Pte Ltd.
Phone: +(65) 6580 3278
Fax: +(65) 6445-3033

South Korea

Honeywell Korea Co Ltd
Phone: +(822) 799 6114
Fax: +(822) 792 9015

EMEA

Phone: + 80012026455 or +44 (0)1202645583

FAX: +44 (0) 1344 655554

Email: (Sales) sc-cp-apps-salespa62@honeywell.com or

(TAC) hfs-tac-support@honeywell.com

NORTH AMERICA

Honeywell Process Solutions,
Phone: 1-800-423-9883
Or 1-800-343-0228

Email: (Sales) ask-ssc@honeywell.com or
(TAC) hfs-tac-support@honeywell.com

SOUTH AMERICA

Honeywell do Brazil & Cia
Phone: +(55-11) 7266-1900
FAX: +(55-11) 7266-1905

Email: (Sales) ask-ssc@honeywell.com or
(TAC) hfs-tac-support@honeywell.com

Specifications are subject to change without notice.

For More Information

Learn more about how Honeywell's ST 3000 Series 900 Remote Seal Transmitters can increase performance, reduce downtime and decrease configuration costs, visit our website www.honeywellprocess.com/ or contact your Honeywell account manager.



Honeywell Process Solutions

1860 West Rose Garden Lane
Phoenix, Arizona 85027
1-800-423-9883 or 1-800-343-0228
www.honeywellprocess.com/

34-ST-03-57
March 2013
© 2013 Honeywell International Inc.