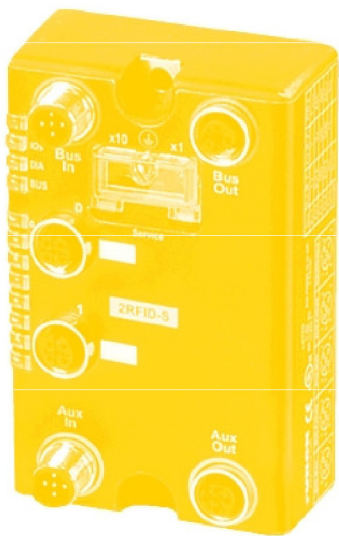


# TURCK

## Industrielle Automation

### User Manual

BLCDP-6M12LT-2RFID-S-8XSG-PD



***Sense it! Connect it! Bus it! Solve it!***

: 2010-6-18

All brand and product names are trademarks or registered trade marks of the owner concerned.

© Hans Turck GmbH, Mülheim an der Ruhr All rights reserved, including those of the translation. No part of this manual may be reproduced in any form or processed, duplicated or distributed by means of electronic systems without written permission of Hans Turck GmbH & Co. KG, Mülheim an der Ruhr. Subject to alterations without notice.

<b>1</b>	<b>General safety notes</b> .....	<b>4</b>
1.1	Before the installation .....	4
<b>2</b>	<b>General information</b> .....	<b>5</b>
2.1	Description of symbols Used.....	5
2.2	Prescribed Use.....	5
2.3	Notes Concerning Planning /Installation of this Product.....	5
<b>3</b>	<b>Introduction</b> .....	<b>6</b>
3.1	BL compact – High signal variety in a compact design.....	6
<b>4</b>	<b>Technical data</b> .....	<b>7</b>
<b>5</b>	<b>Fieldbus and I/O connections</b> .....	<b>9</b>
5.1	Pinning and wiring diagram.....	9
<b>6</b>	<b>Commissioning</b> .....	<b>10</b>
6.1	Address setting.....	10
6.2	Setting the transmission rate.....	10
6.3	Field bus termination.....	10
6.4	Service interface.....	11
6.5	PLC configuration.....	11
<b>7</b>	<b>The I/O-ASSISTANT</b> .....	<b>12</b>
7.1	FDT/DTM.....	12
<b>8</b>	<b>LED description</b> .....	<b>13</b>
8.1	Station LED status.....	13
8.2	I/O LED status slot 1.....	13
8.3	I/O LED status slot 2.....	13
<b>9</b>	<b>Mapping and diagnostics</b> .....	<b>14</b>
9.1	I/O Data mapping.....	14
9.2	RFID-S - Diagnostic messages DPV1.....	15
9.3	8XSG - Diagnostic messages DPV1.....	15
<b>10</b>	<b>Parameters</b> .....	<b>16</b>
10.1	PROFIBUS-DP Parameter.....	16
10.2	RFID-S - Parameters.....	17
10.3	8XSG - Parameters.....	17

## 1 General safety notes

### 1.1 Before the installation

- Disconnect the power supply of the device.
- Ensure that devices cannot be accidentally restarted.
- Verify isolation from the supply
- Earth and short circuit.
- Cover or enclose neighboring units that are live.
- Follow the engineering instructions of the device concerned.
- Only suitably qualified personnel in accordance with EN 50 110-1/-2 (VDE 0 105 Part 100) may work on this device/system.
- Before installation and before touching the device ensure that you are free of electrostatic charge.
- The functional earth (FE) must be connected to the protective earth (PE) or to the potential equalization. The system installer is responsible for implementing this connection.
- Connecting cables and signal lines should be installed so that inductive or capacitive interference do not impair the automation functions.
- Install automation devices and related operating elements in such a way that they are well protected against unintentional operation.
- Suitable safety hardware and software measures should be implemented for the I/O interface so that a line or wire breakage on the signal side does not result in undefined states in the automation devices.
- Ensure a reliable electrical isolation of the low voltage for the 24 volt supply. Only use power supply units complying with IEC 60 364-4-41 (VDE 0 100 Part 410) or HD 384.4.41 S2.
- Deviations of the mains voltage from the rated value must not exceed the tolerance limits given in the specifications, otherwise this may cause malfunction and dangerous operation.
- Emergency stop devices complying with IEC/EN 60 204-1 must be effective in all operating modes of the automation devices. Unlatching the emergency-stop devices must not cause restart.
- Devices that are designed for mounting in housings or control cabinets must only be operated and controlled after they have been installed with the housing closed. Desktop or portable units must only be operated and controlled in enclosed housings.
- Measures should be taken to ensure the proper restart of programs interrupted after a voltage dip or failure. This should not cause dangerous operating states even for a short time. If necessary, emergency stop devices should be implemented.
- Wherever faults in the automation system may cause damage to persons or property, external measures must be implemented to ensure a safe operating state in the event of a fault or malfunction (for example, by means of separate limit switches, mechanical interlocks etc.).
- The electrical installation must be carried out in accordance with the relevant regulations (e. g. with regard to cable cross sections, fuses, PE).
- All work relating to transport, installation, commissioning and maintenance must only be carried out by qualified personnel. (IEC 60 364 and HD 384 and national work safety regulations).
- All shrouds and doors must be kept closed during operation.

## 2 General information

This manual includes all information necessary for the prescribed product. It has been specially conceived for personnel with the necessary qualifications.



### ATTENTION

Please read this section carefully. Safety aspects cannot be left to chance when dealing with electrical equipment.

### 2.1 Description of symbols Used



### WARNING

This sign can be found next to all notes that indicate a source of hazards. This can refer to danger to personnel or damage to the system (hardware and software) and to the facility. This sign means for the operator: work with extreme caution.



### ATTENTION

This sign can be found next to all notes that indicate a potential hazard. This can refer to possible danger to personnel and damages to the system (hardware and software) and to the facility.



### NOTE

This sign can be found next to all general notes that supply important information about one or more operating steps. These specific notes are intended to make operation easier and avoid unnecessary work due to incorrect operation.

### 2.2 Prescribed Use

Appropriate transport, storage, deployment and mounting as well as careful operating and thorough maintenance guarantee the trouble-free and safe operation of these devices.



### WARNING

The devices described in this manual must be used only in applications prescribed in this manual or in the respective technical descriptions, and only with certified components and devices from third party manufacturers.

### 2.3 Notes Concerning Planning /Installation of this Product



### WARNING

All respective safety measures and accident protection guidelines must be considered carefully and without exception.

**BLCDP-6M12LT-2RFID-S-8XSG-PD**

### 3 Introduction

#### 3.1 BL compact – High signal variety in a compact design

For the first time, BL compact provides a product family of IP67 fieldbus devices that can meet any requirement in the I/O level in terms of signal type and connectivity. Until now, compact fieldbus stations were applied to process only digital fieldbus signals. BL compact now allows a wide range of I/O tasks to be implemented outside of the control cabinet in a compact design with virtually any signal combination.

##### The basic concept

With the modular concept of the BL67 system by TURCK a fieldbus node can be installed outside the control cabinet using any signal combination. For this purpose, passive base and active electronic modules are connected to fieldbus gateways which fulfill application specific I/O tasks. Such a fieldbus node can take one gateway with up to 32 extension modules (max. 512 I/O points). For applications with low signal density and limited mounting space, BL compact is an efficient alternative because basically all BL67 I/O signals are also available in BL compact.

##### The modular principle

The BL compact devices provide three basic functions in a single housing: Fieldbus connection, I/O signal and connector. Depending on the housing style, one or two I/O modules can be housed. The smaller versions (e.g. M12S and M12MT) can link any BL67 electronic module each to PROFIBUS-DP or DeviceNet™. The bigger versions (e.g. M12LT) have space for two BL67 electronic modules, making the possibilities of signal combination nearly infinite.



#### NOTE

The I/O-system BL compact does not require mounting in an extra housing. It was specially designed for the harsh industrial environment and for direct mounting on the machine and in the process. The system is extremely robust and protected against dirt, dust and the most liquids through its high degree of protection. However, it is not suited for the following applications: high pressure jet cleaning, 100 % humidity, out-door installation or permanent operation in liquids.

**BLCDP-6M12LT-2RFID-S-8XSG-PD****4 Technical data**

<b>Type</b>	BLCDP-6M12LT-2RFID-S-8XSG-PD
Ident-No.	6811179
<hr/>	
<b>Supply voltage</b>	24 VDC
Admissible range	18...30 VDC
System power supply	via separate source
Voltage supply connection	2 x M12, 5-pin
Operating current	750 mA
Power loss, typical	≤ 1 W
Nominal voltage $V_i$	24 VDC
Nominal voltage $V_o$	24 VDC
Max. sensor supply $I_{sens}$	4 A
Max. load current $I_o$	4 A
<hr/>	
<b>Fieldbus transmission rate</b>	9.6 kbps up to 12 Mbps
Adjustment transmission rate	auto detection
Fieldbus addressing range	0...99
Fieldbus addressing	2 decimally coded rotary switches
Service interface	RS232 interface
Fieldbus connection technology	2 x M12, 5-pin, reverse keyed
Fieldbus termination	external
<hr/>	
<b>Digital inputs</b>	
Input type	pnp
Type of input diagnostics	channel diagnostics
Sensor supply	24 VDC, 100 mA short-circuit limiting
Low level signal voltage	< 4.5 VDC
High level signal voltage	7...30 VDC
Active level (IC) signal current	< 1.5 mA
Signal voltage inactive level	2.1 ... 3.7 mA
Input delay	0.25 or 2.5 ms
<hr/>	
<b>Digital outputs</b>	
Output type	pnp
Type of output diagnostics	channel diagnostics
Output current per channel	0.5 A
Output voltage	24 VDC
Output delay	3 ms
Load type	resistive, inductive, lamp load
Load resistance, resistive	> 48 Ω
Load resistance, inductive	< 1.2 H
Lamp load	< 3 W
Switching frequency, resistive	< 200 Hz
Inductive switching frequency	< 2 Hz
Switching frequency, lamp load	< 20 Hz
Short-circuit protection	yes
<hr/>	
<b>Technology</b>	
Signal type	Simple RFID Interface
Number of channels	2
Sensor supply	0.5 A per channel, short-circuit proof
Simultaneity factor	1
Cable length	50 m
Electrical isolation	isolation of electronics and field level via optocouplers

#### 4 Technical data

---

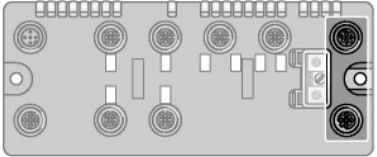

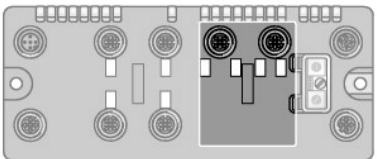







<b>Operating temperature</b>	-40...+70 °C
Storage temperature	-40...+85 °C
- up to 20 g (at 10 to 150 Hz)	For mounting on base plate or machinery
Protection class	IP67
housing material	Glass-filled nylon, nickel plated brass connectors



**BLCDP-6M12LT-2RFID-S-8XSG-PD**

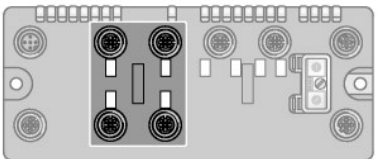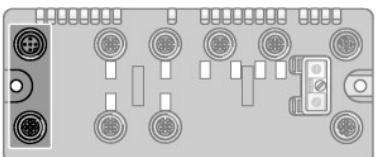**5 Fieldbus and I/O connections**


**5.1 Pinning and wiring diagram**

	<p><b>Fieldbus accessories</b> PROFIBUS-DP fieldbus cable (example): RSSW RKSU 455-2M Ident-nr. U0350</p>	<p><b>Pin configuration</b></p> 
	<p><b>slot 1: RFID</b> Matching connection cable (for example): RK4.5T-5-RS4.5T/S2500 Ident no. 6699201</p>	<p><b>Connector .../S2500</b></p>  <p><b>Connector .../S2501</b></p> 
	<p><b>slot 2: Digital XSG channels</b></p> <p>Note: Each digital channel (pin 2 and pin 4) can be configured as input or output.</p>	<p><b>Pin configuration</b></p>  <p><b>Wiring diagram</b></p> 
	<p><b>Voltage supply</b></p>	<p><b>Pin configuration</b></p> 

## 6 Commissioning
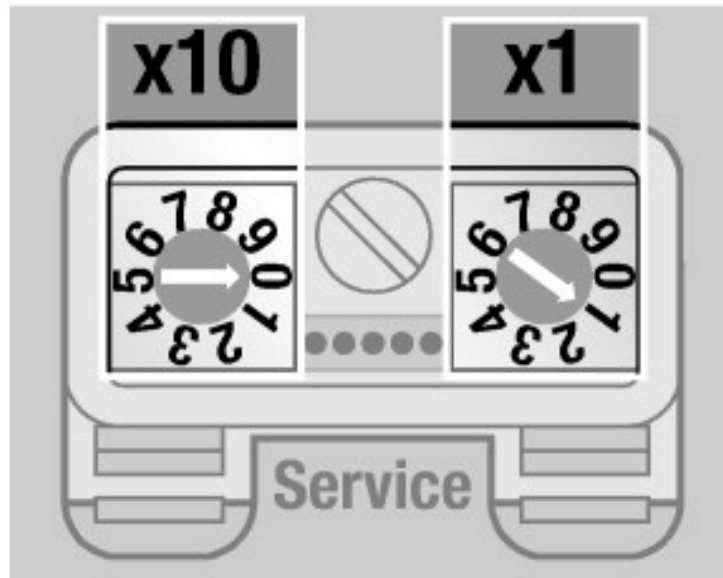
### 6.1 Address setting

The PROFIBUS-DP address setting at the module is done via the two decimal rotary coding switches under the protective cover. A maximum of 100 addresses (00 to 99) can be allocated. Each address may be allocated only once in the entire bus structure. The bus address 00 must not be allocated.



### 6.2 Setting the transmission rate

The module provides automatic transmission rate detection.

All new settings become valid only after a power-cycle!

### 6.3 Field bus termination

If the module is used as the first or the last station in the bus communication, the field-bus line has to be terminated using a terminating resistor.

The module offers no internal bus terminating resistor. The termination has to be done externally.

Passive terminating resistor,  
RSS4.5-PDP-TR, Ident-no.: 66001590

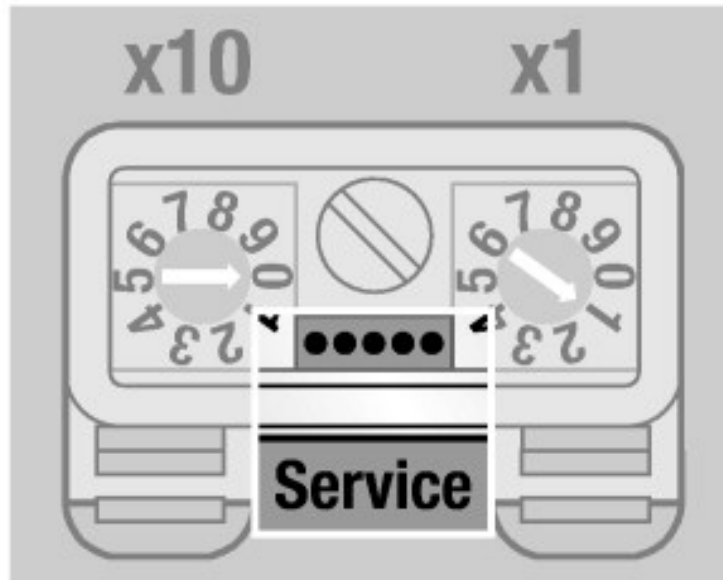
Active terminating resistor,  
PDP-TRA, Ident-no.: 6825346

**BLCDP-6M12LT-2RFID-S-8XSG-PD**

**6 Commissioning**

**6.4 Service interface**

In order to connect the service interface on the module with a PC and the I/O-ASSISTANT software (project planning and diagnostics software), a cable with a pin assignment, different from the PS2 standard pin assignment, has to be used.




**6.5 PLC configuration**

TURCK provides a GSD-file for the integration of BL compact into PROFIBUS-DP.

**Commissioning in a configuration tool**

Install the GSD-file in the PLC configuration tool eg. in "Step 7/ HWConfig" from Siemens. After the installation, the BL compact stations can be found under "Additional Field Devices #> I/O #> TURCK #> BL COMPACT". BL compact modules are shown as modular slaves with a PROFIBUS-DP-gateway and a maximum of 2 I/O-slots which have to be defined according to the module used in the application.

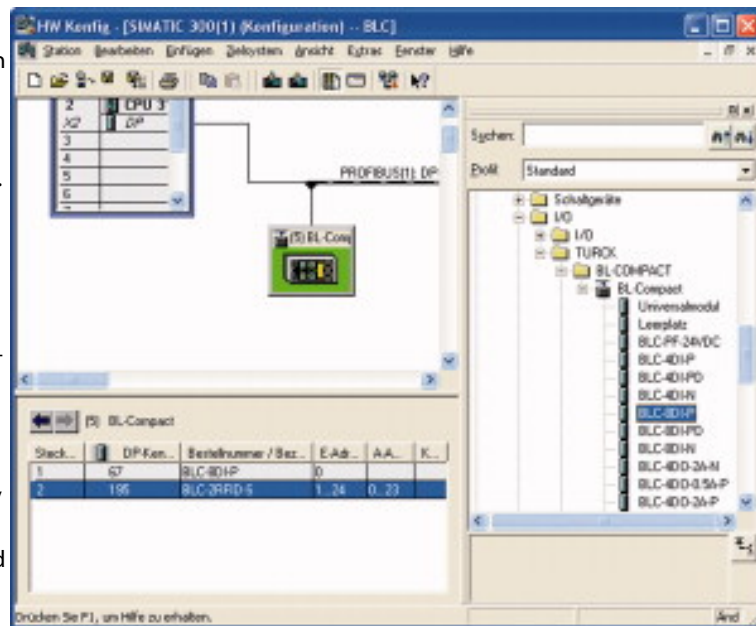Doubleclick the BL compact folder and add an "empty" BLCDP-module to the PROFIBUS-DP line. Now select the required I/O-functions and add them to the station. The BL compact GSD-file can be downloaded from [www.turck.com](http://www.turck.com).



**NOTE**

For more detailed information about the PLC-configuration of TURCK PROFIBUS-DP-products, please read for example the respective BL67 manual D300570.pdf which can be downloaded from [www.turck.com](http://www.turck.com).

## 7 The I/O-ASSISTANT

The configuration software I/O-ASSISTANT supports you in planning and implementation of an I/O system.

No matter if you are online or offline, the software simplifies the configuration and parameterization of the modules. The I/O-ASSISTANT is also extremely helpful in system set-up and testing.

### 7.1 FDT/DTM

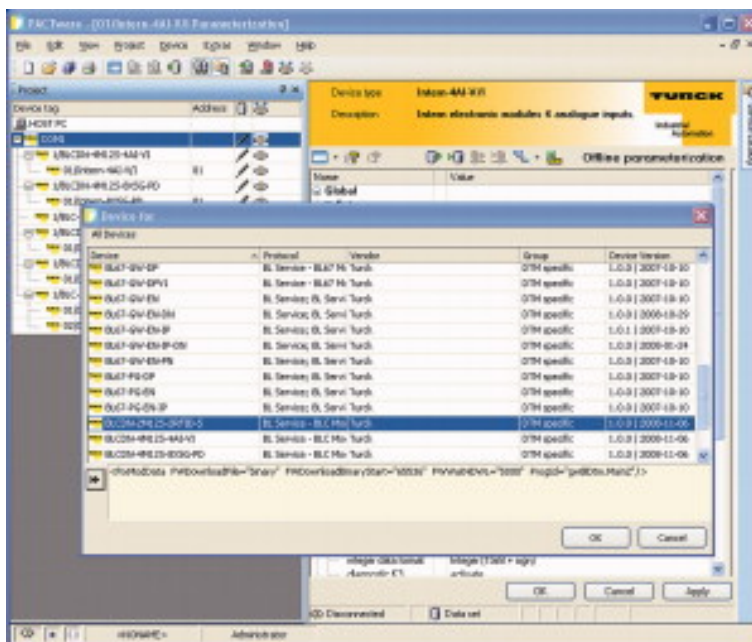
The system configuration, parameterization and diagnostics are done via graphical interfaces based on FDT/DTM technology.

The DTM's can be integrated in any FDT frame application for configuration, commissioning and maintenance.

The I/O-ASSISTANT and the DTM's are available free of charge on [www.turck.com](http://www.turck.com).

#### Software functions

- Supporting software tool
- Configuration, parameterization and commissioning of BL Compact modules via a DTM-technology
- Import of BL Compact DTM-files
- Offline planning and configuration of BL67, BL20 and BL compact I/O modules
- Reading and setting of process data
- Commissioning help for testing the wiring and sensors without PLC
- Automatic documentation of configured TURCK-systems



## 8 LED description

### 8.1 Station LED status

LED	Color	Status	Description
IOs		OFF	No power
	RED	ON	Low power or station error
	RED	FLASHING (1 Hz)	I/O module configuration error
	RED	FLASHING (4 Hz)	No I/O module bus communication
	GREEN	ON	Station ok
	GREEN	FLASHING	Force mode active
DIA		OFF	Station sends no diagnostics
	RED	ON	Station sends static diagnostics
	RED	FLASHING	Station sends extended diagnostics
BUS		OFF	No field bus communication
	GREEN	ON	Field bus communication active
	GREEN	FLASHING (1 Hz)	No field bus communication active, device status OK
	RED	ON	Bus error at the gateway; no data exchange
	RED	FLASHING	Faulty PROFIBUS-DP address

### 8.2 I/O LED status slot 1

LED	Color	Status	Description
D1 *		OFF	No diagnostics active
	RED	ON	Station error/ module bus communication failure
	RED	FLASHING (0.5Hz)	Any diagnostics active
RW0 / RW1		OFF	No tag present, no diagnostics active
	GREEN	ON	Tag present
	GREEN	FLASHING (2 Hz)	Data communication from / to tag active
	RED	ON	Error in the R/W head
	RED	FLASHING (2 Hz)	Short circuit in the transceiver supply

\* D1 LED also reports gateway diagnostics

### 8.3 I/O LED status slot 2

LED	Color	Status	Description
D2 *		OFF	No diagnostics active
	RED	ON	Station error/ module bus communication failure
	RED	FLASHING (0.5Hz)	Any diagnostics active
XSG channels 0...7		OFF	Channel status x = "0" (OFF), no diagnostics active
	GREEN	ON	Channel status x = "1" (ON)
	RED	ON	Short-circuit at output
	RED	FLASHING (2 Hz)	Short-circuit sensor supply

\* D2 LED also reports gateway diagnostics

**BLCDP-6M12LT-2RFID-S-8XSG-PD**

**9 Mapping and diagnostics**

**9.1 I/O Data mapping**

INPUT	BYTE	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
RFID channel 0	0	DONE	BUSY	ERROR	XCVR CON	XCVR ON	TP	TFR	Reserved
	1	Error Code							
	2	Error Code 1							
	3	Reserved							
	4	READ DATA (8 Byte)							
	5								
	...								
	10								
11									
RFID channel 1	12	DONE	BUSY	ERROR	XCVR CON	XCVR ON	TP	TFR	Reserved
	13	Error Code							
	14	Error Code 1							
	15	Reserved							
	16	READ DATA (8 Byte)							
	17								
	...								
	22								
23									
XSG	24	DI 2 <sub>7</sub>	DI 2 <sub>6</sub>	DI 2 <sub>5</sub>	DI 2 <sub>4</sub>	DI 2 <sub>3</sub>	DI 2 <sub>2</sub>	DI 2 <sub>1</sub>	DI 2 <sub>0</sub>
	25	-	-	-	-	-	-	-	-

OUTPUT	BYTE	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0	
RFID channel 0	0	XCVR	NEXT	TAG ID	READ	WRITE	TAG INFO	XCVR INFO	RESET	
	1	Reserved						Byte Count 2	Byte Count 1	Byte Count 0
	2	Address high byte								
	3	Address low byte								
	4	WRITE DATA (8 Byte)								
	5									
	...									
	10									
11										
RFID channel 1	12	XCVR	NEXT	TAG ID	READ	WRITE	TAG INFO	XCVR INFO	RESET	
	13	Reserved						Byte Count 2	Byte Count 1	Byte Count 0
	14	Address high byte								
	15	Address low byte								
	16	WRITE DATA (8 Byte)								
	17									
	...									
	22									
23										
XSG	24	DO 2 <sub>7</sub>	DO 2 <sub>6</sub>	DO 2 <sub>5</sub>	DO 2 <sub>4</sub>	DO 2 <sub>3</sub>	DO 2 <sub>2</sub>	DO 2 <sub>1</sub>	DO 2 <sub>0</sub>	
	25	-	-	-	-	-	-	-	-	

**BLCDP-6M12LT-2RFID-S-8XSG-PD****9 Mapping and diagnostics****9.2 RFID-S - Diagnostic messages DPV1**

<b>Error code no.</b>	<b>Meaning</b>
2	undervoltage
4	overload
21	hardware failure The module detected a hardware failure. Exchange the module.
22	Communication failure The module detected a communication problem at its ports. Check the connection or the function of the attached devices.

**9.3 8XSG - Diagnostic messages DPV1**

<b>Error code no.</b>	<b>Meaning</b>
4	overload
26	sensor supply load dump The module detected a load dump at the sensor supply.

## 10 Parameters

### 10.1 PROFIBUS-DP Parameter

Parameter	Description
startup when expected/actual config. differ	<p>0 = activated *) Reaction depending on the parameter „Bit 6: Static configuration“. If the static configuration is deactivated, the process data exchange is not disturbed in case of module sequence error.</p> <p>1 = deactivated Reaction depending on the parameter „Bit 6: Static configuration“. If the static configuration is activated, the process data exchange is not disturbed in case of module sequence error.</p>
static configuration	<p>0 = activate *) Changes in the station configuration are stored in the gateway following a power-on.</p> <p>1 = deactivate If the static configuration is deactivated, a dynamic configuration take-over is realized directly following station configuration changes (important for acyclic parameterization). The station stops the process data exchange and the bus communication as soon as a module sequence error appears, ignoring the parameterization for error handling. But, the communication is not interrupted, if the gateway-parameter byte 1, bit 0 "startup.</p>
outputs fieldbus error	<p>0 = output 0 *) The gateway switches the outputs of the modules to "0". No error information is transmitted.</p> <p>1 = output substitute value The gateway switches the outputs of all modules (with the exception of analog output modules) to "0". Error information is transmitted to the analog output modules. Depending on their configuration, these modules set their outputs either to "0" or to a default value, or maintain the original values. The non-configured analog output modules set their outputs to "0".</p> <p>2 = hold current value The gateway maintains the actual output settings of all modules (with the exception of analog output modules). Error information is transmitted to the analog output modules. Depending on their configuration, these modules set their outputs either to "0" or to a default value, or maintain the original values. The non-configured analog output modules maintain their current output settings.</p>
outputs mod. sequence error	<p>0 to 2, see above "outputs fieldbus error" 3 = Exchange process data The gateway carries on exchanging process data with the other module bus stations. No error information is transmitted.</p>
outputs mod. sequence error	0 to 3, see above "outputs mod. sequence error"
integer data format	<p>0 = LSB first *) Data is converted to INTEL format (standard format).</p> <p>1 = MSB first 16-bit data are transmitted with the high and low bytes reversed (MOTOROLA format). This parameter influences the process data!</p>
diagnostics from modules	<p>0 = activate *) Diagnostic messages from the module bus stations are made known to the fieldbus master as extended diagnostics.</p> <p>1 = deactivate Diagnostic messages from the module bus stations will not be displayed. A station diagnostic is not automatically generated along with module diagnostics.</p>



## BLCDP-6M12LT-2RFID-S-8XSG-PD

### 10 Parameters

Parameter	Description
Vo diagnostics	0 = activate *) The monitoring function for the field supply Vo (from gateway and power feeding modules) is activated. If this parameter is set but the parameter "Diagnostics from modules" (see above) deactivated, then only the voltage supply at the gateway is monitored. A monitoring of the voltage supply at the power feeding module is not realized. 1 = deactivate A possible over- or undervoltage at UL will not be detected.
I/O-ASSISTANT Force Mode	0 = release *) I/O-ASSISTANT can set the force mode. 1 = block I/O-ASSISTANT cannot set the force mode, if the station was parameterized by the DP master.

\*) = default setting

#### 10.2 RFID-S - Parameters

Parameter	Description
Bypass time channel 1	Bypass time of the transceiver in steps of 4 milliseconds:
Bypass time channel 2	Values from 0*) to 255 # 0 ms to 1020 ms Please maintain the default setting "= 0" of this parameter if the system startup is done without the error message "Dwell time of the Tag in the detection area was not long enough for successful command processing.". Check if the application makes it possible to set the recommended minimum distances, to reduce the speed or the transferred data amount. The information about the recommended and the maximum distances can be found in the Installation manual D101583.pdf for the RFID-system in the chapter "operating data". If you are not able to respect the required distances or if the error is still sent due to external influences even if these distances are respected, this parameter has to be set to an adequate value.

\*) default setting

#### 10.3 8XSG - Parameters

Parameter	Description
Invert input	0 = normal *) 1 = inverted
Output at overcurrent x	0 = automatic recovery *) 1 = controlled recovery
Output x	0 = active *) 1 = inactive
Input filter (2,5 ms)	0 = active *) 1 = inactive

\*) default setting