



Liquid to Liquid
Thermal Shock Chamber
TSB - 21 • TSB - 51



Key technology for ensuring reliability Supports the current trend toward higher stress.

High accuracy is increasingly demanded in the pursuit of reliability in the field of electronics.

“ Liquid-to-liquid ”type thermal shock testing is now attracting attention for its ability to impose higher thermal stress on specimens than “ air-to-air ”type testing, and to deliver test results quickly.

ESPEC has successfully developed next-generation liquid-to-liquid thermal shock chambers that satisfy the demand for environmental conservation and lower running costs from brine and power consumption, which have traditionally been regarded as stumbling blocks with liquid-to-liquid thermal shock chambers.

ESPEC takes great pride in offering this cutting-edge chamber as a key technology in ensuring higher reliability.

TSB - 51



- **A number of mechanisms for drastically reducing brine consumption**

To reduce brine consumption, the airtightness of the test area has been enhanced to prevent vapor leakage and brine evaporation. Numerous mechanisms have also been adopted, including a water separation filter for removing brine from water for the purpose of brine recycling. As a result, these new chamber models have reduced brine consumption by approximately 65% compared to the preceding model (TSB-5).

- **Both single-liquid and double-liquid brine applicable**

Either single-liquid brine or double-liquid brine can be selected simply by switching the valve.

- **Two models available to suit the specimen size and weight**

Two different models are available: TSB-21 can hold specimens weighing up to 1.0 kg, while TSB-51 can hold specimens weighing up to 2.0 kg. Capable of handling a wide variety of electronic parts, from ICs to printed circuit boards.

- **Smooth transfer of specimens realized**

An air cylinder system that suppresses vibration of the specimens and a new specimen loading system that prevents unnecessary stress to the specimens during transfers between the hot bath and the cold bath.


- **Recorder terminals as the standard device**

Thermal shock chamber has one piece of the recorder terminal that outputs the temperature of the specimens.* Additionally, the thermal shock chamber has a specimen power supply control terminal and a time signal.

*Up to 5 pieces of the recorder terminals can be added as an option.




Test Area

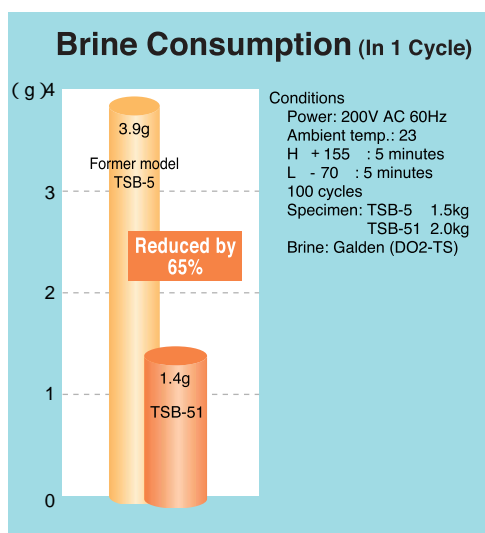

The external alarm terminal is optional.

Comparison of power consumption

Conditions : 20 cycles
 H: + 155 5 min.
 L: - 70 5 min.
 Specimen : TSB-51 2.0 kg
 TSB-5 1.5 kg

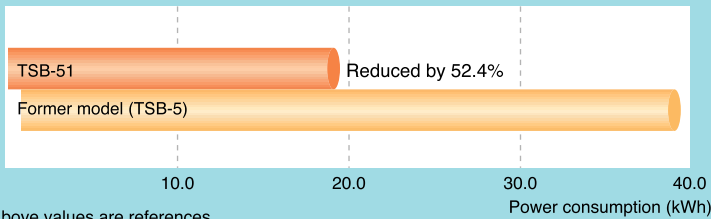


*Above values are references.



Paperless recorder (optional)

ERC - 200M

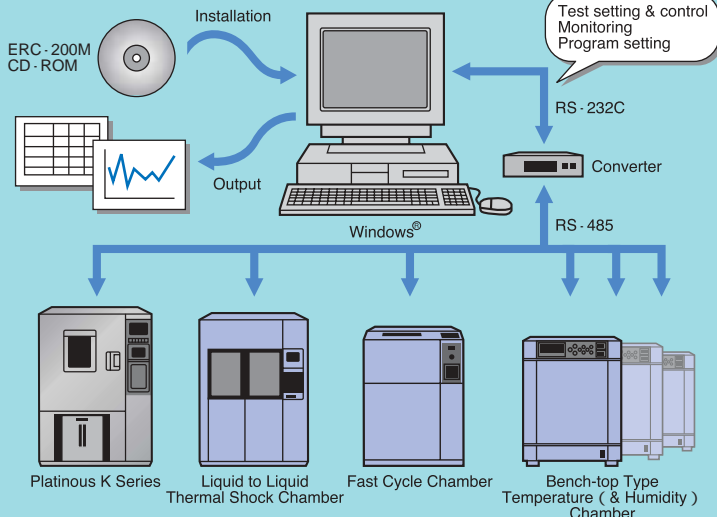

Energy savings achieved

Dramatic energy savings have been achieved through the adoption of a new refrigeration circuit, with power consumption slashed by as much as 52% (compared to former ESPEC models).

Installation environment improved through reduced operation noise

The operation noise level of the chamber has been reduced to as low as 61 dB (A-characteristic) by providing sound-proofing panels for the noise-emitting machine compartment, including the refrigerator.

HFC refrigerant used to protect the global environment

HFC refrigerant that causes no damage to the ozone layer is used for the refrigerator, and thus complies with the measures for ozone-layer protection specified by the Montreal Protocol.

Paperless recording (optional)

The paperless recorder makes it easy record the temperatures of different components, such as the chamber temperature, on a memory card (Compact Flash).

Communication network of environmental test chambers

The liquid to liquid thermal shock chamber incorporates the communication port RS-485 as standard to cope with the [E-PILOT 21], which is a newly developed centralized control system. [E-PILOT 21] not only serves as a system for centralized control of environmental chambers, but also establishes an open network including specimen measurement function and remote chamber maintenance function.

Control operation

Visibility and ease of use improved through interactive input using a touch-screen system and color LCD screen

● Uses a color LCD interactive touch-panel system employed throughout the Thermal Shock Chamber Series

A color LCD panel design allows settings to be made simply by touching the screen in accordance with the display. The test pattern, test area temperature, number of temperature cycles, trend-graph display, etc., are all displayed on the screen.

Setting system	Interactive input system using a touch panel
Display	Color TFT LCD panel (6.5 inch)
Temperature-control	<ul style="list-style-type: none"> • Test area exposure temperature • Hot bath preheating temperature • Cold bath precooling temperature • Liquid temperature recovery for hot bath • Liquid temperature recovery for cold bath
Temperature-setting range	High-temperature side: + 60 to + 200 Low-temperature side : - 75 to 0
Setting resolution	1
Input	Thermocouple T (JIS C 1602)
Control system	PID control
Time-setting range	1 sec. to 99 min. 59 sec.
Cycle-setting range	1 to 9999 cycles
Programs	RAM mode: Max. 40 patterns (writable) ROM mode: 10 standard test patterns (registered)
Auxiliary functions	<ul style="list-style-type: none"> • Timer preset • Test continuity selection • Overheat/overcool protection • Stable time control • Power-saving operation • Power-failure/ recovery operation selection • Liquid temperature recovery • Recycling operation • Automatic preheating/ precooling setting • Time signal • Program memory • Automatic power shutoff • Programmed time display • Test starting point selection • Test halt preset • Test completion mode selection • Trend graph • Alarm history display • Sensor calibration • RS-485 communication



■ Detailed test monitoring ■ Selection of operating modes



■ Test pattern editing

■ Error description



SPECIFICATIONS

Model			TSB-21		TSB-51	
System			Two-liquid bath system with specimen basket transfer			
Brine			Single-liquid or double-liquid fluorine deactivated brine			
Utility requirement	Power supply (within ±10% of the rated voltage)		200V AC, 3 , 3W, 50/60Hz			
	Maximum load current		25A		43A	
	Operating temperature		0 to + 40 (+ 32 to + 104°F)			
	Air-source pneumatic pressure		0.4 to 0.7MPa (4 to 7kgf/ cm ²)			
	Air-source piping connection size		8mm			
	Required air-flow quantity		15L/ min. (ANR) 3.6L/ cycle (ANR)			
	Performance *1	Hot bath	Temp. range	+ 70 to + 200 (+ 158 to + 392°F)		
Temp. fluctuation *2			± 2 (±3.6°F)			
Temp. heat-up rate *3			Ambient temp. to +150 (+ 302°F): within 90 min.			
Temp. pull-down rate *3			+ 150 to + 60 (+ 302 to + 140°F) Within 60 min.		+ 150 to + 60 (+ 302 to + 140°F) Within 100 min.	
Cold bath		Temp. range	- 65 to 0 (- 85 to + 32°F)			
		Temp. fluctuation *2	± 2 (±3.6°F)			
		Temp. heat-up rate *3	- 65 to 0 (- 85 to + 32°F) Within 60 min.		- 65 to 0 (- 85 to + 32°F) Within 65 min.	
		Temp. pull-down rate *3	Ambient temp. to - 65 (- 85°F) Within 120 min.		Ambient temp. to - 65 (- 85°F) Within 90 min.	
Test performance	Hot bath	Liquid temp.	+ 150 ⁺¹⁰ ₀ (+ 302 ⁺¹⁸ ₀ °F) (Galden DO2-TS)			
	Cold bath	Liquid temp.	- 65 ⁰ ₁₀ (- 85 ⁰ ₁₈ °F) (Galden DO2-TS)			
	Exposure time		High and low temperatures 5 min. each			
	Number of cycles		15 cycles			
	Specimen		Plastic molded ICs 1.0kg		Plastic molded ICs 2.0kg	
Specimen transfer time			Within 10 sec. (Time of transfer between hot and cold baths)			
Noise level *4			65 dB or less			
Construction	Exterior material		Painted steel			
	Internal tank		Stainless steel plate (18-8 Cr-Ni)			
	Insulation		Glass wool, foamed polyurethane			
	Heater		Sheathed heater			
	Cooler		Cooling-pipe coil			
	Agitator		2 units (one each for the hot and cold baths)			
	Refrigerator unit		Refrigeration system: Mechanical cascade refrigeration system (Air-cooled condenser)			
	Compressor		Rotary compressor			
	Refrigerant		R508A, R404A			
	Specimen transfer unit		Pneumatic drive system for horizontal and vertical transfer			
	Brine recycling circuit		System: Condensed recovery through refrigerator cooling Refrigerator: Cold bath cooling refrigerator			
	Condensation circuit		System: Condensation by refrigerator Refrigerator: Cold bath cooling refrigerator			
	Miscellaneous		Liquid-level indicator, chamber lamp, specimen transfer-area door, adjuster, specimen power-supply control terminal, time signal, integrating hour meter			
Outside dimensions (W × H × Dmm) *5			1140 × 1785 × 1240 (44.9 × 70.3 × 48.8in)		1200 × 1785 × 1320 (47.2 × 70.3 × 52in)	
Inside bath dimensions (W × H × D mm)			260 × 350 × 440 (10.2 × 13.8 × 17.3in) (Approx. 40L)		290 × 350 × 520 (11.4 × 13.7 × 20.4in) (Approx. 55L)	
Test area internal capacity (L)			Approx. 2.1		Approx. 4.5	
Specimen basket dimensions (W × H × D mm)			120 × 150 × 120 (4.7 × 5.9 × 4.7in)		150 × 150 × 200 (5.9 × 5.9 × 7.8in)	
Specimen basket load capacity (kg) (evenly distributed load)			1.0		2.0	
Chamber (overall) weight (kg) *6			Approx. 650		Approx. 790	

*1 Performance at an ambient temperature of +23

*2 Performance indications conforming to JTM K01-1998

*3 Performance when each bath is operated individually

*4 Value measured in an anechoic room at 1m from the chamber front and at a height of 1.2 m above the floor (A-characteristic: Compliant with JIS-Z-8731)

*5 Protrusions from the machine sides excluded. Leveller height not included.

*6 Weight of the liquid not included

TEST STANDARDS (satisfied by all models in the TSB Series)

Test Standard	Test Condition	Exposure Temperature			Exposure Time		Temperature Recovery Time	Number of Test Cycles	Test Starting Point
		High Temp.	Ambient Temp.	Low Temp.	High/ Low Temp.	Ambient Temp.			
MIL-STD-883E (Method No. 1011.9)	A	+ 100 + 10 - 2	—	0 + 2 - 10	Over 2 min., up to 5 min.	—	Temperature of the specimen under worst-case conditions, recovered within 5 min.	Min. 15 cycles	Low temp. or high temp.
	B	+ 125 + 10 0	—	- 55 0 - 10		—			
	C	+ 150 + 10 0	—	- 65 0 - 10		—			
MIL-STD-202G (Method No. 107G)	A	+ 100 + 10 - 2	—	0 + 2 - 10	Varies by specimen weight Less than 1.4 g: 0.5 min. 1.4 g to 14 g: 2 min. Over 14 g to 140 g: 5 min.	—	—	5 cycles 15 cycles 25 cycles	Low temp.
	B	+ 125 + 10 0	—	- 65 0 - 10		—			
	C	+ 150 + 10 0	—			—			
JIS C 0025	—	+ 100	—	0	5 min. to 20 min.	—	—	10 cycles unless otherwise specified	Low temp.

SAFETY DEVICES

Leakage breaker
 Circuit breaker for wiring
 Motor reverse prevention relay
 Compressor thermal relay
 Compressor temperature switch
 Electric parts compartment door switch
 Specimen transfer area door switch
 Recycling circuit fan temperature switch
 Refrigerator high-pressure switch
 Hot bath agitator temperature switch
 Cold bath agitator temperature switch
 Air-pressure switch
 Hot bath boil-dry protector
 Cold bath boil-dry protector
 Overheat protector for hot bath
 Overcool protector for cold bath
 Overheat/ overcool protector for the hot bath
 (built into the controller)
 Overheat/ overcool protector for the cold bath
 (built into the controller)
 Drive unit transfer time (built into the controller)
 Test area overheat/overcool protector
 (built into the controller)
 Specimen power supply control terminal
 Fuse
 Low-liquid-level alarm
 Locking mechanism for specimen transfer area door

ACCESSORIES

Specimen basket
 (18-8 Cr-Ni stainless steel 5-mesh wire net)1
 Specimen basket cover 1 set
 Fuse (in glass tube, 5 A)1
 Brine drainage hose Inner dia. : 12 mm2
 Inner dia. : 8 mm 1
 Liquid funnel1
 Liquid-charging pipe (with a rubber cap) 1
 Shutter-opening hardware1
 Water absorption mat 1
 User's manual 1 copy



DANGER

Do not use specimens that are explosive or inflammable, or that contain such substances. Doing so may lead to fire or explosion.

Do not use as specimens substances or creatures that may emit inflammable or corrosive gases, or substances that may exceed permissible heating values.



CAUTION

Correctly clean the brine in use. Use of the incorrect liquid will significantly reduce the service life of the chamber and may produce noxious decomposition products. Before using a brine, consult with the brine manufacturer.

Be sure to read the instruction manual before operations.

OPTIONS

Paperless recorder

Records temperature of each section such as the temperature inside the chamber.

Number of inputs:

PL1S: 1 (5 more channels can be turned ON)

Data saving cycle: 1 sec

PL3S: 3 (3 more channels can be turned ON)

Data saving cycle: 1 sec

PL3L: 3 (3 more channels can be turned ON)

Data saving cycle: 5 sec

Temperature range: - 100 to + 220

External recording media :

CF memory card (32 MB)

Language support: ENG, JPN



Temperature recorder (Digital display)

- 100 to + 220 / 100 mm

RK-61: 1-pen

RK-63: 3-pens

RK-64: 6-dots



For future installation of a recorder

If the user elects to prepare a custom temperature recorder or plans to add one at a later date, the necessary power cable, temperature sensor, and ground-ing wire are available as options.

Thermocouple

Used to measure specimen temperature, etc.

- T JIS C 1602 with ball attached

Temperature recorder terminal

Terminal for specimen temperature output.

- Five terminals
(six in total, incl. one for standard supply)

External alarm terminal

If the safety device of the chamber activates, the external alarm terminal will relay the alarm to distant place.



Emergency stop switch

Stops the chamber immediately.

Built-in air compressor

Equipped when there is no air supply source.

Specimen basket

Equivalent to standard accessory.

- Material Stainless steel (5-mesh)

Caster

Installed for mobility.

- Free wheels: 4

Fixture for securing the body

Used to bolt the chamber to the floor.

Power cord

For connection to the primary power source.

- 5, 10m

Communication function

Connected to a PC directly to control the chamber (standard equipment: RS-485).

- E-BUS
- GPIB
- RS-232C

Communication cables

- RS-485 5, 10m
- E-BUS 5, 10m
- GPIB 2, 4m
- RS-232C 1.5, 3, 5m

ESPEC CORP. <http://www.espec.co.jp/english>

Head Office

3-5-6, Tenjinbashi, Kita-ku, Osaka 530-8550, Japan
Tel: 81-6-6358-4741 Fax: 81-6-6358-5500

ESPEC NORTH AMERICA, INC.

Tel: 1-616-896-6100 Fax: 1-616-896-6150

ESPEC EVALUATION & TEST SYSTEMS, INC.

Tel: 1-408-592-4059 Fax: 1-408-778-4353

ESPEC EUROPE GmbH

Tel: 49-89-18939630 Fax: 49-89-189396379

ESPEC ENVIRONMENTAL EQUIPMENT (SHANGHAI) CO., LTD.

Head Office

Tel: 86-21-51036677 Fax: 86-21-63372237

BEIJING Rep. Office

Tel: 86-10-64627025 Fax: 86-10-64627036

GUANGZHOU Rep. Office

Tel: 86-20-83317826 Fax: 86-20-83317825

SHENZHEN Rep. Office

Tel: 86-755-83674422 Fax: 86-755-83674228

SUZHOU Rep. Office

Tel: 86-512-68664007 Fax: 86-512-68601994

WUXI Rep. Office

Tel: 86-510-82735036 Fax: 86-510-82735039

ESPEC TEST TECHNOLOGY (SHANGHAI) CO., LTD.

Tel: 86-21-68798008 Fax: 86-21-68798088

ESPEC (MALAYSIA) SDN. BHD.

Tel: 60-3-89451377 Fax: 60-3-89451287

Specifications are subject to change without notice due to design improvements.

Windows® is a trademark or registered trademark of Microsoft Corporation in the U.S.A. and other countries. Other corporate names and trade names mentioned in this catalog are trademarks or registered trademarks.

Printed on recycled paper.