

CAUTION

This manual is provided for reference only. It does NOT provide instructions on how to operate your chamber.

The Series F4 Temperature Controller uses the Modbus protocol for communications. Only the applicable sections related to Modbus in this manual apply.

Data Communications Reference Electronic User's Manual



Watlow Controls

1241 Bundy Blvd., P.O. Box 5580, Winona, Minnesota USA 55987-5580, Phone: (507) 454-5300, Fax: (507) 452-4507



Safety Information


We use note, caution and warning symbols throughout this book to draw your attention to important operational and safety information.


A “NOTE” marks a short message to alert you to an important detail.

A “CAUTION” safety alert appears with information that is important for protecting your equipment and performance. Be especially careful to read and follow all cautions that apply to your application.

A “WARNING” safety alert appears with

information that is important for protecting you, others and equipment from damage. Pay very close attention to all warnings that apply to your application.

The safety alert symbol, , (an exclamation point in a triangle) precedes a general CAUTION or WARNING statement.

The electrical hazard symbol, , (a lightning bolt in a triangle) precedes an electric shock hazard CAUTION or WARNING safety statement.

Technical Assistance

If you encounter a problem with your Watlow controller, review all of your configuration information to verify that your selections are consistent with your application: inputs; outputs; alarms; limits; etc. If the problem persists after checking the above, you can get technical assistance from your local Watlow representative, or by dialing (507) 454-5300, ext. 1111. An applications engineer will discuss your application with you.

Please have the following information available when calling:

- Complete model number (from the label on the side of the controller)
- All configuration information, User Profile Record, Custom Main Page Record and Operations Page Parameter Record
- User's Manual
- Diagnostic Menu readings (if applicable)

About Watlow Controls

Watlow Controls is a division of Watlow Electric Mfg. Co., St. Louis, Missouri, a manufacturer of industrial electric heating products since 1922. Watlow begins with a full set of specifications and completes an industrial product that is manufactured in-house, in the U.S.A. Watlow products include electric heaters, sensors, controllers and switching devices. The Winona operation has been designing solid-state electronic control devices since

1962, and has earned the reputation as an excellent supplier to original equipment manufacturers. These OEMs and end users depend upon Watlow Controls to provide compatibly engineered controls that they can incorporate into their products with confidence. Watlow Controls resides in a 100,000-square-foot marketing, engineering and manufacturing facility in Winona, Minnesota.

Your Feedback

Your comments or suggestions on this manual are welcome. Please send them to the Technical Literature Team, Watlow Controls, 1241 Bundy Blvd., P.O. Box 5580, Winona, Minnesota, 55987-

5580; phone: (507) 454-5300; fax: (507) 452-4507. The Watlow Controls Data Communications Guide is copyrighted by Watlow Winona, Inc., © June 1998, with all rights reserved. (1454)

T

Table of Contents

Chapter 1

Audience	4
Media	4
Purpose	4
Getting Started	4
Convention	4

Chapter 2

Elements of Machine to Machine Comm.	5
Character Format	5
Bits and Bytes	5
ASCII	5
ASCII Chart	6
Serial Communication	7
Parity Bits	7
Start and Stop Bits	8
Baud Rate	8
Computer Languages	8
Syntax	8

Chapter 3

Interface Standards	9
Wiring	9
Biasing of Buses	9
Interface Converters	10
Protocols	10

Chapter 4

Write Your Own (HMI)	12
Purchase an HMI package	18

Chapter 5

Interface Adapters	20
Watlow Software Tools	20
922 Comm Diagnostic	21
Comm4 Diagnostic Software	21
Comm5vb Diagnostic Software	21
CRC	21
Interface Comparison	22
Controller Comparison Summary	22

Appendix

Glossary	23
Disclaimer of Warranty	28

*A downloadable electronic copy of this user manual is available free of charge through Watlow's web site:
<http://www.watlow.com/prodtechinfo>*

Chapter One - Introduction

Audience

The document is targeted towards new users interested in using data communications with Watlow controllers.

Media

This document is available in electronic format only. It is viewable using Adobe Acrobat Reader available free from the Adobe site www.adobe.com on the World Wide Web.

Purpose

The purpose of this document is to enable users to:

1. Understand the basics of serial data communications via standard definitions, interfaces and protocols.
2. Set up and use a simple network of one Watlow controller.
3. Set up and use a network of two or more Watlow controllers with HMI (human-machine interface) software or an operator interface panel.

Getting Started

Your task is to get one or more controllers to talk to a PC or PLC. How do you make this happen? The purpose of this document is to assist you in that task by providing information about communications. The task of getting a PC or PLC communicating with controllers is a five step process:

1. Determine a strategy for communications.
2. Purchase a controller with a communication interface and protocol that supports your strategy.
3. Wire controllers for power, control and communication.
4. Configure the controllers to do what you want them to do.

5. Configure the PC or PLC software and hardware to do what you want them to do.

The first step is the most difficult since decisions need to be made before anything is purchased. It really involves three basic items:

1. Determine how many controllers you will communicate with.
2. Pick a protocol and interface that supports the information exchange.
3. Purchase hardware and software to make this happen.

This document will only deal with the task of communication. Refer to the user's manuals for each product for information about wiring and configuring the controllers and software.

Convention

In this document, numbers in the format 0x00 represent values in hexadecimal. Numbers in the format 0 represent values in decimal and finally, numbers in the format 00000000 represent values in binary unless stated otherwise.

Chapter 2 - Definition of Terms

Elements of Machine-to-Machine Communication

In human communication there are basic words and sentences used to get a message across. Likewise, with computers and controllers. They need a code called a character format or character set. They need rules called protocol to govern their conversation and prevent confusion and errors. Computers need a connecting interface over which to communicate. They may use one pair of wires to send information in one direction and another pair to send in the opposite direction (full duplex). Or they may use one pair to send in both directions (half duplex).

Character Format

The code or character formats for Watlow data communication is shared by virtually everyone in the electronics business everywhere. This code defines a computer stream of 1's and 0's, that are created by varying a voltage signal in a regular manner. The code is the American Standard Code for Information Interchange, called ASCII (asky).

Bits and Bytes

The word bit is simply the contraction of the words binary digit. A bit is the basic unit in ASCII. It is either a "1" or a "0". A byte is a string of seven or eight bits that a computer treats as a single character. ASCII requires seven bits to represent each letter of the alphabet, each digit and each punctuation mark we use.

ASCII

The ASCII code defines 128 separate seven- or eight-bit characters (see chart below), one for each letter, digit and punctuation mark. ASCII also includes control characters similar to those we find on computer keys, such as backspace, shift and return. It also has nine communications control characters for identification, enquiry (inquiry), start of text, end of text, end of transmission, acknowledge, negative acknowledge and escape.

The ASCII code is sometimes written in a base-16 number system that is called hexadecimal or "hex" for short. The numbers 0 through 9 represents the first ten digits of this system, and the letters A through F represents the final six digits. The 128 ASCII character code with the decimal and hexadecimal equivalents is listed below.

ASCII Chart

ASCII Char	Dec	Hex	No Parity 7 or 8 bit	7 bit w/ Even Parity	7 bit w/ Odd Parity	ASCII Char	Dec	Hex	No Parity 7 or 8 bit	7 bit w/ Even Parity	7 bit w/ Odd Parity
NUL	00	00	00000000	00000000	10000000	@	64	40	01000000	11000000	01000000
SOH	01	01	00000001	10000001	00000001	A	65	41	01000001	01000001	11000001
STX	02	02	00000010	10000010	00000010	B	66	42	01000010	01000010	11000010
ETX	03	03	00000011	00000011	10000011	C	67	43	01000011	11000011	01000011
EOT	04	04	00000100	10000100	00000100	D	68	44	01000100	01000100	11000100
ENQ	05	05	00000101	00000101	10000101	E	69	45	01000101	11000101	01000101
ACK	06	06	00000110	00000110	10000110	F	70	46	01000110	11000110	01000110
BEL	07	07	00000111	10000111	00000111	G	71	47	01000111	01000111	11000111
BS	08	08	00001000	10001000	00001000	H	72	48	01001000	01001000	11001000
HT	09	09	00001001	00001001	10001001	I	73	49	01001001	11001001	01001001
LF	10	0A	00001010	00001010	10001010	J	74	4A	01001010	11001010	01001010
VT	11	0B	00001011	10001011	00001011	K	75	4B	01001011	01001011	11001011
FF	12	0C	00001100	00001100	10001100	L	76	4C	01001100	11001100	01001100
CR	13	0D	00001101	10001101	00001101	M	77	4D	01001101	01001101	11001101
SO	14	0E	00001110	10001110	00001110	N	78	4E	01001110	01001110	11001110
SI	15	0F	00001111	00001111	10001111	O	79	4F	01001111	11001111	01001111
DLE	16	10	00010000	10010000	00010000	P	80	50	01010000	01010000	11010000
DC1	17	11	00010001	00010001	10010001	Q	81	51	01010001	11010001	01010001
DC2	18	12	00010010	00010010	10010010	R	82	52	01010010	11010010	01010010
DC3	19	13	00010011	10010011	00010011	S	83	53	01010011	01010011	11010011
DC4	20	14	00010100	00010100	10010100	T	84	54	01010100	11010100	01010100
NAK	21	15	00010101	10010101	00010101	U	85	55	01010101	01010101	11010101
SYN	22	16	00010110	10010110	00010110	V	86	56	01010110	01010110	11010110
ETB	23	17	00010111	00010111	10010111	W	87	57	01010111	11010111	01010111
CAN	24	18	00011000	00011000	10011000	X	88	58	01011000	11011000	01011000
EM	25	19	00011001	10011001	00011001	Y	89	59	01011001	01011001	11011001
SUB	26	1A	00011010	10011010	00011010	Z	90	5A	01011010	01011010	11011010
ESC	27	1B	00011011	00011011	10011011	[91	5B	01011011	11011011	01011011
FS	28	1C	00011100	10011100	00011100	\	92	5C	01011100	01011100	11011100
GS	29	1D	00011101	00011101	10011101]	93	5D	01011101	11011101	01011101
RS	30	1E	00011110	00011110	10011110	^	94	5E	01011110	11011110	01011110
US	31	1F	00011111	10011111	00011111	_	95	5F	01011111	01011111	11011111
SP	32	20	00100000	10100000	00100000	`	96	60	01100000	01100000	11100000
!	33	21	00100001	00100001	10100001	a	97	61	01100001	11100001	01100001
"	34	22	00100010	00100010	10100010	b	98	62	01100010	11100010	01100010
#	35	23	00100011	10100011	00100011	c	99	63	01100011	01100011	11100011
\$	36	24	00100100	00100100	10100100	d	100	64	01100100	11100100	01100100
%	37	25	00100101	10100101	00100101	e	101	65	01100101	01100101	11100101
&	38	26	00100110	10100110	00100110	f	102	66	01100110	01100110	11100110
'	39	27	00100111	00100111	10100111	g	103	67	01100111	11100111	01100111
(40	28	00101000	00101000	10101000	h	104	68	01101000	11101000	01101000
)	41	29	00101001	10101001	00101001	i	105	69	01101001	01101001	11101001
*	42	2A	00101010	10101010	00101010	j	106	6A	01101010	01101010	11101010
+	43	2B	00101011	00101011	10101011	k	107	6B	01101011	11101011	01101011
,	44	2C	00101100	10101100	00101100	l	108	6C	01101100	01101100	11101100
-	45	2D	00101101	00101101	10101101	m	109	6D	01101101	11101101	01101101
.	46	2E	00101110	00101110	10101110	n	110	6E	01101110	11101110	01101110
/	47	2F	00101111	10101111	00101111	o	111	6F	01101111	01101111	11101111
0	48	30	00110000	00110000	10110000	p	112	70	01110000	11110000	01110000
1	49	31	00110001	10110001	00110001	q	113	71	01110001	01110001	11110001
2	50	32	00110010	10110010	00110010	r	114	72	01110010	01110010	11110010
3	51	33	00110011	00110011	10110011	s	115	73	01110011	11110011	01110011
4	52	34	00110100	10110100	00110100	t	116	74	01110100	01110100	11110100
5	53	35	00110101	00110101	10110101	u	117	75	01110101	11110101	01110101
6	54	36	00110110	00110110	10110110	v	118	76	01110110	11110110	01110110
7	55	37	00110111	10110111	00110111	w	119	77	01110111	01110111	11110111
8	56	38	00111000	10111000	00111000	x	120	78	01111000	01111000	11111000
9	57	39	00111001	00111001	10111001	y	121	79	01111001	11111001	01111001
:	58	3A	00111010	00111010	10111010	z	122	7A	01111010	11111010	01111010
;	59	3B	00111011	10111011	00111011	{	123	7B	01111011	01111011	11111011
<	60	3C	00111100	00111100	10111100		124	7C	01111100	11111100	01111100
=	61	3D	00111101	10111101	00111101	}	125	7D	01111101	01111101	11111101
>	62	3E	00111110	10111110	00111110	~	126	7E	01111110	01111110	11111110
?	63	3F	00111111	00111111	10111111	DEL	127	7F	01111111	11111111	01111111

The first digit in bold is the parity bit when enabled.

Serial Communication

The interfaces we've chosen employ serial communication, which is the exchange of data in a one-bit-at-a-time, sequential manner on a single data line or channel.

Serial contrasts with parallel communication, which sends several bits of information simultaneously over multiple lines or channels. Not only is serial data communication simpler than parallel, it is also less costly

ASCII Control Codes

ASCII Control Codes are used to give instructions to the remote device and result in specific actions, such as a line feed instruction on a printer.

ASCII Control Codes, the first 33 ASCII characters (non printable), are important for the operation of communicating equipment. They give instruction to remote devices that result in specific actions such as a line feed on a printer Holding down the keyboard control key while pressing the appropriate keyboard key will send these values. □

ASCII Char	Dec	Hex	Ctrl Key Equiv.	Definition	ASCII Char	Dec	Hex	Ctrl Key Equiv.	Definition
NUL	00	00	Ctrl @	Null Character	DC1	17	11	Ctrl Q	Data Control 1 - XON
SOH	01	01	Ctrl A	Start of Header	DC2	18	12	Ctrl R	Data Control 2
STX	02	02	Ctrl B	Start of Text	DC3	19	13	Ctrl S	Data Control 3 - XOFF
ETX	03	03	Ctrl C	End of Text	DC4	20	14	Ctrl T	Data Control 4
EOT	04	04	Ctrl D	End of Transmission	NAK	21	15	Ctrl U	Negative Acknowledge
ENQ	05	05	Ctrl E	Enquiry	SYN	22	16	Ctrl V	Synchronous Idle
ACK	06	06	Ctrl F	Acknowledge	ETB	23	17	Ctrl W	End of Trans Block
BEL	07	07	Ctrl G	Bell	CAN	24	18	Ctrl X	Cancel
BS	08	08	Ctrl H	Back Space	EM	25	19	Ctrl Y	End of Medium
HT	09	09	Ctrl I	Horizontal Tabulation	SUB	26	1A	Ctrl Z	Substitute
LF	10	0A	Ctrl J	Line Feed	ESC	27	1B	Ctrl [Escape
VT	11	0B	Ctrl K	Vertical Tabulation	FS	28	1C	Ctrl \	File Separator
FF	12	0C	Ctrl L	Form Feed	GS	29	1D	Ctrl]	Group Separator
CR	13	0D	Ctrl M	Carriage Return	RS	30	1E	Ctrl	Record Separator
SO	14	0E	Ctrl N	Shift Out	US	31	1F	Ctrl _	Unit Separator
SI	15	0F	Ctrl O	Shift In	SP	32	20		Space
DLE	16	10	Ctrl P	Data Link Escape					

Parity Bit

Remember that ASCII is a seven- or eight-bit code. What about that eighth bit? It's called the parity bit. A parity bit is added to the ASCII character to verify the accuracy of the first seven bits. We are declaring that the number of 1s in the 8-bit character frame will be either always odd or always even.

This way we can detect a single error in the seven-bit group. Take a look at the representation of the transmitted upper case "W." In this case we have selected "odd" parity. The number of 1s in the first seven bits, plus the parity bit, must always total an odd number. The total number of 1s in the binary character 1010111 (W) is 5, already an odd number. Thus our parity bit will be a 0.

If we were transmitting the lower case "w" (binary 1110111), the parity bit would be a 1 because the total number of 1's in the character frame is 6, an even number. Adding the parity bit makes it odd, and consistent with the odd parity rule. If a noise spike came onto the data line and changed the signal voltage level enough to reverse a 1 to a 0 in the character frame, the receiver would detect that error. The total number of 1s would be even and a violation of the odd-parity rule.

At Watlow, we use odd, even and no parity. Odd parity sets the parity bit to 0 if there are an odd number of 1s in the first seven bits Even parity sets the parity bit to 0 if there are an even number of 1s in the first seven bits. No parity ignores the parity bit.

Start and Stop Bits

A start bit informs the receiving device that a character is coming, and a stop bit tells it that a character is complete. The start bit is always a 0. The stop bit is always a 1.

The human speech equivalent of these bits could be a clearing of the throat to get someone's attention (start bit); and a pause at the end of a phrase (stop bit). Both help the listener understand the message.

Baud Rate

The baud rate refers to the data transmission. When a change in signal represents one data bit, baud rate is equal to bits per second (bps). Standard baud rates for computers are 300, 600, 1200, 2400, 4800, 9600 and 19200 baud.

Computer Languages

Computer languages are simply sets of symbols and rules for their use. There are many computer languages and a wide variety of applications for them. Programmers use languages to enable computers to do real work.

Syntax

Syntax for a natural language dictates how we put words together to make phrases and sentences. In data communications, syntax also dictates how we order the parts of a message.

Chapter Three - Watlow Controls Approach to Data Communications

Interface Standards

An interface is a means for electronic systems to interact. It's a specific kind of electrical wiring configuration. Four interfaces are commonly used:

EIA-232 (Full Duplex)

An EIA-232 (formerly RS-232) interface uses three wires: a single transmit wire; a single receive wire; and a common line. Only two devices can use an EIA-232 interface. A -3 to -24 volt signal indicates a 1 and a +3 to +24 volt signal indicates a 0. The EIA-232 signal is referenced to the common line rather than to a separate wire, as in EIA-485 and EIA-422. An EIA-232 cable is limited to 50 feet, due to noise susceptibility.

EIA-422 (Full Duplex)

The EIA-422 interface uses five wires: a "talk" pair; a "listen" pair; and a common line. It can handle one master and up to ten remote devices in a multidrop (more than one controller shares the same wires) network up to 4,000 feet long. EIA-422 uses the difference in voltage between the two wires to indicate a 1 or a 0 bit. A 1 is a difference of -5 volts, while a 0 is a difference of +5 volts.

EIA-423 (Full Duplex)

An EIA-423 interface is compatible with EIA-232. It is a newer standard designed for more speed and distance. It uses three wires: a single transmit wire; a single receive wire; and a common line. Only two devices can use an EIA-423 interface. A -3 to -6 volt signal indicates a 1 and a +3 to +6 volt signal indicates a 0. The EIA-423 signal is referenced to the

common line rather than to a separate wire, as in EIA-485 and EIA-422. An EIA-423 cable is limited up to 4,000 feet, due to noise susceptibility.

EIA-485 (Half Duplex)

An EIA-485 interface uses three wires: a T+/R+, a T-/R- and a common line. A -5-volt signal is interpreted as a 1, a +5-volt signal as a 0. As many as 32 remote devices can be connected to a master on a multi-drop network up to 4,000 feet long.

Wiring

Most PCs and some PLCs have a standard EIA-232 port (usually referred to as RS-232). In these instances, you must use an interface converter to connect to EIA-422 or EIA-485. These interface standards are required to have a multi-drop system (more than one controller on the bus). See the list below for some vendors who sell these converters.

Should your PC or PLC have the appropriate interface, just connect using the wiring diagram supplied with your controller.

For EIA-422, the T+ connects to the R+, sometimes labeled "B" while the T- connects to the R-, sometimes labeled "A". For EIA-485, the terminal marked "A" usually connects to the T-/R- while the "B" terminal connects to the T+/R+ of the controller.

The standards do not specify the wire size and type. Use of AWG 24 twisted pair provides excellent results. If shielded cable is used, terminate the shield at one end only.

Always follow the manufacturer's instructions supplied with the interface converter. See Biasing of Buses next.

Biasing of Buses

The EIA-485 standard requires the bus to be biased for reliable communication. This means to provide termination resistors

across the T+/R+ and T-/R- wires. One resistor is placed at the PC or PLC where it connects to the EIA-485 bus. The second resistor is placed at the last controller on the network. Do not place resistors at each controller. The impedance of the wires used for the bus determines the resistor value. For twisted pair, the value is typically 120 ohms. In addition, it may be necessary to have a pull-up and pull-down resistor between the power supply and ground of the interface adapter. Check the documentation that came with your interface adapter.

Biasing the bus reduces reflection of signals sent down the bus. These reflections are sometimes referred to as a standing wave. This condition is most notable when communicating at high baud rates.

Interface Converters

The purpose of an interface converter is to allow two different buses to be connected. Interface converters are required when connecting an EIA-232 port to an EIA-422 or EIA-485 bus.

The EIA-422 bus is a full duplex bus. This means that it can send and receive data at the same time. The EIA-485 bus is a half duplex bus. This means that it can only send or receive data at any given time. Some interface converters on the market have provided the ability to have full duplex with the EIA-485 bus. This is accomplished by using two receivers and transmitters tied in tandem. This type of converter will not work with the Watlow controllers. Be sure that the model you purchase is designed for half duplex.

Another consideration when using interface converters is how the converter handles switching between transmit and receive. When connecting between an EIA-232 and an EIA-485, the converter must convert two items. First it must convert the voltage level. Second it must convert from half duplex to full duplex.

This is not an easy task. Typically it is accomplished via a handshake line from

the PC or PLC. When data flows into the converter from the PC, a handshake line is placed high. When data flows out of the converter to the PC, the handshake line is placed low. In this way, the handshake line controls the direction of information. Another method of achieving this is to use a built-in timer. The converter switches to transmit when a character is sent to it from the PC. After a period of time when the PC has not transmitted, the converter switches to a receive mode.

It is important that you understand how your converter accomplishes this task. You are required to wire this feature or make settings on the converter to enable this function. The PC will not talk to the controllers correctly with out properly setting this.

Your converter may also require settings through dip switches, to set up communications parameters like baud rate, data bits, start bits, stop bits and handshaking. See the documentation that comes with your converter for more detail.

The converter may require a separate power supply. Some converters get their power from the handshake lines of the PC. If you rely on this method, you will need to wire these additional lines. In addition, your software must set these lines high. A more reliable method is to use the external power supply. This is especially necessary when using a laptop computer.

Protocols

Protocol describes how to initiate an exchange. It also prevents two machines from attempting to send data at the same time. There are a number of different data communications protocols, just as there are different human cultural protocols that vary according to the situation.

The protocol part of Watlow communications is very important, because it gives us a quality of communication that others often don't have. Protocol-driven communications

are more accurate, because they are less prone to both operator and noise errors. Protocol maintains system integrity by requiring a response to each message. It's like registered mail — you know that your letter has been received because the post office sends you a signed receipt.

In Watlow data communications, a dialog will continue successfully as long as the messages are in the correct form and responses are returned to the protocol leader. If the operator enters an incorrect message, or interference comes on to the data line, there will be no response. In that case the master must retransmit the message or go to a recovery procedure. If an operator continues to enter an incorrect message or interference continues on the data line, the system will halt until the problem is resolved. Watlow provides you with three protocol choices: XON/XOFF, ANSI x3.28, Modbus RTU

XON/XOFF

The first protocol is conventional XON/XOFF protocol. It works very well for systems that do not require a message response and for those with only two devices (one PC and one controller). Sending of the "XON" (0x11) and "XOFF" (0x13) controls information. This is the simplest protocol offered by Watlow Controls.

ANSI x3.28

The second, called "Full Protocol," is based on the American National Standard Institute's standard ANSI X3.28-1976, Subcategory 2.2. The Full Protocol is required for systems that need a response to every message, and for any "multi-drop" network, which has more than two communication devices. Addressing a certain controller on the bus, then enclosing all messages with a <STX> start of text (0x02) and <ETX> end of text (0x03) controls information exchange. The characters <ENQ>, <EOT>, <DLE> are used to determine who has control of the bus. Lastly, all messages are <ACK>

acknowledged (0x06) or <NAK> negative acknowledged (0x15) to ensure messages were received correctly.

Modbus Remote Terminal Unit (RTU)

Gould Modicon, now called AEG Schneider, created the third protocol for process control systems called "Modbus". This protocol is the most complex of the three. It has the advantage of being extremely reliable in exchanging information, a highly desirable feature for industrial data communications. This protocol works on the principle of packet exchanges. The packet contains the address of the controller to receive the information, a command field that says what is to be done with the information and several fields of data. Reading from these registers retrieves all information in the controller. These registers are listed in your user's manual. You will need this list to determine where the data is located. The last item sent in the packet is a field to ensure the data is received intact. This is called a cyclic redundancy check-sum. All information exchanged is in hex numbers. Watlow only supports the binary version of Modbus, referenced as RTU. The ASCII version is less efficient and is not supported.

Chapter Four - Human Machine Interfaces (HMI)

HMI stands for Human-Machine-Interface, and is sometimes referred to as Man-Machine-Interface (MMI). This is an operator interface that allows you to monitor and control your process. Many software packages were written to allow a PC to perform this function. Use care in selecting software packages. Some will run only under a specific disk operating system such as Windows NT from Microsoft. The serial interface and protocol must match between the PC or PLC and the controller. Many companies provide free working demonstration copies. Obtain a demonstration copy so you can see if the program meets your needs.

Listed below are a few of the many software packages that claim to support the Modbus protocol. Watlow does not recommend any one software package nor supports the implementation of any software package not sold by Watlow. Contact the software manufacturer for more information in applying their software.

Write your own HMI

Writing an XON/XOFF Application

The great thing about XON/XOFF protocol is the simplicity of communications. The basic structure is to send information to the controller as needed until you receive an XOFF (0x13). You must wait until you receive an XON (0x11) before continuing. The controller follows this same scheme. There are no confirmations of commands sent. This protocol is highly efficient in that few characters are sent to handle the flow of

information. This protocol is sometimes referred to as "flow control".

The disadvantage of this protocol is lower reliability in ensuring that both parties receive the proper information. In addition, only two devices can be on a bus because no means is provided to address any controller.

Handling Error Codes (ER2)

All communications' related error codes are ER2 error codes, which means that they're not considered cause for a shutdown of the unit itself. With XON/XOFF flow control, error codes may be generated, but there will be no standard indication of this fact. Therefore, you may want to query the status of ER2 after each command sent to see if it was successful.

User Responsibility

Users must refrain from altering prompts that do not appear on the controller's front panel or are not included on the specific model. For example, do not send an A2LO command to a unit not equipped with an alarm for output 2.

Most Watlow controllers contain a register to disable saving of the current set point to EEPROM. When using your PC or PLC to control the set point in the Watlow controller, the EEPROM may be prematurely damaged. There is a limit to the number of times you can store information in the EEPROM. PCs can quickly reach this limit if the set point is continually changed, as in a ramping controller. Disabling this feature will prevent this damage.

Care must also be taken that the process can not cause damage to property or injury to personnel if the wrong commands are sent due to operator error or equipment malfunction. Be sure to use limit devices on the equipment to prevent system runaway.

Writing an ANSI x3.28 Application

Handling Error Codes (ER2)

All communications' related error codes are ER2 error codes, which means that

they're not considered cause for a shutdown of the unit itself. There is always a communications error code generated when the <NAK> character (0x15) is sent under the ANSI x3.28 protocol

User Responsibility

Users must refrain from altering prompts that do not appear on the controller's front panel or are not included on the specific model. For example, do not send an A2LO command to a unit not equipped with an alarm for output 2.

Most of Watlow controllers contain a register to disable saving of the current set point to EEPROM. When using your PC or PLC to control the set point in the Watlow controller, the EEPROM may be prematurely damaged. There is a limit to the number of times you can store information in the EEPROM. PCs can quickly reach this limit if the set point is continually changed, as in a ramping controller. Disabling this feature will prevent this damage.

Care must also be taken that the process can not cause damage to property or injury to personnel if the wrong commands are sent due to operator error or equipment malfunction. Be sure to use limit devices on the equipment to prevent system runaway.

Because of the wide array of choices available for setting up a Watlow controller, only a subset of the prompts contains parameters in a given situation. The user's manual explains the interrelations between prompts.

Writing a Modbus Application

Modbus RTU enables a computer or PLC to read and write directly to registers containing the controller's parameters. With it you could read all 141 of the controller's parameters with five read commands.

Because of the wide array of choices available for setting up a controller

utilizing Modbus, only a subset of the prompts contain parameters in a given situation. This document explains the interrelations between prompts.

If you already have a software application that uses Modbus, you can simply skip to the Temperature/process Controller Prompt Table or the Modbus RTU Address Table in the user's manual for the address information your program will need. The rest of this section on the Modbus provides information for writing a software application that uses Modbus.

1. You need to code messages in eight-bit bytes, with no parity bit, one stop bit (8, n, 1).
2. Negative parameter values must be written in twos' complement format. Parameters are stored in two-byte registers accessed with read and write commands to a relative address.
3. Messages are sent in packets that are delimited by a pause at least as long as the time it takes to send 30 bits. To determine this time in seconds, divide 30 by your baud rate.
4. Because changing some parameters automatically changes or defaults other parameters, use the Complete Parameter Download Sequence table listed in the user's manual to order write commands.

Using a controller address of 0x00 for a write command, will send that command to all the controllers in the network. This is a powerful feature if all the controllers on a network use all or most of the same parameters.


Packet Syntax

Each message packet begins with a one-byte controller address, from 0x01 to 0xF7.

The second byte in the message packet identifies the message command: read (0x03 or 0x04); write (0x06 or 0x10); or loop back (0x08).



The next n bytes of the message packet contain register addresses and/or data.

The last two bytes in the message packet contain a two-byte Cyclical Redundancy Checksum (CRC) for error detection.

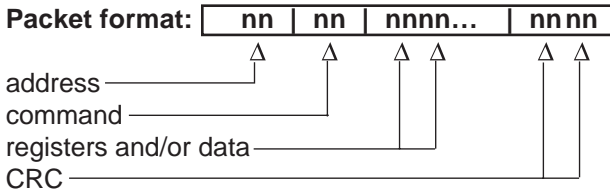

Read Multiple Registers Command (0x03 or 0x04)

This command returns from 1 to 32 registers.

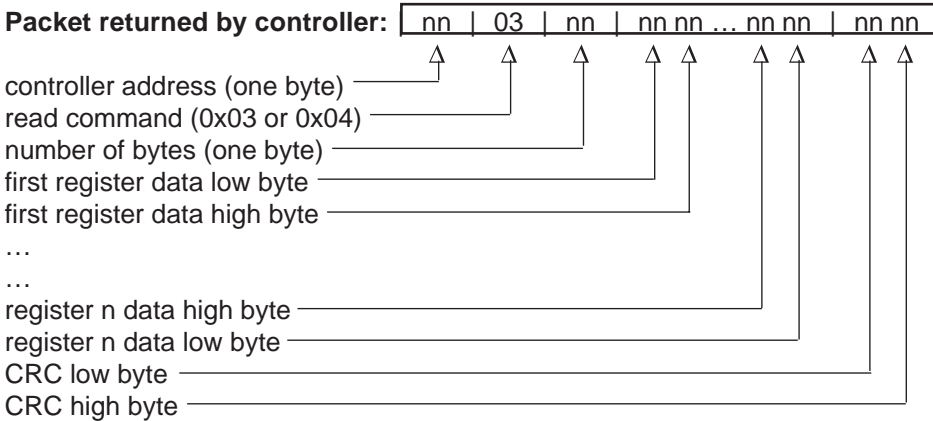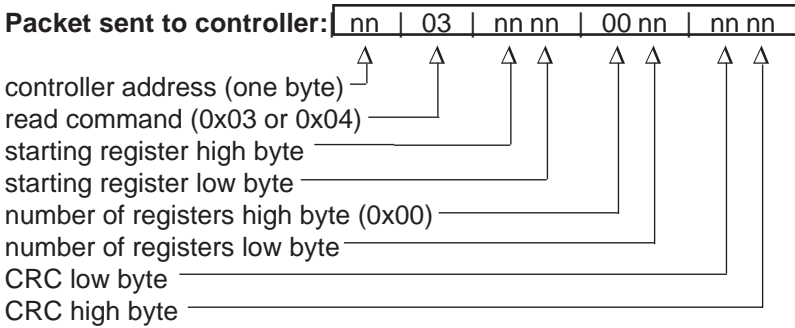

Example (988 only): Read register 0 (model number) of the controller at address 1.

Sent: 01 03 00 00 00 01 84 0A

Received: 01 03 02 03 DC B9 2D

Message: 988 (0x03DC).

Example (988 only): Read register 1 and 2 (Process 1 and 2 values) of controller at address 5.


Sent: 05 03 00 01 00 02 94 4F

Received: 05 03 04 00 64 00 C8 FF BA

Message: 100 (0x0064) and 200 (0x00C8).

Write to a Single Register Command (0x06)

This command writes a parameter to a single register. The controller will echo back the command. An attempt to write to a read-only parameter returns an illegal data address error (0x02). (See "Exception Responses," pg. 4.9.)

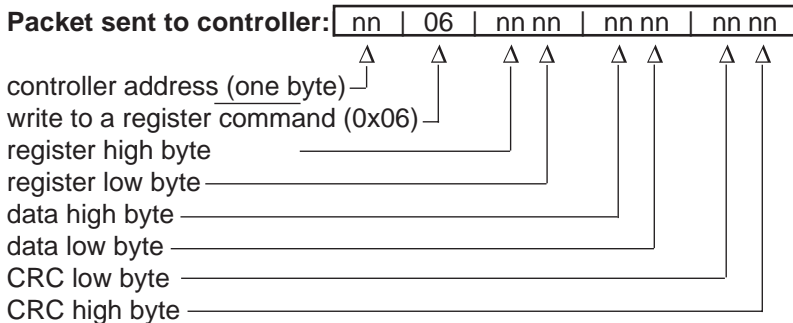


Example (988 only): Set register 7 (SPI) to 200 (0x00C8) on controller at address 9.


Sent: 09 06 00 07 00 C8 38 D5

Received: 09 06 00 07 00 C8 38 D5

Write to Multiple Registers Command (0x10)


This command actually writes a parameter to only a single register. An attempt to write to a read-only parameter returns an illegal data address error (0x02). (See "Exception Responses," pg. 4.9.)

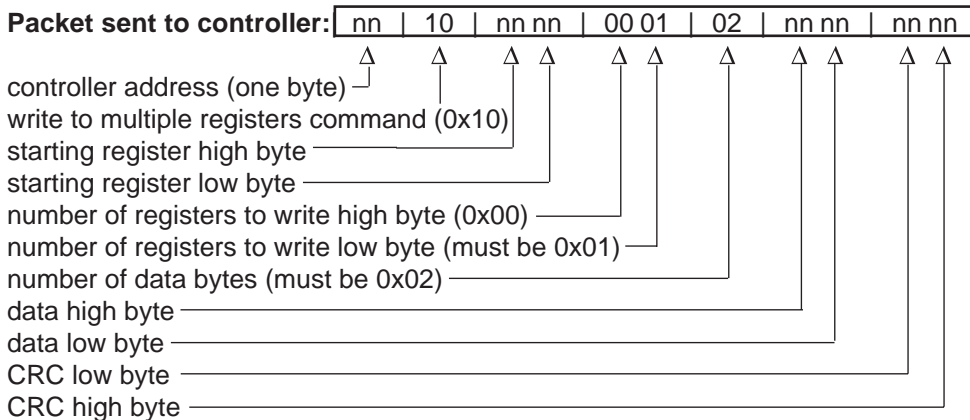

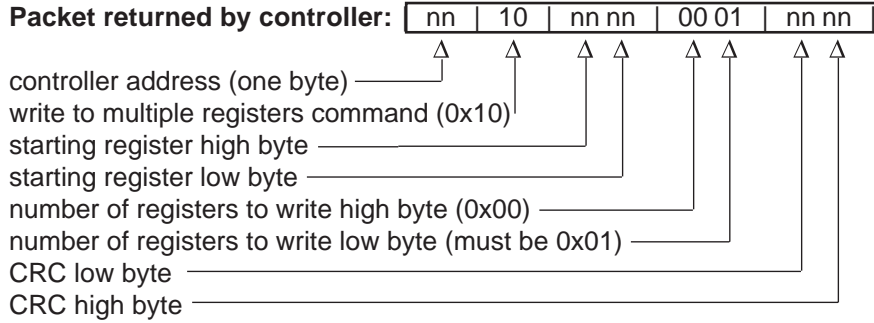

Loop Back Command (0x08)

This command simply echoes the message. This serves as a quick way to check your wiring.

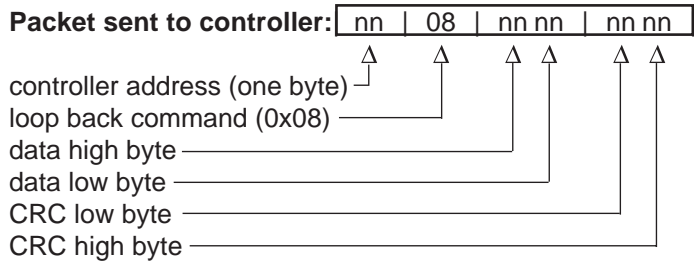

Example: Run loop back test on controller at address 40 (0x28).

Sent: 28 08 55 66 77 88 31 B7

Received: 28 08 55 66 77 88 31 B7


Exception Responses

When a controller cannot process a command it returns an exception response and sets the high bit (0x80) of the command.

0x01 illegal command

0x02 illegal data address

0x03 illegal data value

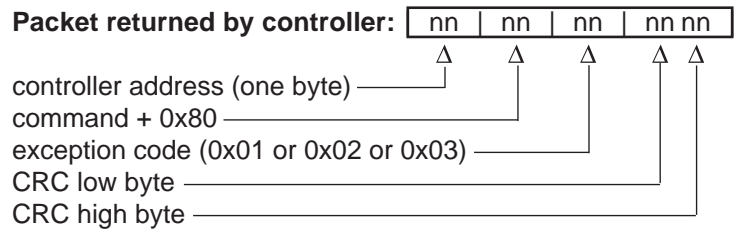

Messages with the wrong format, timing or CRC are ignored. A read command sent to an inactive parameter returns 0x0000.

Example: Exception 01 - Command 02 is not supported.

Sent: 01 02 00 01 00 02 A8 0B
Received: 01 82 01 81 60

Example: Exception 02 - The parameter at register 45 (0x002D) is inactive.

Sent: 01 06 00 2D 00 01 D8 C3
Received: 01 86 02 C3 A1

Example: Exception 03 - Cannot write 12,000 (0x2EE0) to register 7, out of range, illegal data value.

Sent: 01 06 00 07 2E E0 24 23
Received: 01 86 03 02 61

Special Modbus Functions

The following are Modbus registers with special functions: 24, Disable Non-volatile (system) Memory; 106, Alarm Status Output 2; 110, Alarm Status Output 3; 114, Alarm Status Output 4; 200, Auto-Manual Operation Mode; 311, Clear Input Errors; 331, Clear Alarms; 332, Silence Alarms.

A "0" indicates an inactive state. Send "1" to the register to activate the function. It will automatically reset to "0" when the function is complete. See your User's Manual for detail on your specific model.

Handling Error Codes

Error codes are divided into two types. Read error codes and write error codes are called exception codes. Reading from a register that does not exist or is currently disabled will typically respond with a large out of range value such as -32000, -32001, or -32002. The Series 988 returns a value of zero.

Writing to a register that is not supported, is inactive or out of range will return a packet with 0x80 added to the command sent. The byte following this will contain the value 0x01 for illegal command, 0x02 for illegal address, or 0x03 for illegal data value. Writing to a read only register will return an exception code 0x02.

See your user's manual for exact values and definitions.

User Responsibility

Users must refrain from altering prompts that do not appear on the controller's front panel or are not included on the specific model. For example, do not send an A2LO command to a unit not equipped with an alarm for output 2.

Most of Watlow controllers contain a register to disable saving of the current set point to EEPROM. When using your PC or PLC to control the set point in the Watlow controller, the EEPROM may be prematurely damaged. There is a limit to the number of times you can store information in the EEPROM. PCs can quickly reach this limit if the set point is continually changed, as in a ramping controller. Disabling this feature will prevent this damage.

Care must also be taken that the process can not cause damage to property or injury to personnel if the wrong commands are sent due to operator error or equipment malfunction. Be sure to use limit devices on the equipment to prevent system runaway.

Purchase an HMI package

Not all HMIs are equal in performance. Set up and operation / function of each

manufacturer's HMI package is unique. Industrial controllers operate in a harsh, electrically noisy environment. This can cause less robust HMIs to work intermittently or not at all. In addition, the platform (PC or PLC) which runs the HMI is subject to failures causing unpredictable operation of your process. Watlow has not tested the HMIs listed with the exception of ANAWIN and WATLINK. This list is provided as informational only. Watlow makes no claims as to the performance or compatibility with any HMI software package.

Anawin by Watlow Anafaze
334 Westridge Drive
Watsonville, CA 95076
Phone 408-724-3800
<http://www.watlow.com>

WATLINK by Watlow Controls
1241 Bundy Blvd
Winona, MN 55987
Phone 507-454-5300
<http://www.watlow.com>

CONTROLWARE by Controlware
245 Northland Blvd
Cincinnati, OH 45246-3603
Phone 800-776-9704
<http://www.controlware.com>

Cimplicity by GE Fanuc
Phone 1-800-648-2001
<http://www.gefanuc.com>

Genesis by Iconics
100 Foxborough Blvd
Foxborough, MA 02035
Phone 800-946-9679
<http://www.iconics.com>

Interact by CTC
50 W. TechneCenter Drive
Milford, OH 45150
Phone 513-831-2340
<http://www.ctcusa.com>

KEPware MMI by KEPware, Inc.
81 Bridge Street
Yarmouth, ME 04096
Phone 207-846-5881
<http://www.kepware.com>

LabView by National Instruments
6504 Bridge Point Parkway
Austin, TX 78730-5039
Phone 512-794-0100
<http://www.natinst.com>

Lookout by National Instruments
6504 Bridge Point Parkway
Austin, TX 78730-5039
Phone 512-794-0100
<http://www.natinst.com>

Modbus for Windows by Calta
Computer Systems Ltd.
230, 550-71 Ave. SE
Calgary, Alberta Canada T2H 0S6
Phone 403-252-5094
<http://www.calta.com>

OI-2000 by Software Horizons, Inc.
10 Tower Office Park
Suite 200
Woburn, MA 01801-2120
Phone 617-933-3747
<http://www.shorizons.com>

SpecView by SpecView, LLC
41 Canyon Green Court
San Ramon, CA 94583
Phone 510-275-0600
<http://www.specview.com>

Visual Logic Controller by Steeplechase
Software, Inc.
1330 Eisenhower Place
Ann Arbor, MI 48108
Phone 313-975-8100
<http://www.steeplechase.com>

Wonderware 2000 by Wonderware
Corp.
100 Technology Drive
Irvine, CA 92718
Phone 714-727-3200
<http://www.wonderware.com>

Chapter Five - Operator Interface Panels

Not all Operator Interface Panels are equal in performance. Programming of each manufacturer's panel is unique. Industrial controllers operate in a harsh, electrically noisy environment. This can cause less robust panels to work intermittently or not at all. Watlow has not tested the panels listed and this list is provided as informational only. Watlow makes no claims as to the performance or compatibility with any Operator Interface Panel.

EXOR

4740T Interstate Drive
Cincinnati, OH 45246
Phone 513-874-4665
<http://www.exor-rd.com>

CTC

50 W. TechneCenter Drive
Milford, OH 45150
Phone 513-831-2340
<http://www.ctcusa.com>

Maple Systems

1930 220th Street SE
Suite 101
Bothell, WA 98021
Phone 425-486-4477
<http://www.maple-systems.com>

Advantech

Phone 1-800-800-6889
<http://www.advantech-usa.com>

Interface Adapters

Not all converters are equal in performance. Industrial controllers

operate in a harsh, electrically noisy environment. This can cause less robust converters to work intermittently or not at all. Watlow has not tested the converters listed and this list is provided as informational only. Watlow makes no claims as to the performance or compatibility with any converter.

B&B Electronics

707 Dayton Road
PO Box 1040
Ottawa, IL 61350
Phone 815-433-5100
<http://www.bb-elec.com>

Part # 485OIC for EIA-232 to EIA-422
or EIA-485

Dataforth Corporation (formerly supplied by Burr-Brown)

3331 E. Hemisphere Loop
Tucson, AZ 85706
Phone 800-444-7644
Part # LDM422 for EIA-232 to EIA-422
Part # LDM485 for EIA-232 to EIA-485

CMC – Connecticut Microcomputer Corporation

Watlow Software Tools

920Comm Diagnostic Software

Watlow has a program available free of charge called "920COMM.EXE" that is used with the Series 920 Controller. This can be downloaded from our BBS at 507-452-3958. This is a terminal program that handles the protocol for you. The program can be used to determine if your cables are properly connected and that the controller is working. This program supports the ANSI x3.28 and XON/XOFF protocols.

922Comm Diagnostic Software

Another program available free of charge is called "922COMM.EXE" which is used with the Series 922 Controller. This can be downloaded from our BBS at 507-452-3958. This is a terminal program that handles the protocol for you. The program can be used to determine if your cables are properly connected and that the controller is working. This program supports the ANSI x3.28 and XON/XOFF protocols.

Comm4 Diagnostic Software

The "COMM4.EXE" program can be downloaded free of charge from our BBS at 507-452-3958. This is a terminal program which handles the protocol for you. The program can be used to determine if your cables are properly connected and that the controller is working. This program supports the ANSI x3.28 and XON/XOFF protocols.

Comm5vb Diagnostic Software

The "COMM5VB.EXE" program can be downloaded free of charge from our BBS at 507-452-3958. This is a terminal program that handles the protocol for you. The program can be used to determine if your cables are properly connected and that the controller is working. This program supports the Modbus, ANSI x3.28 and XON/XOFF protocols.

CRC

Cyclical Redundancy Checksum (CRC) Algorithm

This C routine, `calc_crc()`, calculates the cyclical redundancy checksum, CRC, for a string of characters. The CRC is the result of dividing the string by 0xA001. Modbus applications calculate the packet's CRC then append it to the packet.

```
#define POLYNOMIAL 0xA001;
unsigned int calc_crc(unsigned char
*start_of_packet, unsigned char
*end_of_packet)
{
unsigned int crc;
unsigned char bit_count;
unsigned char *char_ptr;

/* Start at the beginning of the packet */
char_ptr = start_of_packet;
/* Initialize CRC */
crc = 0xffff;
/* Loop through the entire packet */
do{
/* Exclusive-OR the byte with the CRC */
crc ^= (unsigned int)*char_ptr;
/* Loop through all 8 data bits */
bit_count = 0;
do{
/* If the LSB is 1, shift the CRC and XOR
the polynomial mask with the CRC */
if(crc & 0x0001){
crc >>= 1;
crc ^= POLYNOMIAL;
}

/* If the LSB is 0, shift the CRC only */
else{
crc >>= 1;
}
} while(bit_count++ < 7);
} while(char_ptr++ < end_of_packet);
return(crc);
}
```

Interface Comparison

Interface	Maximum Bus Length	Max # Controllers	Cable Type	Voltage Level	Balanced/Unbalanced	Duplex
EIA-232	50 feet	1	3-wire	3 – 24 v	Unbalanced	Full
EIA-423	4,000 feet	1	3-wire	3 – 12 v	Unbalanced	Full
EIA-422	4,000 feet	10	5-wire	2.0 – 6 v	Balanced	Full
EIA-485	4,000 feet	32	3-wire	1.6 – 6 v	Balanced	Hal

Summary

As first stated in this article, the steps involved to communicate are:

1. Determine how many controllers you will communicate with
2. Pick a protocol and interface that supports the information exchange
3. Purchase hardware and software to make this happen.

The number of controlled zones will determine the number of controllers connected to the PC or PLC. Pick a protocol that will support this number. Consider speed and reliability of communications when picking the protocol. Ask yourself, how will the devices understand each other? Pick an interface that will support the number of devices connected, transmit over the desired distance and is industrially hardened (will communicate in electrically noisy environments). Lastly, purchase an interface, controllers, PC or PLC and software that will work together. Software may be written to accomplish the task if you have the skills and resources to do so.

Appendix

Glossary

Address

A unique designator for a location of data or a controller that allows each location or controller on a single communications bus to respond to its own message. Similar to your own residence address.

ANSI

American National Standards Institute

ANSI x3.28

The American National Standards Institute developed this communication standard protocol. This method uses a unique address for each device. Only the master can initiate a communications session by sending an address and then the <ENQ> character. All other messages must start with a start of text <STX> and end with an end of text <ETX> character. The bus is released to the other device by sending <EOT> character. Messages are <ACK> acknowledged or <NAK> negative acknowledged.

ASCII (pronounced AS-KEY)

American Standard Code for Information Interchange. A universal standard for encoding alphanumeric characters into 7 or 8 binary bits.

Asynchronous

Communications where characters can be transmitted at an unsynchronized point in time. In other words, it can start and stop anytime. The time between transmitted characters may be of varying lengths. Communication is controlled by “start” and “stop” bits at the beginning and end of each character.

Baud

Unit of signaling speed derived from the number of events per second (normally bits per second).

Baud rate

The rate of information transfer in serial communications, measured in bits per second.

Binary

Number based system where only two characters exist, 0 and 1. Counting is 0, 1, 10, 11...

Bit

Derived from “Binary DigiT”, a one or zero condition in the binary system.

Byte

A term referring to eight associated bits of information, sometimes called a “character”.

CAN Bus

The Controller Area Network Bus is a serial communications protocol that includes software and hardware. CAN was originally developed by the German company Robert Bosch for use in the auto industry to provide a cost-effective communications bus for in-car electronics.

Character

Letter, numeral, punctuation, control figure or any other symbol contained in a message. Typically this is encoded in one byte.

Communications

The use of digital computer messages to link components. (See serial communications and baud rate)

Converter

This device will convert from one hardware interface to another such as from EIA-232 to EIA-485. The converter may be transparent to the software, which means you do not have to give any special considerations to software programming.

CRC

When data is corrupted during transmission, a method is used to return the data to its correct value. This can be accomplished through several methods: parity, checksum and CRC (cyclic redundancy checksum) are three of these. Cyclic Redundancy Checksum is an error-checking mechanism using a polynomial algorithm based on the content of a message frame at the transmitter and included in a field appended to the frame. At the receiver, it is then compared with the results of the calculation that is performed by the receiver.

Data

The information that is transferred across the communications bus. This may be a setpoint, setup parameter, or any character. This information is transferred to an address or register.

DB-9

A standardized connector shaped like the letter “D” when viewed on edge. This connector has 9 contacts. It is utilized on most IBM AT compatible PCs as the serial port.

DB-15

A standardized connector shaped like the letter “D” when viewed on edge. This connector has 15 contacts. It is utilized on most IBM AT compatible PCs as the game/midi port.

DB-25

A standardized connector shaped like the letter “D” when viewed on edge. This connector has 25 contacts. It is utilized on most IBM AT compatible PC’s as the parallel port when the PC end contains socket contacts. Can also be the serial port when the PC end contains pin contact.

Decode

This is the reverse of encode. When a piece of data has information embedded in it, decode is to extract that information. Ex. To extract an “A” from 01000001.

DeviceNet

A software protocol / hardware interface based on CAN. A low cost communication link that connects industrial devices over a network. Uses twisted pair wires for the power and bus. Nodes can be removed or inserted on the bus without powering down the network.

Double Word

Equivalent to two words or four bytes. This equals 32 bits.

Duplex

The ability to send and receive data at the same time. “To listen and talk at the same time.”

EIA

See Electronic Industries Association

EIA-232

Electronic Industries Association developed this standard hardware interface to allow one device to talk to another device in full duplex mode. This method uses a differential voltage between one wire and ground. Also called an unbalanced system since the ground wire carries the sum of current of all lines. First standard to gain wide acceptance by manufacturers. Transmission is limited to about 50 feet.

EIA-422

Electronic Industries Association developed this standard hardware interface to allow up to 10 devices to be on a bus at one time. This method uses a differential voltage between two wires. Also called a balanced system since each wire carries the same current values. This has the advantage of being immune to outside electrical disturbances.

EIA-423

Electronic Industries Association developed this standard hardware interface to allow one device to talk to another device in full duplex mode. This method uses a differential voltage between one wire and ground. Also called an unbalanced system since the ground wire carries the sum of current of all lines. This standard is compatible with EIA-232. The outputs were beefed up to allow transmission up to 4000 ft.

EIA-485

Electronic Industries Association developed this standard hardware interface to allow up to 32 devices to be on a bus at one time. This method uses a differential voltage between two wires. Also called a balanced system since each wire carries the same current value. This has the advantage of being immune to outside electrical disturbances.

EIA/TIA -232, -422, -423 and -485

Data communications standards set by the Electronic Industries Association and Telecommunications Industry Association.

Formerly referred to as RS- (Recommended Standard). (See EIA-232, EIA-422, EIA-423 and EIA-485)

Electronic Industries Association (EIA)

An association in the US that establishes standards for electronics and data communications

Encode

To embed information into a piece of data. This is the reverse of decode. Ex. Let's let 01000001 stand for an "A".

Error Correction

When an inconsistency is in the data, a method is used to detect and/or return the data to its correct value. This can be done through several methods, parity, checksum and CRC (cyclic redundancy checksum) are a three of these.

Ethernet

A local area network developed by Xerox in the early 70's and standardized by Xerox, Digital Equipment and Intel in 1978. This is a serial communications method which all devices share the lines. An address is sent in a packet to talk to a device on the line. This protocol supports peer-to-peer communications.

Even

This term is used with parity. See parity.

Fieldbus

The term fieldbus is a general definition for an industrial network media that resides at the machine level and below in a total network system. The primary purpose of this network is to interconnect the machine level and sublevel control functions and services in a distributive topology. It is not a particular protocol or physical connection system. Included in this generalization definition are standard protocols of Profibus, Modbus, DeviceNet, SDS, WorldPIP, and P-Net.

Firmware

Instruction or data stored in an IC (integrated circuit) or on a read only disk.

This data is programmed once and cannot easily be changed as software can.

Full

See Full Duplex.

Full Duplex

Full is used to mean the duplex's full capability. The ability to send and receive data at the same time. The same as duplex.

GPIB

See IEEE488

Half Duplex

The ability to send or receive data, but not at the same time. "To listen or talk, but not both at the same time."

Handshake (Handshaking)

Exchange of predetermined signals between two devices establishing a connection. Using extra wires or software signals to coordinate communications, signals can be sent to tell the transmitter the current status of the other device receiver. Ex. Are you busy or are you ready?

Hex or Hexadecimal

Number based system where sixteen characters exist, 0 to 9, A to F. Counting is 0..9,A,B,C..

HMI

Human to Machine Interface typically performed in software on a personal computer. Also called MMI.

IEEE488

Bus developed by Hewlett-Packard in 1965 as HP-IB. Also referred to as GPIB (General Purpose Interface Bus). Consist of 8 data lines and 8 control lines. Bus length limited to 20.0 meters. Supports 15 devices on the bus at one time.

Logic Level

A voltage measurement system where only two stable voltage values exist. Ex. 0v and 5V, or -3v and +3v.

Mark

Represents the transmission of data bit logic 1 (see logic level). Usually this is the most negative voltage value in serial communications.

Master

The device on the bus that controls all communications. Only the master can initiate conversation.

Modbus

A software protocol developed by Gould Modicon (now AEG) for process control systems. No hardware interface is defined. Modbus is accessed on the master/slave principle, the protocol providing for one master and up to 247 slaves. Only the master can initiate a transaction. This is a half duplex protocol.

MMI

Man to Machine Interface typically performed in software on a personal computer. Also called HMI.

Network

When two or more devices share communications lines, the devices are “networked”.

Node

A point of interconnection to a network.

Noise Immunity

The ability of communications lines to ignore electrical noise generated in the communications lines by nearby magnetic and electrostatic fields.

Odd

This term is used with parity. See parity.

OSI

Open Systems Interconnection are those which conform to specifications and guidelines that are open to all. This allows equipment from any manufacturer, which claims to comply with the standard, to be used interchangeably on the standard network.

Parallel

Communication using this method, transfers eight bits or one byte at a time over eight data wires and one ground wire. This method is eight times faster than using serial but utilizes more hardware.

Parity

A bit is assigned at the beginning of a byte to stand for parity. When the ‘1’ bits are counted, the number will be even or odd. A parity bit is used to ensure that the answer is always even if even parity or odd if odd parity. If the receiving end counts the ‘1’ bits and the sum is not the same odd or even, an error is generated. Ex. 00010000 has an odd number of 1s. In even parity, we would set the parity to 1 so we have an even number of bits. In odd parity, we would set the parity bit to 0 so we have an odd number of ‘1’ bits. Parity is used to detect errors caused by noise in data transmission.

PC

Personal Computer, coined by IBM when it introduced its first IBM PC Jr., which later became PC, XT, AT, 286, 386, 486, Pentium, Pro, MMX Pentium, and latest Pentium II.

Peer to Peer

Two devices that can talk to each other. Both devices can initiate communications. This may also be called Master-to-Master communications.

Profibus

Profibus is actually three buses. Profibus FMS (Field Message Specification), Profibus PA (Process Automation), and Profibus DP (Process Periphery). FMS is a higher level bus intended to operate with PLCs, PCs and higher level nodes. Profibus DP supports three masters. The masters then operate with field nodes as master-to-slaves. Profibus PA is an intrinsically safe bus. The protocol is essentially the same as DP but the electrical / physical specifications are modified to satisfy low voltage and current requirements.

Protocol

A set of rules for communication. This will specify what method to transfer information, packet size, information headers and who should talk when. It is used to coordinate communication activity.

Receive

To accept data sent from another device. The device that receives the data is the receiver.

Register

An area of memory that provides temporary storage of digital data.

RJ11

A connector used on most telephones that has four terminals.

SDS

Smart Distributed System is a CAN based device-level control network that can be scan or event driven, configured as master-slave or peer-to-peer, and can support devices of varying complexity. . Uses twisted pair wires for the power and bus.

Slave

A device that only responds to commands. This device never starts communication on it's own. Only the Master can do this. (See Master)

SCADA

Supervisory Control and Data Acquisition

Serial

To process something in order. First item, second item, etc.

Serial Communications

A method of transmitting information between devices by sending all bits serially (see serial) over a single communication channel.

EIA/TIA-232

(Formerly RS-232) -

An Electronic Industries Association (EIA)/Telecommunication Industry Association (TIA) standard for interface

between data terminal equipment and data communications equipment for serial binary data interchange. This is usually for communications over a short distance (50 feet or less) and to a single device.

EIA/TIA-485 (Formerly RS-485) –

An Electronic Industries Association (EIA)/Telecommunication Industry Association (TIA) standard for electrical characteristics of generators and receivers for use in balanced digital multi-point systems. This is usually used to communicate with multiple devices over a common cable or where distances over 50 feet are required.

Software

Information of data or program stored in an easily changeable format. (RAM, Floppy Disk, Hard Disk)

Space

Represents the transmission of a data bit logic 0 (see logic level). Usually this is the most positive voltage value in serial communications.

Start Bit

A binary bit or logic level that represents when the serial data information is about to start (at the beginning of a character or byte). This voltage level is positive.

Stop Bit

A binary bit or logic level that represents when the serial data information is complete (at the end of a character or byte). This voltage level is negative.

Synchronous

When data is transmitted on a data line and a clock signal is used on another line to determine when to check the data line for a logic level. This clock is said to “synchronize” the data.

TCP/IP

Transmission Control Protocol/Internet Protocol is a software protocol used to send and receive data between different computer systems. Standard protocol used on the Internet.

Transmit

To send data from one device to another. The device that sends the data is the transmitter.

Word

Two bytes make a word. This contains 16 bits.

XON/XOFF

A software protocol that controls the flow of serial information. Sending an XON tells the transmitter to start sending information. An XOFF tells the transmitter to stop sending until the receiver has processed the current information. XOFF = DC3 = Control S = hex 11, XON = DC1 = Control Q = hex 13.

Disclaimer of Warranty

This is a general overview and statement of the safety-related need for and methods of applying "data communications for temperature processes." Because of the diversity of conditions and hazards under which control products may be applied, and because of the differences in components and methods of their installation, no representation or warranty of any kind, express or implied, is hereby made, that the data communications discussed and presented herein will be effective in any particular application or set of circumstances, or that additional or different precautions will not be reasonably necessary for a particular application. We will be pleased to consult with you regarding a specific application upon request.

Trademark Information

Watlow®, Gordon®, Anafaze®, ANASOFT®, ANAWIN®, MICRODIN are trademarks of Watlow Electric Manufacturing Company. Modbus™ is a trademark of AEG Schneider Automation. Windows® and Microsoft® are trademarks of the Microsoft Corporation.

Index

A

922 Comm Diagnostic 21
Appendix 23
ASCII Chart 6
ASCII 5
Audience 4

B

Baud Rate 8
Biasing of Buses 9
Bits and Bytes 5

C

Character Format 5
Comm4 Diagnostic Software 21
Comm5vb Diagnostic Software 21
Computer Languages 8
Controller Comparison Summary 22
Convention 4
CRC 21

D

Disclaimer of Warranty 28

E

Elements of Machine to Machine
Comm. 5

G

Getting Started 4
Glossary 23

I

Interface Adapters 20
Interface Comparison 22
Interface Converters 10
Interface Standards 9

M

Media 4

P

Parity Bits 7
Protocols 10
Purchase an HMI package 18
Purpose 4

S

Serial Communication 7
Start and Stop Bits 8
Syntax 8

W

Watlow Software Tools 20
Wiring 9
Write Your Own (HMI) 12

How to Reach Us



Quality and Mission Statement:

Watlow Controls will be the world's best supplier of industrial temperature control products, services and systems by exceeding our customers', employees' and shareholders' expectations.

Contact

Your Authorized Watlow Distributor:

- Phone: (507) 454-5300.
- Fax: (507) 452-4507.
- For technical support, ask for an Applications Engineer.
- To place an order, ask for Customer Service.
- To discuss a custom option, ask for a Product Manager.

Warranty

Most Watlow Controls are warranted to be free of defects in material and workmanship for 36 months after delivery to the first purchaser for use, providing that the units have not been misapplied. Since Watlow has no control over their use, and sometimes misuse, we cannot guarantee against failure. Watlow's obligations hereunder, at Watlow's option, are limited to replacement, repair or refund of purchase price, and parts which upon examination prove to be defective within the warranty period specified. This warranty does not apply to damage resulting from transportation, alteration, misuse or abuse.

Returns

- Call or fax Customer Service for a Return Material Authorization (RMA) number before returning a controller.
- Put the RMA number on the shipping label, and also on a written description of the problem.
- A restocking charge of 20% of the net price is charged for all standard units returned to stock.

Watlow Controls Communications Guide

Watlow Controls, 1241 Bundy Blvd., P.O. Box 5580, Winona, Minnesota USA 55987-5580,
Phone: (507) 454-5300, Fax: (507) 452-4507