

INSTALLATION

10-175UL

Power Supply



In or Out... we make it Easy!

10-175UL

Access Control Power Supply/Charger

Installation and Specifications Manual

Overview

The 10-175UL is a power limited power supply/charger that will convert 115VAC / 60Hz input, into two individually PTC protected 12VDC or 24VDC output, (see specifications). They are intended for use in applications requiring UL Listing for Access Control (UL294) and applications requiring an interface with Fire Alarm Control Panels. It must be installed in accordance with National and Local Electrical Codes and Regulations.

Specifications

- UL listed Access Control (UL294)
- CSFM approved - California State Fire Marshal
- MEA approved - NYC Dept. of Buildings 18-98-E
- NFPA 101 (Life Safety)
- Input 115VAC/60 Hz, .6 amps
- Switch selectable 12VDC or 24VDC power limited output
- 1.75 amps continuous supply current @ 12VDC or 24VDC
- Latching fire alarm tie-in with manual reset
- Filtered and electronically regulated output
- Charge current: 0.4 amps Max
- Aux relay output: (form "C", 1 amp, 28VDC)
- AC Fail output relay (form "C" 1 amp, 28VDC)
- Enclosure Dimensions: 15.5"H x 12"W x 4.5"D

Output Specifications

Output VDC	Switch Position	Max. Stand-by Load DC	Max. Alarm Load DC	Battery (Optional)
12VDC	SW1 Open	1.75 amps	1.75 amps	12VDC
24VDC	SW1 Open	1.75 amps	1.75amps	24VDC

Stand-By Specifications

Output	4Hr. of Stand-by & 5 minutes of alarm
12VDC / 7 AH Battery	Stand-by = 1.25 amps
24VDC / 7 AH Battery	Alarm = 1.25 amps

Installation Instructions

The 10-175UL should be installed in accordance with article 760 of The National Electrical Code or NFPA 72 as well as all applicable Local Codes.

See Terminal Identification Chart on page 4 for a description of each terminal function.

1. Mount the 10-175UL in desired location.
2. Connect AC power (115VAC 60Hz) to the black and white flying leads of the transformer. Secure green wire lead to earth ground. Use 18 AWG or larger for all power connections (Battery, DC output). Use 22 AWG to 18 AWG for power limited circuits (trigger inputs, dry outputs).
Keep power limited wiring separate from non-power limited wiring (115VAC/ 60Hz Input, Battery Wires). Minimum .25" (6.4mm) spacing must be provided.
3. Set the 10-175UL to the desired DC output voltage by setting switch SW1 to the appropriate position (power supply output specification table).
Note: It is good operating practice to measure and verify output voltage before connecting devices to ensure proper operation of equipment.
4. Connect battery to terminals marked [+ BAT -] (battery leads included). Use two (2) 12VDC batteries connected in series for 24VDC operation.
Note: For Access Control applications, batteries are optional. When batteries are not used a loss of AC will result in the loss of output voltage. When the use of stand-by batteries are desired, they must be lead acid or gel type.
5. Connect appropriate signaling notification devices to AC Fail supervisory relay outputs marked [N.C., N.O., C].
Note: To meet UL requirements, AC Supervisory outputs must be connected to the zone of Alarm Control Panel or to visual AC trouble indicator.
6. For Access Control Device & Fire Alarm Interface connections refer to desired Application Diagrams (pg. 6-8) and Terminal Identification Chart

Maintenance

Unit should be tested at least once a year for the proper operation as follows:

Output Voltage Test: Under normal load conditions, the DC output voltage should be checked for proper voltage level (see power supply output specifications chart).

Battery Test: Under normal load conditions check that the battery is fully charged, check specified voltage both at battery terminal and at the board terminals marked [- BAT +] to insure there is no break in the battery connection wires.

Note: Maximum charging current under discharges is 0.40 amps.


Note: Expected battery life is 5 years, however it is recommended changing batteries in 4 years or less if needed.

Terminal / Switch Identification:

Terminal Legend	Function/Description
TRG1 & TRG2	These input terminals are designed to connect to the normally closed outputs of an access control or fire alarm relay. These terminals control [LOCK+], and [STRIKE+], as well as 10-175UL output relay contacts [N.C., N.O., C]
LOCK+	This terminal provides DC output voltage when [TRG1] and [TRG2] are shorted together and are typically used to power Mag Locks.
STRIKE+	This terminal provides DC output voltage when [TRG1] and [TRG2] are unshorted and are typically used to power Electric Strikes.
N.C., N.O., C	Isolated dry Form "C" contacts. Shorting [TRG1] and [TRG2] together causes these contacts to switch. They are typically used for controlling multiple 10-175ULs with fire alarm tie-in (Fig. 4 and Fig. 5, pg. 7-8).
AUX+	Continuous positive (+) DC power output voltage. It is not affected by TRG1, TRG2 operation.
COM –	Common negative (-) output (ground).
FACP	Spare wiring terminal used for fire alarm tie-in application (Fig. 1, pg. 6).
BAT+, BAT –	Stand-by battery connections.
SW2	Momentary reset button (on front door) is used as a manual power supply reset after fire alarm system is restored.

LED Diagnostics

RED(DC)	Green (AC) (Front Door)	Power Supply Status
ON	ON	Normal Function
ON	OFF	Battery backup is powering output
OFF	ON	No DC output
OFF	OFF	Loss of AC. Discharged or missing stand-by battery. No DC output.

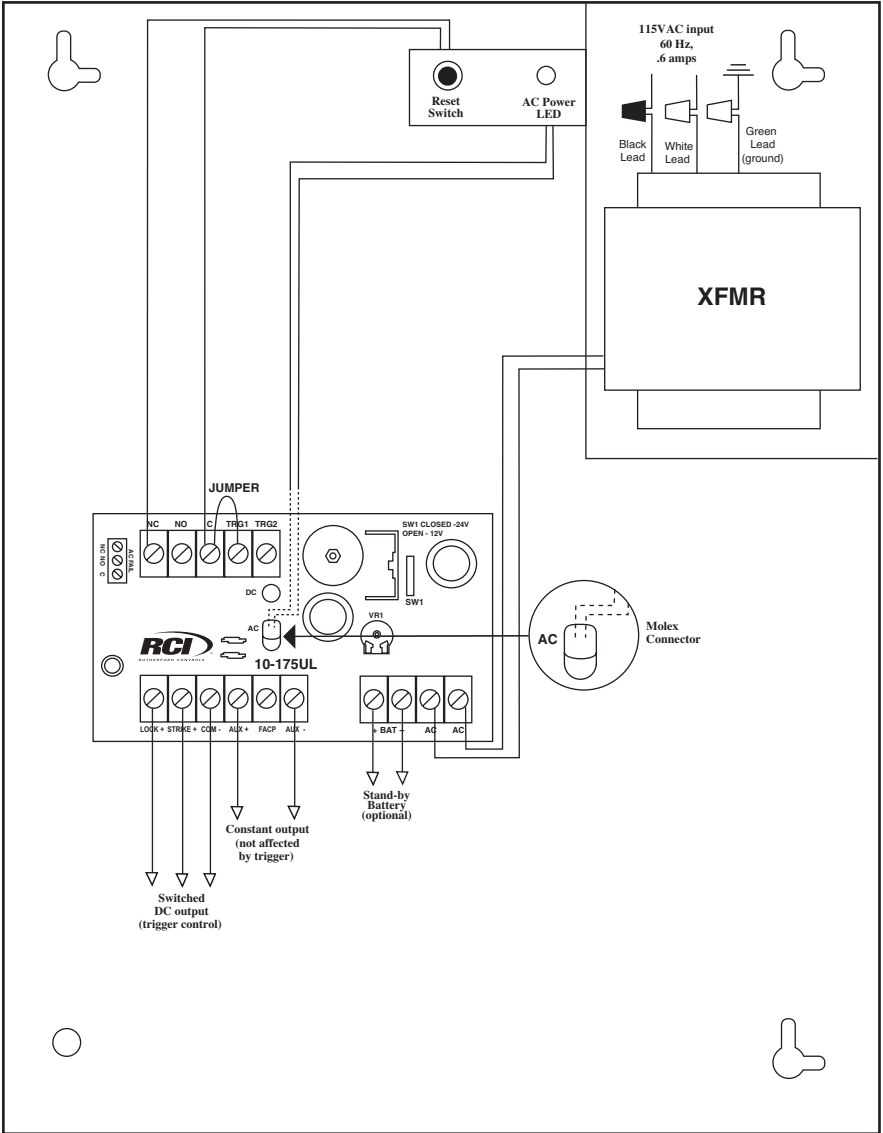

Enclosure Dimensions

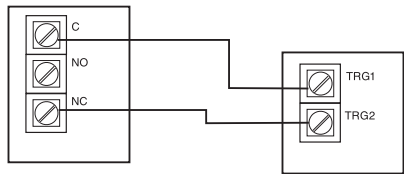
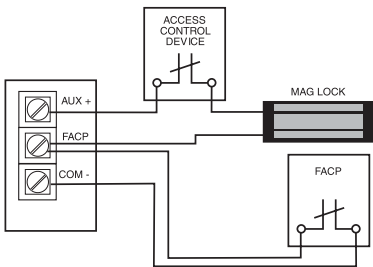
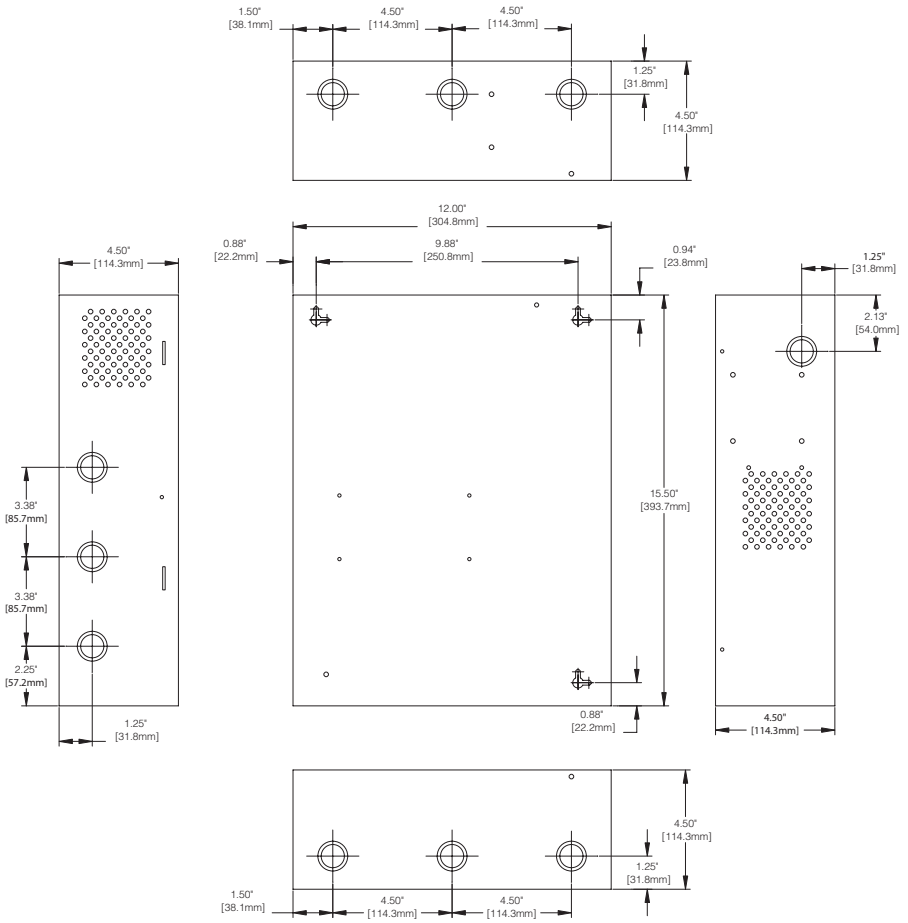


FIG 1. Typical mag lock with fire alarm tie-in using aux output installation.

FIG 2. Multiple 10-175 power supply connections.

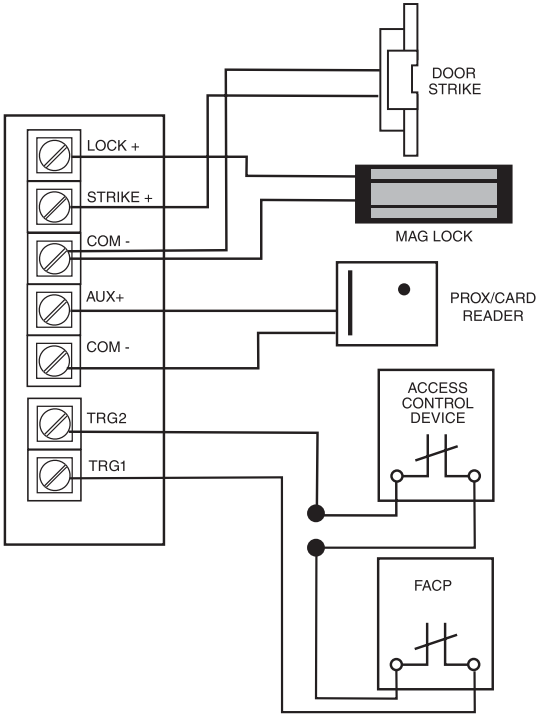


FIG 3. Typical Single Mag lock or door strike installation with fire alarm tie-in using trigger controlled output.


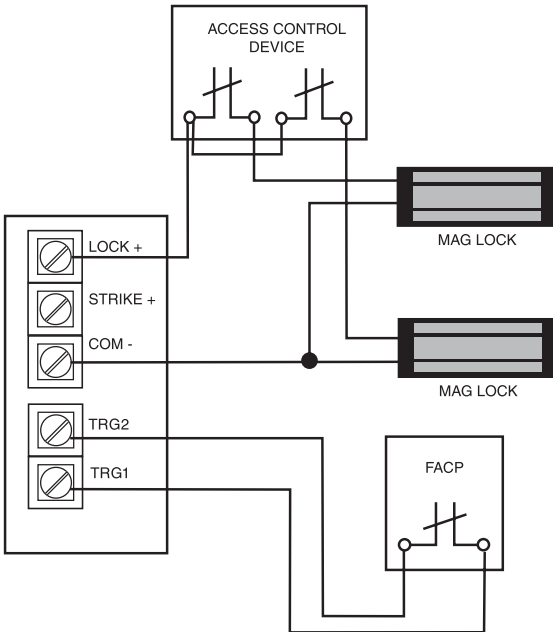


FIG 4. Typical dual mag lock installation with fire alarm tie-in using trigger controlled outputs.

FIG 5. Latching fire alarm tie-in with manual reset.

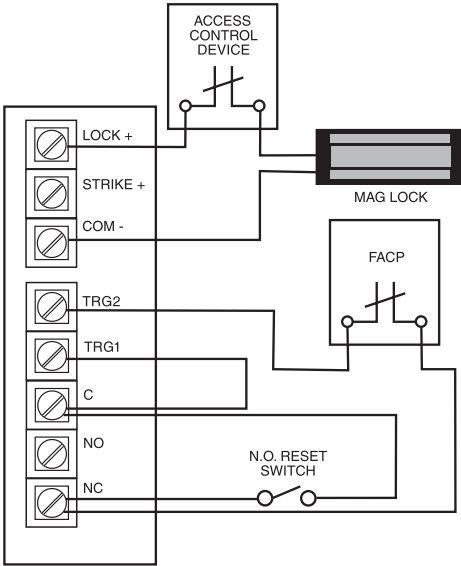

Troubleshooting Guide

Problem	Solution
No DC output from terminals.	<ul style="list-style-type: none"> - Check AC and DC LED's on power supply board. Both should be on for proper operation AC ON –GREEN, Trouble: Normal – AMBER, DC ON - RED. - If LED's are not on, check AC power.
Output voltage is not correct for the connected equipment.	<ul style="list-style-type: none"> - Disconnect AC power, battery(s) and all connected equipment IMMEDIATELY. - Change voltage selection switch to desired voltage. - Reconnect equipment and reapply AC power.
Trouble output relay is de-energized. (Relay terminals are labeled shown in the Normal, energized, "no trouble" condition. Relays are energized when no trouble is detected.	-Check battery voltage.

For Technical Support:

1-800-265-6630 or 519-621-7651 www.rutherfordcontrols.com

© 2007 RUTHERFORD CONTROLS INT'L CORP. • WWW.RUTHERFORDCONTROLS.COM

USA: 2697 INTERNATIONAL PKWY, PARKWAY 5, VIRGINIA BEACH, VA 23452

CANADA: 210 SHEARSON CRESCENT, CAMBRIDGE, ON N1T 1J6

PHONE: 1.800.265.6630 • 519.621.7651 • FAX: 519.621.7939 • E-MAIL: SALES@RUTHERFORDCONTROLS.COM