




GE Appliances

## WSM2480T—GE Unitized Spacemaker® Compact Capacity Gas Washer and Dryer

Dimensions (in inches)

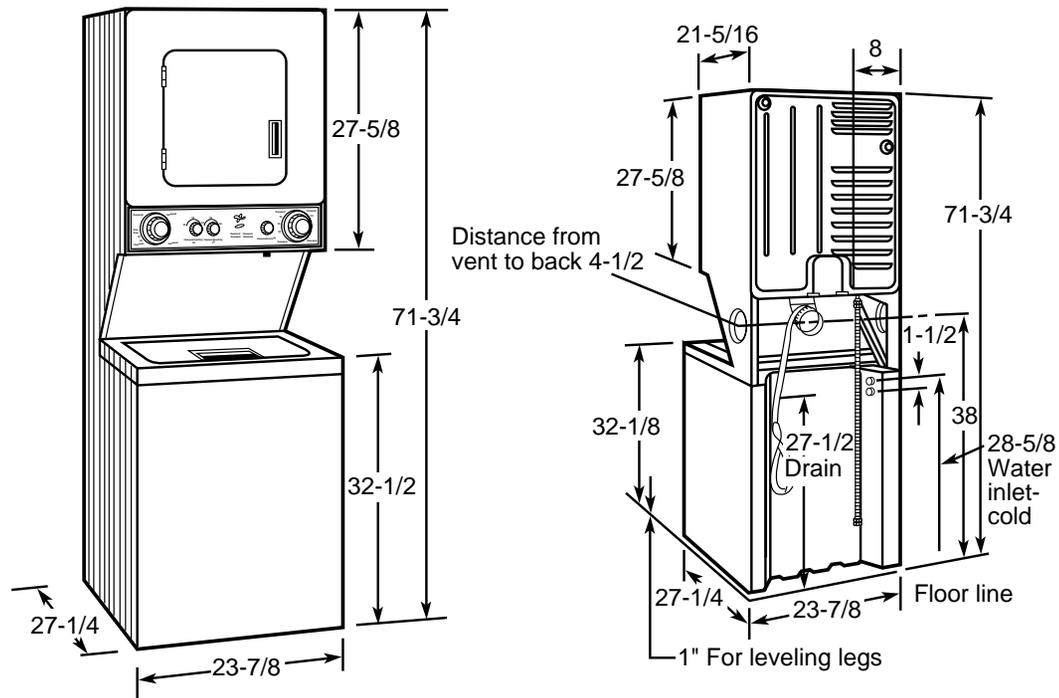

**Gas Requirements:** WSM2480T Gas Dryer—This appliance should be connected to an individual, properly-grounded branch circuit with a three-prong grounding-type receptacle and 120-volt single-phase 60 Hz electrical service and should be protected by 15 or 20-amp time-delay fuses or circuit breakers. Gas rated input 10,500 BTU/HR. Factory equipped for natural gas. Tested for LP gas.

**Gas Requirements:** WSM2480T. **LP gas supply requires a conversion kit.** Have a qualified gas technician install a conversion kit before use.

**Exhaust Information:** Exhausting the dryer to the outside is strongly recommended to prevent large amounts of moisture and lint from being blown into the room. Closet installations **must** be exhausted to the outside.

**Installation Information:** For complete information, see installation instructions packed with the product.

Revised 11/98

For answers to your Monogram®,  
GE Profile Performance Series™,  
GE Profile™ or GE appliance questions, call  
GE Answer Center® service, 800.626.2000.




Listed by  
Underwriters  
Laboratories





GE Appliances

## WSM2480T—GE Unitized Spacemaker® Compact Capacity Gas Washer and Dryer



Domestic Dryer Models	Best Performance				
	Number of 90° Turns	Exhaust Hood Type		Exhaust Hood Type	
		Cat. No. WX8X59 (Preferred) A 4" Opening	B 2-1/2" Opening	Cat. No. WX8X59 (Preferred) A 4" Opening	B 2-1/2" Opening
Spacemaker® Models DSKS433ET WSM2780T	0 1 2 3	46 ft. 38 ft. 31 ft. 24 ft.	37 ft. 30 ft. 22 ft. 15 ft.	30 ft. 25 ft. 20 ft. 16 ft.	24 ft. 20 ft. 14 ft. 10 ft.
Spacemaker® Model DSKP233ET	0 1 3	43 ft. 33 ft. 23 ft.	36 ft. 26 ft. 16 ft.	30 ft. 24 ft. 16 ft.	24 ft. 18 ft. 10 ft.
Spacemaker® Model WSM2700T	0 1 2 3	56 ft. 46 ft. 34 ft. 32 ft.	42 ft. 36 ft. 28 ft. 18 ft.	30 ft. 22 ft. 16 ft. 10 ft.	22 ft. 14 ft. 10 ft. 5 ft.
Spacemaker® Models WSM2420T WSM2480T	0 1 2	43 ft. 33 ft. 23 ft.	36 ft. 26 ft. 16 ft.	30 ft. 24 ft. 16 ft.	24 ft. 18 ft. 10 ft.

For complete information, see installation instructions packed with your dryer.

### Ducting Materials:

For best performance, this dryer should be vented with 4" diameter all rigid metal exhaust duct. If "all rigid metal" duct cannot be used, then "flexible all metal" venting can be used, but it will reduce the maximum recommended duct length.

### Exhaust Length Calculation:

1. Determine the number of 90° turns needed for your installation. If you exhaust to the side or bottom of dryer, add one turn.

2. The maximum length of 4" rigid (aluminum or galvanized) duct which can be tolerated is shown in the table. The maximum length for flexible ducts are less than for rigid duct.

A turn of 45° or less may be ignored. Two 45° turns within the duct length should be treated as a 90° elbow. A turn over 45° should be treated as a 90° elbow.

**Exhausting the dryer to the outside is strongly recommended** to prevent large amounts of moisture and lint from being blown into the room. Gas dryers or any dryer located in a closet **must** be exhausted to the outside.

**Caution:** For personal safety do not terminate exhaust into a chimney, under any enclosed house floor (crawl space), or into an attic, since the accumulated lint could create a fire hazard or moisture could cause damage. Never terminate the exhaust into a common duct or plenum with a kitchen exhaust, since the combination of lint and grease could create a fire hazard.

Exhaust ducts should be terminated in a dampered wall cap to prevent back drafts, bird nesting, etc. The wall cap must also be located at least 12" above the ground or any other obstruction with the opening pointed down. Other terminations, such as louvered wall boxes, are acceptable provided they are equivalent to a 4" opening dampered wall cap.

### Special Installation Requirements

#### Alcove or Closet Installation:

- If your dryer is approved for installation in an alcove or closet, it will be stated on a label on the dryer back.
- The dryer **MUST** be exhausted to the outside.
- Minimum clearances between dryer cabinet and adjacent walls or other surfaces are:
  - 0" either side
  - 3" front and rear
- Minimum vertical space from floor to overhead cabinets, ceilings, etc. is 52".
- Closet doors must be louvered or otherwise ventilated and must contain a minimum of 60 sq. in. of open area equally distributed. If this closet contains both a washer and a dryer, doors must contain a minimum of 120 sq. in. of open area equally distributed.
- The closet should be vented to the outdoors to prevent gas pocketing in case of a gas leak in the supply line.
- No other fuel-burning appliance shall be installed in the same closet with the dryer.

#### Bathroom or Bedroom Installation:

- The dryer **MUST** be exhausted to the outdoors.
- The installation must conform with the local codes, or in the absence of local codes, with the National Fuel Gas Code, ANSI Z223.

#### Minimum Clearances other than Alcove or Closet Installation:

- Minimum clearances to combustible surfaces
  - 0" both sides
  - 3" rear

For answers to your Monogram®, GE Profile Performance Series™, GE Profile™ or GE appliance questions, call GE Answer Center® service, 800.626.2000.




Listed by Underwriters Laboratories





*GE Appliances*

## ***WSM2480T—GE Unitized Spacemaker® Compact Capacity Gas Washer and Dryer***

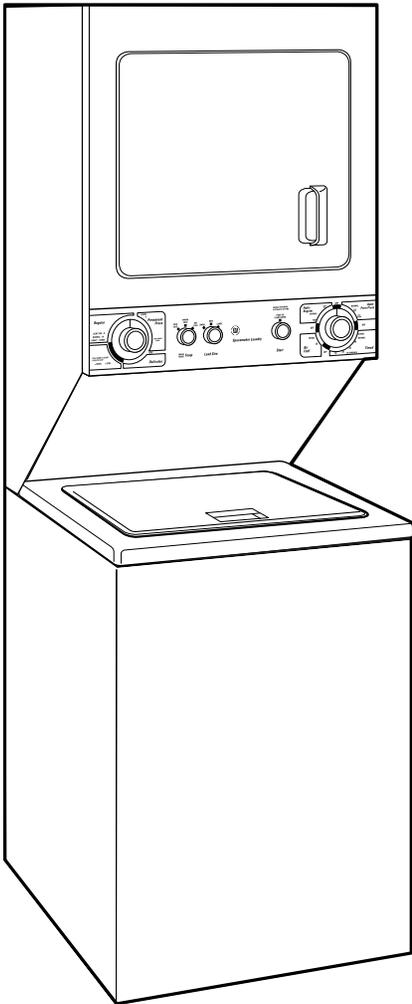

### ***Features and Benefits***

- 24" Wide
- Compact Capacity Washer
- Washer Features:
  - 3 Cycles: Regular, Permanent Press and Delicate
  - 3 Wash/Rinse Temperatures
  - 3 Water Levels
  - 2 Wash/Spin Speed Combinations
- Gas Dryer Features:
  - Automatic Dry Control
  - 4 Cycles: Automatic Regular, Automatic Permanent Press, Timed Dry, and Air Fluff
- Available In White on white
- Electric Dryer Model Available as WSM2420T