

# Operating instructions

## SINEAX VQ604s Programmable multifunctional transmitter with very fast setting times



VQ604s Be

Version 00

02.12

Camille Bauer AG  
Aargauerstrasse 7  
CH-5610 Wohlen/Switzerland  
Phone +41 56 618 21 11  
Fax +41 56 618 21 21  
[info@camillebauer.com](mailto:info@camillebauer.com)  
[www.camillebauer.com](http://www.camillebauer.com)

 CAMEILLE BAUER

# Operating instructions

## Programmable multifunctional transmitter SINEAX VQ604s

### First read, then ...



The unobjectionable and safe operation presupposes that these operating instructions have been read and understood!



Devices may only be disposed of in a professional manner!

### Contents

1. Functional description .....	2
2. Connection to a PC and communication via CB-Manager .....	2
3. Block diagram.....	3
4. Technical data.....	4
5. Signal flow .....	8
6. Modbus interface.....	9
6.1 EIA-RS-485 Standard.....	9
6.2 Coding and addressing .....	9
6.3 Mapping .....	10
6.4 Device identification .....	10
6.5 Measured values .....	11
6.6 Configuration parameters.....	12
7. Electric connections .....	18
8. Dimensional drawing .....	20
9. Accessories .....	20
10. Conformity declaration .....	20

### 1. Functional description

VQ604s is a multifunctional transmitter for top-hat rail assembly with the following main characteristics:


- Fast measurement of DC voltage, DC current, temperature (RTD, TC) and resistance
- Setting time up to 10 ms
- Sensor connection without any external jumpers
- 2 inputs (e.g. for sensor redundancy or difference formation)
- 2 outputs (I)
- 2 inputs can be linked with each other and allocated to the 2 outputs which enables calculations and sensor monitoring (e.g. prognostic maintenance of sensors)
- System capability: Communication via Modbus interface
- Freely programmable relay, e.g. for limit or alarm signalling
- AC/DC wide-range power supply unit
- Pluggable high-quality screw terminals

All settings of the instrument can be adapted to the measuring task by PC software. The software also serves visualising, commissioning and service.

### 2. Connection of SINEAX VQ604s to a PC and communication via CB-Manager.

VQ604s communicates with a PC (CB-Manager) via an RS 232/RS485 interface and a MODBUS protocol.


Select the following settings in this respect:

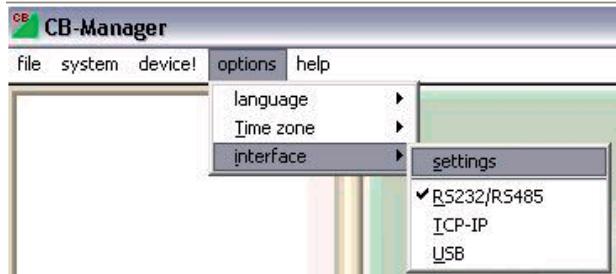

Select the RS 232/ RS485 interface under Options / Interface.

This is also applicable if an RS485/USB converter is used and the converter is connected to the computer via the USB connection.

Subsequently, enter the following settings under Options / Interface / Settings:

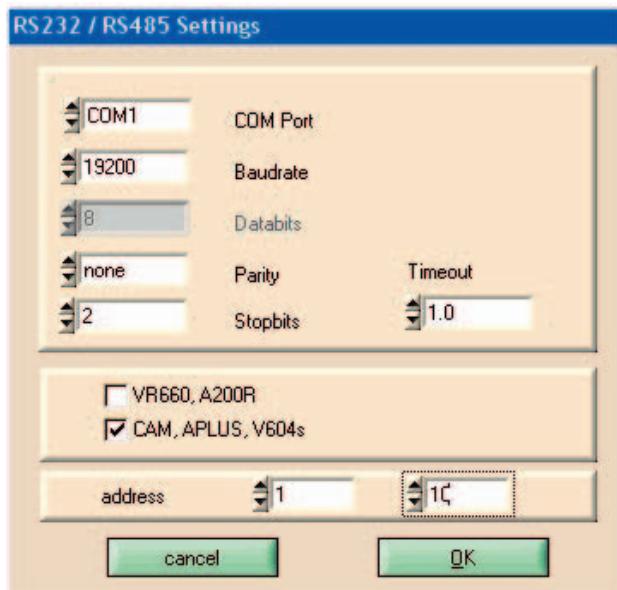


The existing COM ports are determined as the communication interface when starting the program and selecting RS232/RS485. Only COM ports found are available for selection.

Limiting the range of possible device addresses speeds up the search of connected devices considerably.  
Example: If only 2 devices are connected, it makes sense to select the address range from 1 to 2.

All settings are stored as the program is terminated. If the COM port is not available upon the next start of the program (e.g. because the converter has not been plugged in) another valid interface is set.

**To determine which COM port has been allocated to the RS485 converter (if required), please proceed as follows:**

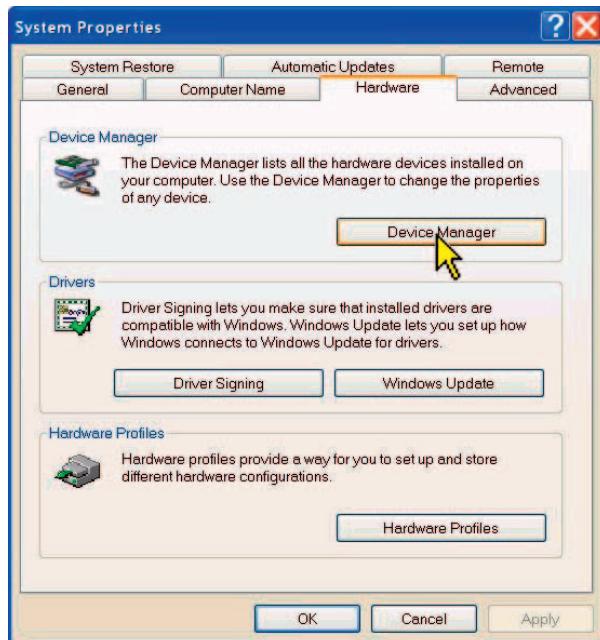

The COM port of an external RS232 or RS485 converter may be determined (and, if required, changed) via the Windows system control.


Example for Windows XP: **System control => System**




This example shows the COM ports of a PCMCIA card and a USB-RS232 converter:

- Silicom Serial Card: COM1
- USB-RS232 adapter: COM4

If you use the Camille Bauer USB-RS485 converter (Article Number 163189), the same is to be connected as follows:

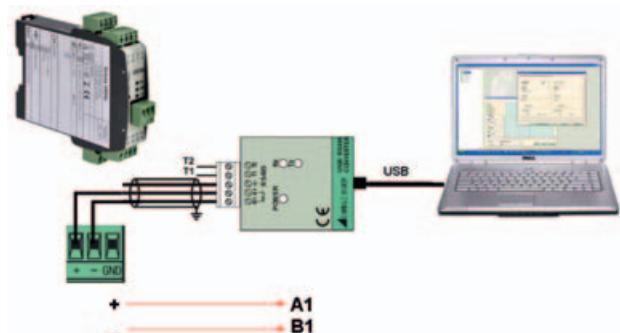

### 3. Block diagram

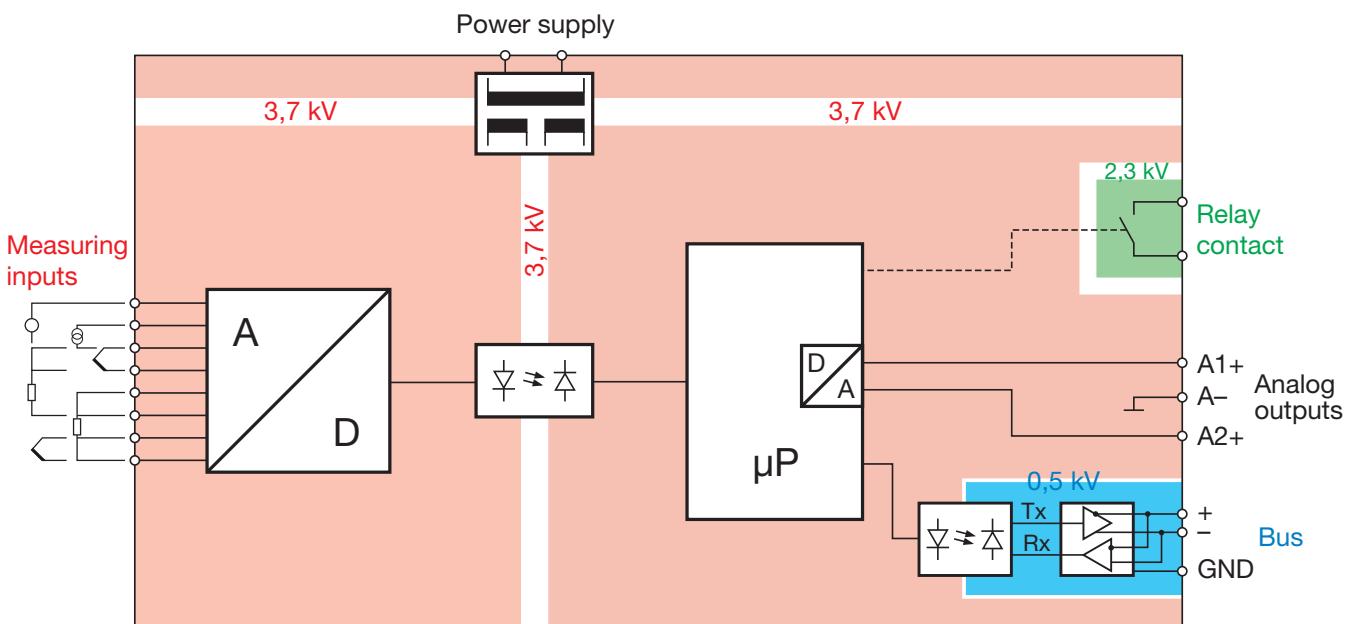



## Transmission behaviour

Measured variables  
for the outputs

- Input 1
  - Input 2
  - Input 1 + Input 2
  - Input 1 – Input 2
  - Input 2 – Input 1
  - Input 1 · Input 2
  - Minimum value, maximum value  
or mean value of Input 1  
and Input 2
  - Sensor redundancy  
Input 1 or Input 2
- Transmission function Linear,  
user-specific via  
basic value table  
(24 basic values per measured  
variable)
- Settling time:  
Adjustable 0.01...30 s,  
depending on the device configura-  
tion

Type of measurement	Error monitoring	Minimum setting time [ms]	
		Frequency 50 Hz	Frequency 1000 Hz
Voltage [mV]		48	10
Current [mA]		48	10
Thermocouple internally compensated	Breakage	249	97
Resistance [ $\Omega$ ] 2L	Breakage Short circuit	137	23
Resistance [ $\Omega$ ] 3L, WF, WF-DIN	Breakage Short circuit	338	110
Resistance [ $\Omega$ ] 4L	Breakage Short circuit	296	106

Using the CB-Manager configuration software (part of the scope of delivery) the minimum setting time can be calculated with any possible configuration and frequency.

## Line frequency suppression


Line hum which is superimposed on the signal can be attenuated by a filter. The device performs a line frequency suppression. For this purpose, the line frequency must be entered.

The suppression works on the frequency ( $f_{sys}$ ) and its multiples (i.e. 1x, 2x, 3x, ...Nx- $f_{sys}$ ).

The set frequency is simultaneously the scanning frequency of the internal A/D converter and thus also has an influence on the setting time. (See specified time/setting time).

## Specified time/setting time

The setting time ( $t_{99\%}$ ) is provided for the respective parameter and is applicable to both inputs. The longer this time is, the better the filtration of measuring fluctuations can be effected.

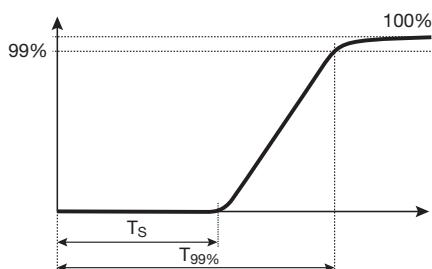

The minimum setting time depends on the following settings:

- Number of active inputs
- Type of measurement
- Selected (line) frequency (line hum suppression)
- Sensor error monitoring (breakage, short circuit)

The following table shows the minimum setting times with an active measuring input und a frequency of e.g. 50Hz or 1000Hz set at the device:

## Limit values and monitoring

Number of limit values 2

Measured variables for limit values

- Input 1
- Input 2
- Measured variable for outputs
- Input 1 – Input 2  
(e.g. drift monitoring in case of 2 sensors)
- Input 2 – Input 1  
(e.g. drift monitoring in case of 2 sensors)

Functions

Absolute amount  
Gradient  $dx/dt$  (e.g. temperature gradient monitoring)

Time delay Adjustable 0...3600 s

Signaling Relay contact, alarm LED, Status 1

## Sensor breakage and short circuit monitoring measuring input

Signalling Relay contact, alarm LED, Status 1  
Output value in case of a fault

## Other monitoring operations

Drift monitoring

Monitoring of measured value between 2 input sensors for a certain period of time (e.g. due to different sensor response times). If this time is exceeded, an alarm is signalled.  
(See Limit values 1 and 2)

Sensor redundancy

Measurement with 2 temperature sensors; if Sensor 1 fails (fault) Sensor 2 is activated for bridging (see measuring variable for outputs).

## Alarm signalling

Relay contact	With closed contact, the yellow LED shines, invertible
Alarm LED	
Time delay	Adjustable 0...60 s
Output value in case of a fault	For sensor breakage and short circuit, value adjustable -10...110%

## Power supply

Rated voltage UN	Tolerance
24...230 V DC *	±15%
100...230 V AC, 45...400 Hz	±15%

\* In case of a power supply voltage >125 V DC, the power supply circuit must contain an external fuse.

Power consumption <3 W or 7 VA

## Displays at the instrument

LED	Color	Function
ON	green	Power on
	green flashing	Communication activ
ERR	red	Alarm
—	yellow	Relay on

## Configuration, programming

Operation with PC software «CB-Manager»

## Accuracies (according to EN/IEC 60770-1)

### Reference conditions

Ambient temperature	23 °C ± 2 K
Power supply	24 V DC
Reference value	Span
Settings	Input 1: Direct voltage mV, 0...1000 mV Output 1: 4...20 mA, burden resistance 300 Ω Mains frequency 50 Hz, Setting time 50 ms Input 2, output 2, relay, monitoring off or not active
Installation position:	Vertically, detached

### Basic accuracy

At reference conditions ±0.2%

Other types of measurement and input ranges:

RTD Pt100, Ni100	±0.2% ±0.3 K
Resistance measurement	±0.2% ±0.1 Ω
TC Type K, E, J, T, N, L, U	±0.2% ±0.4 K, measurement value > -100 °C
TC Type R, S	±0.2% ±2.4 K
TC Type B	±0.2% ±2.4 K, measurement value > 300°C
TC W5Re-W26Re, W3Re-W25Re	±0.2% ±2.0 K
DC voltage mV	±0.2% ±0.015 mV
DC current mA	±0.2% ±0.0015 mA

## Additional error (additive)

High range minimum value (Minimum value >40% of maximum value):	±0.2% of maximum value
Small output range	±0.2% * (reference range / new range)
Cold junction compensation internal	typical ±3 to 5 K
Mains frequency >50 Hz	in resistance measurement and RTD: ±0.05 %

## Influencing factors

Ambient temperature	±0.2% per 10 K at reference con- ditions other settings: basic accuracy and additional errors per 10 K
Long-term drift	±0.1%
Common mode/ series mode influence	±0.2%

## Ambient conditions

Operating temperature	-25 ... +55 °C
Storage temperature	-40 ... +70 °C
Relative humidity	≤75%, no dew
Range of utilisation	Internal room up to 2000m above sea level

## Installation details

Design	Top-hat rail housing U4 Combustibility class V-0 according to UL 94
Dimensions	See dimensional drawing
Assembly	For snap-on fastening on top-hat rail (35 x 15 mm or 35 x 7.5 mm) according to EN 50 022
Terminals	Pluggable, 2.5 mm <sup>2</sup>
Weight	0.14 kg

## Product safety, regulations

Electromagnetic compatibility	EN 61 000-6-2 / 61 000-6-4
Ingress protection (acc. IEC 529 or EN 60 529)	Housing IP 40 terminal IP20
Electric design	Acc. IEC or EN 61 010
Degree of pollution	2
Between power supply and all circuits and between the measuring input (1 + 2) and all circuits	Reinforced insulation overvoltage category III Working voltage 300 V Test voltage 3.7 kV AC rms
Between output (1 + 2) and relay contact	Reinforced insulation overvoltage category II Working voltage 300 V Test voltage 2.3 kV AC rms
Between output (1 + 2) and the bus connection	Functional insulation Working voltage <50 V Test voltage 0.5 kV AC rms
Environmental tests	EN 60 068-2-1/-2/-3 EN 60 068-2-27 Shock: 50g, 11ms, sawtooth, half-sine EN 60 068-2-6 Vibration: 0.15mm/2g, 10...150Hz, 10 cycles

## Type label


<b>Sineax VQ604s</b>		Camille Bauer AG Switzerland
Schneller Universalmessumformer Universal highspeed converter		Man: 12 / 7 NLB: XXXX
Ord: 999/123456/999/001		
 		
 +   -  24...230VDC / 100...230VAC 45-400Hz, 5VA		
 INPUT 1: 4...20mA      INPUT 2: 4...20mA		
 5+  4-  6+  4-		
 OUTPUT		
 +   -   +  OUT1:4...20mA  +   -   GND OUT2:4...20mA		
 RS485 Modbus		
 9  13 NO, 250VAC/2A, 30VDC/2A		

## Explanation of symbols on the type label

Symbol	Meaning
	Double insulation, device of protection class 2
	CE conformity mark. The device fulfills the requirements of the applicable EG directives
	Caution! General hazard point. Read the operating instructions.
	The instruments must be only be disposed of in the correct way!
	General symbol: Input
	General symbol: Output
	General symbol: Power supply
	General symbol: Communication
	General symbol: Relay

## 5.5 Signal flow

The following diagram shows the VQ604s signal flow. All relevant measured variables and parameters determining the signal flow are represented.

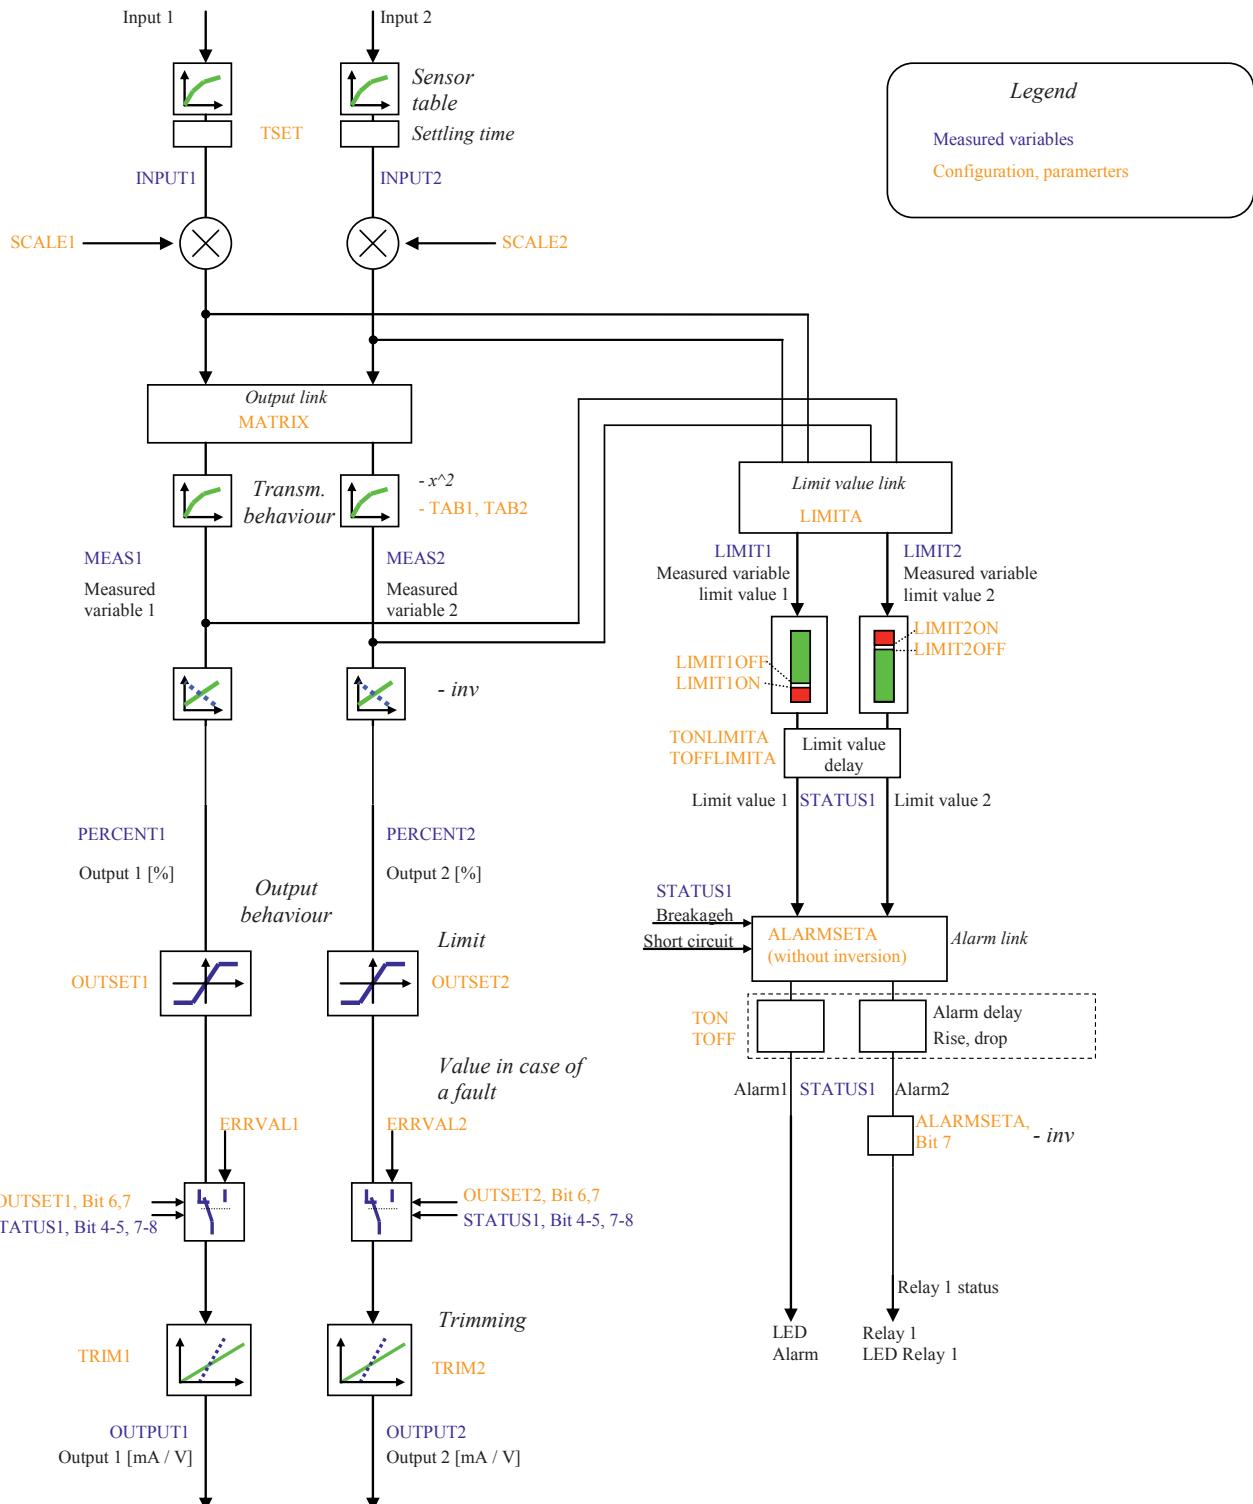

## 6. Modbus interface

### 6.1 EIA-RS-485 Standard


The EIA-RS-485 standard defines the physical layer of the Modbus interface.

#### Coding


The data is transmitted in serial form via the 2-wire bus. The information is coded as a difference signal in the NRZ code. Positive polarity signals a logic 1, negative polarity signals the logic 0.

#### Connections

A shielded, twisted, 2-conductor cable should be used as a bus cable. Shielding serves improved electromagnetic compatibility (EMC). Depending on the source of information, the description of Conductor A and B is contradictory.



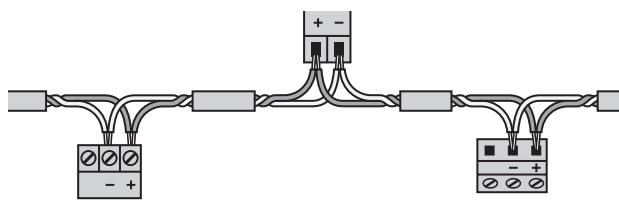


The potential difference of all bus participants may not exceed  $\pm 7V$ . Therefore, the use of a shield or a third conductor (ref line) is recommended to create potential equalisation.



#### Topology

Both ends of the bus cable must be equipped with a line terminator. Supplementing the line termination resistance  $R_T$  of the EIA-RS-485 standard an additional resistance  $R_U$  (pullup) must be wired against the supply voltage and a resistance  $R_D$  (pulldown) against the reference potential. These two resistances ensure a defined idle potential on the line when none of the participants is sending.

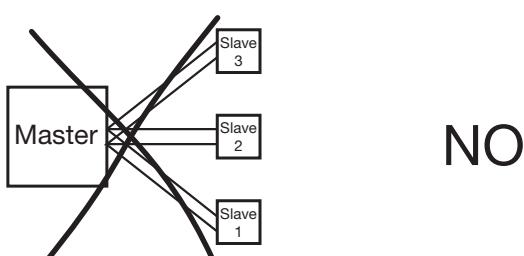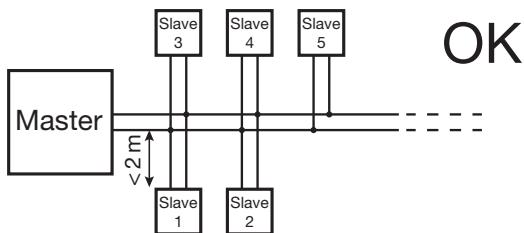

#### System requirements

Cable:	Twisted, 2-wire line, wave resistance 100 to 130 $\Omega$ , min. 0.22mm <sup>2</sup> (24AWG)
Line length:	Maximum 1'200m depending on the transmission rate
Participants:	Maximum 32 per segment
Rate:	9'600, 14'400, 19'200, 38'400, 56'000, 57'600, 115'200 Baud
Mode:	11 bit format - 2 stop bit without parity or 1 stop bit with even/uneven parity

### 6.2 Coding and addressing

#### Addressing


In the telegram, all data addresses refer to zero. The first data element is always addressed via the 0 address. For example, the coil which is known as "Coil 1" in the device, is addressed as "Coil 0" in the telegram. Coil 127 is addressed as 0x007E.

Holding register 40001 is addressed as Register 0 in the telegram. The function code of the telegram already states that a "holding register" is concerned. Consequently, the reference to "4XXXX" is implicit.

Holding register 40108 is addressed as 0x006B (107 decimal).

#### Serialisation

The specification defines the telegrams as byte sequences. The respective physical layer (RS485, Ethernet) is responsible for the correct serialisation of the bytes (MSB or LSB First). RS485 (UART, COM) transmits the "Least Significant Bit" first (LSB First) and adds the synchronisation and backup bits (start bit, parity bit and stop bit).



#### Bits

Bits are represented within a byte in a conventional manner with the MSB (Bit 7) leftmost and the LSB (Bit 0) rightmost ( $0101'1010 = 0x5A = 90$ ). An example for the inquiry of Coils 20 to 40 of Slaves 17.

Byte	Inquiry		Response
0	Slave address	0x11	Slave address
1	Function code	0x01	Function code
2	Start address	0x00	Byte count
3	19 = Coil 20	0x13	Byte 0
4	Number	0x00	Byte 1
5	20...40 = 21	0x15	Byte 2

The start address in the inquiry plus the bit position in response byte 0 corresponds to the coil address. Commenced bytes are completed with zeros. Coil 27...20 = 0xCD = 11001101b  $\rightarrow$  Coil20 = ON, Coil21 = OFF, Coil22 = ON, etc.

#### Bytes

Modbus does not know a byte or character data type (see address space). Strings or byte arrays are mapped in "holding registers" (2 characters per register) and transmitted as a "character stream", e.g. "Hello\_World".


Register	HEX	char	Register	HEX	char
40101	0x4865	,H', ,e'	40104	0x576F	,W', ,o'
40102	0x6C6C	,l', ,l'	40105	0x726C	,r', ,l'
40103	0x6F5F	,o', ,_'	40106	0x6400	,d'

## Words

Registers or words are transmitted according to specification in "Big Endian" format, e.g. Read Holding Register 40101 of Slave 17.

## Real

Modbus does not know any data types to represent floating point numbers. On principle, any data structures may be mapped on the 16Bit register ("cast"). The IEEE 754 standard is the most used standard to represent floating point numbers.

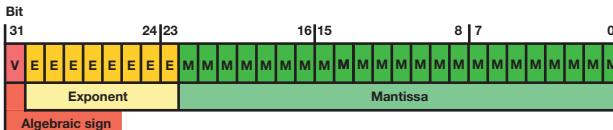

The first register contains Bits 15 – 0 of the 32-bit number (bit 0...15 of the mantissa).

The second register contains Bits 16 – 32 of the 32-bit number (algebraic sign, exponent and Bit 16- 22 of the mantissa).

## 6.3 Mapping

### Address space

The address space may be divided into 4 address spaces according to the 4 types of data.

Space	r/w	Address area	Function code	
Coil	Readable Writeable	00001 - 09999	0x01 0x05 0x0F	Read Coil Status <sup>1)</sup> Force Single Coil <sup>1)</sup> Force Multiple Coils <sup>1)</sup>
Discrete input	Only readable	10001 - 19999	0x02	Read Input Status <sup>1)</sup>
Input register	Only readable	30001 - 39999	0x04	Read Input Register <sup>1)</sup>
Holding register	Readable Writeable	40001 - 49999	0x03 0x06 0x10	Read Holding Registers Force Single Register <sup>1)</sup> Preset Multiple Registers

<sup>1)</sup> not implemented

To reduce the commands, the device image was represented as far as possible in "holding registers".

### Segments

Address	Description	Permitted function codes	
40209 - 40210	Actions		
40257 - 40284	Measured values, status	0x03	Read Holding Registers
40515 - 40516	Settings (Modbus)	0x10	Preset Multiple Registers
40517 - 40761	Configuration data		
41076	Device type	0x03	Read Holding Registers

### Syntax

Address	Start address of the described data block (register, coil or input status)
Description	Unique variable or structure description
Data type	Data type of variable (U: unsigned, INT: integer, 8/16/32 bit, REAL or CHAR[.])
#	Offset from the start address in the data type unit, for Byte 0: Low, 1: High byte
Default	Value upon delivery or after a hardware reset
Description	Exact details concerning the variable described

## 6.4 Device identification

The device is identified by "Read Slave ID".

### Function 11h: Report Slave ID

Master telegram:

Device address	Function	CRC	
ADDR	0x11	LO	HI

Slave telegram:

Device Address	Function	Number data bytes	Slave ID	Sub ID	Data 2	CRC	
ADDR	0x11	3				LO	HI

Device ID	Sub-ID	Device	Description
0x01	0x00	VR660	Temperature controller
0x02	0x00	A200R	Display
0x03	0x01	CAM	Universal measuring unit for heavy current variables
0x04	0x00	APLUS	Multifunctional display
0x05	0x00	V604s	Universal transmitter
0x05	0x01	VB604s	Universal transmitter multi in/out
0x05	0x02	VC604s	Universal transmitter second relay
0x05	0x03	VQ604s	Universal transmitter fast setting times

### Device information

Adress	Description	Data type	Description
41076	DEVICE	UINT16	Device type Bit Description 0 Reserved 1 Reserved 2 0: V / mA inputs 1: 2 x mA inputs 3 Output 1: 0: Current output 4 Output 2: 0: Current output 5-15 Reserved

## 6.5 Measured values

### Triggering action

Address	Description	Data type	#	Default	Description						
40209	ACTION	UINT16		0	<p>This register starts actions.</p> <table> <thead> <tr> <th>Action</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>18</td> <td>Input 1: With short-circuited input terminals, the line calibration is realised and the measured parameters are stored in the device. This procedure is indicated by a flashing green LED.</td> </tr> <tr> <td>19</td> <td>Line calibration at Input 2 (same as Input 1)</td> </tr> </tbody> </table>	Action	Description	18	Input 1: With short-circuited input terminals, the line calibration is realised and the measured parameters are stored in the device. This procedure is indicated by a flashing green LED.	19	Line calibration at Input 2 (same as Input 1)
Action	Description										
18	Input 1: With short-circuited input terminals, the line calibration is realised and the measured parameters are stored in the device. This procedure is indicated by a flashing green LED.										
19	Line calibration at Input 2 (same as Input 1)										
40210	ACTDAT				Additional information for the implementation of an action.						

### Simulation of output variables

- Writing into the PERCENT1, PERCENT2, OUTPUT1, OUTPUT2 registers interrupts the signal flow to the respective variable and the desired value is specified (However, percent and output value cannot be simulated simultaneously). The status of the simulation mode can be read in the STATUS2 status register.
- The simulation mode is terminated by writing 0 into the respective bits in the STATUS2 register.

### Current measured variables

Address	Description	Data type	#	Default	Description																																						
40257	STATUS1	UINT16		0	<p>Status 1</p> <table> <thead> <tr> <th>Bit</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>Reserved</td> </tr> <tr> <td>1</td> <td>Reserved</td> </tr> <tr> <td>2</td> <td>Device fault</td> </tr> <tr> <td>3</td> <td>Parameter fault</td> </tr> <tr> <td>4</td> <td>Sensor breakage</td> <td>Input 1</td> </tr> <tr> <td>5</td> <td>Sensor short circuit</td> <td>Input 1</td> </tr> <tr> <td>6</td> <td>Reserved</td> </tr> <tr> <td>7</td> <td>Sensor breakage</td> <td>Input 2</td> </tr> <tr> <td>8</td> <td>Sensor short circuit</td> <td>Input 2</td> </tr> <tr> <td>9</td> <td>Reserved</td> </tr> <tr> <td>10</td> <td>Alarm 1</td> </tr> <tr> <td>11</td> <td>Alarm 2 (relay 1 status before inverting)</td> </tr> <tr> <td>12</td> <td>Limit value 1</td> </tr> <tr> <td>13</td> <td>Limit value 2</td> </tr> <tr> <td>14</td> <td>Relay 1 status</td> </tr> <tr> <td>15</td> <td>Device reset or new parameter values</td> </tr> </tbody> </table>	Bit	Description	0	Reserved	1	Reserved	2	Device fault	3	Parameter fault	4	Sensor breakage	Input 1	5	Sensor short circuit	Input 1	6	Reserved	7	Sensor breakage	Input 2	8	Sensor short circuit	Input 2	9	Reserved	10	Alarm 1	11	Alarm 2 (relay 1 status before inverting)	12	Limit value 1	13	Limit value 2	14	Relay 1 status	15	Device reset or new parameter values
Bit	Description																																										
0	Reserved																																										
1	Reserved																																										
2	Device fault																																										
3	Parameter fault																																										
4	Sensor breakage	Input 1																																									
5	Sensor short circuit	Input 1																																									
6	Reserved																																										
7	Sensor breakage	Input 2																																									
8	Sensor short circuit	Input 2																																									
9	Reserved																																										
10	Alarm 1																																										
11	Alarm 2 (relay 1 status before inverting)																																										
12	Limit value 1																																										
13	Limit value 2																																										
14	Relay 1 status																																										
15	Device reset or new parameter values																																										
40258	STATUS2	UINT16		0	<p>Status of the simulation mode: A set bit indicates the simulation mode of the respective register.</p> <table> <thead> <tr> <th>Bit</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>Output 1 (PERCENT1)</td> </tr> <tr> <td>1</td> <td>Output 1 (OUTPUT1)</td> </tr> <tr> <td>2</td> <td>Output 2 (PERCENT2)</td> </tr> <tr> <td>3</td> <td>Output 2 (OUTPUT2)</td> </tr> </tbody> </table> <p>The simulation mode is terminated by writing zeros into the respective bit positions (0..3).</p>	Bit	Description	0	Output 1 (PERCENT1)	1	Output 1 (OUTPUT1)	2	Output 2 (PERCENT2)	3	Output 2 (OUTPUT2)																												
Bit	Description																																										
0	Output 1 (PERCENT1)																																										
1	Output 1 (OUTPUT1)																																										
2	Output 2 (PERCENT2)																																										
3	Output 2 (OUTPUT2)																																										
40259	INPUT1	REAL		0.0	Measured value Input 1																																						
40261	INPUT2	REAL		0.0	Measured value Input 2																																						
40263	MEAS1	REAL		0.0	Measured variable for Output 1																																						
40265	MEAS2	REAL		0.0	Measured variable for Output 2																																						
40267	LIMIT1	REAL		0.0	Measured variable for Limit value 1																																						
40269	LIMIT2	REAL		0.0	Measured variable for Limit value 2																																						
40271	T_JUNCTION1	REAL		0.0	Cold junction temperature Input 1																																						
40273	T_JUNCTION2	REAL		0.0	Cold junction temperature Input 2																																						
40275	ELAPSED	UINT32		0	Operation hour counter [s]																																						
40277	PERCENT1	REAL		0.0	Output 1: Scaled output variable in %																																						
40279	PERCENT2	REAL		0.0	Output 2: Scaled output variable in %																																						
40281	OUTPUT1	REAL		0.0	Output 1 [mA] / [V]																																						
40283	OUTPUT2	REAL		0.0	Output 2 [mA] / [V]																																						

## 6.6 Configuration parameters

### Settings

Address	Description	Data type	#	Default	Description																																		
40515	DEVADDR	UINT16		01h	MODBUS Slave address (1...247)																																		
40516	MODBUS	UINT16		3222h	<p>MODBUS settings</p> <table> <thead> <tr> <th>Bit</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>0-2</td> <td>Baudrate</td> </tr> <tr> <td>0:</td> <td>9600</td> </tr> <tr> <td>1:</td> <td>14400</td> </tr> <tr> <td><b>2:</b></td> <td><b>19200</b></td> </tr> <tr> <td>3:</td> <td>38400</td> </tr> <tr> <td>4:</td> <td>56000</td> </tr> <tr> <td>5:</td> <td>57600</td> </tr> <tr> <td>6:</td> <td>115200</td> </tr> <tr> <td>7:</td> <td>Reserved</td> </tr> <tr> <td>3</td> <td>0: Odd parity</td> </tr> <tr> <td></td> <td>1: Even parity</td> </tr> <tr> <td>4</td> <td><b>0: Parity disabled</b></td> </tr> <tr> <td></td> <td>1: Parity enabled</td> </tr> <tr> <td>5</td> <td>0: 1 Stop bit</td> </tr> <tr> <td></td> <td><b>1: 2 Stop bits</b></td> </tr> <tr> <td>8-15</td> <td>Response delay [ms] (5..255)</td> </tr> </tbody> </table>	Bit	Description	0-2	Baudrate	0:	9600	1:	14400	<b>2:</b>	<b>19200</b>	3:	38400	4:	56000	5:	57600	6:	115200	7:	Reserved	3	0: Odd parity		1: Even parity	4	<b>0: Parity disabled</b>		1: Parity enabled	5	0: 1 Stop bit		<b>1: 2 Stop bits</b>	8-15	Response delay [ms] (5..255)
Bit	Description																																						
0-2	Baudrate																																						
0:	9600																																						
1:	14400																																						
<b>2:</b>	<b>19200</b>																																						
3:	38400																																						
4:	56000																																						
5:	57600																																						
6:	115200																																						
7:	Reserved																																						
3	0: Odd parity																																						
	1: Even parity																																						
4	<b>0: Parity disabled</b>																																						
	1: Parity enabled																																						
5	0: 1 Stop bit																																						
	<b>1: 2 Stop bits</b>																																						
8-15	Response delay [ms] (5..255)																																						

### Resetting of communication settings

Once the MODBUS settings have been stored in the device, communication with the device is only possible if the settings are known.

The following technique resets the MODBUS settings to the delivery status:

- Device address: 01h
- Baudrate: 19200
- Parity: None
- Stop bits: 2

A plug prepared for this purpose (Terminal + is connected to Terminal GND with a resistance of 1 kOhm) is connected to the RS485 interface before the device is switched on.

After the device has been switched on, the red LED shines for approx. 30 seconds. During this time, the green LED flashes. Subsequently, the red LED turns off (the green LED continues flashing). Within further 30 seconds, this plug has to be removed from the device.

After the successful completion of this procedure, the communication default settings are stored again in the device.

If the procedure described is not adhered to, the interface parameters are not changed.

## Configuration

Address	Description	Data type	#	Default	Description																																																																																																						
40517	DATE	UINT32		0	Configuration date (UTC time stamp in seconds starting 1.1.1970)																																																																																																						
40519	TAG	CHAR[8]		"V604s"\0 or "VB604s"\0	Device text																																																																																																						
40523	INPUT1	UINT8	0	00h at 2xmA: 40h	<p>Type of measurement Input 1 FFh: Measurement is inactive</p> <p><b>Wiring variant A</b></p> <table> <tbody> <tr><td>00h:</td><td>Voltage measurement [mV]</td><td>Terminal 3,4</td></tr> <tr><td>04h:</td><td>Thermocouple internally compensated [K]</td><td>3,4</td></tr> <tr><td>60h:</td><td>Thermocouple with ext. cold junction thermostat [K]</td><td>3,4</td></tr> <tr><td>21h:</td><td>Resistance thermometer 2-wire [K]</td><td>1,4</td></tr> <tr><td>22h:</td><td>Resistance thermometer 3-wire [K]</td><td>1,3,4</td></tr> <tr><td>23h:</td><td>Resistance thermometer 4-wire [K]</td><td>1,2,3,4</td></tr> <tr><td>24h:</td><td>Thermocouple with ext. Pt100 on Terminals 1-4 [K]</td><td>1,3,4</td></tr> <tr><td>44h:</td><td>Thermocouple with ext. Pt100 on Terminals 2-8 [K]</td><td>3,4,2,8</td></tr> <tr><td>01h:</td><td>Resistance measurement 2-wire [Ω]</td><td>1,4</td></tr> <tr><td>02h:</td><td>Resistance measurement 3-wire [Ω]</td><td>1,3,4</td></tr> <tr><td>03h:</td><td>Resistance measurement 4-wire [Ω]</td><td>1,2,3,4</td></tr> <tr><td>42h:</td><td>Resistance teletransmitter WF [Ω]</td><td>1,3,4</td></tr> <tr><td>62h:</td><td>Resistance teletransmitter WFDIN [Ω]</td><td>1,3,4</td></tr> <tr><td>20h:</td><td>Voltage measurement [V]</td><td>6,4</td></tr> <tr><td>40h:</td><td>Current measurement [mA]</td><td>5,4</td></tr> <tr><td>06h:</td><td>Sensor earthed: Voltage measurement [mV]</td><td>3,4</td></tr> <tr><td>07h:</td><td>Sensor earthed: TC internally compensated [K]</td><td>3,4</td></tr> <tr><td>66h:</td><td>Sensor earthed: TC, ext. cold junction thermostat [K]</td><td>3,4</td></tr> <tr><td>27h:</td><td>Sensor earthed: TC with ext. Pt100 on Terminals 1-4 [K]</td><td>1,3,4</td></tr> </tbody> </table> <p><b>Wiring variant B</b></p> <table> <tbody> <tr><td>10h:</td><td>Voltage measurement [mV]</td><td>7,8</td></tr> <tr><td>14h:</td><td>Thermocouple internally compensated [K]</td><td>7,8</td></tr> <tr><td>70h:</td><td>Thermocouple with ext. cold junction thermostat [K]</td><td>7,8</td></tr> <tr><td>31h:</td><td>Resistance thermometer 2-wire [K]</td><td>2,8</td></tr> <tr><td>32h:</td><td>Resistance thermometer 3-wire [K]</td><td>2,7,8</td></tr> <tr><td>54h:</td><td>Thermocouple with ext. Pt100 on Terminals 1-4 [K]</td><td>7,8,1,4</td></tr> <tr><td>34h:</td><td>Thermocouple with ext. Pt100 on Terminals 2-8 [K]</td><td>2,7,8</td></tr> <tr><td>11h:</td><td>Resistance measurement 2-wire [Ω]</td><td>2,8</td></tr> <tr><td>12h:</td><td>Resistance measurement 3-wire [Ω]</td><td>2,7,8</td></tr> <tr><td>52h:</td><td>Resistance teletransmitter WF [Ω]</td><td>2,7,8</td></tr> <tr><td>72h:</td><td>Resistance teletransmitter WFDIN [Ω]</td><td>2,7,8</td></tr> <tr><td>16h:</td><td>Sensor earthed: Voltage measurement [mV]</td><td>7,8</td></tr> <tr><td>17h:</td><td>Sensor earthed: TC internally compensated [K]</td><td>7,8</td></tr> <tr><td>76h:</td><td>Sensor earthed: TC, ext. cold junction thermostat [K]</td><td>7,8</td></tr> <tr><td>50h:</td><td>2nd current input [mA]</td><td>6,4</td></tr> </tbody> </table> <p>Combination limits are separately shown in a table on page 16.</p>	00h:	Voltage measurement [mV]	Terminal 3,4	04h:	Thermocouple internally compensated [K]	3,4	60h:	Thermocouple with ext. cold junction thermostat [K]	3,4	21h:	Resistance thermometer 2-wire [K]	1,4	22h:	Resistance thermometer 3-wire [K]	1,3,4	23h:	Resistance thermometer 4-wire [K]	1,2,3,4	24h:	Thermocouple with ext. Pt100 on Terminals 1-4 [K]	1,3,4	44h:	Thermocouple with ext. Pt100 on Terminals 2-8 [K]	3,4,2,8	01h:	Resistance measurement 2-wire [Ω]	1,4	02h:	Resistance measurement 3-wire [Ω]	1,3,4	03h:	Resistance measurement 4-wire [Ω]	1,2,3,4	42h:	Resistance teletransmitter WF [Ω]	1,3,4	62h:	Resistance teletransmitter WFDIN [Ω]	1,3,4	20h:	Voltage measurement [V]	6,4	40h:	Current measurement [mA]	5,4	06h:	Sensor earthed: Voltage measurement [mV]	3,4	07h:	Sensor earthed: TC internally compensated [K]	3,4	66h:	Sensor earthed: TC, ext. cold junction thermostat [K]	3,4	27h:	Sensor earthed: TC with ext. Pt100 on Terminals 1-4 [K]	1,3,4	10h:	Voltage measurement [mV]	7,8	14h:	Thermocouple internally compensated [K]	7,8	70h:	Thermocouple with ext. cold junction thermostat [K]	7,8	31h:	Resistance thermometer 2-wire [K]	2,8	32h:	Resistance thermometer 3-wire [K]	2,7,8	54h:	Thermocouple with ext. Pt100 on Terminals 1-4 [K]	7,8,1,4	34h:	Thermocouple with ext. Pt100 on Terminals 2-8 [K]	2,7,8	11h:	Resistance measurement 2-wire [Ω]	2,8	12h:	Resistance measurement 3-wire [Ω]	2,7,8	52h:	Resistance teletransmitter WF [Ω]	2,7,8	72h:	Resistance teletransmitter WFDIN [Ω]	2,7,8	16h:	Sensor earthed: Voltage measurement [mV]	7,8	17h:	Sensor earthed: TC internally compensated [K]	7,8	76h:	Sensor earthed: TC, ext. cold junction thermostat [K]	7,8	50h:	2nd current input [mA]	6,4
00h:	Voltage measurement [mV]	Terminal 3,4																																																																																																									
04h:	Thermocouple internally compensated [K]	3,4																																																																																																									
60h:	Thermocouple with ext. cold junction thermostat [K]	3,4																																																																																																									
21h:	Resistance thermometer 2-wire [K]	1,4																																																																																																									
22h:	Resistance thermometer 3-wire [K]	1,3,4																																																																																																									
23h:	Resistance thermometer 4-wire [K]	1,2,3,4																																																																																																									
24h:	Thermocouple with ext. Pt100 on Terminals 1-4 [K]	1,3,4																																																																																																									
44h:	Thermocouple with ext. Pt100 on Terminals 2-8 [K]	3,4,2,8																																																																																																									
01h:	Resistance measurement 2-wire [Ω]	1,4																																																																																																									
02h:	Resistance measurement 3-wire [Ω]	1,3,4																																																																																																									
03h:	Resistance measurement 4-wire [Ω]	1,2,3,4																																																																																																									
42h:	Resistance teletransmitter WF [Ω]	1,3,4																																																																																																									
62h:	Resistance teletransmitter WFDIN [Ω]	1,3,4																																																																																																									
20h:	Voltage measurement [V]	6,4																																																																																																									
40h:	Current measurement [mA]	5,4																																																																																																									
06h:	Sensor earthed: Voltage measurement [mV]	3,4																																																																																																									
07h:	Sensor earthed: TC internally compensated [K]	3,4																																																																																																									
66h:	Sensor earthed: TC, ext. cold junction thermostat [K]	3,4																																																																																																									
27h:	Sensor earthed: TC with ext. Pt100 on Terminals 1-4 [K]	1,3,4																																																																																																									
10h:	Voltage measurement [mV]	7,8																																																																																																									
14h:	Thermocouple internally compensated [K]	7,8																																																																																																									
70h:	Thermocouple with ext. cold junction thermostat [K]	7,8																																																																																																									
31h:	Resistance thermometer 2-wire [K]	2,8																																																																																																									
32h:	Resistance thermometer 3-wire [K]	2,7,8																																																																																																									
54h:	Thermocouple with ext. Pt100 on Terminals 1-4 [K]	7,8,1,4																																																																																																									
34h:	Thermocouple with ext. Pt100 on Terminals 2-8 [K]	2,7,8																																																																																																									
11h:	Resistance measurement 2-wire [Ω]	2,8																																																																																																									
12h:	Resistance measurement 3-wire [Ω]	2,7,8																																																																																																									
52h:	Resistance teletransmitter WF [Ω]	2,7,8																																																																																																									
72h:	Resistance teletransmitter WFDIN [Ω]	2,7,8																																																																																																									
16h:	Sensor earthed: Voltage measurement [mV]	7,8																																																																																																									
17h:	Sensor earthed: TC internally compensated [K]	7,8																																																																																																									
76h:	Sensor earthed: TC, ext. cold junction thermostat [K]	7,8																																																																																																									
50h:	2nd current input [mA]	6,4																																																																																																									
		1	FF		<p>Sensor type Input 1 FFh: Linear</p> <table> <tbody> <tr><td>0:</td><td>RTD Ptxxx (e.g. Pt100)</td></tr> <tr><td>1:</td><td>RTD Nixxx</td></tr> <tr><td>2:</td><td>Customer-specific characteristic curve (only with NLB)</td></tr> <tr><td>3:</td><td>TC Type B</td></tr> <tr><td>4:</td><td>TC Type E</td></tr> <tr><td>5:</td><td>TC Type J</td></tr> <tr><td>6:</td><td>TC Type K</td></tr> <tr><td>7:</td><td>TC Type L</td></tr> <tr><td>8:</td><td>TC Type N</td></tr> <tr><td>9:</td><td>TC Type R</td></tr> <tr><td>10:</td><td>TC Type S</td></tr> <tr><td>11:</td><td>TC Type T</td></tr> <tr><td>12:</td><td>TC Type U</td></tr> <tr><td>13:</td><td>TC Type W5-W26Re</td></tr> <tr><td>14:</td><td>TC Type W3-W25Re</td></tr> </tbody> </table> <p><i>Automatic parameter correction<sup>2</sup></i></p>	0:	RTD Ptxxx (e.g. Pt100)	1:	RTD Nixxx	2:	Customer-specific characteristic curve (only with NLB)	3:	TC Type B	4:	TC Type E	5:	TC Type J	6:	TC Type K	7:	TC Type L	8:	TC Type N	9:	TC Type R	10:	TC Type S	11:	TC Type T	12:	TC Type U	13:	TC Type W5-W26Re	14:	TC Type W3-W25Re																																																																								
0:	RTD Ptxxx (e.g. Pt100)																																																																																																										
1:	RTD Nixxx																																																																																																										
2:	Customer-specific characteristic curve (only with NLB)																																																																																																										
3:	TC Type B																																																																																																										
4:	TC Type E																																																																																																										
5:	TC Type J																																																																																																										
6:	TC Type K																																																																																																										
7:	TC Type L																																																																																																										
8:	TC Type N																																																																																																										
9:	TC Type R																																																																																																										
10:	TC Type S																																																																																																										
11:	TC Type T																																																																																																										
12:	TC Type U																																																																																																										
13:	TC Type W5-W26Re																																																																																																										
14:	TC Type W3-W25Re																																																																																																										


Address	Description	Data type	#	Default	Description
40524	INPRANGE1	REAL			Measuring range Input 1  Variable Range Minimum span U[mV]: $\pm 0 \text{ mV} \dots 1000 \text{ mV}$ 2 mV U[V]: $\pm 0 \text{ V} \dots 300 \text{ V}$ 1 V RTD: Acc. sensor limits TC: Acc. sensor limits R: 0 ... 5000 [Ω] 8 Ohm see special case WF, WFDIN * I [mA]: $\pm 0 \dots 50 \text{ mA}$ 0.2 mA  Automatic parameter correction <sup>2</sup>
			0	0.0 at 2xmA: 4.0	Measuring range start
			1	1000.0 at 2xmA: 20.0	Measuring range end
40528	SCALE1	REAL		1.0	Scaling factor for INPUT1 (larger than 0.0)
40530	SENSVAL1	REAL		100.0	Input 1: Sensor value [Ω] at 0°C (e.g. 100.0 for Pt100) Pt20 ... Pt1000 Ni50 ... Ni1000 WF, WFDIN: SENSVAL1=Rd Automatic parameter correction <sup>2</sup>
40532	REF1	REAL		0.0	Reference value Input 1: – Line resistance [Ω] in 2-wire measurement: 0...30 Ohm – Reference temperature in TC ext. comp.: -20 ... 70 °C Automatic parameter correction <sup>2</sup>
40534	INPUT2	UINT8	0	FFh at 2xmA: 50h	Type of measurement Input 2 (same as Input 1)
			1	FFh	Sensor type Input 2 (same as Input 1)
40535	INPRANGE2	REAL			Measuring range Input 2 (same as Input 1)  0 0.0 at 2xmA: 4.0 Measuring range start  1 1000.0 at 2xmA: 20.0 Measuring range end
40539	SCALE2	REAL		1.0	Scaling factor for INPUT2 (larger than 0.0)
40541	SENSVAL2	REAL		100.0	Input 2: Sensor value [Ω] at 0°C (e.g. 100.0 for Pt100) Pt20 ... Pt1000 Ni50 ... Ni1000 WF, WFDIN: SENSVAL1=Rd Automatic parameter correction <sup>2</sup>
40543	REF2	REAL		0.0	Reference value Input 2: – Line resistance [Ω] in 2-wire measurement: 0 ... 30 Ohm – Reference temperature [°C] in TC ext. comp.: -20 ... 70 °C
40545	FREQ	REAL		50.0	System frequency [Hz]: 2.5, 5, 10, 15, 25, 30, 50, 60, 100, 500 or 1000 Automatic parameter correction <sup>2</sup>

\* Resistance teletransmitter

For teletransmitters the measuring range is defined by 3 resistance values

Input 2: Same as Input 1.

Parameter	Meaning
INPRANGE1, measuring range start	Ra
INPRANGE1, measuring range end	Re
SENSVAL1	Rd

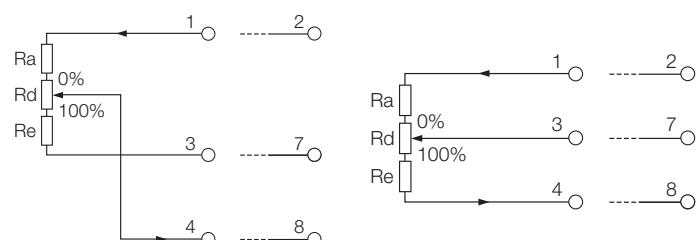

Address	Description	Data type	#	Default	Description																													
40547	TSET	REAL		1.0	Settling time (99%) [s] 0.01* ... 30 * minimum setting time see "Specified time / setting time" on page 5 <i>Automatic parameter correction</i> <sup>2</sup>																													
40549	SETTING	UINT16		00h	<p>Settings</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr><td>0</td><td>Recognition of the type of connection (2L, 3L, 4L) after reset</td></tr> <tr><td>1</td><td>Input 1: Breakage monitoring activated</td></tr> <tr><td>2</td><td>Input 2: Breakage monitoring activated</td></tr> <tr><td>3</td><td>Input 1: Short circuit monitoring activated</td></tr> <tr><td>4</td><td>Input 2: Short circuit monitoring activated</td></tr> </tbody> </table>	Bit	Description	0	Recognition of the type of connection (2L, 3L, 4L) after reset	1	Input 1: Breakage monitoring activated	2	Input 2: Breakage monitoring activated	3	Input 1: Short circuit monitoring activated	4	Input 2: Short circuit monitoring activated																	
Bit	Description																																	
0	Recognition of the type of connection (2L, 3L, 4L) after reset																																	
1	Input 1: Breakage monitoring activated																																	
2	Input 2: Breakage monitoring activated																																	
3	Input 1: Short circuit monitoring activated																																	
4	Input 2: Short circuit monitoring activated																																	
40550	MATRIX	UINT8			<p>Linking of inputs with outputs</p> <table> <tbody> <tr> <td>0</td><td>01h</td><td> <p>Output 1:</p> <ul style="list-style-type: none"> <li>00h: Not used</li> <li>01h: Input 1</li> <li>02h: Input 2</li> <li>03h: Input 1 + 2</li> <li>04h: Input 1 – 2</li> <li>05h: Input 2 – 1</li> <li>06h: Input 1 * 2</li> <li>07h: Minimum value (Input 1,2)</li> <li>08h: Maximum value (Input 1,2)</li> <li>09h: Mean value (Input 1,2)</li> <li>81h: Sensor redundancy: Input 1 normally</li> <li>82h: Sensor redundancy: Input 2 normally</li> <li>87h: Sensor redundancy: Minimum value (Input 1,2)</li> <li>88h: Sensor redundancy: Maximum value (Input 1,2)</li> <li>89h: Sensor redundancy: Mean value (Input 1,2)</li> </ul> <p>- Only measured variables of the same unit may be linked.</p> <p>- Product formation: Only possible for combinations V*mV, V*mA, mA*mA, mV*mA and mV*mV.</p> <p>Sensor redundancy</p> <p>- Measured variable in case of a fault: INPUTx which does not show a fault</p> <p>- Limitations:</p> <ul style="list-style-type: none"> <li>- The same measuring range for both inputs</li> <li>- The same scaling factors (always 1.0)</li> <li>- No output value in case of a fault</li> <li>- Temperature measurement</li> <li>- Breakage or short circuit monitoring active</li> </ul> </td></tr> <tr> <td>1</td><td>00h at 2xmA: 02h</td><td>Output 2 (same as Output 1)</td></tr> </tbody> </table>	0	01h	<p>Output 1:</p> <ul style="list-style-type: none"> <li>00h: Not used</li> <li>01h: Input 1</li> <li>02h: Input 2</li> <li>03h: Input 1 + 2</li> <li>04h: Input 1 – 2</li> <li>05h: Input 2 – 1</li> <li>06h: Input 1 * 2</li> <li>07h: Minimum value (Input 1,2)</li> <li>08h: Maximum value (Input 1,2)</li> <li>09h: Mean value (Input 1,2)</li> <li>81h: Sensor redundancy: Input 1 normally</li> <li>82h: Sensor redundancy: Input 2 normally</li> <li>87h: Sensor redundancy: Minimum value (Input 1,2)</li> <li>88h: Sensor redundancy: Maximum value (Input 1,2)</li> <li>89h: Sensor redundancy: Mean value (Input 1,2)</li> </ul> <p>- Only measured variables of the same unit may be linked.</p> <p>- Product formation: Only possible for combinations V*mV, V*mA, mA*mA, mV*mA and mV*mV.</p> <p>Sensor redundancy</p> <p>- Measured variable in case of a fault: INPUTx which does not show a fault</p> <p>- Limitations:</p> <ul style="list-style-type: none"> <li>- The same measuring range for both inputs</li> <li>- The same scaling factors (always 1.0)</li> <li>- No output value in case of a fault</li> <li>- Temperature measurement</li> <li>- Breakage or short circuit monitoring active</li> </ul>	1	00h at 2xmA: 02h	Output 2 (same as Output 1)																							
0	01h	<p>Output 1:</p> <ul style="list-style-type: none"> <li>00h: Not used</li> <li>01h: Input 1</li> <li>02h: Input 2</li> <li>03h: Input 1 + 2</li> <li>04h: Input 1 – 2</li> <li>05h: Input 2 – 1</li> <li>06h: Input 1 * 2</li> <li>07h: Minimum value (Input 1,2)</li> <li>08h: Maximum value (Input 1,2)</li> <li>09h: Mean value (Input 1,2)</li> <li>81h: Sensor redundancy: Input 1 normally</li> <li>82h: Sensor redundancy: Input 2 normally</li> <li>87h: Sensor redundancy: Minimum value (Input 1,2)</li> <li>88h: Sensor redundancy: Maximum value (Input 1,2)</li> <li>89h: Sensor redundancy: Mean value (Input 1,2)</li> </ul> <p>- Only measured variables of the same unit may be linked.</p> <p>- Product formation: Only possible for combinations V*mV, V*mA, mA*mA, mV*mA and mV*mV.</p> <p>Sensor redundancy</p> <p>- Measured variable in case of a fault: INPUTx which does not show a fault</p> <p>- Limitations:</p> <ul style="list-style-type: none"> <li>- The same measuring range for both inputs</li> <li>- The same scaling factors (always 1.0)</li> <li>- No output value in case of a fault</li> <li>- Temperature measurement</li> <li>- Breakage or short circuit monitoring active</li> </ul>																																
1	00h at 2xmA: 02h	Output 2 (same as Output 1)																																
40551	LIMITA	UINT8			<p>Setting of limit values</p> <table> <tbody> <tr> <td>0</td><td>0</td><td> <p>Measured variable for Limit value 1</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr><td>0-4</td><td>Limit value</td></tr> <tr><td>0</td><td>0: Not used</td></tr> <tr><td>1</td><td>1: Input 1 (INPUT1)</td></tr> <tr><td>2</td><td>2: Input 2 (INPUT2)</td></tr> <tr><td>3</td><td>3: Measured variable Output 1 (MEAS1)</td></tr> <tr><td>4</td><td>4: Measured variable Output 2 (MEAS2)</td></tr> <tr><td>5</td><td>5: Input 1 – Input 2</td></tr> <tr><td>6</td><td>6: Input 2 – Input 1</td></tr> <tr><td>6</td><td>6: Absolute value of measured variable for the limit value</td></tr> <tr><td>7</td><td>7: Gradient dx/dt</td></tr> </tbody> </table> <p>Note: Drift monitoring is realised by difference calculation. Only measured variables of the same unit may be linked.</p> </td></tr> <tr> <td></td><td>1</td><td>0</td><td>Measure variable for Limit value 2 (same as Limit value 1)</td></tr> </tbody> </table>	0	0	<p>Measured variable for Limit value 1</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr><td>0-4</td><td>Limit value</td></tr> <tr><td>0</td><td>0: Not used</td></tr> <tr><td>1</td><td>1: Input 1 (INPUT1)</td></tr> <tr><td>2</td><td>2: Input 2 (INPUT2)</td></tr> <tr><td>3</td><td>3: Measured variable Output 1 (MEAS1)</td></tr> <tr><td>4</td><td>4: Measured variable Output 2 (MEAS2)</td></tr> <tr><td>5</td><td>5: Input 1 – Input 2</td></tr> <tr><td>6</td><td>6: Input 2 – Input 1</td></tr> <tr><td>6</td><td>6: Absolute value of measured variable for the limit value</td></tr> <tr><td>7</td><td>7: Gradient dx/dt</td></tr> </tbody> </table> <p>Note: Drift monitoring is realised by difference calculation. Only measured variables of the same unit may be linked.</p>	Bit	Description	0-4	Limit value	0	0: Not used	1	1: Input 1 (INPUT1)	2	2: Input 2 (INPUT2)	3	3: Measured variable Output 1 (MEAS1)	4	4: Measured variable Output 2 (MEAS2)	5	5: Input 1 – Input 2	6	6: Input 2 – Input 1	6	6: Absolute value of measured variable for the limit value	7	7: Gradient dx/dt		1	0	Measure variable for Limit value 2 (same as Limit value 1)
0	0	<p>Measured variable for Limit value 1</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr><td>0-4</td><td>Limit value</td></tr> <tr><td>0</td><td>0: Not used</td></tr> <tr><td>1</td><td>1: Input 1 (INPUT1)</td></tr> <tr><td>2</td><td>2: Input 2 (INPUT2)</td></tr> <tr><td>3</td><td>3: Measured variable Output 1 (MEAS1)</td></tr> <tr><td>4</td><td>4: Measured variable Output 2 (MEAS2)</td></tr> <tr><td>5</td><td>5: Input 1 – Input 2</td></tr> <tr><td>6</td><td>6: Input 2 – Input 1</td></tr> <tr><td>6</td><td>6: Absolute value of measured variable for the limit value</td></tr> <tr><td>7</td><td>7: Gradient dx/dt</td></tr> </tbody> </table> <p>Note: Drift monitoring is realised by difference calculation. Only measured variables of the same unit may be linked.</p>	Bit	Description	0-4	Limit value	0	0: Not used	1	1: Input 1 (INPUT1)	2	2: Input 2 (INPUT2)	3	3: Measured variable Output 1 (MEAS1)	4	4: Measured variable Output 2 (MEAS2)	5	5: Input 1 – Input 2	6	6: Input 2 – Input 1	6	6: Absolute value of measured variable for the limit value	7	7: Gradient dx/dt										
Bit	Description																																	
0-4	Limit value																																	
0	0: Not used																																	
1	1: Input 1 (INPUT1)																																	
2	2: Input 2 (INPUT2)																																	
3	3: Measured variable Output 1 (MEAS1)																																	
4	4: Measured variable Output 2 (MEAS2)																																	
5	5: Input 1 – Input 2																																	
6	6: Input 2 – Input 1																																	
6	6: Absolute value of measured variable for the limit value																																	
7	7: Gradient dx/dt																																	
	1	0	Measure variable for Limit value 2 (same as Limit value 1)																															
40552	ALARMSETA	UINT8			<p>Relay and alarm (Relay 1)</p> <table> <tbody> <tr> <td>0</td><td>00h</td><td> <p>Relay 1, LED Relay 1</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr><td>0</td><td>Limit value 1</td></tr> <tr><td>1</td><td>Limit value 2</td></tr> <tr><td>2</td><td>Sensor breakage Input 1 or 2</td></tr> <tr><td>3</td><td>Sensor short circuit Input 1 or 2</td></tr> <tr><td>7</td><td>Inverted</td></tr> </tbody> </table> <p>These settings may all be combined with each other.</p> </td></tr> </tbody> </table>	0	00h	<p>Relay 1, LED Relay 1</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr><td>0</td><td>Limit value 1</td></tr> <tr><td>1</td><td>Limit value 2</td></tr> <tr><td>2</td><td>Sensor breakage Input 1 or 2</td></tr> <tr><td>3</td><td>Sensor short circuit Input 1 or 2</td></tr> <tr><td>7</td><td>Inverted</td></tr> </tbody> </table> <p>These settings may all be combined with each other.</p>	Bit	Description	0	Limit value 1	1	Limit value 2	2	Sensor breakage Input 1 or 2	3	Sensor short circuit Input 1 or 2	7	Inverted														
0	00h	<p>Relay 1, LED Relay 1</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr><td>0</td><td>Limit value 1</td></tr> <tr><td>1</td><td>Limit value 2</td></tr> <tr><td>2</td><td>Sensor breakage Input 1 or 2</td></tr> <tr><td>3</td><td>Sensor short circuit Input 1 or 2</td></tr> <tr><td>7</td><td>Inverted</td></tr> </tbody> </table> <p>These settings may all be combined with each other.</p>	Bit	Description	0	Limit value 1	1	Limit value 2	2	Sensor breakage Input 1 or 2	3	Sensor short circuit Input 1 or 2	7	Inverted																				
Bit	Description																																	
0	Limit value 1																																	
1	Limit value 2																																	
2	Sensor breakage Input 1 or 2																																	
3	Sensor short circuit Input 1 or 2																																	
7	Inverted																																	

Address	Description	Data type	#	Default	Description																
			1	00h	<p>Alarm1, LED Alarm</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr> <td>0</td><td>Limit value 1</td></tr> <tr> <td>1</td><td>Limit value 2</td></tr> <tr> <td>2</td><td>Sensor breakage Input 1 or 2</td></tr> <tr> <td>3</td><td>Sensor short circuit Input 1 or 2</td></tr> </tbody> </table> <p>These settings may all be combined with each other.</p>	Bit	Description	0	Limit value 1	1	Limit value 2	2	Sensor breakage Input 1 or 2	3	Sensor short circuit Input 1 or 2						
Bit	Description																				
0	Limit value 1																				
1	Limit value 2																				
2	Sensor breakage Input 1 or 2																				
3	Sensor short circuit Input 1 or 2																				
40553	TON	REAL		0.0	Alarms rise delay [s]: 0..60																
40555	TOFF	REAL		0.0	Alarms drop delay [s]: 0..60																
40557	TONLIMITA	REAL		0.0	Limit values 1,2: rise delay [s]: 0..3600																
40559	TOFFLIMITA	REAL		0.0	Limit values 1,2: drop delay [s]: 0..3600																
40561	LIMIT1ON	REAL		0.0	Switching-on threshold Limit value 1, unit of LIMIT1																
40563	LIMIT1OFF	REAL		0.0	Switching-off threshold Limit value 1, unit of LIMIT1																
40565	LIMIT2ON	REAL		0.0	Switching-on threshold Limit value 2, unit of LIMIT2																
40567	LIMIT2OFF	REAL		0.0	Switching-off threshold Limit value 2, unit of LIMIT2																
40569	OUTSET1	UINT16		05h at VB604s 01h	<p>Output settings Output 1</p> <table> <thead> <tr> <th>Bit</th><th>Description</th></tr> </thead> <tbody> <tr> <td>0-1</td><td>           Output limit            0: ±0 mA or 0 V  <b>1: ±1 mA or 0.5 V</b>            2: ±2 mA or 1 V            3: -0.2/+0.5 mA or -0.1/+0.25 V (e.g. 3.8 mA ... 20.5 mA)         </td></tr> <tr> <td>2</td><td>           Signal flow            0: Interrupted (only possible with VB604s)            1: Activated (VB604s)         </td></tr> <tr> <td>3</td><td>           Output configuration  <b>0: Current output</b>            Inverting      <b>0: normal</b>, 1: inverted            Table      <b>0: without</b>, 1: with table         </td></tr> <tr> <td>4</td><td>Output in case of a fault</td></tr> <tr> <td>5</td><td><b>0: PERCENTx</b>,</td></tr> <tr> <td>6-7</td><td>           1: ERRVALx in case of fault Input 1            2: ERRVALx in case of fault Input 2            3: ERRVALx in case of fault Input 1 or 2            Transmission function            0: User-defined            1: Linear            2: Quadratic            3: Volume of a horizontal cylinder         </td></tr> <tr> <td>8-15</td><td></td></tr> </tbody> </table>	Bit	Description	0-1	Output limit 0: ±0 mA or 0 V <b>1: ±1 mA or 0.5 V</b> 2: ±2 mA or 1 V 3: -0.2/+0.5 mA or -0.1/+0.25 V (e.g. 3.8 mA ... 20.5 mA)	2	Signal flow 0: Interrupted (only possible with VB604s) 1: Activated (VB604s)	3	Output configuration <b>0: Current output</b> Inverting <b>0: normal</b> , 1: inverted Table <b>0: without</b> , 1: with table	4	Output in case of a fault	5	<b>0: PERCENTx</b> ,	6-7	1: ERRVALx in case of fault Input 1 2: ERRVALx in case of fault Input 2 3: ERRVALx in case of fault Input 1 or 2 Transmission function 0: User-defined 1: Linear 2: Quadratic 3: Volume of a horizontal cylinder	8-15	
Bit	Description																				
0-1	Output limit 0: ±0 mA or 0 V <b>1: ±1 mA or 0.5 V</b> 2: ±2 mA or 1 V 3: -0.2/+0.5 mA or -0.1/+0.25 V (e.g. 3.8 mA ... 20.5 mA)																				
2	Signal flow 0: Interrupted (only possible with VB604s) 1: Activated (VB604s)																				
3	Output configuration <b>0: Current output</b> Inverting <b>0: normal</b> , 1: inverted Table <b>0: without</b> , 1: with table																				
4	Output in case of a fault																				
5	<b>0: PERCENTx</b> ,																				
6-7	1: ERRVALx in case of fault Input 1 2: ERRVALx in case of fault Input 2 3: ERRVALx in case of fault Input 1 or 2 Transmission function 0: User-defined 1: Linear 2: Quadratic 3: Volume of a horizontal cylinder																				
8-15																					
40570	OUTRANGE1	REAL			<p>Output range Output 1</p> <p><i>Automatic parameter correction</i><sup>2</sup></p> <table> <tbody> <tr> <td>0</td><td>4.0</td><td>Minimum value    -20...20 [mA] / -10...10 [V]</td></tr> <tr> <td>1</td><td>20.0</td><td>Maximum value    -20...20 [mA] / -10...10 [V]</td></tr> </tbody> </table>	0	4.0	Minimum value    -20...20 [mA] / -10...10 [V]	1	20.0	Maximum value    -20...20 [mA] / -10...10 [V]										
0	4.0	Minimum value    -20...20 [mA] / -10...10 [V]																			
1	20.0	Maximum value    -20...20 [mA] / -10...10 [V]																			
40574	TRIM1	REAL			<p>Output trimming Output 1</p> <p><i>Automatic parameter correction</i><sup>2</sup></p> <table> <tbody> <tr> <td>0</td><td>0.0</td><td>Offset trimming [in % of the output range, setting range +/- 10%]<sup>1</sup></td></tr> <tr> <td>1</td><td>100.0</td><td>Gain trimming [in % of the output range, setting range 90...110%]<sup>1</sup></td></tr> </tbody> </table>	0	0.0	Offset trimming [in % of the output range, setting range +/- 10%] <sup>1</sup>	1	100.0	Gain trimming [in % of the output range, setting range 90...110%] <sup>1</sup>										
0	0.0	Offset trimming [in % of the output range, setting range +/- 10%] <sup>1</sup>																			
1	100.0	Gain trimming [in % of the output range, setting range 90...110%] <sup>1</sup>																			
40578	ERRVAL1	REAL		0.0	Output value Output 1 in case of a fault [in % of the output range, setting range -10...+110%] <sup>1</sup>																
40580	OUTSET2	UINT16		05h, at VB604s 01h	Output settings Output 2 (same as Output 1)																
40581	OUTRANGE2	REAL			<p>Output range Output 2</p> <table> <tbody> <tr> <td>0</td><td>4.0</td><td>Minimum value    -20...20 [mA] / -10...10 [V]</td></tr> <tr> <td>1</td><td>20.0</td><td>Maximum value    -20...20 [mA] / -10...10 [V]</td></tr> </tbody> </table>	0	4.0	Minimum value    -20...20 [mA] / -10...10 [V]	1	20.0	Maximum value    -20...20 [mA] / -10...10 [V]										
0	4.0	Minimum value    -20...20 [mA] / -10...10 [V]																			
1	20.0	Maximum value    -20...20 [mA] / -10...10 [V]																			
40585	TRIM2	REAL			<p>Output trimming Output 2</p> <table> <tbody> <tr> <td>0</td><td>0.0</td><td>Offset trimming [in % of the output range, setting range +/- 10%]<sup>1</sup></td></tr> <tr> <td>1</td><td>100.0</td><td>Gain trimming [in % of the output range, setting range 90...110%]<sup>1</sup></td></tr> </tbody> </table>	0	0.0	Offset trimming [in % of the output range, setting range +/- 10%] <sup>1</sup>	1	100.0	Gain trimming [in % of the output range, setting range 90...110%] <sup>1</sup>										
0	0.0	Offset trimming [in % of the output range, setting range +/- 10%] <sup>1</sup>																			
1	100.0	Gain trimming [in % of the output range, setting range 90...110%] <sup>1</sup>																			

Address	Description	Data type	#	Default	Description
40589	ERRVAL2	REAL		0.0	Output value Output 2 in case of a fault [in % of the output range, setting range -10...+110%] <sup>1</sup>
40591	GRAD_TIME	REAL		1.0	Time span between two measured values for gradient calculation of limit values in seconds Range: 4 x TSET ... 26210 s <i>Automatic parameter correction<sup>2</sup></i>
40593	NUMTAB	UINT8	Number of table values		
			0	0	Number of table values Table 1 <i>Automatic parameter correction<sup>2</sup></i>
			1	0	Number of table values Table 2 <i>Automatic parameter correction<sup>2</sup></i>
40594	TAB1_YA	REAL		-10.0	Table 1: Y-value (-10%) in % of the measuring range
40596	TAB1_X	REAL[20]		0.0	Table 1: X-values in % of the measuring range
40636	TAB1_Y	REAL[20]		0.0	Table 1: Y-values in % of the measuring range
40676	TAB1 YE	REAL		110.0	Table 1: Y-value (110%) in % of the measuring range
40678	TAB2 YA	REAL		-10.0	Tabelle 1: Y-Wert (-10%) in % vom Messbereich
40680	TAB2_X	REAL[20]		0.0	Tabelle 1: X-Werte in % vom Messbereich
40720	TAB2_Y	REAL[20]		0.0	Tabelle 1: Y-Werte in % vom Messbereich
40760	TAB2 YE	REAL		110.0	Tabelle 1: Y-Wert (110%) in % vom Messbereich

<sup>1</sup> Max. +/-22 mA or +/-11 V

<sup>2</sup> Automatic correction of parameters in the device.

Each parameter must range within permitted limits. These partly depend on other parameters.

If parameters determining the limits of dependent parameters are changed,

(e.g. measuring range is dependent on the type of measurement), the respective parameters are automatically limited to the permitted parameters. The status will show that such a correction has taken place.

## Limitations of configuration parameters

### Options to combine types of measurement

Register: 40523, 40534

The numerous types of measurement can be combined with each other in different ways.

See Table 3 p.19

The "earthed" combination is used if both sensors are connected to each other.

### Measuring ranges

Register: 40524, 40535

see table 1 / page 4

Due to linking and scaling, the measuring ranges are rescaled to different ranges.

This is automatically realised in the device.

Abbreviations:

k<sub>1</sub>: SCALE1

k<sub>2</sub>: SCALE2

T<sub>1a</sub>...T<sub>1e</sub> INPRANGE1 Min1 = T<sub>1a</sub> \* k<sub>1</sub> Max1 = T<sub>1e</sub> \* k<sub>1</sub>


T<sub>2a</sub>...T<sub>2e</sub> INPRANGE2 Min2 = T<sub>2a</sub> \* k<sub>2</sub> Max2 = T<sub>2e</sub> \* k<sub>2</sub>

Matrix	Minimum value MEAS1	Maximum value MEAS1
Input 1	Min1	Max1
Input 2	Min2	Max2
Input 1 + 2	Min1 + Min2	Max1 + Max2
Input 1 - 2	Min1 - Max2	Max1 - Min2

Matrix	Minimum value MEAS1	Maximum value MEAS1
Input 2 - 1	Min2 - Max1	Max2 - Min1
Input 1 * 2		
Input 1	Input 2	
Min1	Max1	
≥0	>0	≥0 >0
<0	≤0	≥0 >0
<0	>0	≥0 >0
≥0	>0	<0 ≤0
<0	≤0	<0 ≤0
>0	>0	<0 ≤0
≥0	>0	<0 >0
<0	≤0	<0 >0
<0	>0	<0 >0
Min1 * Min2		
Min1 * Max2		
Min1 * Max2		
Min2 * Max1		
Max1 * Max2		
Min1 * Min2		
Max1 * Min2		
Max1 * Min2		
Min1 * Max2		
Min1 * Min2		
Min (Min1 * Max2, Min2 * Max1)		
Max (Min1 * Min2, Max1 * Max2)		
Min (Min1, Min2)		
Max (Min1, Min2)		
(Min1 + Min2)/2		
Sensor backup Input 1	Min1 <sup>1</sup>	Max1 <sup>1</sup>
Sensor backup Input 2	Min2 <sup>1</sup>	Max2 <sup>1</sup>
Sensor backup minimum value (Input 1, 2)	Min1 <sup>1</sup>	Max2 <sup>1</sup>
Sensor backup maximum value (Input 1, 2)	Min1 <sup>1</sup>	Max2 <sup>1</sup>
Sensor backup mean value (Input 1, 2)	Min1 <sup>1</sup>	Max2 <sup>1</sup>

<sup>1</sup> k<sub>1</sub> = k<sub>2</sub>, T<sub>1a</sub> = T<sub>2a</sub>, T<sub>1e</sub> = T<sub>2e</sub>

## Linearisation tables

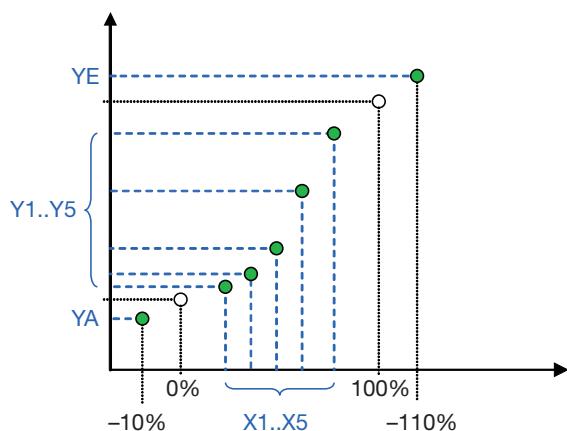

The transmission functions stored in registers OUTSET1 or OUTSET2 constitute information for the PC software to generate the desired transmission function with the table values. This information is irrelevant for the device.

Characteristic curves:

- User-defined, linear, quadratic
  - Volume of a horizontal cylinder:
- $$y = \frac{1}{\pi} \cdot \left[ \text{acos}(1 - 2x) - 2 \cdot \sqrt{x - x^2} \cdot (1 - 2x) \right] \quad (\text{h}/2r = x = 0..1, \quad y = 0..1)$$

## 7. Electric connections

Circuit	Terminals	Remarks
Measuring input	1 to 8	See Table 2, page 18
Output 1 Output 2	11 (+), 12 (-) 10 (+), 12 (-)	
Relay contact	9, 13	
Power supply	15 (+/-) 16 (-/~/)	Note polarity at DC
Bus-/programming connection	+, -, GND	Front plug

### Wiring with 2 input sensors

If 2 input sensors or input variables are used, observe combination options in Table 3!













If 2 input sensors or input variables are used, these must be free of potential or galvanically isolated against each other, on principle! Otherwise, the transmitter may be damaged.  
Exceptions:

- In case of a permitted input combination<sup>1</sup> with common (and approved) connections on Terminal 4.  
E.g. direct voltage mV (Terminal 3, 4) & direct voltage V (Terminal 6, 4)
- In case of a permitted input combination<sup>1</sup> with the same reference potential (e.g. earth) on Terminal 4 and 8  
E.g. 2 thermocouples (on Terminals 3, 4 or 7, 8) with earthed sensor tips or two mV inputs with a common earth potential on Terminals 4 and 8.  
In these cases, the specified types of measurement must be configured for earthed sensors.

<sup>1</sup> See Table 3 "Options to combine types of measurement" page 19


**Table 2: Connections of inputs**

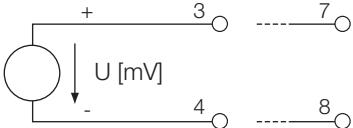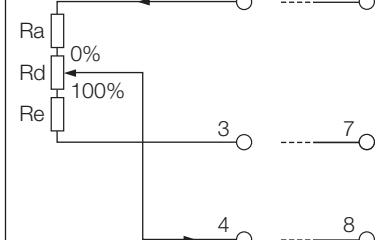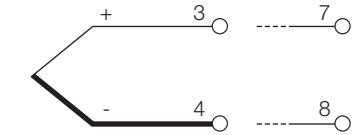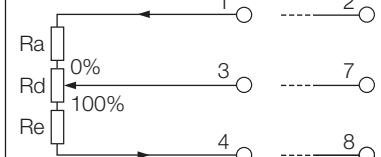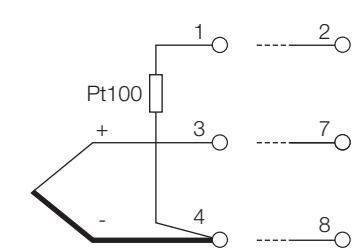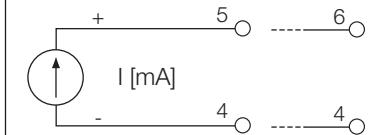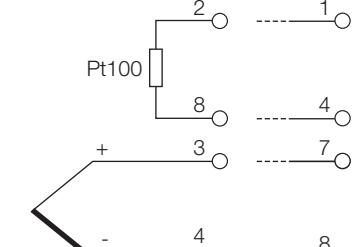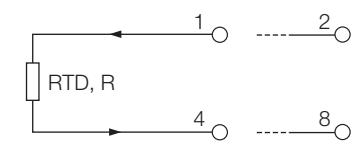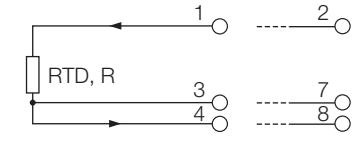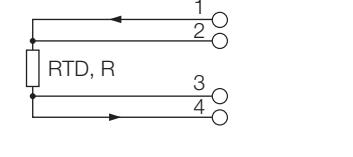Types of measurement	Wiring		Types of measurement	Wiring	
	Input 1	Input 2		Input 1	Input 2
Direct voltage mV			Resistance teletransmitter WF		
Thermocouple with external cold junction thermostat or internally compensated			Resistance Teletransmitter WF-DIN		
Thermocouple with Pt100 at the terminals at the same input			Direct voltage mA		
Thermocouple with Pt100 at the terminals at the other input					
Resistance thermometer or resistance measurement 2-wire					
Resistance thermometer or resistance measurement 3-wire					
Resistance thermometer or resistance measurement 4-wire					

**Table 3: Measuring method combination options**

	Input 2 measuring method	U [mV] earthing	TC ext. earthing	TC int. earthing	R 2L	R 3L	RTD 2L	RTD 3L	I [mA]
Input 1 measuring method	Terminals	7,8	7,8	7,8 2,7,8 2,8	2,7,8 2,8	2,7,8 2,8	2,7,8 2,8	2,7,8 2,8	6,4
U [mV] earthing	3,4	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓
I [mA]	5,4	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓
TC ext. earthing	3,4	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓
TC int. earthing	3,4	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓	✓ ✓
	1,3,4	✓ ✓	✓ ✓		✓ ✓	✓ ✓	✓ ✓	✓ ✓	
R 2L	1,4	✓ ✓	✓ ✓		✓ ✓	✓ ✓	✓ ✓	✓ ✓	
R 3L	1,3,4	✓ ✓	✓ ✓		✓ ✓	✓ ✓	✓ ✓	✓ ✓	
R 4L	1,2,3,4	✓ ✓	✓ ✓						
RTD 2L	1,4	✓ ✓	✓ ✓		✓ ✓	✓ ✓	✓ ✓	✓ ✓	
RTD 3L	1,3,4	✓ ✓	✓ ✓		✓ ✓	✓ ✓	✓ ✓	✓ ✓	
WF	1,3,4	✓ ✓	✓ ✓		✓ ✓	✓ ✓	✓ ✓	✓ ✓	
WF_DIN	1,3,4	✓ ✓	✓ ✓		✓ ✓	✓ ✓	✓ ✓	✓ ✓	
RTD 4L	1,2,3,4	✓ ✓	✓ ✓						

## 8. Dimensional drawing

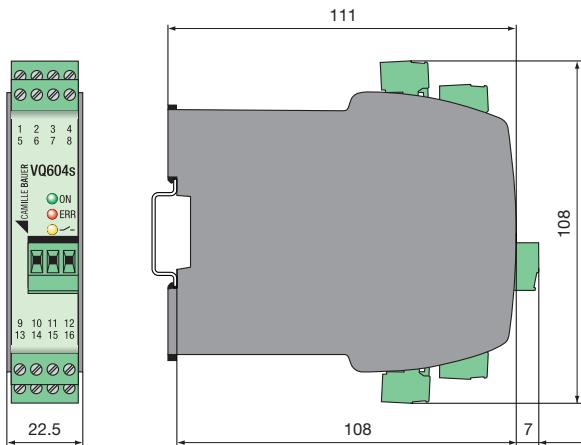

## 9. Accessories

USB-RS485 converter  
(for SINEAX V604s programming): Article No. 163189

## 10. Conformity declaration

<b>CE</b>		<b>EG - KONFORMITÄTSERKLÄRUNG</b>	<b>CAMILLE BAUER</b>
<b>EC DECLARATION OF CONFORMITY</b>			
Dokument-Nr./ Document.No.:	VQ604s_CE-konf.DOC		
Hersteller/ Manufacturer:	Camille Bauer AG Switzerland		
Anschrift / Address:	Aargauerstrasse 7 CH-5610 Wohlen		
Produktbezeichnung/ Product name:	<b>Programmierbarer multifunktionaler Messumformer</b> Programmable multifunctional transmitter		
Typ / Type:	<b>Sineax VQ604s</b>		
Das bezeichnete Produkt stimmt mit den Vorschriften folgender Europäischer Richtlinien überein, nachgewiesen durch die Einhaltung folgender Normen:			
The above mentioned product has been manufactured according to the regulations of the following European directives proven through compliance with the following standards:			
<b>Nr. / No.</b>	<b>Richtlinie / Directive</b>		
2004/108/EG	Elektromagnetische Verträglichkeit - EMV-Richtlinie Electromagnetic compatibility - EMC directive		
<b>EMV / EMC</b>	<b>Fachgrundnorm / Generic Standard</b>	<b>Messverfahren / Measurement methods</b>	
Störaussendung / Emission	EN 61000-6-4 : 2007	EN 55011 : 2007+A2:2007	
Störfestigkeit / Immunity	EN 61000-6-2 : 2005	IEC 61000-4-2: 1995+A1:1998+A2:2001 IEC 61000-4-3: 2006+A1:2007 IEC 61000-4-4: 2004 IEC 61000-4-5: 2005 IEC 61000-4-6: 2008 IEC 61000-4-11: 2004	
<b>Nr. / No.</b>	<b>Richtlinie / Directive</b>		
2006/95/EG	Elektrische Betriebsmittel zur Verwendung innerhalb bestimmter Spannungsgrenzen – Niederspannungsrichtlinie – CE-Kennzeichnung : 95		
2006/95/EC	Electrical equipment for use within certain voltage limits – Low Voltage Directive – Attachment of CE marking : 95		
<b>EN/Norm/Standard</b>	<b>IEC/Norm/Standard</b>		
EN 61010-1: 2010	IEC 61010-1: 2010		
Ort, Datum / Place, date:		Wohlen, 16.Januar 2012	
Unterschrift / signature:			
<i>M. Ulrich</i> M. Ulrich Leiter Technik / Head of engineering	<i>J. Brem</i> J. Brem Qualitätsmanager / Quality manager		