




IP 54
 -20°C - +50°C
 3 x AA LR6 1.5V

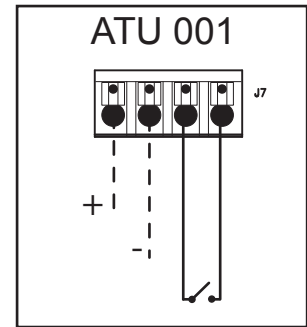




AND/OR

+ 12-24 VDC

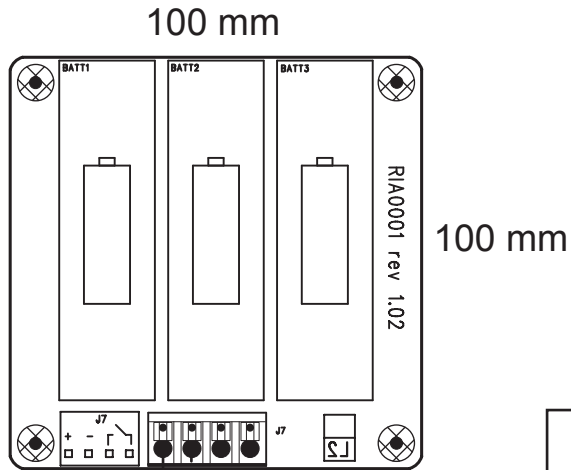




FGC 211

Alarm output

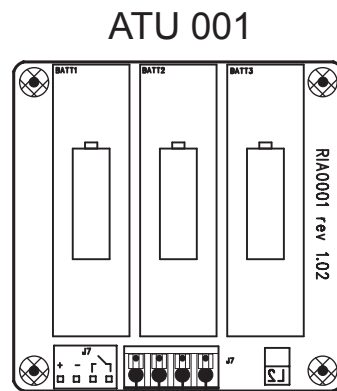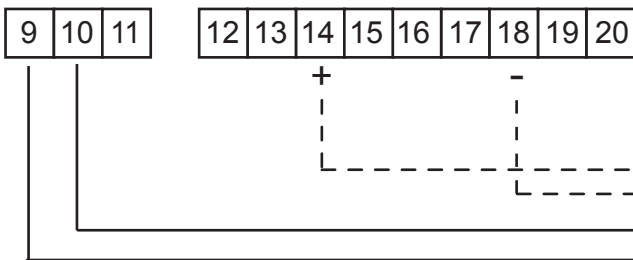

FGC 300

Alarm output

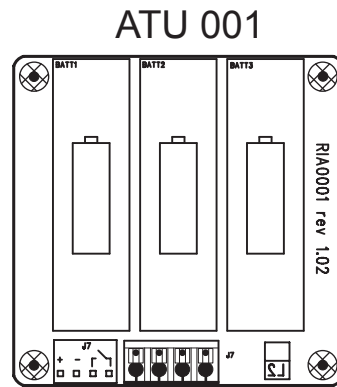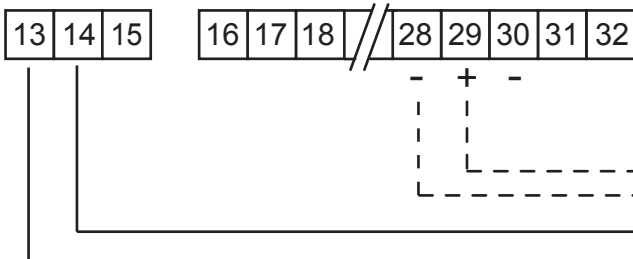



© Copyright 2008 ITT Water & Wastewater AB. All rights reserved. No part of this manual may be reproduced or copied without the written permission of ITT Water & Wastewater AB.

ITT Water & Wastewater AB
P.O Box 2058
SE-291 02 Kristianstad
Sweden
April 2008