


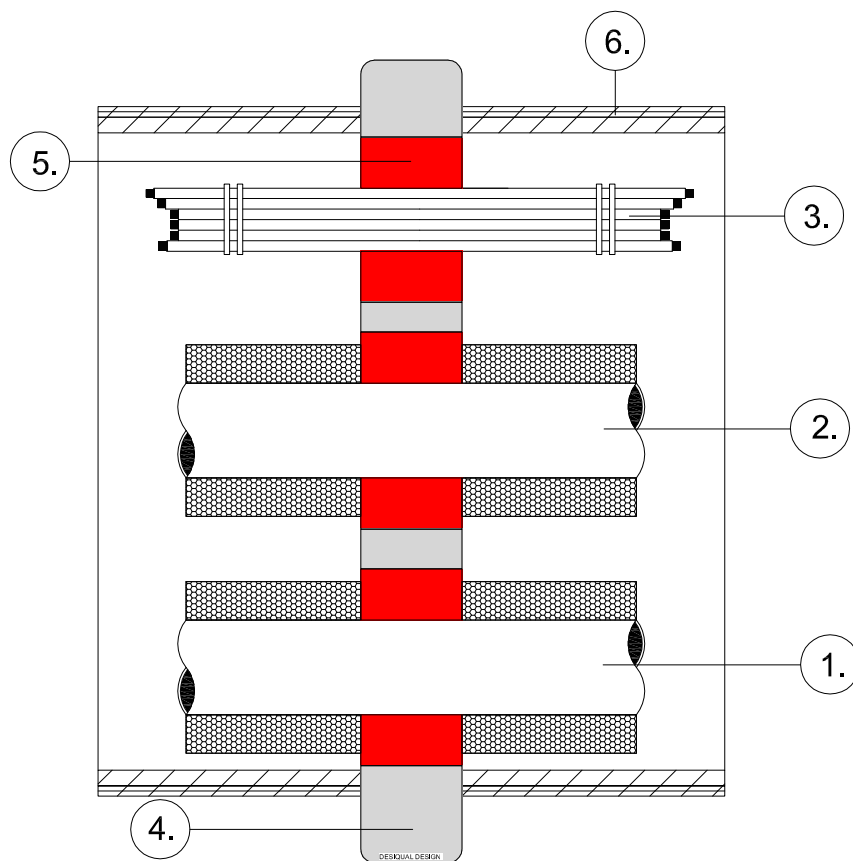

Fire class: EI 60

1. Copper pipe 15-22mm, Armaflex-insulation.
2. Composite pipe 16-20mm, Armaflex-insulation.
3. Cable bundle max. 40mm.
4. Concrete wall min. 100mm.
5. 2K Fire foam fillin, Joints 2K Firefoam Pro+, Depth=100mm, at cable bundles care needs to be taken that seal is made throughout. ETA-11/0206.
6. PS 100 PVC-pipe casing.

Min. seam width = 10mm.

Min. well penetration diameter = Pipe diameter + 20mm.