


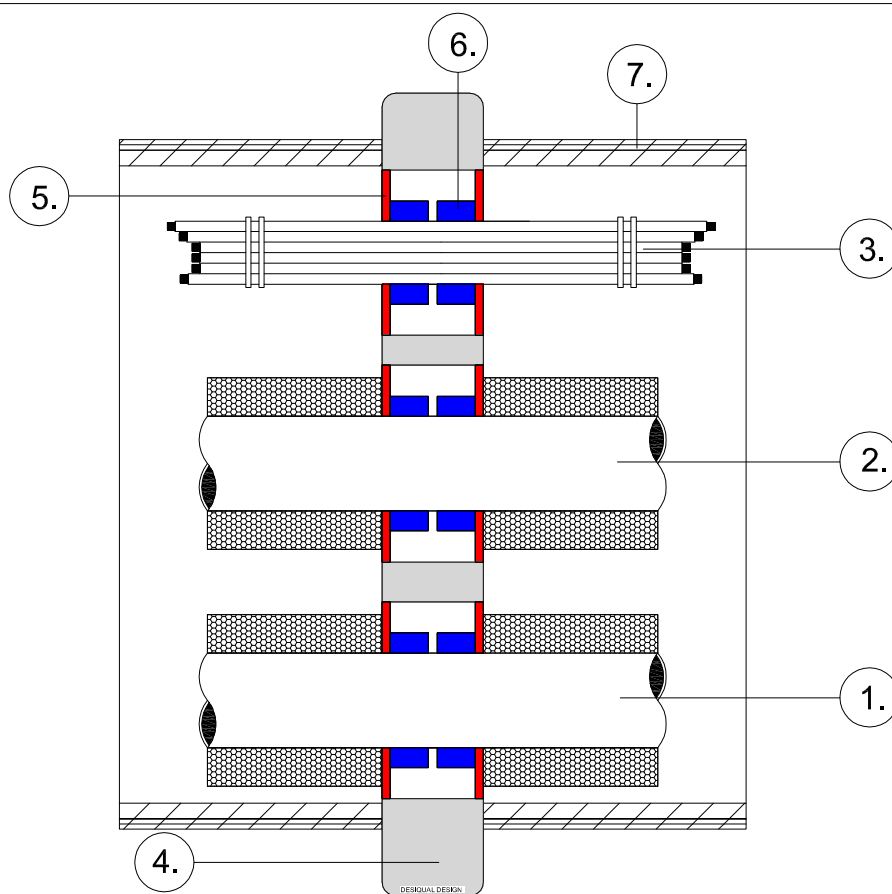

Fire class: EI 60

1. Copper pipe 15-22mm, Armaflex-insulation.
2. Composite pipe 16-20mm, Armaflex-insulation.
3. Cable bundle max. 40mm.
4. Concrete wall min. 60mm.
5. Fire gas seal: Fire acryl filling, Joints Fire Acryl Pro+, ETA-13/0992.
6. Firewrap, Joints Fire Wrapl Pro+, Installation: 2 laps around the pipe or cable bundle, ETA 14/0033.
7. PS 100 PVC-pipe casing.

Seam width = 6-10mm.

Wall penetration diameter = Pipe diameter + 12-20mm.