

Operating Instructions

OPTISWITCH 3300 C

with NAMUR output



Variable area flowmeters

Vortex flowmeters

Flow controllers

Electromagnetic flowmeters

Ultrasonic flowmeters

Mass flowmeters

Level measuring instruments

Communications engineering

Engineering systems & solutions

Switches, counters, displays and recorders

Heat metering

Pressure and temperature

Contents

1 About this document

1.1 Function 5

1.2 Target group 5

1.3 Symbolism used 5

2 For your safety

2.1 Authorised personnel 6

2.2 Appropriate use 6

2.3 Warning about misuse 6

2.4 General safety instructions 6

2.5 CE conformity 6

2.6 SIL conformity 7

2.7 Safety information for Ex areas 7

3 Product description

3.1 Configuration 8

3.2 Principle of operation 8

3.3 Adjustment 9

3.4 Storage and transport 10

4 Mounting

4.1 General instructions 11

4.2 Mounting information 12

5 Connecting to power supply

5.1 Preparing the connection 18

5.2 Connection procedure 18

5.3 Wiring plans, signal chamber housing 19

6 Setup

6.1 General 22

6.2 Adjustment elements 22

6.3 Function chart 23

6.4 Recurring function test 24

7 Maintenance and fault rectification

7.1 Service 27

7.2 Fault rectification 27

7.3 Exchanging the electronics 28

7.4 Instrument repair 30

8 Dismounting

8.1 Dismounting steps 31

8.2 Disposal	31
9 Functional safety	
9.1 General.	32
9.2 Planning	33
9.3 Setup	35
9.4 Reaction during operation and in case of failure	36
9.5 Recurring function test.	36
9.6 Safety-related characteristics	37
10 Supplement	
10.1 Technical data.	40
10.2 Dimensions.	44
10.3 Certificates	47

Supplementary operating instructions manuals



Information:

OPTISWITCH 3300 C is available in different versions. Depending on the selected version, supplementary operating instructions manuals will also be included in the scope of delivery. The supplementary operating instructions manuals are listed in section "*Product description*".

Operating instructions manuals for accessories and replacement parts



Tip:

We offer accessories and replacement parts to enable reliable use and operation of your OPTISWITCH 3300 C. The corresponding operating instructions manuals are:

- Operating instructions manual "*Oscillator*"
- Operating instructions manual "*Lock fitting*"

1 About this document

1.1 Function

This operating instructions manual has all the information you need for quick setup and safe operation of OPTISWITCH 3300 C. Please read this manual before you start setup.

1.2 Target group

This operating instructions manual is directed to trained personnel. The contents of this manual should be made available to these personnel and put into practice by them.

1.3 Symbolism used



Information, tip, note

This symbol indicates helpful additional information.



Caution, warning, danger

This symbol informs you of a dangerous situation that could occur. Ignoring this cautionary note can impair the person and/or the instrument.



Ex applications

This symbol indicates special instructions for Ex applications.



List

The dot set in front indicates a list with no implied sequence.



Action

This arrow indicates a single action.



Sequence

Numbers set in front indicate successive steps in a procedure.

2 For your safety

2.1 Authorised personnel

All operations described in this operating instructions manual must be carried out only by trained and specialist personnel authorised by the operator. For safety and warranty reasons, any internal work on the instruments must be carried out only by personnel authorised by the manufacturer.

2.2 Appropriate use

OPTISWITCH 3300 C is a sensor for level detection.

Detailed information on the application range of OPTISWITCH 3300 C is available in chapter "Product description".

2.3 Warning about misuse

Inappropriate or incorrect use of the instrument can give rise to application-specific hazards, e.g. vessel overfill or damage to system components through incorrect mounting or adjustment.

2.4 General safety instructions

OPTISWITCH 3300 C is a high-tech instrument requiring the strict observance of standard regulations and guidelines. The user must take note of the safety instructions in this operating instructions manual, the country-specific installation standards (e.g. the VDE regulations in Germany) as well as all prevailing safety regulations and accident prevention rules.

2.5 CE conformity

OPTISWITCH 3300 C is in CE conformity with EMC (89/336/EEG), fulfils the NAMUR recommendation NE 21 and is in CE conformity with NSR (73/23/EEG).

Conformity has been judged acc. to the following standards:

- EMC:
 - Emission EN 61326: 1997 (class B)
 - Susceptibility EN 61326: 1997/A1: 1998
- LVD: EN 61010-1: 2001

2.6 SIL conformity

OPTISWITCH 3300 C fulfills the requirements for functional safety acc. to IEC 61508. You will find further information in chapter "Functional safety".

2.7 Safety information for Ex areas

Please note the Ex-specific safety information for installation and operation in Ex areas. These safety instructions are part of the operating instructions manual and come with the Ex-approved instruments.

3 Product description

3.1 Configuration

Scope of delivery

The scope of delivery encompasses:

- OPTISWITCH 3300 C level sensor
- Documentation
 - this operating instructions manual
 - Supplementary instructions manual *"Plug connector for level sensors"* - optional
 - Ex specific safety instructions (with Ex versions), if necessary further certificates

Components

OPTISWITCH 3300 C consists of the following components:

- Housing cover
- Housing with electronics
- process fitting with tuning fork

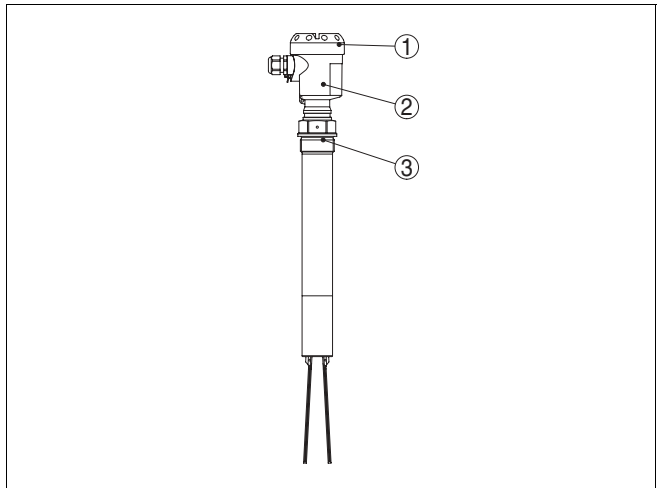


Fig. 1: OPTISWITCH 3300 C - with plastic housing

- 1 Housing cover
- 2 Housing with electronics
- 3 Process fitting

3.2 Principle of operation

Area of application

OPTISWITCH 3300 C is a level sensor with tuning fork for level detection.

It is designed for industrial use in all areas of process technology and is preferably used for bulk solids.

Typical applications are overfill and dry run protection. Thanks to its simple and robust measuring system, OPTISWITCH 3300 C is virtually unaffected by the chemical and physical properties of the solid.

It functions even when exposed to strong external vibration or changing products.

Solid detection in water

If OPTISWITCH 3300 C was ordered for solid detection in water, the tuning fork is set to the density of water. In air or if immersed in water (density: 1 g/cm³ / 0.036 lbs/in³), OPTISWITCH 3300 C signals uncovered. Only if the vibrating element is also covered with solids (e.g. sand, sludge, gravel etc.) will the sensor signal covered.

Fault monitoring

The electronics of OPTISWITCH 3300 C continuously monitors the following criteria:

- Correct vibrating frequency
- Line break to the piezo drive

If one of these faults is detected, the electronics signals it via a defined current to the signal conditioning instrument. The connection cable to the vibrating element is also monitored.

Physical principle

The tuning fork is piezoelectrically energised and vibrates at its mechanical resonance frequency of approx. 150 Hz. When the tuning fork is submerged in the product, the vibrating amplitude changes. This change is detected by the integrated oscillator and converted into a switching command.

Power supply

OPTISWITCH 3300 C with NAMUR electronics can be connected to different NAMUR amplifiers depending to your requirements. The specifications for NAMUR amplifiers are available in the Technical data.

The exact range of the power supply is stated in the Technical data in the Supplement.

3.3 Adjustment

With the factory setting, products with a density of >0.02 g/cm³ (>0.0008 lbs/in³) can be measured. It is possible to adapt the instrument for products with lower density >0.008 g/cm³ (>0.0003 lbs/in³).

On the electronics module you will find the following indicating and adjustment elements:

- signal lamp for indication of the switching condition (yellow)
- potentiometer for adaptation to the product density
- Mode switch to select the switching condition (reverse characteristics)
- Simulation key

3.4 Storage and transport

Packaging

Your instrument was protected by packaging during transport. Its capacity to handle normal loads during transport is assured by a test acc. to DIN 55439.

The packaging of standard instruments consists of environment-friendly, recyclable cardboard. In addition, the sensor is provided with a protective cover of cardboard. For special versions PE foam or PE foil is also used. Dispose of the packaging material via specialised recycling companies.

Storage and transport temperature

- Storage and transport temperature see "Supplement - Technical data - Ambient conditions"
- Relative humidity 20 ... 85 %

4 Mounting

4.1 General instructions

Switching point

In general, OPTISWITCH 3300 C can be mounted in any position. The instrument must be mounted in such a way that the tuning fork is at the height of the requested switching point.

Moisture

Use the recommended cable (see chapter "*Connecting to power supply*") and tighten the cable gland.

You can give your OPTISWITCH 3300 C additional protection against moisture penetration by leading the connection cable downward in front of the cable entry. Rain and condensation water can thus drain off. This applies mainly to mounting outdoors, in areas where moisture is expected (e.g. by cleaning processes) or on cooled or heated vessels.

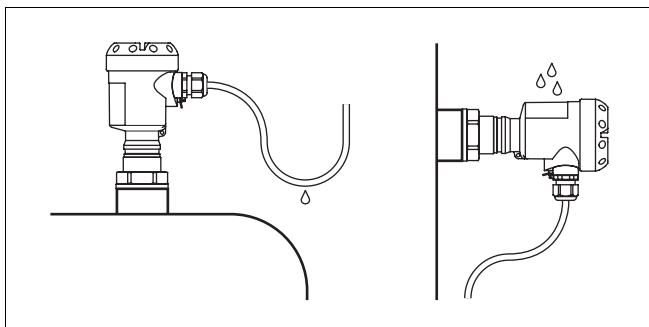


Fig. 2: Measures against moisture penetration

Transport

Do not hold OPTISWITCH 3300 C on the vibrating element. Especially with flange and tube versions, the sensor can be damaged by the weight of the instrument.

Remove the protective cover just before mounting.

Pressure/Vacuum

The process fitting must be sealed if there is gauge or low pressure in the vessel. Before use, check if the seal material is resistant against the measured product and the process temperature.

Handling

The vibrating level switch is a measuring instrument and must be treated accordingly. Bending the vibrating element will destroy the instrument.

**Warning:**

The housing must not be used for screwing in! Tightening can cause damages on the locking piston of the housing.

To screw in, use the hexagon above the thread.

4.2 Mounting information

Agitators and fluidization

Due to agitators, vibrations or similar, the level switch can be subjected to strong lateral forces. For this reason, do not use an overly long extension tube for OPTISWITCH 3300 C, but check if you can mount a short level switch on the side of the vessel in horizontal position.

Extreme vibration caused by the process or the equipment, e. g. agitators or turbulence in the vessel e.g. from fluidization, can cause the extension tube of OPTISWITCH 3300 C to vibrate in resonance. This leads to increased stress on the upper weld joint. Should a longer tube version be necessary, you can provide a suitable support or guy directly above the tuning fork to secure the extension tube.



This measure applies particularly to applications in Ex areas. Make sure that the tube is not subjected to bending forces through this measure.

Inflowing material

If OPTISWITCH 3300 C is mounted in the filling stream, unwanted switching signals may be generated. Mount OPTISWITCH 3300 C at a location in the vessel where no disturbing influence from e.g. filling openings, agitators, etc. can occur.

This applies particularly to instrument types with long extension tube.

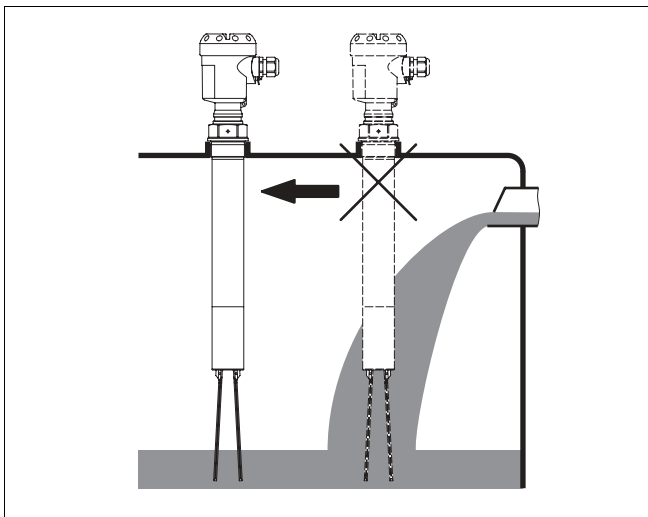


Fig. 3: Inflowing material

Lock fitting

OPTISWITCH 3300 C can be mounted with a lock fitting for height adjustment. Take note of the pressure information of the lock fitting.

Socket

The vibrating element should protrude into the vessel to avoid buildup. For that reason, avoid using mounting bosses for flanges and screwed fittings. This applies particularly to use with adhesive products.

Material cone

Material cones can form in solids silos which can change the switching point. Please keep this in mind when installing the sensor in the vessel. We recommend selecting an installation location where the tuning fork detects an average value of the material cone.

The vibrating element must also be mounted at a location that takes the arrangement of the filling and emptying apertures into account.

To compensate measurement errors in cylindrical vessels caused by the material cone, the sensor must be mounted at a distance of $d/6$ from the vessel wall.

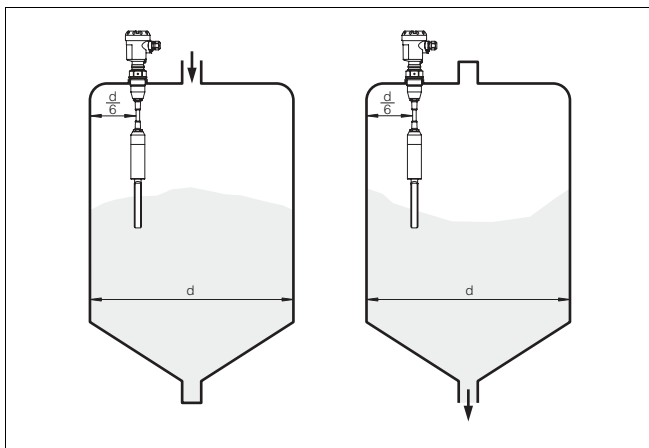


Fig. 4: Filling and emptying centered

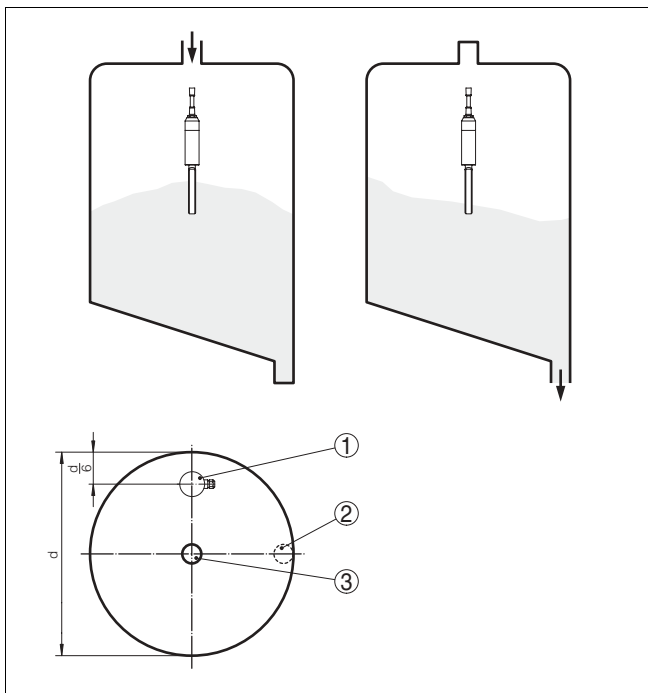


Fig. 5: Filling in the center, emptying laterally

1 OPTISWITCH 3300 C

2 Emptying opening

3 Filling opening

Flow

If there is movement within the product, the tuning fork of OPTISWITCH 3300 C should be mounted in such a way that the surfaces of the fork are parallel to the product movement.



Fig. 6: Orientation of the tuning fork in case of flow

- 1 Marking with screwed version
- 2 Direction of flow

Baffle protection against falling rocks

In applications such as grit chambers or settling basins for coarse sediments, the vibrating element must be protected against damage with a suitable baffle.

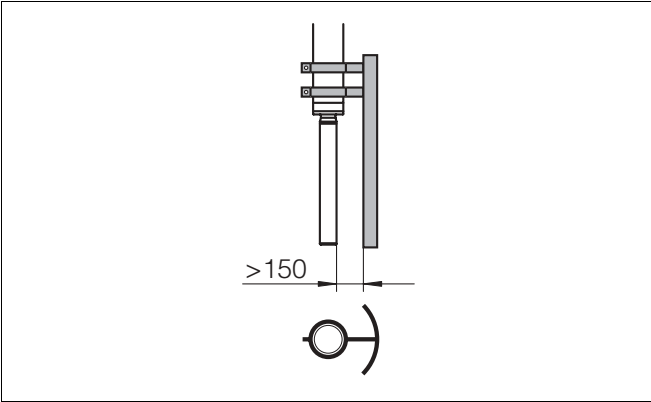


Fig. 7: Baffle protection against damages

5 Connecting to power supply

5.1 Preparing the connection

Note safety instructions

Always observe the following safety instructions:

- Connect only in the complete absence of line voltage

Take note of safety instructions for Ex applications



In hazardous areas you should take note of the appropriate regulations, conformity and type approval certificates of the sensors and power supply units.

Select power supply

Connect the power supply acc. to the following diagrams. Take note of the general installation regulations. As a rule, connect OPTISWITCH 3300 C to vessel ground (PA), or in case of plastic vessels, to the next ground potential. On the side of the instrument housing there is a ground terminal between the cable entries. This connection serves to drain off electrostatic charges. In Ex applications, the installation regulations for hazardous areas must be given priority.

The data for power supply are stated in the Technical data in the Supplement.

Select connection cable

OPTISWITCH 3300 C is connected with standard cable with round cross-section. An outer cable diameter of 5 ... 9 mm (0.2 ... 0.35 in) ensures the seal effect of the cable entry.

If cable with a different diameter or wire cross section is used, exchange the seal or use an appropriate cable connection.



In hazardous areas, only use approved cable connections for OPTISWITCH 3300 C.

Select connection cable for Ex applications



Take note of the corresponding installation regulations for Ex applications.

5.2 Connection procedure



With Ex instruments, the housing cover may only be opened if there is no explosive atmosphere present.

Proceed as follows:

- 1 Unscrew the housing cover
- 2 Loosen compression nut of the cable entry

- 3 Remove approx. 10 cm (4 in) of the cable mantle, strip approx. 1 cm (0.4 in) insulation from the ends of the individual wires
- 4 Insert the cable into the sensor through the cable entry
- 5 Lift the opening levers of the terminals with a screwdriver (see following illustration)
- 6 Insert the wire ends into the open terminals according to the wiring plan
- 7 Press down the opening levers of the terminals, you will hear the terminal spring closing
- 8 Check the hold of the wires in the terminals by lightly pulling on them
- 9 Tighten the compression nut of the cable entry, the seal ring must completely encircle the cable
- 10 Screw the housing cover back on

The electrical connection is finished.

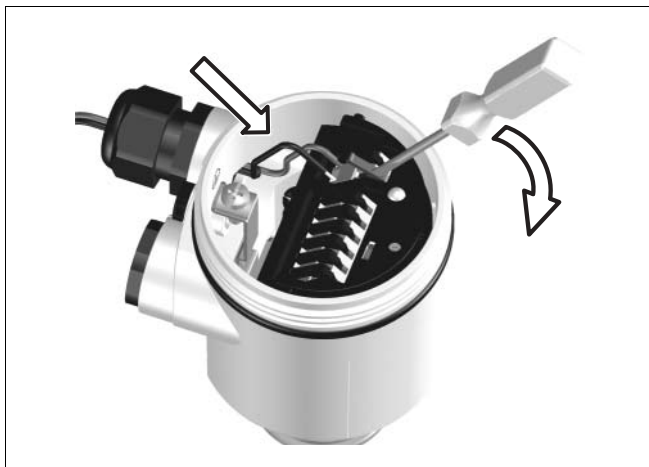


Fig. 8: Connection steps 5 and 6

5.3 Wiring plans, signal chamber housing



The following illustrations apply to the non-Ex as well as to the EEx d version.

Housing overview

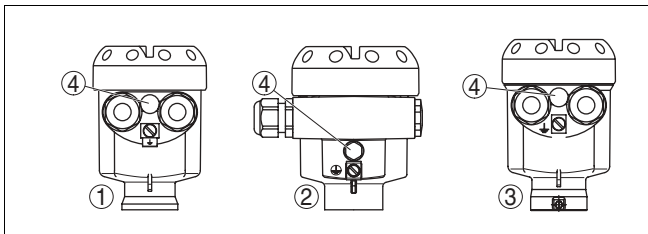


Fig. 9: Material versions, single chamber housing

- 1 Plastic
- 2 Aluminium
- 3 Stainless steel
- 4 Filter element for pressure compensation

Electronics and connection compartment, single chamber housing

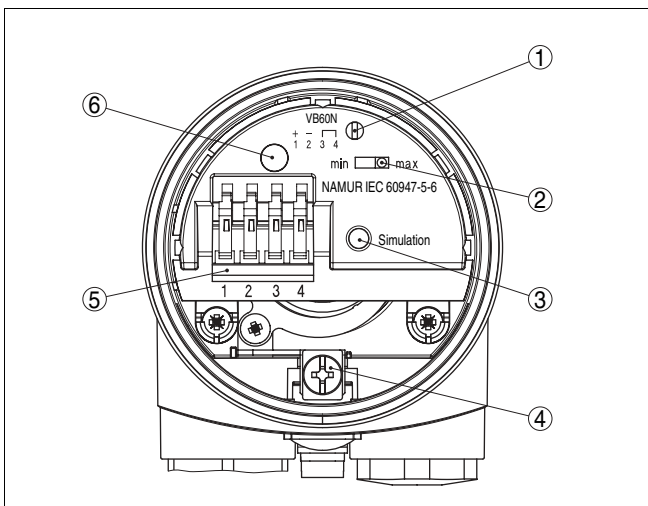


Fig. 10: Electronics and connection compartment, single chamber housing

- 1 Potentiometer for switching point adaptation
- 2 DIL switch for characteristics reversal
- 3 Simulation key
- 4 Ground terminal
- 5 Terminals
- 6 Control lamp

Wiring plan

For connection to an amplifier acc. to NAMUR (IEC 60947-5-6, EN 50227). For further information see Technical data in the Supplement.

Further information you will find in the Technical data in the Supplement, Ex technical data are specified in the attached safety instructions manual.

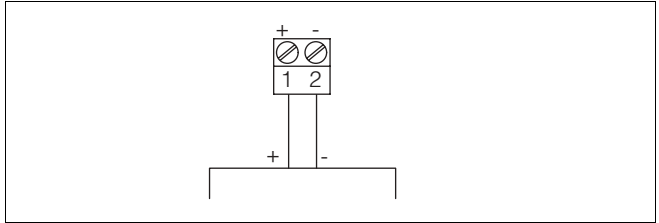


Fig. 11: Wiring plan, single chamber housing

External simulation key

In addition to the test key on the electronics module, you can connect an external modulator to start the test procedure. Connect the modulator acc. to the following wiring plan. Terminals 3 and 4 are already bridged.

For additional information see "*Recurring function test*".

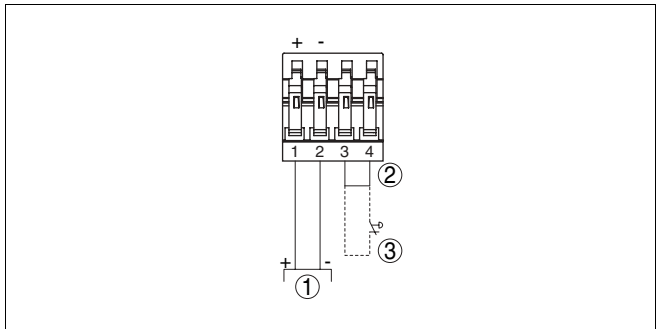


Fig. 12: Wiring plan - External simulation key

- 1 NAMUR amplifier
- 2 Bridge
- 3 External simulation key

6 Setup

6.1 General

The numbers in brackets refer to the following illustrations.

Function/Configuration

On the electronics module you will find the following indicating and adjustment elements:

- Potentiometer for switching point adaptation (1)
- DIL switch for mode adjustment - min/max (2)
- Simulation key (3)
- Signal lamp (6)

6.2 Adjustment elements

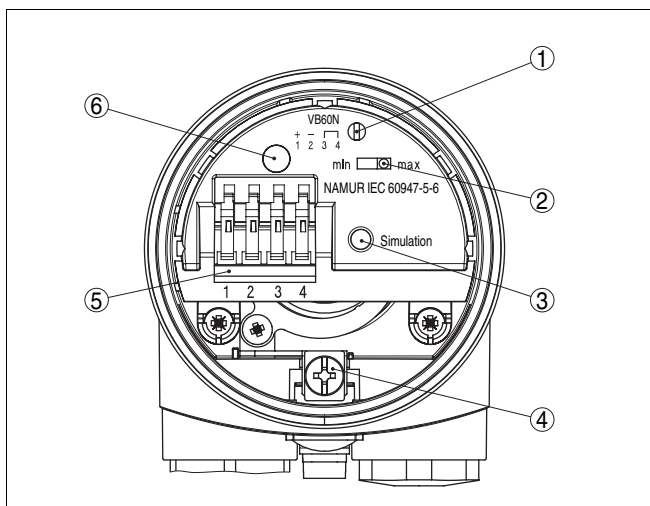


Fig. 13: Oscillator VB 60N - NAMUR output

- 1 Potentiometer for switching point adaptation
- 2 DIL switch for characteristics reversal
- 3 Simulation key
- 4 Ground terminal
- 5 Terminals
- 6 Control lamp

Switching point adaptation (1)

You can adapt the switching point to the solid with the potentiometer. The switching point is preset and covered by a label. It must only be modified in special cases.

The factory setting of the potentiometer of OPTISWITCH 3300 C is mid position ($>0.02 \text{ g/cm}^3$ or $>0.0008 \text{ lbs/in}^3$). In case of

very light solids, turn the potentiometer completely to the left ($>0.008 \text{ g/cm}^3$ or $>0.0003 \text{ lbs/in}^3$). By doing this, OPTISWITCH 3300 C will be more sensitive and light solids can be detected more reliably.

For instruments detecting solids in water, these values are not applicable. The potentiometer is preset and must not be changed.

Characteristics reversal (2)

The characteristics reversal can be carried out with the DIL switch. You can choose between falling characteristics (switch position max.) and rising characteristics (switch position min.). You can have the requested current outputted.

Modes

- min. - rising characteristic curve (High current when immersed)
- max. - falling characteristics (Low current when immersed)

The NAMUR output can be switched over to falling or rising characteristics (see also Function chart).

Simulation key (3)

The simulation key is located in a recess on the upper side of the oscillator. Push the simulation key with a suitable object (screwdriver, pen, etc.).

When the key is pushed, line break between sensor and processing unit is simulated. The signal lamp on the sensor extinguishes. The measuring system must signal failure and take on safe condition when the key is pushed.

Keep in mind that the connected instruments are activated during operation. By doing this, you can check the correct function of the measuring system.

Signal lamp (6)

Control lamp (LED) for indication of the switching condition.

- yellow = High current $\geq 2.2 \text{ mA}$
- dark = Low current $\leq 1 \text{ mA}$
- yellow (flashing) = Failure $\leq 1 \text{ mA}$

6.3 Function chart

OPTISWITCH 3300 C level switch

The following chart provides an overview of the switching conditions depending on the adjusted mode and level.



Note:
Select the mode setting on the NAMUR amplifier in such a way that the switching output takes on safe condition if there is a fault signal ($I \leq 1.0 \text{ mA}$).

	Level	Signal current - Sensor	Control lamp
Falling characteristics max.		$\geq 2.2 \text{ mA}$	
Falling characteristics max.		$\leq 1.0 \text{ mA}$	
Rising characteristics min.		$\geq 2.2 \text{ mA}$	
Rising characteristics min.		$\leq 1.0 \text{ mA}$	
Failure	any	$\leq 1.0 \text{ mA}$	 flashes

6.4 Recurring function test

Acc. to IEC 61508.

In mode A (overflow protection), OPTISWITCH 3300 C is qualified for use in measuring chains of stage SIL2 acc. to IEC 61508 (redundant, stage SIL3).

SIL

The following instrument combinations meet the requirements acc. to SIL:

OPTISWITCH 3300 C

- Oscillator VB E60N

Recurring function test

The recurring function test acc. to IEC 61508 can be carried out by pushing the simulation key on the electronics module or by briefly (> 2 seconds) interrupting the cable to the sensor. The correct sequence of the switching conditions must be monitored on the switch amplifier as well as on the connected systems. Neither must the sensor be removed nor a response triggered by filling the vessel. This applies to OPTISWITCH 3300 C with NAMUR oscillator VB E60N.

You can carry out the function test with the outputted current values also directly with a safety PLC or a process control system.

Simulation key on the electronics module

In applications in conjunction with the NAMUR electronics module VB E60N, a function test can be carried out. Hence the integration time must be set to 0.5 s. OPTISWITCH 3300 C has an integrated simulation key. The simulation key is lowered on the electronics module. Push the simulation key for > 2 seconds.

If OPTISWITCH 3300 C is connected to an SPLC, you have to interrupt the connection cable to the sensor for > 2 seconds.

After releasing the simulation key or briefly interrupting the connection cable to the sensor, you can check the complete measuring system on correct function. A switching procedure is simulated during the test.

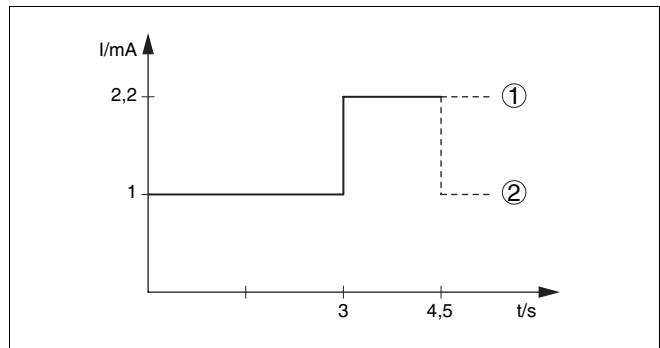


Fig. 14: Flow chart of the function test

- 1 Full signal
- 2 Empty signal

Check if the switching conditions occur in the correct sequence and the stated time period. If this is not the case, there is a fault in the measuring system. Keep in mind that

connected instruments are activated during the function test. By doing this, you can check the correct function of the measuring system.

Test procedure (after releasing the simulation key)

	Sensor current	Level relay amplifier - overfill protection	Level relay amplifier - dry run protection	Signal lamp amplifier - overfill protection	Signal lamp amplifier - dry run protection	Signal lamp - sensor
1. Low Current (approx. 3 s)	approx. 1 mA	energized	currentless			
2. High Current (approx. 1.5 s)	approx. 2.2 mA	currentless	energized			
3. Return to the actual operating condition						



Note:
Mode B (dry run protection) is not permitted, when used in meas. chains acc. to IEC 61508.

With the stated current values you can carry out the function test directly via a safety PLC or a process control system.

7 Maintenance and fault rectification

7.1 Service

When used as directed in normal operation, OPTISWITCH 3300 C is completely maintenance-free.

7.2 Fault rectification

OPTISWITCH 3300 C offers maximum reliability. Nevertheless faults can occur during operation. These may be caused by the following, e.g.:

- Sensor
- Process
- Power supply
- Signal processing.

Fault rectification

The first measure is checking the output signal. In many cases, the reasons can be determined and faults rectified.

? OPTISWITCH 3300 C signals "covered" when the vibrating element is not submerged (overflow protection)

? OPTISWITCH 3300 C signals "uncovered" when the vibrating element is submerged (dry run protection)

- Supply voltage too low

→ Check the power supply

- Electronics defective

→ Push the characteristics reversal switch. If the instrument then changes the mode, the instrument may be mechanically damaged. Should the switching function in the correct mode still be faulty, return the instrument for repair.

→ Push the characteristics reversal switch. If the instrument then does not change the mode, the oscillator may be defective. Exchange the oscillator.

→ Check if there is buildup on the vibrating element, and if so, remove it.

- Unfavourable installation location

→ Mount the instrument at a location where no dead zones or mounds can form in the vessel.

- Check if the vibrating element is covered by buildup on the socket.
- Wrong characteristics selected
- Set the correct characteristics on the characteristics reversal switch (overflow protection; dry run protection). Wiring should be carried out acc. to the quiescent current principle.
- ? Signal lamp flashes yellow
 - Failure on the electronics
 - Exchanging the electronics
- ? Signal lamp flashes yellow
 - instrument defective
 - Exchange instrument or return it for repair

7.3 Exchanging the electronics

In general, all oscillators of series VB60 can be interchanged. If you want to use an oscillator with a different signal output, you can download the corresponding operating instructions manual from our homepage under Downloads.



With EExd instruments, the housing cover must only be opened if there is no explosive atmosphere present.

Proceed as follows:

- 1 Switch off power supply
- 2 Unscrew the housing cover
- 3 Lift the opening levers of the terminals with a screwdriver
- 4 Pull the connection cables out of the terminals
- 5 Loosen the two screws with a Phillips screwdriver (size 1)

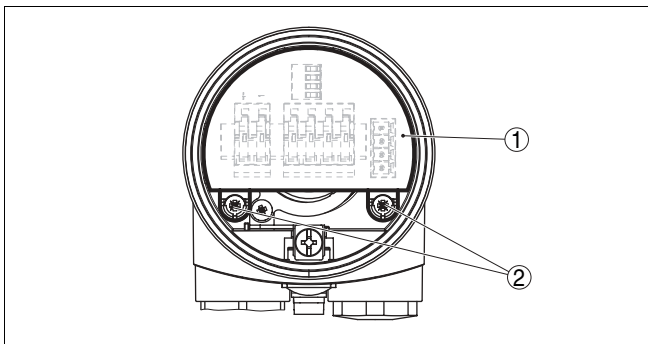


Fig. 15: Loosen the screws

- 1 Electronics module
- 2 Screws (2 pcs.)

- 6 Remove the old oscillator
- 7 Compare the new oscillator with the old one. The type label of the oscillator must correspond to that of the old oscillator. This applies particularly to instruments used in hazardous areas.
- 8 Compare the settings of the two oscillators. Set the adjustment elements of the new oscillator to the settings of the old oscillator.



Information:

Make sure that the housing is not rotated during the electronics exchange. Otherwise the plug may be in a different position later.

- 9 Insert the oscillator carefully. Make sure that the plug is in the correct position.
- 10 Screw in and tighten the two screws with a Phillips screwdriver.
- 11 Insert the wire ends into the open terminals according to the wiring plan
- 12 Close the opening levers of the terminals, you will hear the terminal spring closing
- 13 Check the hold of the wires in the terminals by lightly pulling on them
- 14 Check the tightness of the cable entry. The seal ring must completely encircle the cable.
- 15 Screw the housing cover back on

The electronics exchange is finished.

7.4 Instrument repair

If a repair is necessary, please proceed as follows:

You can download a return form from our Internet homepage
http://www.krohne-mar.com/fileadmin/media-lounge/PDF-Download/Specimen_e.pdf.

By doing this you help us carry out the repair quickly and without having to call back for needed information.

- Print and fill out one form per instrument
- Clean the instrument and pack it damage-proof
- Attach the completed form and possibly also a safety data sheet to the instrument

8 Dismounting

8.1 Dismounting steps

**Warning:**

Before dismounting, be aware of dangerous process conditions such as e.g. pressure in the vessel, high temperatures, corrosive or toxic products etc.

Take note of chapters "*Mounting*" and "*Connecting to power supply*" and carry out the listed steps in reverse order.



With Ex instruments, the housing cover may only be opened if there is no explosive atmosphere present.

8.2 Disposal

OPTISWITCH 3300 C consists of materials which can be recycled by specialised recycling companies. We have purposely designed the electronic modules to be easily separable.

WEEE directive 2002/96/EG

This instrument is not subject to the WEEE directive 2002/96/EG and the respective national laws (in Germany, e.g. ElektroG). Pass the instrument directly on to a specialised recycling company or use the municipal collecting points. They may only be used for privately used products acc. to the WEEE directive.

Correct disposal avoids negative effects to persons and environment and ensures recycling of useful raw materials.

Materials: see "*Technical data*"

If you cannot dispose of the instrument properly, please contact us about disposal methods or return.

9 Functional safety

9.1 General

Validity

This safety manual applies to measuring systems consisting of OPTISWITCH 3300 C vibrating level switches and integrated oscillator VB60N. The instrument corresponds to a subsystem of type B.

The sensor software must correspond at least to version 1.00 or higher.

Area of application

The measuring system can be used for level detection of powders and granules which meet the specific requirements of the safety technology, e.g.:

- Mode "max" for overfill protection
- Mode "min" for dry run protection

The measuring system is qualified in both modes to meet the following requirement degree acc. to IEC 61508-2:

- **SIL2** with architecture 1oo1D (single channel)
- **SIL3** with architecture 1oo2D (double-channel/redundant)

With a special factory setting, the measuring system is also suitable for detection of solids in water (see operating instructions manual).

Safety function

The safety function of this measuring system is the detection and signalling of the condition of the vibration element. The safe condition depends on the mode:

- In mode "max": condition "covered"
- In mode "min": condition "uncovered"

Relevant standards

- IEC 61508-1, -2, -4
 - Functional safety of electrical/electronic/programmable electronic systems

Safety requirements

The failure limit values for a safety function, depending on the SIL class (of IEC 61508-1, 7.6.2)

Safety integrity level	Low demand mode	High demand mode
SIL	PFD _{avg}	PFH
4	$\geq 10^{-5}$ up to $< 10^{-4}$	$\geq 10^{-9}$ up to $< 10^{-8}$
3	$\geq 10^{-4}$ up to $< 10^{-3}$	$\geq 10^{-8}$ up to $< 10^{-7}$
2	$\geq 10^{-3}$ up to $< 10^{-2}$	$\geq 10^{-7}$ up to $< 10^{-6}$
1	$\geq 10^{-2}$ up to $< 10^{-1}$	$\geq 10^{-6}$ up to $< 10^{-5}$

Safety integrity of the hardware for safety-relating subsystems of type B (IEC 61508-2, 7.4.3)

Safe failure fraction	Hardware fault tolerance		
SFF	HFT = 0	HFT = 1	HFT = 2
<60 %	not permitted	SIL1	SIL2
60 % up to <90 %	SIL1	SIL2	SIL3
90 % up to <99 %	SIL2	SIL3	(SIL4)
>=99 %	SIL3	(SIL4)	(SIL4)

9.2 Planning

General instructions and restrictions

- The measuring system must be used acc. to the application
- The application-specific limits must be maintained and the specifications must not be exceeded.
- Acc. to the specifications in the operating instructions manual, the current load of the output circuits must be within the limits.
- It must be used only in products to which the materials of the vibrating system are sufficiently chemically resistant.

Note the following items for use as dry run protection system:

- Avoid buildup on the vibrating system (possibly smaller proof test intervals)
- Avoid granulation size of the product > 15 mm

Assumptions

For the implementation of FMEDA (Failure Mode, Effects and Diagnostics Analysis) the following assumptions form the basis:

- Failure rates are constant, wear of the mechanical parts is not taken into account
- Failure rates of external power supplies are not included
- Multiple errors are not taken into account
- The average ambient temperature during the operating time is +40°C (104°F)
- The environmental conditions correspond to an average industrial environment
- The service lift of the components is between 8 to 12 years (IEC 61508-2, 7.4.7.4, remark 3)
- The processing unit can interpret "fail low" and "fail high" failures as interferences and output a suitable fault signal

- The communication via the IIC bus interface is only used for default scaling and for service purposes.
- The repair time (exchange of the measuring system) after a fail-safe error is eight hours (MTTR = 8 h)
- In the mode with the lowest demand rate, the reaction time of a connected control and processing unit to dangerous detectable errors is max. 1 hour.

Low demand mode

If the demand rate is only once a year, then the measuring system can be used as safety-relevant subsystem in "low demand mode" (IEC 61508-4, 3.5.12).

If the ratio of the internal diagnostics test rate of the measuring system to the demand rate exceeds the value 100, the measuring system can be treated in the way it is executing a safety function in the mode with low demand rate (IEC 61508-2, 7.4.3.2.5).

Corresponding characteristics is the value PFD_{avg} (average Probability of dangerous Failure on Demand). It is dependent on the test interval T_{Proof} between the function tests of the protective function.

For number values see paragraph "Safety-technical characteristics".

High demand mode

If the "low demand rate" does not apply, the measuring system as safety-relevant part system in "high demand mode" should be used (IEC 61508-4, 3.5.12).

The fault tolerance time of the complete system must be higher than the sum of the reaction times or the diagnostics test periods of all components in the safety chain.

Corresponding characteristics is the value PFH (failure rate).

For number values see paragraph "Safety-technical characteristics".

Safe condition

The safe condition depends on the mode and is stated in the following chart:

The characteristics min/max must be set acc. to the mode (see Function chart).

	Overfill protection	Dry run protection
Safe condition	"covered"	"uncovered"
Output current in safe condition	0.4 ... 1 mA	0.4 ... 1 mA

	Overfill protection	Dry run protection
Interference current "Fail Low"	< 1 mA	< 1 mA
Interference current "Fail High"	> 6.5 mA	> 6.5 mA

Fault description

A safe failure exists if the measuring system goes to the defined safe condition without being required by the process or the interference current outputs "Fail low" or "Fail high".

If the internal diagnostics system detects an error, an interference current of < 1 mA will be outputted.

A dangerous undetected failure exists if the measuring system switches neither to the defined safe condition, nor to failure mode when the process requires it.

Configuration of the processing unit

If the measuring system delivers output currents of "fail low" or "fail high", it can be assumed that there is a failure somewhere.

The processing unit must therefore interpret such currents as failure and output a suitable fault signal.

If this is not the case, the appropriate shares of the failure rates must be assigned to the dangerous failures. Therefore the stated values in chapter "Safety-relevant characteristics" can deteriorate.

The processing unit must correspond to the SIL level of the measuring chain.

The adjustment of the mode on the NAMUR amplifier acc. to IEC 60947-5-6 must be selected in such a way that its switching condition takes on safe condition if there is an input current < 1.2 mA.

9.3 Setup

Mounting and installation

The prevailing plant conditions influence the safety of the measuring system. Therefore note the mounting and installation instructions of the appropriate operating instructions manual. Mainly important is the correct setting of the mode (min./max.).

9.4 Reaction during operation and in case of failure

- The adjustment elements must not be modified during operation.
- In case of modifications during operation, you have to take note of the safety functions.
- Occurring fault signals are described in the appropriate operating instructions manual.
- In case of detected failures or fault signals, the entire measuring system must be switched out of service and the process held in a safe condition by means of other measures.
- An electronics exchange is easily possible and described in the operating instructions manual.
- If due to the detected failure, the electronics or the complete sensor is interchanged, the manufacturer must be informed (incl. a fault description).

9.5 Recurring function test

The recurring function test serves to reveal potential dangerous errors that are otherwise not discernible. The function of the measuring system must be checked at adequate intervals.

The operator is responsible for choosing the type of test and the intervals in the stated time frame. The time frame depends on the PFD_{avg} value acc. to the chart and diagram in section "Safety-related characteristics".

In high demand rate, no recurring function test is arranged in IEC 61508. A proof of the functional efficiency is seen in the more frequent demand of the measuring system. In double channel architectures it is useful to proof the redundancy by recurring function tests in appropriate intervals.

The test must be carried out in a way that verifies the flawless operation of the safety functions in conjunction with all system components.

This is ensured by a controlled reaching of the response height during filling. If filling up to the response height is not possible, then a response of the measuring system must be triggered by a suitable simulation of the level or the physical effect.

The methods and procedures used during the tests must be stated and their suitability must be specified. The tests must be documented.

Recurring function test when using the measuring system as overfill protection

If the function test proves negative, the entire measuring system must be switched out of service and the process held in a safe condition by means of other measures.

In the double channel architecture 1oo2D this applies separately to both channels.

If the measuring system is used as overfill protection, the proof of the function is ensured by a simple function test which can be triggered and monitored manually or by a connected control system.

This function test is triggered by interrupting the supply cable for at least two seconds, then a switch on procedure follows as described in the operating instructions manual.

If the test is carried out this way, make sure that the vibrating element is not covered.

If the evaluation is made by a control system, the correct sequence of the current change must be checked and documented.

9.6 Safety-related characteristics

The failure rates of the electronics and the vibrating system were determined by an FMEDA acc. to IEC 61508. Basis for the calculations are component failure rates acc. to SN 29500. All values relate to an average ambient temperature of +40°C (104°F) during operation. The calculations are further based on the instructions stated in chapter "Planning".

Overfill protection

Mode switch is set to "max"

λ_{sd}	12 FIT	safe detected failure (1 FIT = failure/10 ⁹ h)
λ_{su}	160 FIT	safe undetected failure
λ_{dd}	390 FIT	dangerous detected failure
λ_{du}	47 FIT	dangerous undetected failure
SFF	> 92 %	Safe Failure Fraction
DC _S	7 %	Diagnosis coverage $DC_S = \lambda_{sd}/(\lambda_{sd} + \lambda_{su})$
DC _D	89 %	Diagnosis coverage $DC_D = \lambda_{dd}/(\lambda_{dd} + \lambda_{du})$

Dry run protection


Mode switch is set to "min"

λ_{sd}	36 FIT	safe detected failure
λ_{su}	155 FIT	safe undetected failure
λ_{dd}	366 FIT	dangerous detected failure
λ_{du}	52 FIT	dangerous undetected failure
SFF	> 91 %	Safe Failure Fraction
DC _S	19 %	Diagnosis coverage $DC_S = \lambda_{sd}/(\lambda_{sd} + \lambda_{su})$
DC _D	88 %	Diagnosis coverage $DC_D = \lambda_{dd}/(\lambda_{dd} + \lambda_{du})$

General data

T _{Diagnosis} Diagnosis test period	100 sec
MTBF = MTTF + MTTR	1.56x10 ⁶ h
max. useful life of the measuring system for the safety function	approx. 10 years

Architecture 1oo1D - Overfill protection



Single channel architecture


SIL2 (Safety Integrity Level)

HFT = 0 (Hardware Fault Tolerance)

Mode switch is set to "max"

PFD_{avg}	
T _{Proof} = 1 year	< 0.020 x 10 ⁻²
T _{Proof} = 5 years	< 0.100 x 10 ⁻²
T _{Proof} = 10 years	< 0.200 x 10 ⁻²
PFH [1/h]	< 0.047 x 10 ⁻⁶ /h

Architecture 1oo1D - Dry run protection



SIL2 (Safety Integrity Level)

HFT = 0 (Hardware Fault Tolerance)

Mode switch is set to "min"

PFD_{avg}	
T _{Proof} = 1 year	< 0.023 x 10 ⁻²
T _{Proof} = 5 years	< 0.114 x 10 ⁻²
T _{Proof} = 10 years	< 0.228 x 10 ⁻²
PFH [1/h]	< 0.052 x 10 ⁻⁶ /h

Time-dependent process of PFD_{avg}

The time-dependent process of PFD_{avg} reacts in the time period up to 10 years virtually linear to the operating time. The above values only apply to the T_{Proof} interval, after which a recurring function test must be carried out.

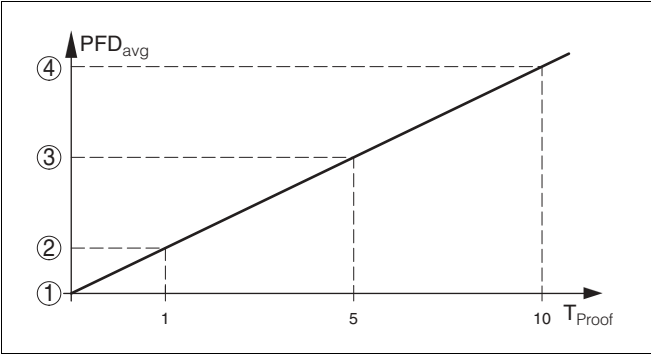


Fig. 16: Time-dependent process of PFD_{avg} ¹⁾

- 1 $PFD_{avg} = 0$
- 2 PFD_{avg} after 1 year
- 3 PFD_{avg} after 5 years
- 4 PFD_{avg} after 10 years

Architecture 1oo2

Multiple channel architecture

SIL3 (Safety Integrity Level)

HFT = 1 (Hardware Fault Tolerance)

SIL	SIL3
HFT	1

If the measuring instrument is used in double channel architecture, the safety-relevant characteristics of the selected structure of the measuring chain must be calculated specifically for the selected application acc. to the above failure rates . A Common Cause Factor must be taken into account.

The measuring system can be used in a diversitary redundant as well as a homogeneous redundant structure.

¹⁾ Numbers see in the above charts.

10 Supplement

10.1 Technical data

General data

Material 316L corresponds to 1.4404 or 1.4435

Materials, wetted parts

- | | |
|-------------------------------------|-------------------|
| – Process fitting - Thread | 316L |
| – Process fitting - Flange | 316L |
| – Process seal | Klingersil C-4400 |
| – Tuning fork | 316L |
| – Extension tube ø 43 mm (ø 1.7 in) | 316L |

Materials, non-wetted parts

- | | |
|---|--|
| – Housing | plastic PBT (Polyester), Alu-die casting powder-coated, stainless steel 316L |
| – Seal ring between housing and housing cover | NBR (stainless steel housing), silicone (Alu/plastic housing) |
| – Ground terminal | 316L |

Weights

- | | |
|--------------------------------|-------------------------------|
| – with plastic housing | 1500 g (53 oz) |
| – with Aluminium housing | 1950 g (69 oz) |
| – with stainless steel housing | 2300 g (81 oz) |
| – Extension tube | approx. 2000 g/m (21.5 oz/ft) |

Sensor length	0.3 ... 6 m (1 ... 20 ft)
---------------	---------------------------

Output variable

Output	two-wire NAMUR output
--------	-----------------------

Current consumption

- | | |
|----------------------------------|--|
| – Falling characteristics (max.) | ≥ 2.2 mA uncovered/ ≤ 1.0 mA covered |
| – Rising characteristics (min.) | ≤ 1.0 mA uncovered/ ≥ 2.2 mA covered |
| – Fault signal | ≤ 1.0 mA |

Necessary processing system

NAMUR processing system acc. to IEC 60947-5-6 (EN 50 227/DIN 19234)

Modes (NAMUR output adjustable to falling or rising characteristics)

- | | |
|--------|---|
| – Min. | rising characteristics (High current when immersed) |
| – max. | falling characteristics (Low current when immersed) |

Ambient conditions

Ambient temperature on the housing	-40 ... +80°C (-40 ... +176°F)
Storage and transport temperature	-40 ... +80°C (-40 ... +176°F)

Process conditions

Parameter	level of solids
Process pressure	-1 ... 16 bar (-100 ... 1600 kPa / -14.5 ... 232 psi)

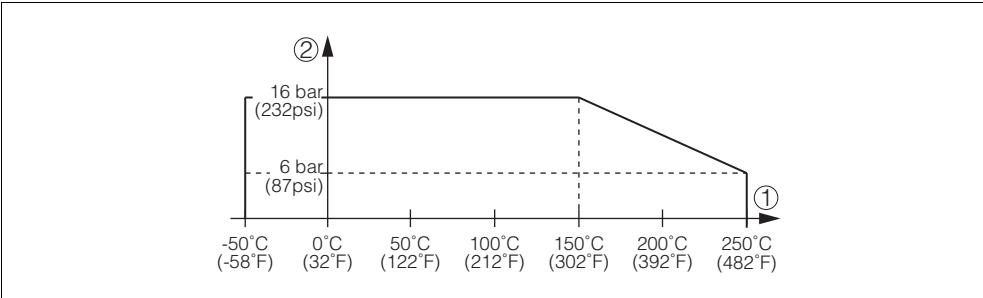


Fig. 17: Process pressure - Product temperature
1 Product temperature
2 Process pressure

OPTISWITCH 3300 C of 316L	-50 ... +150°C (-58 ... +302°F)
Process temperature (thread or flange temperature) with temperature adapter (option)	-50 ... +250°C (-58 ... +482°F)

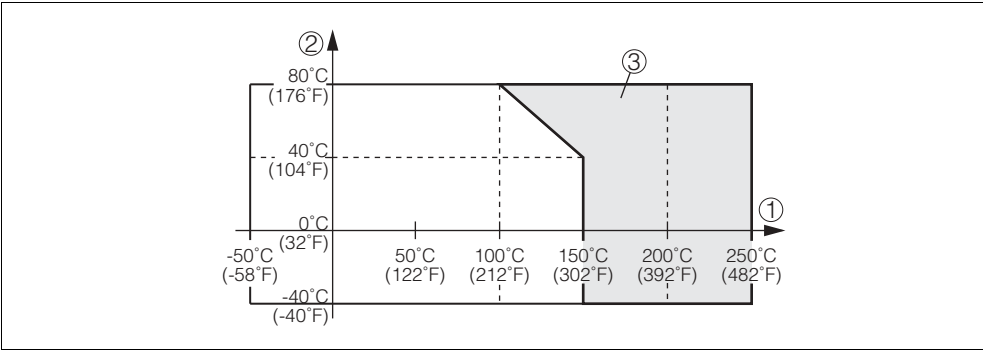


Fig. 18: Ambient temperature - Product temperature
1 Product temperature
2 Ambient temperature
3 Temperature range with temperature adapter

Density

- | | |
|--------------|--|
| – Standard | $>0.02 \text{ g/cm}^3$ ($>0.0007 \text{ lbs/in}^3$) |
| – adjustable | $>0.008 \text{ g/cm}^3$ ($>0.0003 \text{ lbs/in}^3$) |

Electromechanical data

Cable entry/plug²⁾

- | | |
|--------------------------|---|
| – Single chamber housing | <ul style="list-style-type: none"> ● 1x cable entry M20x1.5 (cable-ø 5 ... 9 mm), 1x blind stopper M20x1.5 or:
<ul style="list-style-type: none"> ● 1x closing cap ½ NPT, 1x blind stopper ½ NPT or:
<ul style="list-style-type: none"> ● 1x plug (depending on the version), 1x blind stopper M20x1.5 |
|--------------------------|---|

Spring-loaded terminals	for wire cross section up to 1.5 mm^2 (0.0023 in^2)
-------------------------	---

Adjustment elements

Mode switch

- | | |
|--------|---|
| – Min. | rising characteristics (High current when immersed) |
| – max. | falling characteristics (Low current when immersed) |

Potentiometer for switching point adaptation	$0.02 \dots 0.1 \text{ g/cm}^3$ ($0.0007 \dots 0.036 \text{ lbs/in}^3$)
--	---

Simulation key	simulation of a line break between sensor and processing unit
----------------	---

Voltage supply

Supply voltage (standard characteristics)	for connection to an amplifier acc. to NAMUR IEC 60947-5-6, approx. 8.2 V
Open-circuit voltage	U_0 approx. 8.2 V
Short-circuit current	I_U approx. 8.2 mA

Electrical protective measures

Protection	IP 66/IP 67
Overvoltage category	III
Protection class	II

²⁾ Depending on the version M12x1, acc. to DIN 43650, Harting, Amphenol-Tuchel, 7/8" FF

Approvals³⁾

ATEX II 1G, 1/2G, 2G EEx ia IIC T6 + ATEX II 1/2 D IP66 T

ATEX II 1/2G, 2G EEx d IIC T6

ATEX II 1/2 D IP66 T ⁴⁾

³⁾ Deviating data with Ex applications: see separate safety instructions.
⁴⁾ See temperature statements in the safety instructions manual

10.2 Dimensions

OPTISWITCH 3300 C⁵⁾

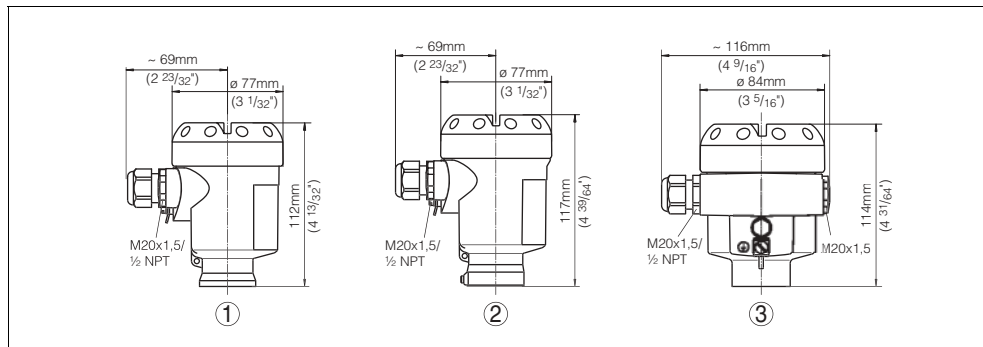


Fig. 19: Housing versions

- 1 Plastic housing
- 2 Stainless steel housing
- 3 Aluminium housing

⁵⁾ All dimensions in mm (inch).

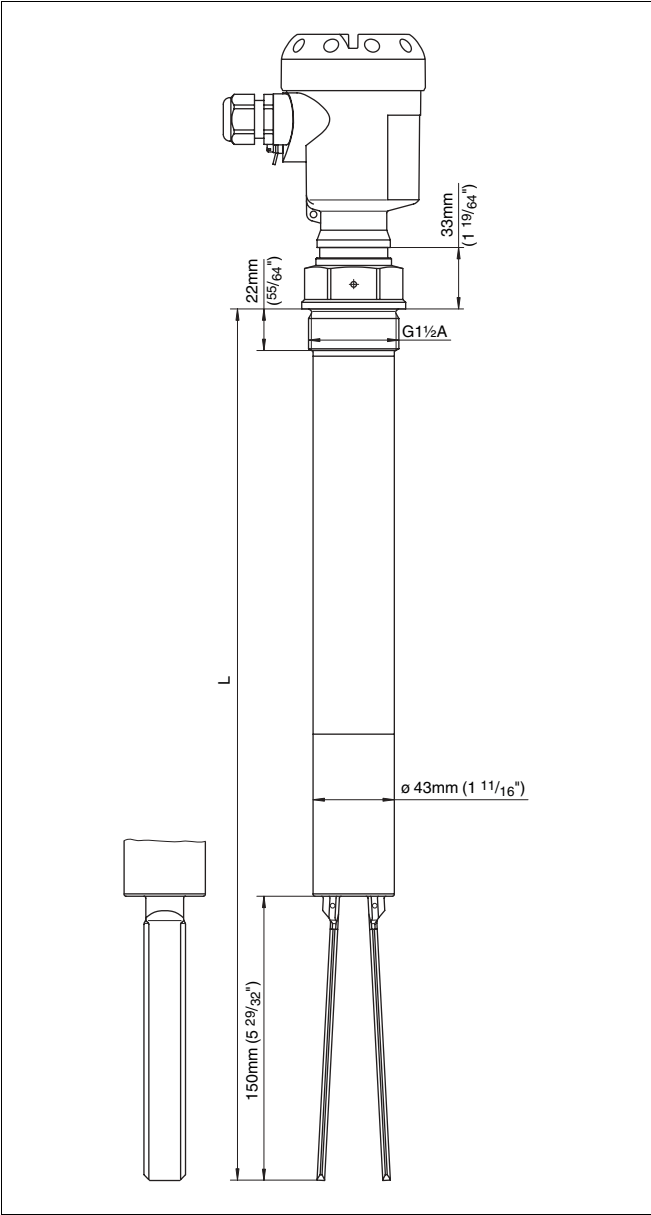


Fig. 20: OPTISWITCH 3300 C - Threaded version G1 1/2 A
L = Sensor length, see Technical data

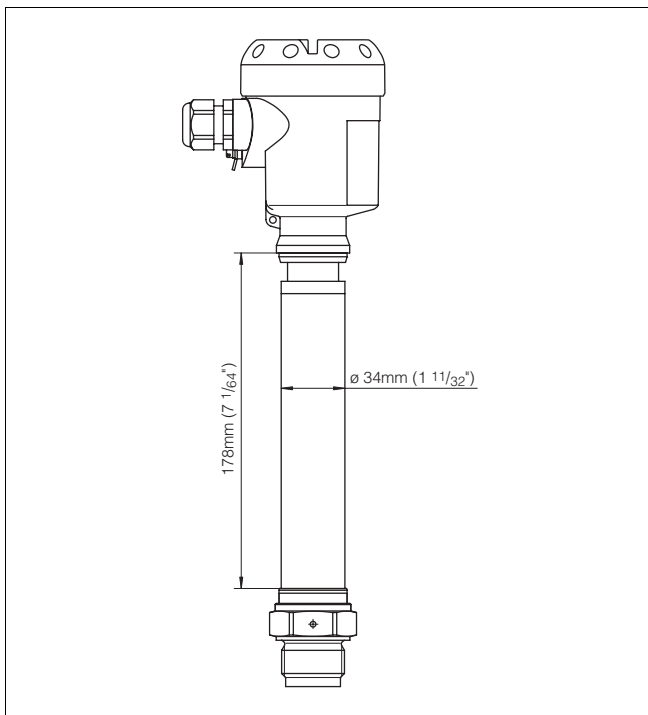


Fig. 21: Temperature adapter

10.3 Certificates

SIL declaration of conformity

KROHNE

Konformitätserklärung
declaration of conformity
Déclaration de conformité
IEC 61508 / IEC 61511

KROHNE S.A.S.
 Les Ors
 26103 ROMANS
 France

erklärt als Hersteller, dass die Vibrationsgrenzschalter
 declares as manufacturer, that the vibrating level switches
 déclare en tant que fabricant que les détecteurs vibrants

OPTISWITCH 3100 C, 3200 C, 3300 C
mit / with / avec VB60C / ...R / ...T / ...N / ...Z (Ex)

entsprechend der IEC 61508 für den Einsatz in sicherheitsinstrumentierten Systemen
 geeignet sind. Die Sicherheitstechnische Kennzahlen sowie die Sicherheitshinweise im
 Safety Manual sind zu beachten.
 (siehe entsprechende Betriebsanleitung, Kapitel „Funktionale Sicherheit“)

according to IEC 61508 are suitable for safety instrumented systems (SIS). The safety
 related characteristics as well as the instructions of the safety manual must be considered.
 (see corresponding operating instruction, chapter "Functional Safety")

conviennent à une utilisation dans les systèmes de sécurité instrumentés suivant la norme
 IEC 61508. Les caractéristiques techniques relatives à la sécurité ainsi que les consignes de
 sécurité stipulées dans le Safety Manual sont à respecter.
 (voir la notice technique de mise en service au chapitre „Sécurité fonctionnelle“)

Romans, 21.10.2005
 KROHNE S.A.S.



Dr. Florian Stengele
 Geschäftsführer
 Managing Director
 Directeur général

Fig. 22: SIL declaration of conformity

CE declaration of conformity


Konformitätserklärung
Declaration of conformity
Déclaration de conformité

Krohne S.A.S.
Les Ors BP 98
F-26103 Romans Cedex

erklärt in alleiniger Verantwortung, daß das Produkt / declare under
our sole responsibility that our product / déclare sous sa seule
responsabilité que le produit

OPTISWITCH 3100 C, OPTISWITCH 3200 C, OPTISWITCH 3300 C
mit NAMUR-Ausgang / with NAMUR output /
avec sortie NAMUR (VB60N)

auf das sich diese Erklärung bezieht, mit den folgenden Normen
übereinstimmt / to which this declaration relates is in conformity
with the following standards / auquel se réfère cette déclaration
est conforme aux normes

Emission / Emission / Emission → EN 61326 : 2004 Klasse B
Immission / Susceptibility / Immission → EN 61326 : 2004 einschließlich Anhang A
EN 61010 – 1 : 2002

gemäß den Bestimmungen der Richtlinien / following the provision
of Directives / conformément aux dispositions des Directives

73/23 EWG
89/336 EWG

08.11.2005

i.V./p.p./P.O. Florian Stengele

Fig. 23: CE declaration of conformity

Subject to change without notice