

HENGSTLER

Operating Instructions **tico 735** - Position Indicator

Introduction

Your Hengstler **tico 735** Position Indicator is one model in a family of 1/8 DIN units which offers breakthrough display technology as well as easy-to-program single-line parameters.

Designed to provide instant visual feedback regarding an application's key input value, the **tico 735** not only has a 18 mm high LED display, but also the ability to change display colour based on process status (programmable parameter in Operation Mode). Easy programming is made possible via a help function and a secondary legend display.

This manual will guide you through the installation and wiring of your **tico 735** unit with information on proper panel mounting and rear terminal layout and wiring instructions. In addition, the instrument's operation and programming modes are thoroughly explained. The operation mode provides day to day operation and allows editing of preset values. The Program Mode enables the configuration of various parameters prior to initial operation. These parameters include those for basic configuration as well as other settable features which will enhance the functionality and usability of the device.

This manual also provides information on the **tico 735** Position Indicator's product specifications and ordering information.



Features

- Awesome 18 mm high digit LED display
- Programmable colour change display based on an event
- Programmable help function and secondary legend display
- High and low alarm outputs
- Optional linear output relative to position
- Filter speed settable 20 Hz, 200 Hz, or 10 kHz
- Standard outputs: 2 NPN transistors & 1 relay (optional 2nd relay)
- Front panel reset enable and preset/alarm lockout
- Optional RS-485 plug in card

Index

Safety Instructions	2
Installation.....	3
Panel mounting.....	3
Wiring.....	4
Operation	5
Front Panel	5
Operation Mode	6
Program Mode	7
Entering Program Mode and basic operation.....	7
Program Parameter Sequence	7
Technical Data.....	10
Ordering Information	11

Safety Instructions




This symbol indicates passages in the text which you have to pay special attention to so as to guarantee proper use and preclude any risk.

- The range of applications for this product are industrial processes and controls, where the overvoltages applied to the product at the connection terminals are limited to values of the overvoltage category II.
- This device is made and tested according to the valid standards of technics and has left the factory in a perfect safety state. To keep this state and secure operation without danger, the user has to observe the safety and warning hints, contained in this operation manual.
- Assembling and mounting of electrical devices are restricted to be done by skilled electricians! Skilled electrician is, who can judge the tasks deputed to him and foresee possible dangers, due to his special education, knowledge and experience and consciousness of the pertinent standards.
- Mount devices are only allowed to be operated when mounted.
- Finger protection at connection part of mount devices is to be secured when mounting!
- While mounting the device, it must be secured that the requirements, which are asked for the device in the pertaining standards for safety, are not affected in a negative way, so reducing the safety of this mount device.
- Mounting and assembling of device needs observation of the specifications of the local Energy Suppliers.
- Before switching on, make sure that the power and control voltages are not exceeding the values in accordance with the technical data.
- If it is to be assumed that operation without danger is not further possible, the device must be put out of operation and secured from unintentional operation! It must be assumed that an operation without danger is not further possible,
if the device shows damage
if the device stops functioning
after a longer stocking period under unfavourable conditions
after heavy strain during transportation.
- If by a failure or a malfunction of the device, endangering of men or animals or damaging of facilities are possible, this must be avoided by additional safety measures (end switches, protection devices and etc.).
- Before opening any cover, the device must be switched voltagefree.
- Hengstler Counters are intended for industrial applications.
- The mounting environment and nearby cabling have an important influence on the EMC (noise radiation and noise immunity) of the counter. When putting into operation, the EMC of the whole installation (unit) has to be secured. In particular, the relay outputs are to be protected from high noise radiation by suitable wiring.

Installation

Panel mounting

The instrument can be mounted in a panel with a thickness of up to 12 mm. The cutout should be made based on the recommended panel opening illustrated in the drawing below.

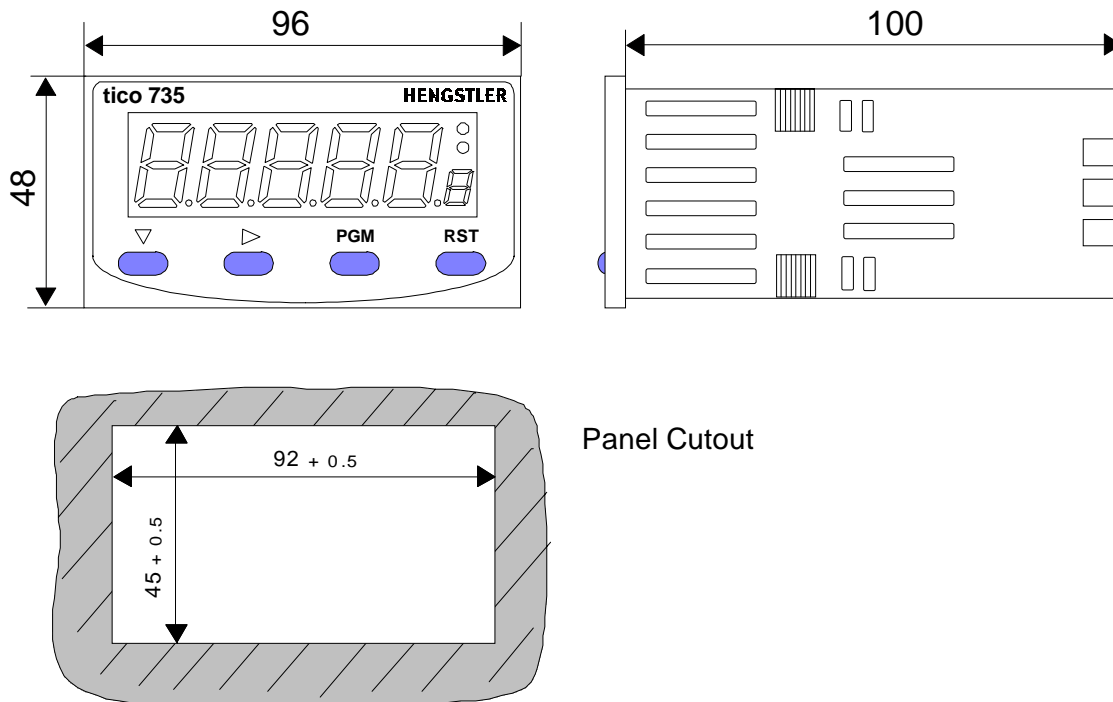


Insert the unit in the panel through the cutout. Ensure that the panel gasket is not distorted and the instrument is positioned squarely against the panel. Slide the mounting clamp into place on the instrument and push it forward until it is firmly in contact with the rear face of the mounting panel and the tabs on the bracket arm are seated in the mounting grooves on the side of the unit.

The electronic components of the instrument can be removed from the housing after installation without disconnecting the wiring. To remove the components, grip the side edges of the panel and pull the instrument forward. Take note of orientation of the unit for subsequent replacement in the housing.

Wiring

Rear Terminal Connections

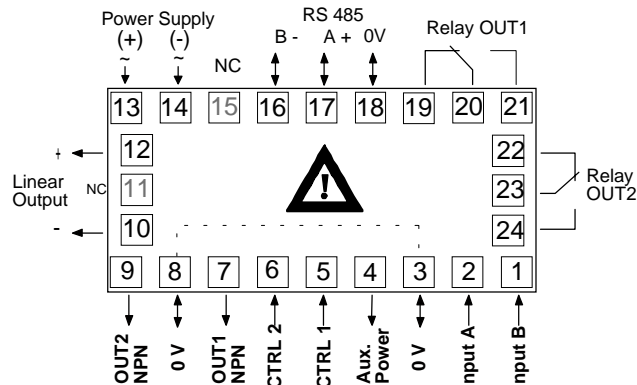

Danger! Hazardous voltage!

Count Inputs

Terminal #2 is the connection for Input A, which is used for channel A of an encoder input. Terminal #1 is the connection for Input B which is used for channel B of an encoder input. The common connection for both input A and input B is terminal #3.

Control/Digital Inputs

A contact closure or NPN signal can be used to activate preconfigured functionality. Terminal #5 is used for a remote reset function, while terminal #6 is a security function, that when active, will prohibit entry into Program Mode. Terminal #8 serves as the common for both of these inputs.

Auxiliary Power Output

A 9-15 VDC for powering external sensors and encoders up to 125 mA can be accessed by connecting the positive supply side of the sensor to Terminal #4 and the negative side to Terminal #8.

Linear Output

An option board may be installed that provides a 10 bit linear output signal relative to the Position Value. Terminal #12 is the positive side of the connection, and Terminal #10 is the negative side. The default range of the input is 4-20mA but can be changed via the front panel to 0-20 mA, 0-10 VDC, 2-10 VDC, 0-5 VDC, or 1-5 VDC.

Power Supply Input

For an AC powered unit, Terminal #13 serves as the line or hot side connection for AC powered units and as the positive side for DC powered units. The neutral side for AC powered units and the negative side for DC powered units are connected to terminal #14.

Transistor Outputs

Your unit comes standard with 2 NPN outputs which are activated by each of the alarms. Transistor Output 1, which is tied to the High Alarm Value, is on Terminal #7. Transistor Output 2, which is tied to the Low Alarm Value, is on Terminal #9. Terminal #8 serves as the common connection for both transistor outputs.

Relay Outputs

Your unit comes standard with a relay output which is tied to the High Alarm Value. Terminal #19 is NC, Terminal #20 is common, and Terminal #21 is NO. A second relay output tied to the Low Alarm Value can be added as an option at the time of order or later installed in the field. Terminal #22 is NC, Terminal #23 is common and Terminal #24 is NO.

Serial Communication


An RS-485 communication board, utilizing ASCII protocol, can be installed as an option. Terminals #16 and #17 serve as the B and A connections respectively, while terminal #18 is connected as the common.








Terminals 11 & 15 are not used and must not be connected!

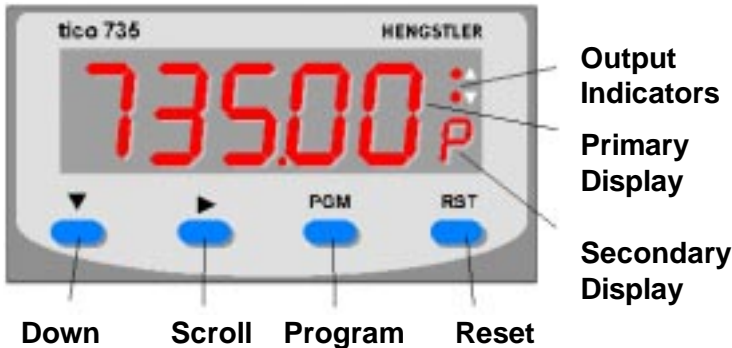Operation

Front Panel



Key functions


Key	Function
Down 	<p>In <i>Operation Mode</i>: Used in Edit Operation to decrement the digit highlighted by the Scroll Key.</p> <p>In <i>Program Mode</i>: Used in Edit Operation to decrement the digit highlighted by the Scroll Key, if the setting is a numerical value, or present the next in the series of choices for that parameter.</p>
Scroll 	<p>In <i>All Modes</i>: Moves the unit into Edit Operation, which is indicated by the left most digit flashing. Successive presses of the key are used to move to the digit to be edited. Wrap around will occur from least significant digit to most significant digit.</p>
Program 	<p>In <i>Operation Mode</i>: Used to move between the position display & the alarms and to enter an edited alarm value. Holding the key down for 3 seconds will cause the unit to enter Program Mode.</p> <p>In <i>Program Mode</i>: Used to move from one parameter to the next and enter the edited parameter values. Holding the key down for 3 seconds will cause the unit to return to Operation Mode.</p>
Reset 	<p>In <i>Operation Mode</i>: Resets the position display to zero (under Reset Value in Program Mode). This button can be disabled via the „Front Panel Reset Enable“ parameter in Program Mode.</p> <p>In <i>Program Mode</i>: No function</p>
Down & Scroll 	<p>In <i>All Modes</i>: Will abort an Edit Operation and return the preset/parameter to its previous value.</p>

Display functions


Display	Function
Primary	<p>In <i>Operation Mode</i>: Default display is the position. Can be scrolled using the program key to display the alarm values. If the „Help“ function is enabled, this display will first show the parameter description for 3 seconds (see page 5 for example).</p> <p>In <i>Program Mode</i>: Displays the value or selection for the current parameter. If the „Help“ function is enabled, this display will first show the parameter description for 3 seconds (see page 6 for example).</p>
Secondary	<p>In <i>Operation Mode</i>: Indicates alphabetically if one of the alarms is being viewed on the primary display. This display is blank when Position is being shown.</p> <p>In <i>Program Mode</i>: Provides a 1 digit alpha or numeric character to indicate which parameter value is being shown on the primary display.</p>
Output indicators	<p>▲ illuminates when the High Alarm Value is reached (OUT1)</p> <p>▼ illuminates when the Low Alarm Value is reached (OUT2)</p>

Operation Mode


Changing a Preset value (example)

 Default display is the position value.




 Pressing the Program Key will cause the display description to appear on the main display.* If there is no key activity for 3 seconds, the primary display will switch back to the count value.




 Continued pressing of the Program Key will scroll to the Alarms. (see parameter sequence below.) The full parameter description will appear on the main display.*




 To change the Alarm value, press the Scroll Key. If there was no key activity for 3 seconds, the Alarm value will appear (one digit description shown on secondary display); however, press the Scroll Key in order to edit. The unit will now be in Edit Operation as signified by the most significant digit flashing.**




 Use the Scroll Key to move from left to right and highlight the digit that needs to be changed. Wrap around will occur from the least significant to the most significant digit.



 Use the Down Key to decrement the digit until the desired value appears. The display will wrap around from 0 to 9.




 After the desired digits have been changed, press the Program Key to enter the new value. The new value will appear on the main display without any flashing digits. Press the Program Key again and the parameter description will appear on the main display.


* Parameter descriptions will not appear on the primary display if the „Help“ function has been disabled


** Edit Operation cannot be accessed if the Preset Lock has been enabled in Program Mode

Display Parameter Sequence

 **Position**
Function: Displays the position value.
Display Range: -19999 to 99999



 **Low Alarm Value**
Function: Defines the position value at or below which Alarm 2 will activate.
Adjustm. Range: -19999 to 99999
Default Value: 10

 **High Alarm Value**
Function: Defines the position value at or above which Alarm 1 will activate.
Adjustm. Range: -19999 to 99999
Default Value: 1000



Program Mode

Entering Program Mode and basic operation

The Program Mode can be **accessed** from the Operation Mode by holding the Program Key for 3 seconds.

↑ PGM ↓
for 3 secs.

The Program Mode can be **exited** by holding the Program Key for 3 seconds or remove power from the unit and repower it.

After 90 seconds of key inactivity the unit returns to Operation Mode automatically.

The name of the first parameter will appear on the primary display.*

3 secs. or



Successive presses of the Program Key will scroll the display through the remaining parameters in the Program Mode. To **exit** Program Mode, hold the Program Key for 3 seconds.

PGM

* Parameter names will not appear on the main display if the „Help“ function has been disabled in Program Mode

Edit Operation

Pressing the Scroll Key or no key activity for 3 seconds will display the value for that parameter. The secondary display will indicate the one digit identifier for the parameter. The digit in the secondary display will flash to indicate the unit is in Program Mode. If the Scroll Key was pressed (instead of waiting 3 seconds), the unit is in Edit Operation, as indicated by the MSD flashing. If there had been no key activity for 3 seconds, press the scroll key to enter Edit Operation (MSD flashing). Use the scroll and edit keys to change the value as in Operation Mode, described on page 5. Press the Program Key to enter any changes.

Program Parameter Sequence

PGM

Calibration Factor

Function: Scales the input into engineering units by multiplying this value by the number of pulses received.

Adjustment Range: 0.0001 to 9.9999

Default Value: 1.0000

PGM

Decimal Position

Function: Set the decimal point position for the position and alarm displays

Adjustment Range: 0 (no dp) to 0.0000

Default Value: 0 (no dp)

PGM

Reset Value

Function: Defines a home position by selecting a value other than zero or another value within the displayed range of the device to which the counter can reset

Adjustment Range: -19999 to 99999

Default Value: 0

SPEED F

Filter Speed

Function: Enables the debounce filter of the counter to properly match the application.
 Note: the sum of both input frequencies should not exceed 10 kHz, i.e. you can apply up to 5kHz channel frequency.

Adjustment Range:

20 F

200 F

10000 F

Default Value: 10000

20: The unit will accept up to 20 pulses per second. Generally used with contact inputs to eliminate false counts caused by contact bounce

200: The unit will accept up to 200 pulses per second. Generally used for higher speed contact inputs or to filter noise on electronic signals in low speed applications

10,000: The unit will accept up to 10,000 pulses per second. Generally used with high speed electronic inputs and encoders

PGM



rs En r

Front Panel Reset Enable

Function: Determines whether the Front Panel Reset key can be used to reset the position value.

Adjustment Range:

En r

dis r

Default Value: Enable

Enable: The position value can be reset while being viewed in Operation Mode by pressing the Front Panel Reset Key

Disabled: The Front Panel Reset Key is disabled and the position value can only be reset through the Remote Reset Input

PGM



rt En t

Retransmission Enable/Select

Function: Determines whether a voltage/current is an output, and if so, which range. A jumper on the output module determines whether it outputs current or voltage.

Adjustment Range:

none t

0-5v t
1-5v t

0-10v t
2-10v t

0-20A t
4-20A t

None

Default Value: None

0-5 or 1-5 Volts

0-10 or 2-10 Volts

0-20 mA, 4-20mA

PGM



rt Lo L

Retransmission Scale Minimum (Appears only if a current/voltage is selected)

Function: Defines the lower end of the linear scale for the retransmission output by defining the value equated to the minimum output signal.

Adjustment Range: -19999 to 99999

Default Value: 0

rt Hi H

Retransmission Scale Maximum (Appears only if a current/voltage is selected)

Function: Defines the upper end of the linear scale for the retransmission output by defining the value equated to the maximum output signal.

Adjustment Range: -19999 to 99999

Default Value: 100

CoM75 c

Serial Communication enabled (Appears only if communication board is installed and activated)

Function: Activates the RS-485 communication option board.

Adjustment Range:

none c

F it c

None: no communication board installed

Fitted: A communication board is installed in the unit

Default Value: If ordered from the factory with the RS-485 board, the default will be „Fitted“. If the board is installed in the field, this parameter will need to be changed from its default of „none“.

PGM

Addr A

Communication Address

(Appears only if communication board is installed and activated)

Function: Defines the unique communication address of the unit

Adjustment Range: 1 to 99

Default Value: 1

PGM

bAud b

Baud Rate

(Appears only if communication board is installed and activated)

Function: Selects the serial communication speed

Adjustment Range:

1200 b

2400 b

4800 b

9600 b

1200 BPS

2400 BPS

Default: 4800 BPS

9600 BPS

PGM

Color o

Display Colour Change

Function: Defines the colour of the display

Adjustment Range:

red o

GrEEen o

Grn.rd o

rd.Gr o

Red: The display will always be red

Green: The display will always be green

Green to Red: The display will be green prior to the Alarm value being reached. It will turn red after the Alarm has been reached

Red to Green: The display will be red prior to the Alarm value being reached. It will turn green after the Alarm has been reached

Default Value:

Green to red

PGM

LoCP P

Preset Lock

Function: Determines whether the Alarm Values changes via the front panel are locked out.

Adjustment Range:

En P

d IS P

Default Value:

Locking Disable

Locking Enable. Alarm values are read only.

Locking Disabled. Alarm values can be viewed and changed.

PGM

HELP h

Help Prompt

Function: Determines whether the multi-character parameter name will appear on the main display for 3 seconds prior to the parameter value appearing.

Adjustment Range:

HLP y h

HLP n h

Help-Yes: Multi character parameter descriptions will appear on the primary display. The value associated with that parameter will appear by pressing the scroll key or waiting for 3 seconds

Help-No: Only the parameter values will appear on the primary display. The parameter can be identified by a single digit in the secondary display

Default


Value:

Help Yes

Technical Data

Display and Keyboard	Primary Display	Red/Green, 7 segment LED, 5 digits, height 18.5 mm
	Secondary Display	Red/Green, single digit 7 segment LED, height 7 mm
	Annunciators	2 red LEDs for OUT1 and OUT2
	Keyboard	4 rubber keys for programming and manual reset
Physical	Dimensions	DIN 48 mm x 96 mm, 110 mm total depth
	Mounting	Front panel mounting (mounting bracket supplied)
	Panel Cutout	45+0.5 mm x 92+0.5 mm, panel thickness max 12 mm
	Construction	Front carrier with circuit boards can be pulled out
	Terminals	Screw Type - combination head
Environmental	Power Supply	90 - 264 VAC 50/60 Hz (electrically separated from all inputs and outputs) or 20 to 50 VAC / 22 to 55 VDC
	Power Consumption	4 Watts
	Temperature	Operation: 0°C to +55°C (32°F to 131°F) Storage: -20°C to +80°C (-4°F to 176°F)
	Relative Humidity	20 % to 90 %, non-condensing
Approvals	Ratings	Frontpanel IP 66
	EMC Susceptibility	Complies with EN 50082-1/92-95
	EMC Emissions	Complies with EN 50081-1/92, -2/94
	Safety	DIN EN 61010 part 1; according to protection class II
	General	Overvoltage category II, Contamination level 2 UL, CUL
Count Inputs A and B	Phase Discriminator	capable of TTL; 30 VDC max; counts up when A leading B
	Levels	High ≥ 3.0 V, Low < 2.0 V or open; 10 kOhm to 0V
	Count Frequency	20 Hz, 200 Hz or 10 kHz programmable (5 kHz per channel)
Control Inputs	CTRL1 (Reset)	NPN; High ≥ 3.0 V or open, Low < 2.0 V; 4,7 kOhm to V+ edge sensitive; 25 ms min., max 30 VDC
	CTRL2 (Security Lockout)	NPN; High ≥ 3.0 V or open, Low < 2.0 V; 4,7 kOhm to V+ level sensitive; 25 ms min.; max 30 VDC
Outputs	OUT1 NPN, OUT2 NPN	Open Collector; 30 VDC max; 100 mA max; response time $< 75 \mu\text{s}$ at $< 2 \mu\text{s}$ cyclical accuracy
	OUT1 Relay, OUT2 Relay	Changeover (Form C); 240 VAC / 3A or 115 VAC / 5A; pull-in time approx. 8 ms
	Sensor Power Supply	12 (unregulated VDC), 125 mA max; ripple < 0.5 V
	Isolation	Optically isolated; 250 VAC / 400 VDC against all other inputs and outputs.
Linear Output Option	Output Range	0-20 mA, 4-20 mA, 0-5 V, 1-5 V, 0-10 V, 2-10 V
	Accuracy	± 0.25 % (mA at 250 Ohm, V at 2kOhm); Linear Deviation ± 0.5 %
	Resolution	8 Bit after 250 ms (10 Bit after 1000 ms typically)
	Updating	approx. 4 updates per second
	RS-485 Option	Type
	Parameters	9600...1200 Bd, 1 start, 7 data, 1 stop, even parity

Ordering Information

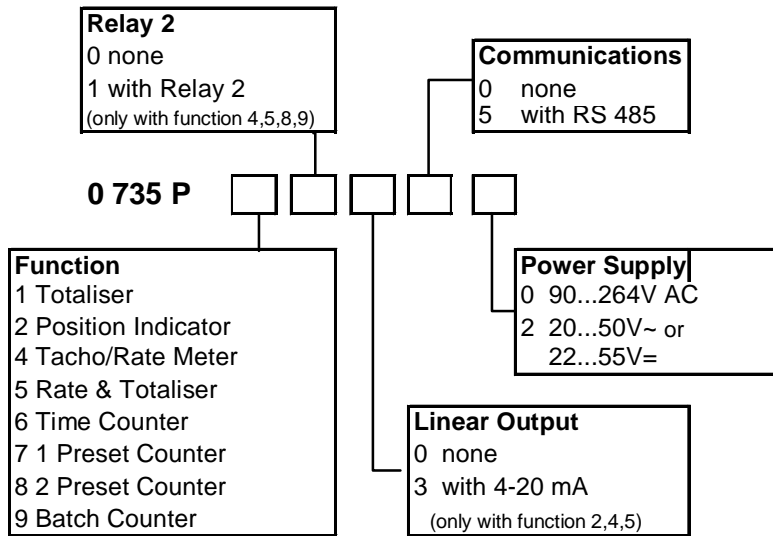


© 1998 HENGSTLER GmbH

This documentation may not be changed, amended, or copied without prior written consent of HENGSTLER GmbH, and may not be used in contradiction to this company's rightful interests.

HENGSTLER

Hengstler GmbH
Postfach 11 51
D-78550 Aldingen
Germany
Tel. +49-7424-89 539
Fax +49-7424-89 470



Member of the  **DANAHER CORPORATION** U.S.A